

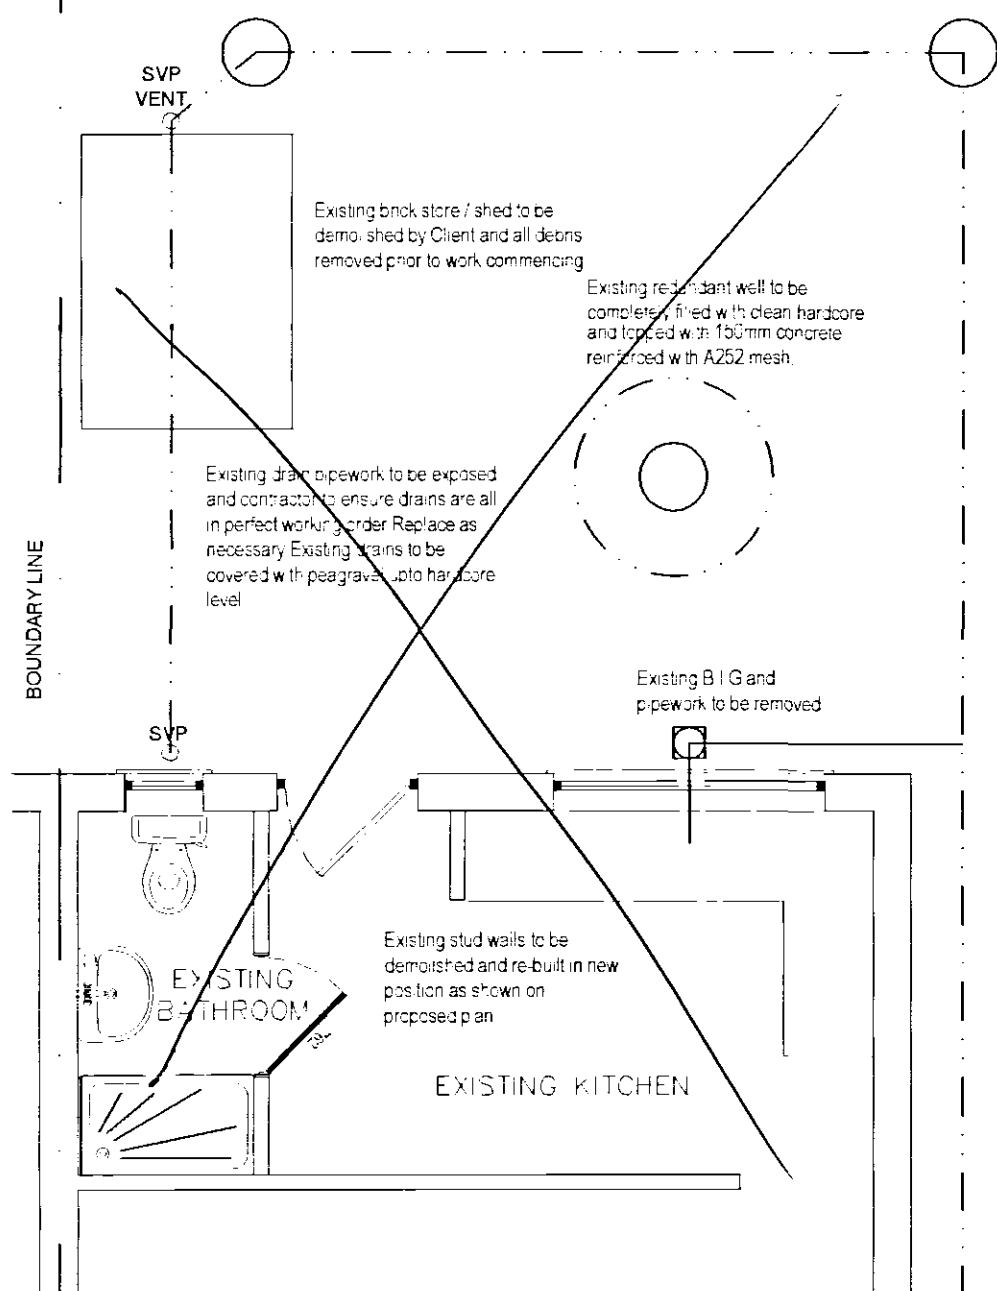
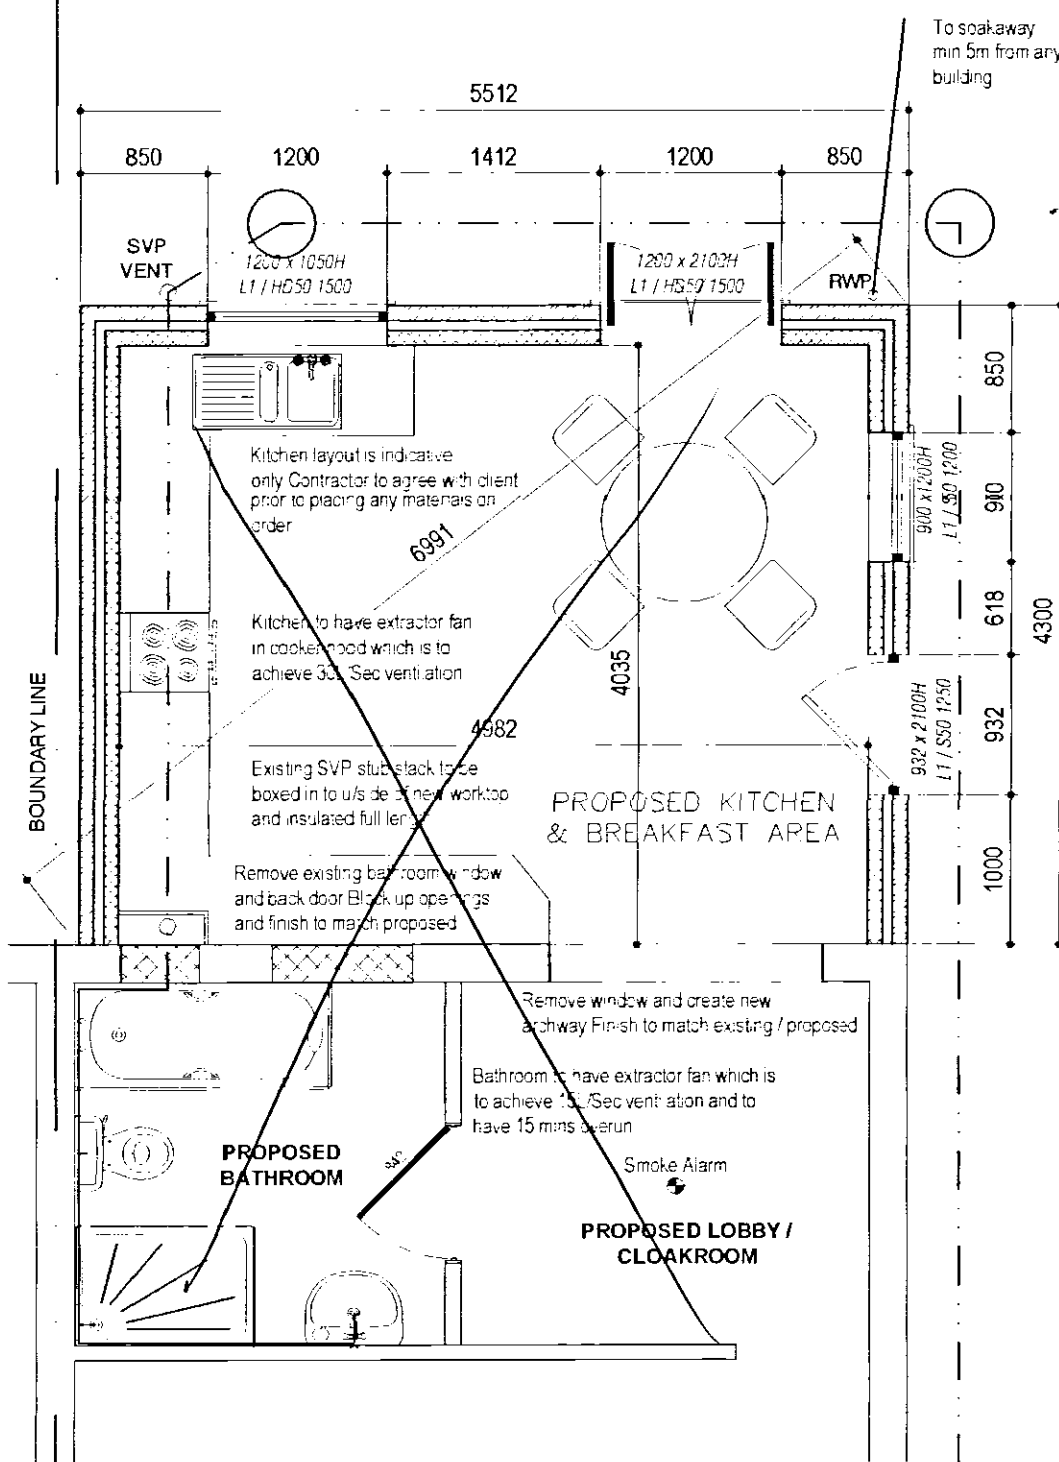


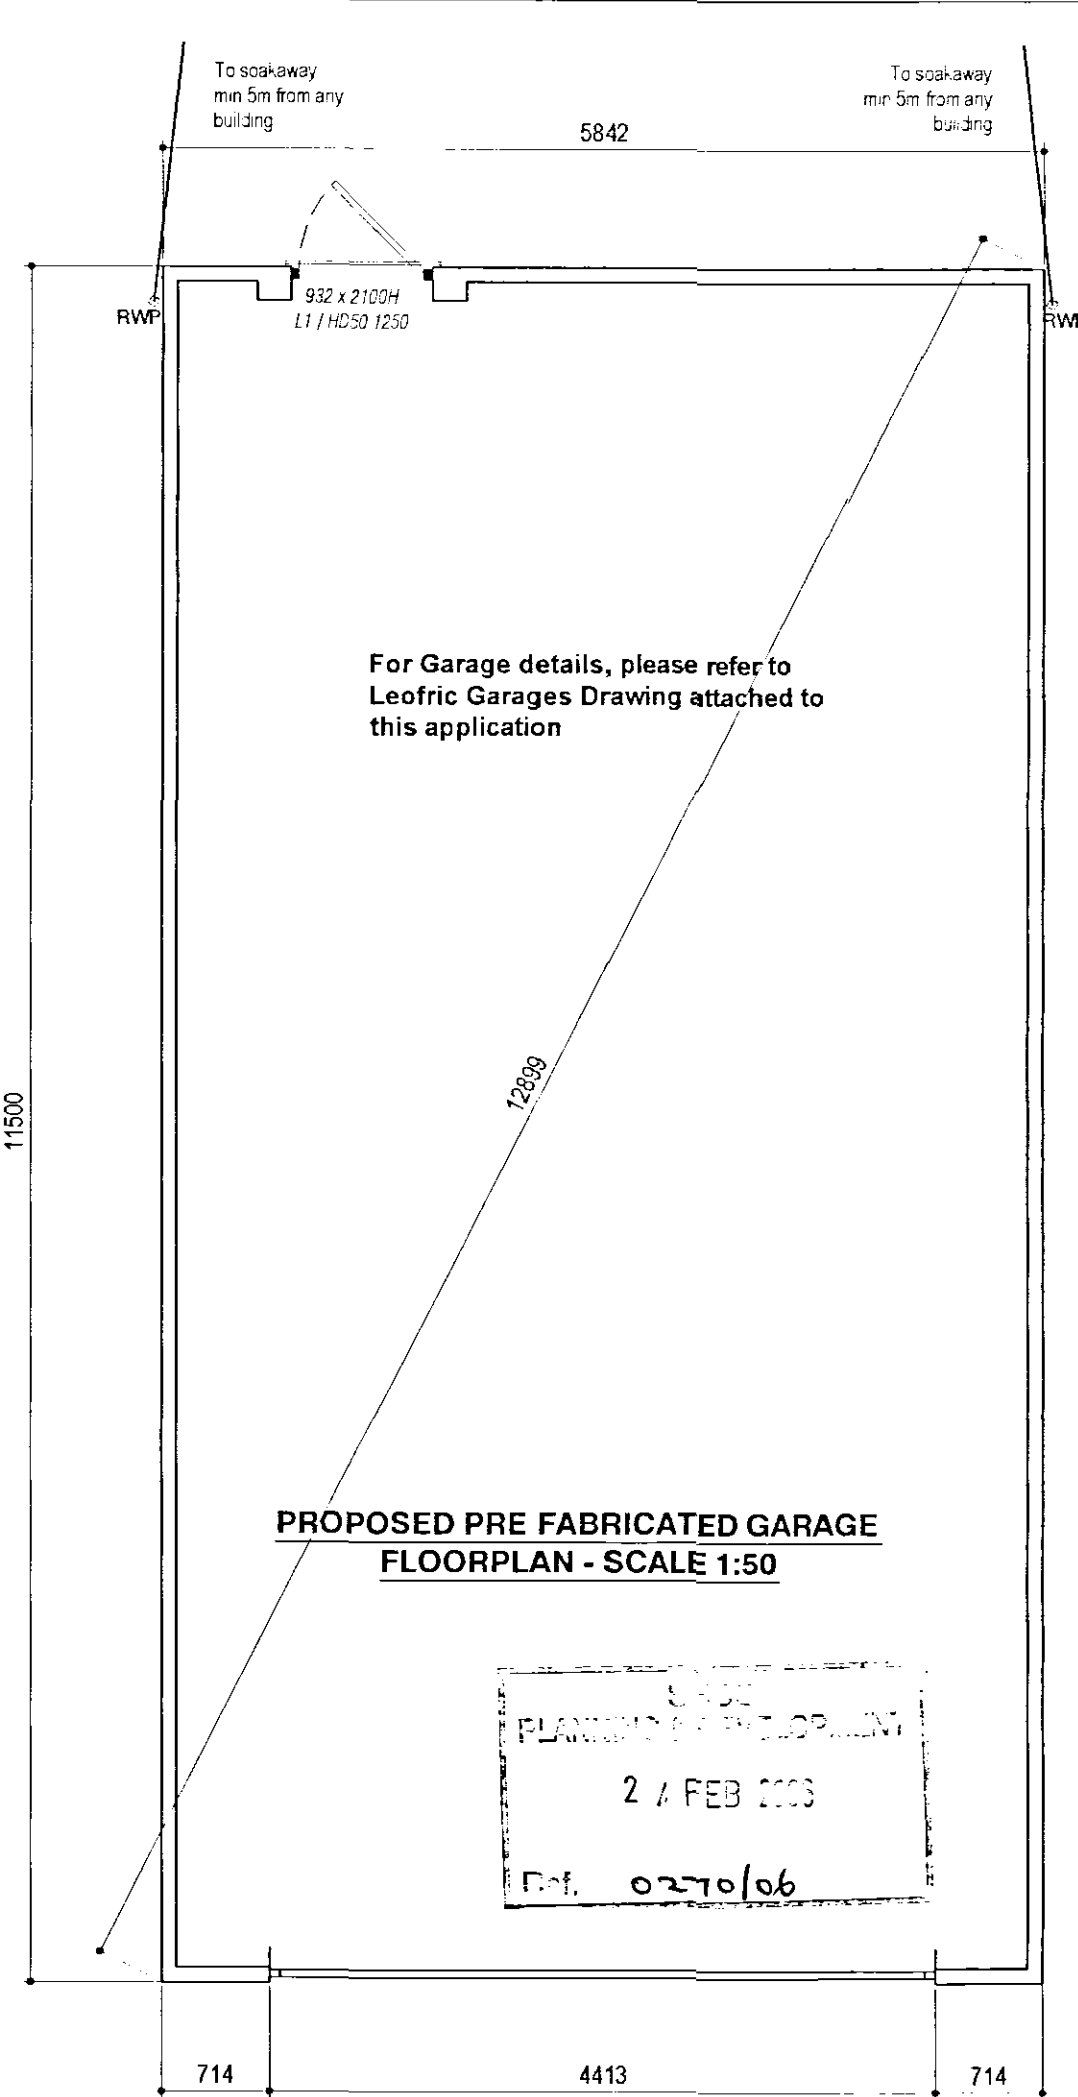

GENERAL CONDITIONS
Contractors are responsible for checking all dimensions on site when work commences and before ordering any materials. Any discrepancies should be brought to the attention of the Client for remedial action before commencing further work. All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority. The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification. No allowance has been made for Structural Calculations or "SAP" calculation. If deemed necessary then these will be a chargeable extra. All materials not specified to be of a standard suitable for the work proposed and be fit for purpose. All work to be in accordance with good building practice and all necessary BS codes for Workmanship on Building Sites.

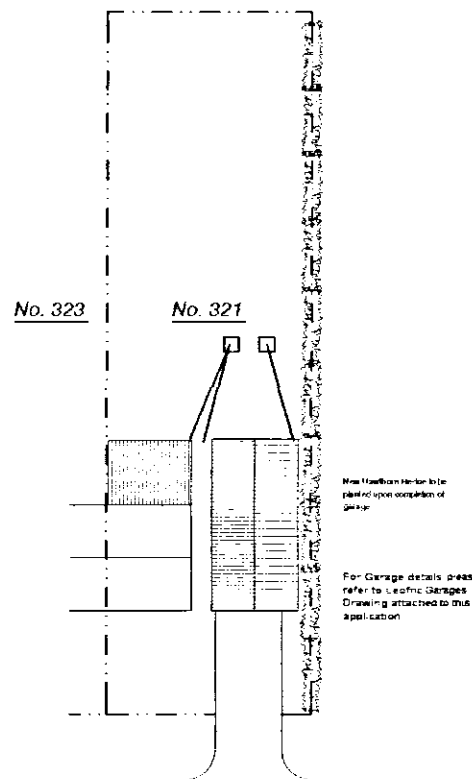

WESTHORPE ROAD

PROPOSED SITE PLAN
Scale 1:250

WASTE SIZES FOR NEW PLUMBING
All new plumbing to have the following waste sizes:
W.C. = 100mm Ø Multikwik or similar approved
W.H.B. = 32mm Ø uPVC with 75mm Deep sealed trap
SINK = 40mm Ø uPVC with 75mm Deep sealed trap
SHOWER = 40mm Ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction. Provide anti-siphon traps where pipe runs exceed 3m and W.H.B. pipe run exceeds 1.8m.

ROOF INSULATION
Lay 300mm mineral fibre insulation to roof area to achieve a U value of 0.16w/mK. 100mm between rafters and 200mm over rafters at right angles to first layer. Fix Dovetail rafter tray in accordance with manufacturers instructions or similar approved where insulation meets roof slope to maintain roof ventilation.

ROOF FINISH
Concrete interlocking roof tiles to match existing in accordance with manufacturers instructions on 38x25 preservative treated timber battens on untearable sarking felt with min 150mm overlaps.

REV DESCRIPTION:

- 'D' - 24.02.06 - Garage amended from Brokwork to Pre Fabricated
- 'C' - 21.07.05 - Garage moved away from boundary and Hawthorn Hedge added
- 'B' - 19.06.05 - Garage Length increased
- 'A' - 25.09.02 - Amended in accordance with SHDC's comments

remway design
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project: **Proposed Rear Kitchen Extension & Detached Double Garage**

Client: **Mr Dean Bingham
321, Westhorpe Road
Gosberton PE11 4ER**

Date: Sept 02 DRG No.: **01** REV: **D**

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min depth of 150mm before excavation commences. Concrete mix for foundations to be S7.4 Grade in accordance with BS5328:1981. Foundations to external wall to be min 700mm wide x 225mm deep. Excavate down to solid firm strata i.e. 750mm deep (min 1000mm if soil is of a shrinkable nature). Exact depth to suit conditions on site and to the strict approval of the L.A. Building Inspector. Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge polythene separating layer on a 60mm Celotex Double R/GA2000 rigid insulation board or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation on u/s of D.P.C. level on 100mm thick S7.4 concrete sub floor on a 1200 gauge DPM lapped onto DPC within walls on min 150mm clean and well compacted hardcore. Depth of hardcore must not exceed 500mm. All service entries to be sealed with pressure sensitive tape. Floor to achieve a min U Value of 0.25w/mK.

WALLS BELOW D.P.C.
3rd Coarse of Class B brickwork below D.P.C. on outer face and 1st coarse of 7N/mm² on inner skin of cavity face. Elsewhere to be either 7N/mm² concrete blockwork or full width trench blocks. Bath to be within 225mm of DPC level. Cavity to be filled to within 225mm min. of below DPC with lean concrete.

DAMP PROOF COARSE (D.P.C.)
Horizontal heavy duty polythene DPC to all walls in accordance with BS 6615 and set min 150mm above all external ground levels. DPC in walls must be linked / lapped with DPM in ground floor. Provide perforated cavity wall trays above windows & doors with weep vents at a max of 2m centres with a min of 2m per opening.

CAVITIES
Close all cavity walls at jambs with Thermabre insulated cavity closers fitted strictly in accordance with manufacturers instructions. Close top of cavity walls with 75mm Ditherm or similar approved insulation batt supported on wall ties.

EXTERNAL WALLS
All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Ditherm (or equal approved) built in as work progresses
-100mm Thermalite Shield insulating blockwork
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min U value of 0.35w/mK.

MORTAR
All mortar to be 6:1:1 sand/cement/lime or equally approved and to be a close match to existing as possible.

CEILING
All ceilings to be 12.7mm plasterboard to BS1230.
Ceilings to be have Coveing and an Arflex finish to match existing or to clients requirements. Plasterboard sheets to be fixed with joints staggered and must be laid perpendicular to all joist runs. Fix boards at a min 150mm centres.

NOGGINGS
Fix 38x35mm timber noggings to all potential loose plasterboard ceiling edges and light fittings. Position of light fittings to be advised by client on site.

INTERNAL JOINERY, SKIRTING & ARCHITRAVES
All internal finished timber to match existing or to clients requirements.

LATERAL RESTRAINT STRAPS
Tie roof structure to blockwork wall with 30x5 galvanised mid steel straps at max 2m ctrs where rafters and ceiling joists run parallel to blockwork walls. Also fit at max 2m ctrs to anchor wallplate to blockwork wall with min 3rd fixings per strap.

WALL TIES
Cavity wall ties to be BS1243 19/8 To be built into cavity wall as work proceeds and spaced at 900mm centres horizontally, 450mm centres vertically and 300mm staggered around all openings.

HEATING
Provided from existing with new radiators to have thermostatic radiator control valves.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E. Regulations and Engineer to advise if any appliance does not conform.

SOAKAWAYS
All soakaways to be min of 5m from any building & a min of 1m² filled with rubble to within 450mm of external ground level. Overlay rubble with polythene sheet and backfill with clean topsoil. Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions.



UNITELS
All lintels to cavity wall to be factory insulated I.G.L1 range unless noted otherwise or equally approved. All lintels must have a min 150mm endearing and installed in accordance with manufacturer's instructions. Note: Lintels are not to have a continuous baseplate.

WINDOWS
All windows to be White uPVC double glazed to match existing with 8000mm² trickle ventilators all in accordance with clients requirements. Opening vents to give 1/20th of floor area rapid ventilation to all rooms. All glazing to meet the requirements of section N of the Building Regulations and BS6268 class B. All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a Low 'E' glass inner pane to achieve a min U value of 2.0 w/mK. Note all windows to have a perimeter weatherseal both internally and externally.

RAINWATER DRAINAGE
White uPVC gutturing and downpipes to match existing. Falls for gutturing to be 1:600 and brackets fixed at max 2m ctrs. Downpipes to be connected into underground drains via reducing adaptor. Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm pea gravel and min 150mm surrounds laid to 1:100 falls to new soakaway. Soakaway specification detailed elsewhere.

ROOF CONSTRUCTION
To be Trussed Rafters designed and constructed in accordance with BS 5268 Part 3 1985 all by specialist approved manufacturer. Trusses to be set at max 600mm centres with all necessary 100x25 bracing. Truss manufacturer to provide calculations and details to Client for L.A. Building Inspectors approval prior to manufacture.

SMOKE ALARMS
To be self contained, interconnected and wired to a separately fused circuit with a battery back up. Smoke alarms to be fitted to u/s of plasterboard ceiling to the ground floor max 7m from the kitchen and lounge.

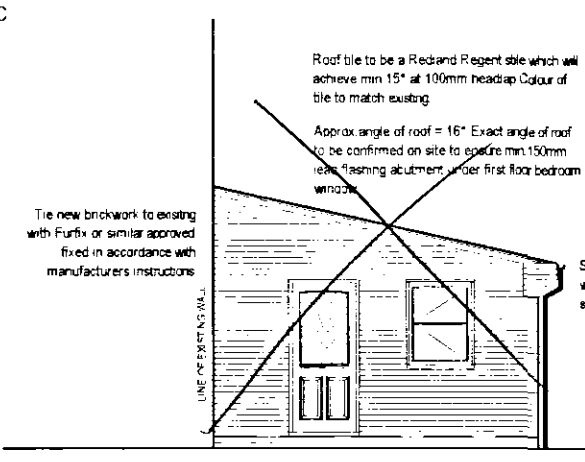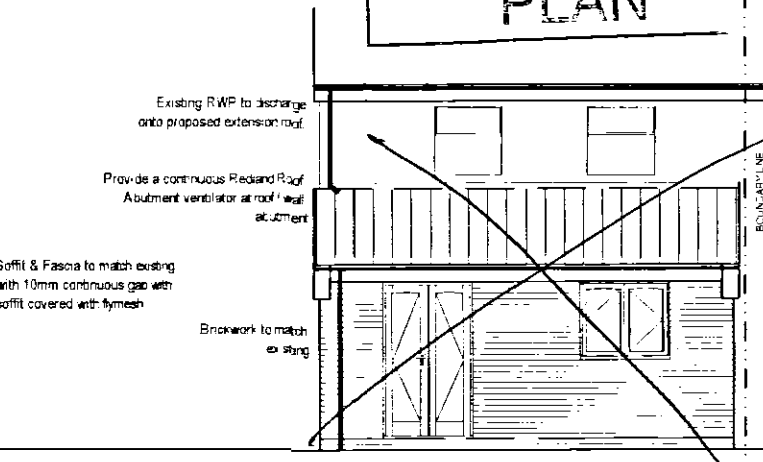

DETERMINED PLAN