SOUTH HOLLAND DISTRICT COUNCIL

Application no: H15/0311/94

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8EG

Agent: East Midlands Electricity p
Sleaford Road
Boston
Lincs
PE21 8EG

Description: Proposed 11KV overhead line

Location: South Drove
Quadring
Spalding

Type: ELECTRICITY

APPLICATION DETERMINED BY SECRETARY OF STATE - SUMMARY OF DECISION

Planning permission has been granted by the Secretary of State, or is deemed to have been granted, on conditions set out below or attached.

Development to which this permission relates shall be begun not later than the expiration of five years beginning with the date hereof.

Reason: To comply with the provisions of Section 91(1) of the 1990 Act.

14 July 1994

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

ADMIN RECORD SHEET

Initial

Submitted Fee £NIL

Receipt No

Date first Rec'd 28 MAR 1994

Registration

Reference H15/0311/94

Cross-Ref

Date 29-MAR-94 JAC

Validation

TYPE DEL

Site area
No of dwellings
Floorspace

Earlier permission – Ref:
New/Redevelop/Use/Ext/Alt/Works

Description to be recorded

Invalid
Site plans ☐
Certificate ☐

Fee ☐
Fee (not free) ☐

Inaccurate ☐
Incomplete ☐
Unclear ☐

Fees
Correct fee £NIL

Nil fee ☐
Discounted ☐

Previous app – ref:
Type of app
Reason:

Additional £
Refund £

Receipt No
Voucher No

Date
Date

Information

Index sheet 32 (31+)
Grid ref 518000 332000

OS Plots

Ward C

Parish QUADRING

Inside IBD NO

Inside LP area NO

Constraints:

CA Cons Area ☐
LB Listed – Grade: ☐
ARC Archaeology ☐
AM Ancient Mon ☐
SSI Special Int ☐

TR Rural ☐
BP TR proposed 67m ☐
LC Level Cross ☐
FP Footpath ☐
TPO Tree Pres ☐

Hazards –
HAZ Site ☐
AIR Safeguard ☐
LIN Elect ☐
PIP Pipe ☐
CON Waste/contamin ☐

Linked to site Ref 2020

Linked to property Ref

Dist Bound ☐

Other: Area of pits + ponds ☐

Planning Records:
Earlier apps

B Reg Records:
Already submitted – Ref:
Request needed
Requested

DC INSTRUCTION SHEET

APPLICATION REF: H15/0311/94

Directions

Art 7 ☐ RM checklist

	Sit	Des	Ext	Acc	Land
Previous					
Current					
Required					

EA ☐ Reg4 – ☐ Scale dwg: Highway S/W: Agric appraisal:

LB ☐ Advt ☐

Details needed: (Non-std only)

Other.....

Direction authorised by Senior Officer..... Date.....

Revalidation after Direction

Information satisfactory Signed..... Date.....

Valid date:

Amended description

Superseded plans indicated ☐

Unsatisfactory – Further direction:
Signed.....
Senior Off.....

Precise details:

Extra Consultations/Publicity Required

☐ None identified initially

RECONSULTS (revalidated) ☐ All

		Publicity: >>	Consultations:	
Departure		.....	County	.....
Setting of LB		.....	E Heritage	.....
Public Right of Way		.....	Societies	..... G ROW
Discretionary		.....		

Extra Consultations:

Transport	D/Transp A15	..... G* T15
TRA	D/Transp A18	.....
	B Rail	.....
Environment/	Env Services	.....
Drainage	NRA	.....
WAT	IDB	.....
	Env Assess	☐ G ENV (See separate sheet)
Conservation	LB Demolish	..... G* DEM
LB	Archaeology	..... G ARC Specify:
	Eng Heritage	.....
	Consultant	..... Order No:
	Other	..... Specify:
Hazards	HSC Group	..... G* HAZ
	Specific	..... Specify:
Other PLA		..... Specify:

WP Note –
G Group available
G* Group essential (longer expiry)

Press
PC
WM
Residents

Case Officer : PM

Senior Officer Confirmed ..... PR Date 30/3 Recorded DC....

APPLICATION ASSESSMENT

Notes for Case Officer

Site Inspection

Accuracy :
Neighbours :
Boundaries :
Site Features :

Inspected by PM
Date 8-4

Site Notice posted by
Date
Expiry

Individual Resident Notices required:

Addresses to be sent to –

Addresses delivered to –

Telephone/Visitor Record

Date	Conversation with	Conclusion

Case Officer Conclusions

Doesn't affect any LB's or TPO's.
Will run front of Mr Haywards ~~me~~ site.
Some hedges now establishing itself on route of new cables should not be removed

RECOMMENDATION/DECISION

NON-DETERMINATION

Permitted Dev (or equiv) .....
Non Development (or equiv) .....
Non Response after Direction .....

Senior Officer confirmed .....

Withdrawn .....

COMMITTEE

Confirmed as agenda .....

SUB-COMMITTEE

Confirmed as agenda .....

DPBCS AUTHORISED

Decision Issue confirmed .....

DELEGATED DECISION

Case Officer

Approve (or equiv) ✓ Refuse (or adverse)

Signed PM Date 15-4

Notes:

☐ Disabled
☐ Prev conditions
☐ Amended plans –
Dwg no:
Received:

CONDITIONS/REASONS:

Condition monitoring:

non-std expiry .....
prior submission ☐
prior siteworks ☐

Determined plans indicated ☑

Departure approval confirmed ☐

Flag for on-site review ☐

Department of Trade & Industry
Electricity Division

1 Palace Street
London SW1E 5HE

Fax No. 01 834 3771
Switchboard 01 238 3000
Direct Line ~~01~~ 238 3634
071

The Planning Officer
S Holland DC
Spalding.

Date: 4 JULY 1994

Dear Sir

ELECTRICITY ACT 1989.

I enclose 1 copy consents to the placing above ground of electric lines issued during June by the Secretary of State. Incorporated in each are directions as to planning permission granted under paragraph 7 of Schedule 8 to the Electricity Act 1989.

Should any correspondence arise would you please quote this Department's reference quoted on the consent in question.

Yours faithfully

Maria Grange

Maria Grange (Mrs)

S.H.D.C. PLANNING DEPT.
RECEIVED
- 7 JUL 1994
Attention of
DPO NRM
DCPO DS
JC ACP
Action by .....
Discuss with .....
Copy to .....
File Nos.
Acknowledge YES/NO
by
date

S. Holland 1 c

Department of Trade and Industry
Electricity & Nuclear Fuels Division
1 Palace Street
London SW1E 5HE

Enquiries 071 238 3000
Direct Line 071 238 3634/3711
Fax 071 834 3771

The Secretary
East Midlands Electricity plc
Lincoln

Dear Sir

Our Reference OL/266/2520
Date 24 JUN 1994

OVERHEAD LINES
ELECTRICITY ACT 1989
TOWN AND COUNTRY PLANNING ACT 1990.

With reference to the application particulars of which are specified below, I am directed by the Secretary of State to inform you that consent is hereby granted pursuant to section 37(1) of the Electricity Act 1989 ("the 1989 Act") to the installing above ground of electric lines ("the lines") particulars of which are specified below.

Pursuant to section 37(3) of the 1989 Act this consent is given subject to the following conditions:

1. The Secretary of State may review this consent at any time after a period of five years from the date hereof, and upon such review, after giving all persons concerned an opportunity of being heard, he may vary or revoke his consent.

2. If the Secretary of State revokes this consent the lines shall be removed within such period as the Secretary of State may direct.

Pursuant to section 90(2) of the Town and Country Planning Act 1990 ("the 1990 Act") the Secretary of State hereby directs that planning permission for the development shall be deemed to be granted subject to the following condition(s):

1. The development to which this permission relates shall be begun not later than the expiration of five years beginning with the date hereof.

Reason: To comply with the provisions of section 91(1) of the 1990 Act.

PLANNING AUTHORITY REFERENCE: H 15/0311/94

APPLICANT COMPANY: East Midlands Electricity plc

DATE AND REFERENCE OF APPLICATION: 28 April 1994 EM 21/147-95001

PARTICULARS OF OVERHEAD LINES:

Situated in the Parish of Quadring

Route as indicated on Map No 92/95001 2 of 2 or within a distance not exceeding 30 metres on either side thereof.

Voltage 11,000

Yours faithfully

D. R. JOHNSON

Authorised by the Secretary of State

dti

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H15/0311/94 Received:28-MAR-94 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8EG

Description: Proposed 11KV overhead line

Location : South Drove Quadring
Spalding

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Director of Planning and Building Control Services
25-APR-94 H15/0311/94

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

Town and Country Planning Act etc

DRAFT PERMISSION

Reference: H15/0311/94 Received:28-MAR-94 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 8EG

Description: Proposed 11KV overhead line

Location : South Drove Quadring
Spalding

South Holland District Council hereby give notice
that permission has been granted (or equiv)
on the following condition(s):

18-APR-94

AD check....AD 19/4...

Authorised to issue (inc Delegation)...[illegible] 20/4..

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

H15/0311/94

ELECTRICITY

Applicant: East Midlands Electricity plc Agent: East Midlands Electricity
Tel: 0205 365181 0205 365181

Description: Proposed 11KV overhead line

Location: South Drove
Quadring
Spalding

Valid date:	28-MAR-94	Terminal date:	23-MAY-94
Target dates:		Target Committee:	11-MAY-94
To case officer	04-APR-94	Report deadline:	27-APR-94
Inspected by	11-APR-94	Agreed TD Ext:	
Extra contacts	18-APR-94	Case Officer:	
Report if not clear by 02-MAY-94		P J UDY	

DEVELOPMENT/CONSTRAINTS

Size:
Category: Misc works
Listed building: Other Constraints: PIT
Conservation Area:

CONSULTATIONS CARRIED OUT

	Sent	Expiry
Clerk to Quadring PC 0775 820049	31-MAR-94	14-APR-94
Cllr Mrs R Hunt MBE 0775 820291	31-MAR-94	07-APR-94
Cllr M S L Rollinson	31-MAR-94	07-APR-94

SITE RECORD

Grid ref: 518000 332500
OS Sheet: 31 32 Parcel:

L.C.C No objections /s ch.

East Midlands Electricity

Our Ref: GJP/95001
Your Ref: B282/733/1

If telephoning please ask for: Mr G Paling
Ext 3725

East Lincolnshire District
ELECTRICITY DIVISION
East Midlands Electricity plc
Sleaford Road, Boston,
Lincolnshire PE21 8EG

Tel: (0205) 365181
Facsimile: (0205) 310264

Dept of Trade & Industry
Electricity Division
1 Palace Street
London
SW1E 5HE

25 March 1994

Dear Sir

RE. PROPOSED 11KV OVERHEAD LINE AT SOUTH DROVE QUADRING, NR. SPALDING LINCOLNSHIRE

I refer to your letter dated 23 February 1993 and its application to the above proposal.

It is my Company's intention to erect an 11000 volt spur some 1.1km in length and install 2 pole mounted transformers. This line being installed to alleviate two substantiated voltage complaints. The route is on the existing low voltage route and care has been taken so no lopping of trees will be required.

Joint construction has been used where possible to reduce the number of poles and hence the visual impact of the line.

If you require any further information please do not hesitate to contact me at this office.

Yours faithfully

(Graham Paling) Project Manager
Overhead Networks Boston

RC

H15/0311/94

28 MAR 1994

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 Kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road
Boston
Lincolnshire

Postcode: PE21 8EG

Telephone Number: (0205) 365181

OFFICE COPY

PART I

East Midlands Electricity plc Application Number EM147 Date 25 March 1994

To the Chief Executive Planning Dept. Council South Holland District

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

Designation (D A Tuley) Projects Manager

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The District/Borough Council

(i) object on the grounds set out below/have no objection to make to the development described overleaf.*

(ii) request/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date Signed

*Delete as appropriate Designation

On behalf of the District/Borough Council

(Reasons for objections)

S.H.D.C. PLANNING DEPT.
RECEIVED
28 MAR 1994
Allocation of
File Nos.
Acknowledge YES/NO
by
date

PARTICULARS OF PROPOSED DEVELOPMENT AND REPRESENTATIONS

(To be completed by East Midlands Electricity plc)

Application is being made:

(a) for consent under section 37 of the Electricity Act 1989 to install or keep installed an electric line above ground;

~~(b) for a direction under section 90(2) of the Town and Country Planning Act 1990 that planning permission for the proposed development be deemed to be granted.~~

1. Particulars of proposed development. (These particulars should be accompanied by such plans as may be necessary to enable the local planning authority to identify the land affected by the proposals and to appreciate the nature and extent of the proposed development and by a copy of the environment statement if the applicant has prepared one.)

To erect the proposed 11,000 volt overhead line on wooden poles in the parish of Quadring with a tolerance of 30m either side of the route shown on the attached plan.

2. Particulars of any representations of objections which have been made to East Midlands Electricity plc.

3. Particulars of the applicant's compliance with his duty under paragraph 1 of Schedule 9 to the Electricity Act 1989.

See attached environmental statement.

Date 25 March 19 94 For and on behalf of East Midlands Electricity plc.

Signed (D A Tuley) Designation Project Manager.

***Note:** This Part to be completed, dated and signed before submitting to the local planning authority.*

East Midlands Electricity plc Application Number

(Application dated 25 March 1994)

PART II—INFORMATION AND OBSERVATION

(To be completed by the District/Borough Council)

Planning Reference Number EM147

1. Names of interested parties consulted about the proposals with details of any observations received.

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?

4. Does the propoosed development involve the demolition, alteration or extension of a buildin special architectural or historic interest included in a list compiled or approved under section 1 of the Planning (Listed Builkdings and Conservation Areas) Act 1990?

5. Does the local planning authority agree that the proposed development should be approved by the Secretary of State for Energy as described? (If the answer is 'NO', please answer question 6.)

6. Would the local planning authority be prepared to agree that the proposed development should be approved subject to modifications or conditions? (If so, specify the modifications or conditions proposed and state whether they are acceptable to the applicant). [Note: the precise form of any modifications or conditions subject to which the consent or direction given is a matter for the Secretary of State, but he will have regard to the form of words used by the local planning authority.]

Date Signed

Designation

On behalf of the Council
(Local planning authority for the area in which the proposed development is to be carried out.)

Two completed copies of this Form, both signed, should be returned to East Midlands Electricity plc for submission by them to the Department of Energy.

East Midlands Electricity

Our Ref: GJP/95001
Your Ref: B282/733/1

If telephoning please ask for: Mr G Paling
Ext 3725

East Lincolnshire District
ELECTRICITY DIVISION
East Midlands Electricity plc
Sleaford Road, Boston,
Lincolnshire PE21 8EG

Tel: (0205) 365181
Facsimile: (0205) 310264

Dept of Trade & Industry
Electricity Division
1 Palace Street
London
SW1E 5HE

25 March 1994

Dear Sir

RE. PROPOSED 11KV OVERHEAD LINE AT SOUTH DROVE QUADRING, NR. SPALDING LINCOLNSHIRE

I refer to your letter dated 23 February 1993 and its application to the above proposal.

It is my Company's intention to erect an 11000 volt spur some 1.1km in length and install 2 pole mounted transformers. This line being installed to alleviate two substantiated voltage complaints. The route is on the existing low voltage route and care has been taken so no lopping of trees will be required.

Joint construction has been used where possible to reduce the number of poles and hence the visual impact of the line.

If you require any further information please do not hesitate to contact me at this office.

Yours faithfully

(Graham Paling) Project Manager
Overhead Networks Boston

RC

East Midlands Electricity PLC

EAST LINCOLNSHIRE DISTRICT

Title QUADRING , SOUTH DROVE

	EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines	33 kV		
	11 kV		
Underground Cables	33 kV		
	11 kV		
Stream	LV		
Transformers Ground	GMT		
	PMT		

Date May Drawn No. TT 6382/1823 Scale 1 : 2500

Quadring Low Fen

Middle Fen Farm

Munday Fen

Quadring Low Fen

Fen Foot Drain

Fen Foot Drain

3 × 1 (6/.186/7/.062sc.) S.C.A.

4 × 1 (7/.136sc.) Cu

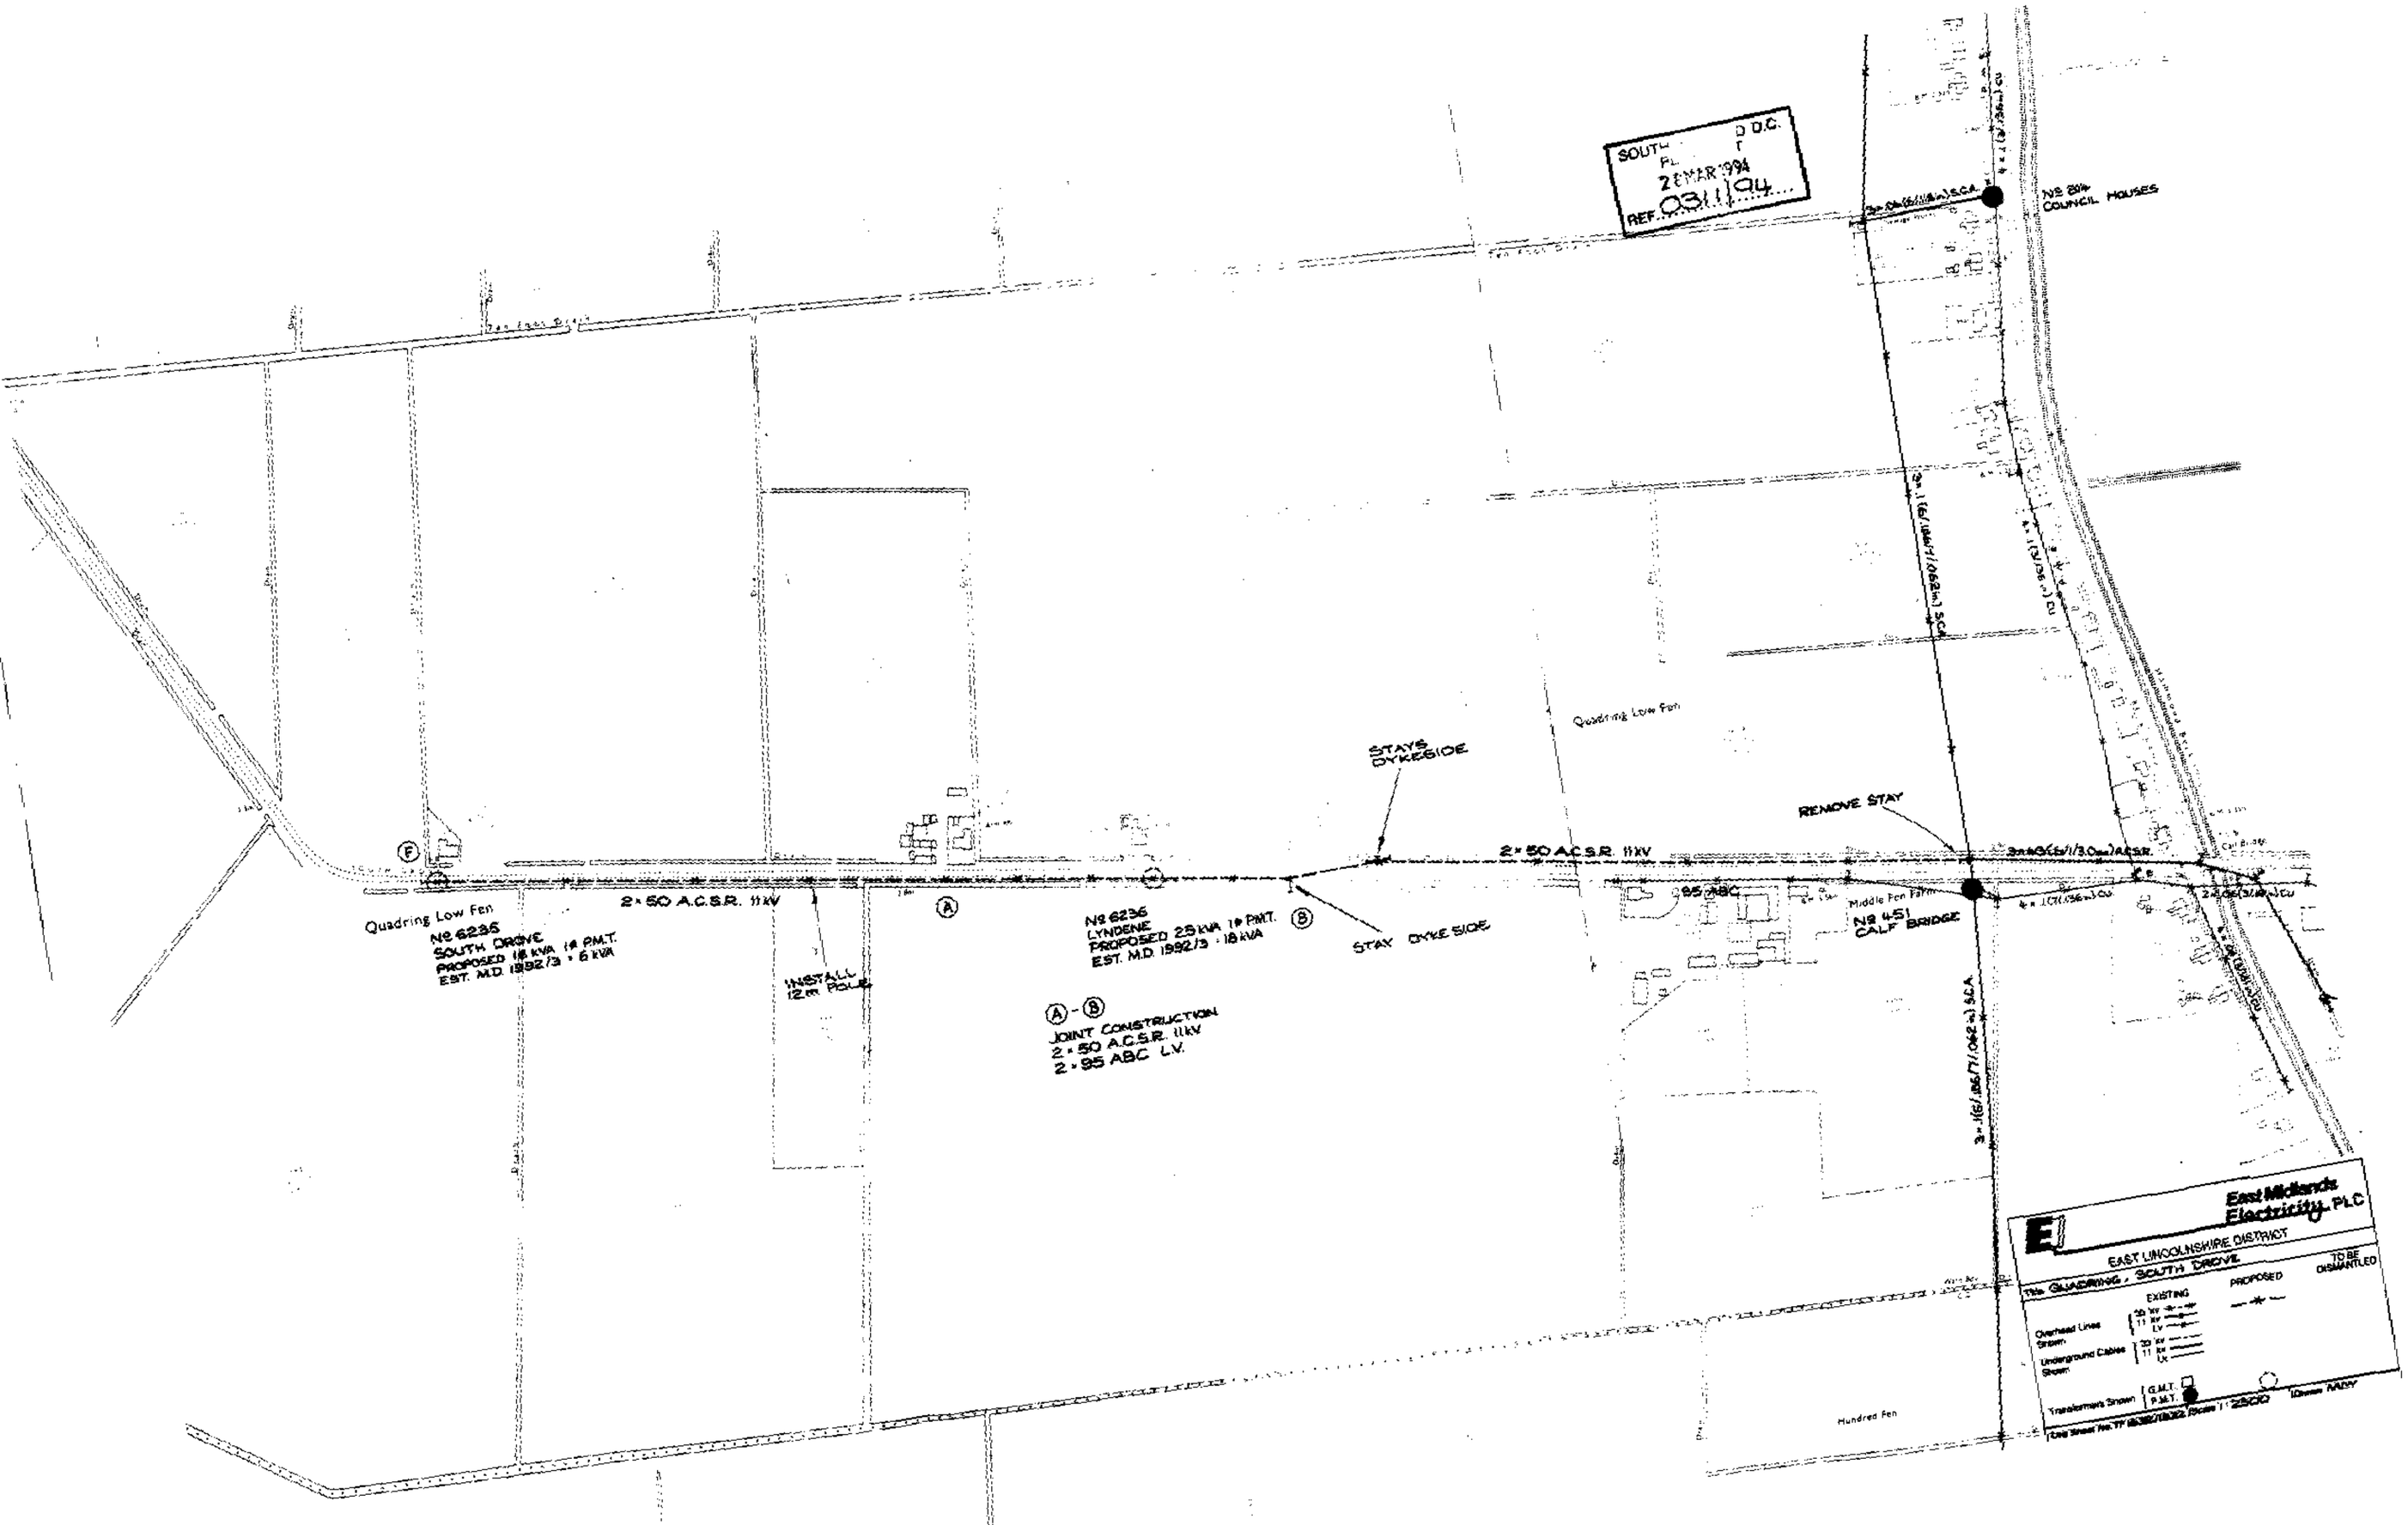

SOUTH D.C.
28 MAR 1994
REF. 0311/94
Nº 814
COUNCIL HOUSES
Quadring Low Fen
STAYS
DYKESIDE
REMOVE STAY
2 × 50 A.C.S.R. 11kV
Middle Fen Farm
Nº 451
CALF BRIDGE
Quadring Low Fen
Nº 6235
SOUTH DROVE
PROPOSED 16 kVA 1# P.M.T.
EST. M.D. 1992/3 = 6 kVA
2 × 50 A.C.S.R. 11kV
INSTALL
12m POLE
Nº 6236
LYNDENE
PROPOSED 25 kVA 1# P.M.T.
EST. M.D. 1992/3 = 18 kVA
STAY DYKE SIDE
Ⓐ - Ⓑ
JOINT CONSTRUCTION
2 × 50 A.C.S.R. 11kV
2 × 95 ABC L.V.
Hundred Fen
East Midlands Electricity PLC
EAST LINCOLNSHIRE DISTRICT
The QUADRING, SOUTH DROVE
EXISTING
PROPOSED
TO BE DISMANTLED
Overhead Lines Shown
Underground Cables Shown
Transformers Shown
G.M.T.
P.M.T.
Scale 1 : 2500

