



NORTH

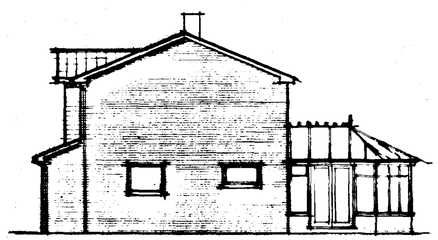

WEST

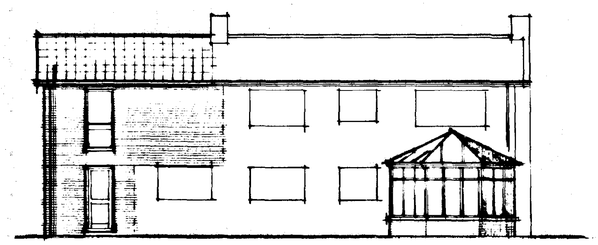

SOUTH

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 250mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees.
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.
Any investigation work relating to extg foundations should be carried out prior to the commencement of any works.

FLOOR CONSTRUCTION

Ground
65mm sand/cement screed reinforced with chicken wire mesh
300g polythene separating membrane
80mm Jablite SD floor insulation (k = 0.037W/m°C)
100mm ST4 grade oversite concrete
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm
Where 100mm internal walls are constructed off the floor slab the slab is to be thickened to 230mm for a min width of 450mm
Strip off all vegetable soil beneath proposal

First
18mm Weyroc floor panels
2no 50mm SC3 grade tanalised timber joists at 400mm cts with min. 1 row herringbone strutting midspan
12.7mm plasterboard, fixed in accord with manufacturers instructions, with all necessary noggins etc. and finished with either artex or skim in accord. with clients instructions
Note : finished floor level to match existing first floor level

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

Internal Walls
To be 100mm blockwork constructed off a dpc off the floor slab

Stud Partitions
to be constructed as follows :-

75 x 50mm head and sole plate
75 x 50mm studs at 400mm cts with min. 2 rows
75 x 50mm noggins equally spaced
75mm glassfibre insulation within framework
face both sides with 12.7mm plasterboard, tape joint and skim finish

stud partitions to be constructed off doubled up floor joists (bolted together at 1.0m cts) at first floor level when running parallel to joists, and off 75 x 50mm sole plate, with solid blocking between joists, when running perpendicular to joists

Dry lining to extg garage wall
Extg wall
Building paper vapour barrier
75 x 50mm head and sole plate
75 x 50mm studs at 400mm cts with min. 2 rows
75 x 50mm noggins equally spaced
75mm glassfibre insulation within framework
face with 12.7mm plasterboard, tape joint and skim finish

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.
A dpc cavity tray, stepped as applicable, is to be constructed within the wall immediately above an abutment

LINTELS

Lintels to be RS, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels over internal openings to be RS internal 100 lintels unless specified otherwise

Lintels to be protected with min. 15mm gypsum plaster, skim finish to give a min. half hour fire protection

WINDOWS & DOORS

Windows and doors to be purpose made UPVC double glazed with min. 12mm air gap to sealed units and weather stripped.

Windows to habitable rooms are to incorporate a controllable trickle vent of 8000mm², 4000mm² to non habitable rooms.

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

WINDOW/DOOR & LINTEL SCHEDULE

Location	window/door sizes width x depth	lintel ref. &	length
1	900 x 2100	L1/S	1200
	Entrance door & frame		
2	1200 x 750	L1/S	1500
3	1200 x 1050	L1/S	1500
4	Std garage door	L1/S	2700
5	1800 x 1200	L1/S	2100
6	1800 x 1200	L1/S	2100
7	Extg entrance door	L1/S	2400
8	900 x 2100	L1/S	1200
9	1800 x 1200	L1/S	2100
10	1800 x 1200	-	-

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

The en suite shower room is to be mechanically ventilated direct to the external air. The capacity of the extractor is to be 15 litres/sec

The internal bathroom is to be mechanically ventilated direct to the external air. Extractor is to be capable of a min. 3No. air changes per hour and is to incorporate a 15 minute over-run period

SMOKE DETECTION

Self contained smoke alarms complying with BS5446 : Pt 1 : 1990 are to be installed where indicated SD on the drawing. An alarm must be positioned within 3.0m of bedroom doors.

The alarms are to be permanently wired to a separately fixed circuit at the distribution board operating at a low voltage via a mains transformer

The wiring installation is to comply with the I.E.E. Regulations.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay in where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

Foul
Supply and install proprietary upvc inspection chambers on 100mm pea gravel bed in strict accordance with manufacturers instructions. Inspection chambers to conform to the following sizes : -

Depth	Internal diam	Cover diam
.6m or less	190mm	190mm
1.0m or less	450 mm	450mm
1.5m or less	1050mm	800mm
over 1.5m	1200mm	800mm

Excavate for and lay in where indicated 100mm diam. flexible jointed upvc drains on 100mm pea gravel bed at a gradient of 1 : 70.

Where 100mm diam. drains pass through walls they are to be protected by the use of a lintel over. Both sides the wall to be masked with rigid sheet material with 50mm clearance of the pipe.

Where flexible pipes are not under a road and have less than 600mm cover they are to have concrete paving slabs laid as bridging above the pipes for protection and are to have a min. 75mm granular material between the top of the pipe and the underside of he slab.

Where 100mm diam pipes pass beneath the building they are to be encased in 150mm pea gravel surround

Install where indicated a 100mm diam. soil and vent pipe jointed to 100mm diam. upturned bend at base. Finish at top, a min. 900mm above window head height with a durable cage.


Install where indicated 100mm diam. stub soil stack jointed to 100mm diam. upturned bend at base. Provide removable screw on lid/air admittance valve at head.

Install 40mm diam. pvc waste to sinks and showers, (*NOTE : shower trays to be constructed on a suitable plinth to maintain access to trap and waste*) 32mm diam. pvc waste to hand basins all with 75mm deep traps 40mm diam. pvc waste to bath with combined trapped waste and overflow. *Unless specified other wise on plan*


All waste pipes to have rodding access at each change of direction and be readily accessible throughout their length.

Above ground drainage to comply with BS5272 : 1978
Below ground drainage to comply with BS8301 : 1985


All drainage items are to be installed in strict accordance with the manufacturers instructions

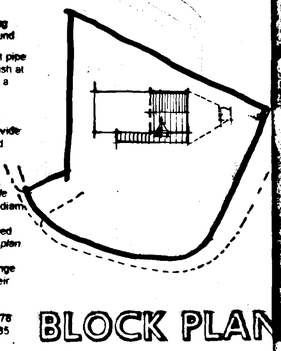

BLOCK PLAN

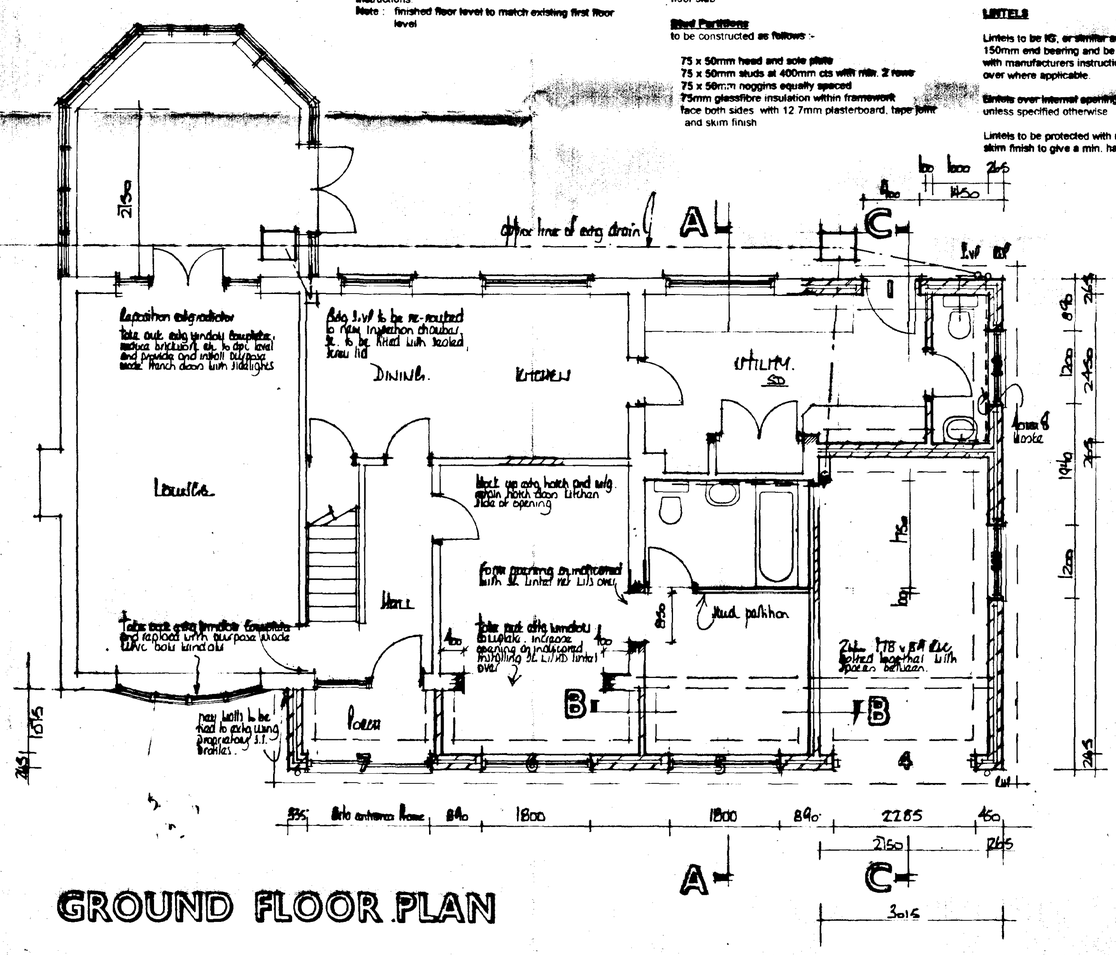

GROUND FLOOR PLAN

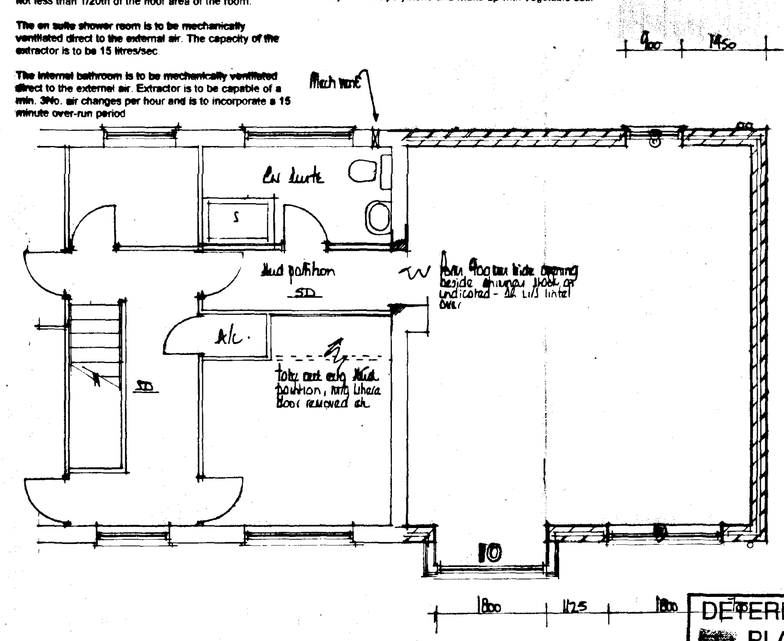

DETERMINED PLAN

SOUTH HOLLAND DC HOUSING & PLANNING 25 JUL 1997 Ref: 0330/97

FIRST FLOOR PLAN

A	
Date	Revisions

© copyright

East Midlands Design Associates
"Willow Ledge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767966

Client
Mr. & Mrs Tweed

Job Title
Extension & Alterations to DWELLING at 126 Main Road Algarkirk Spalding

Drawing Title
Plans & Elevations As Proposed

Scale 1:50 & 1:100

Date MAY '97 | Drawn by AL

Drg. No. 97128/101 | Rev