
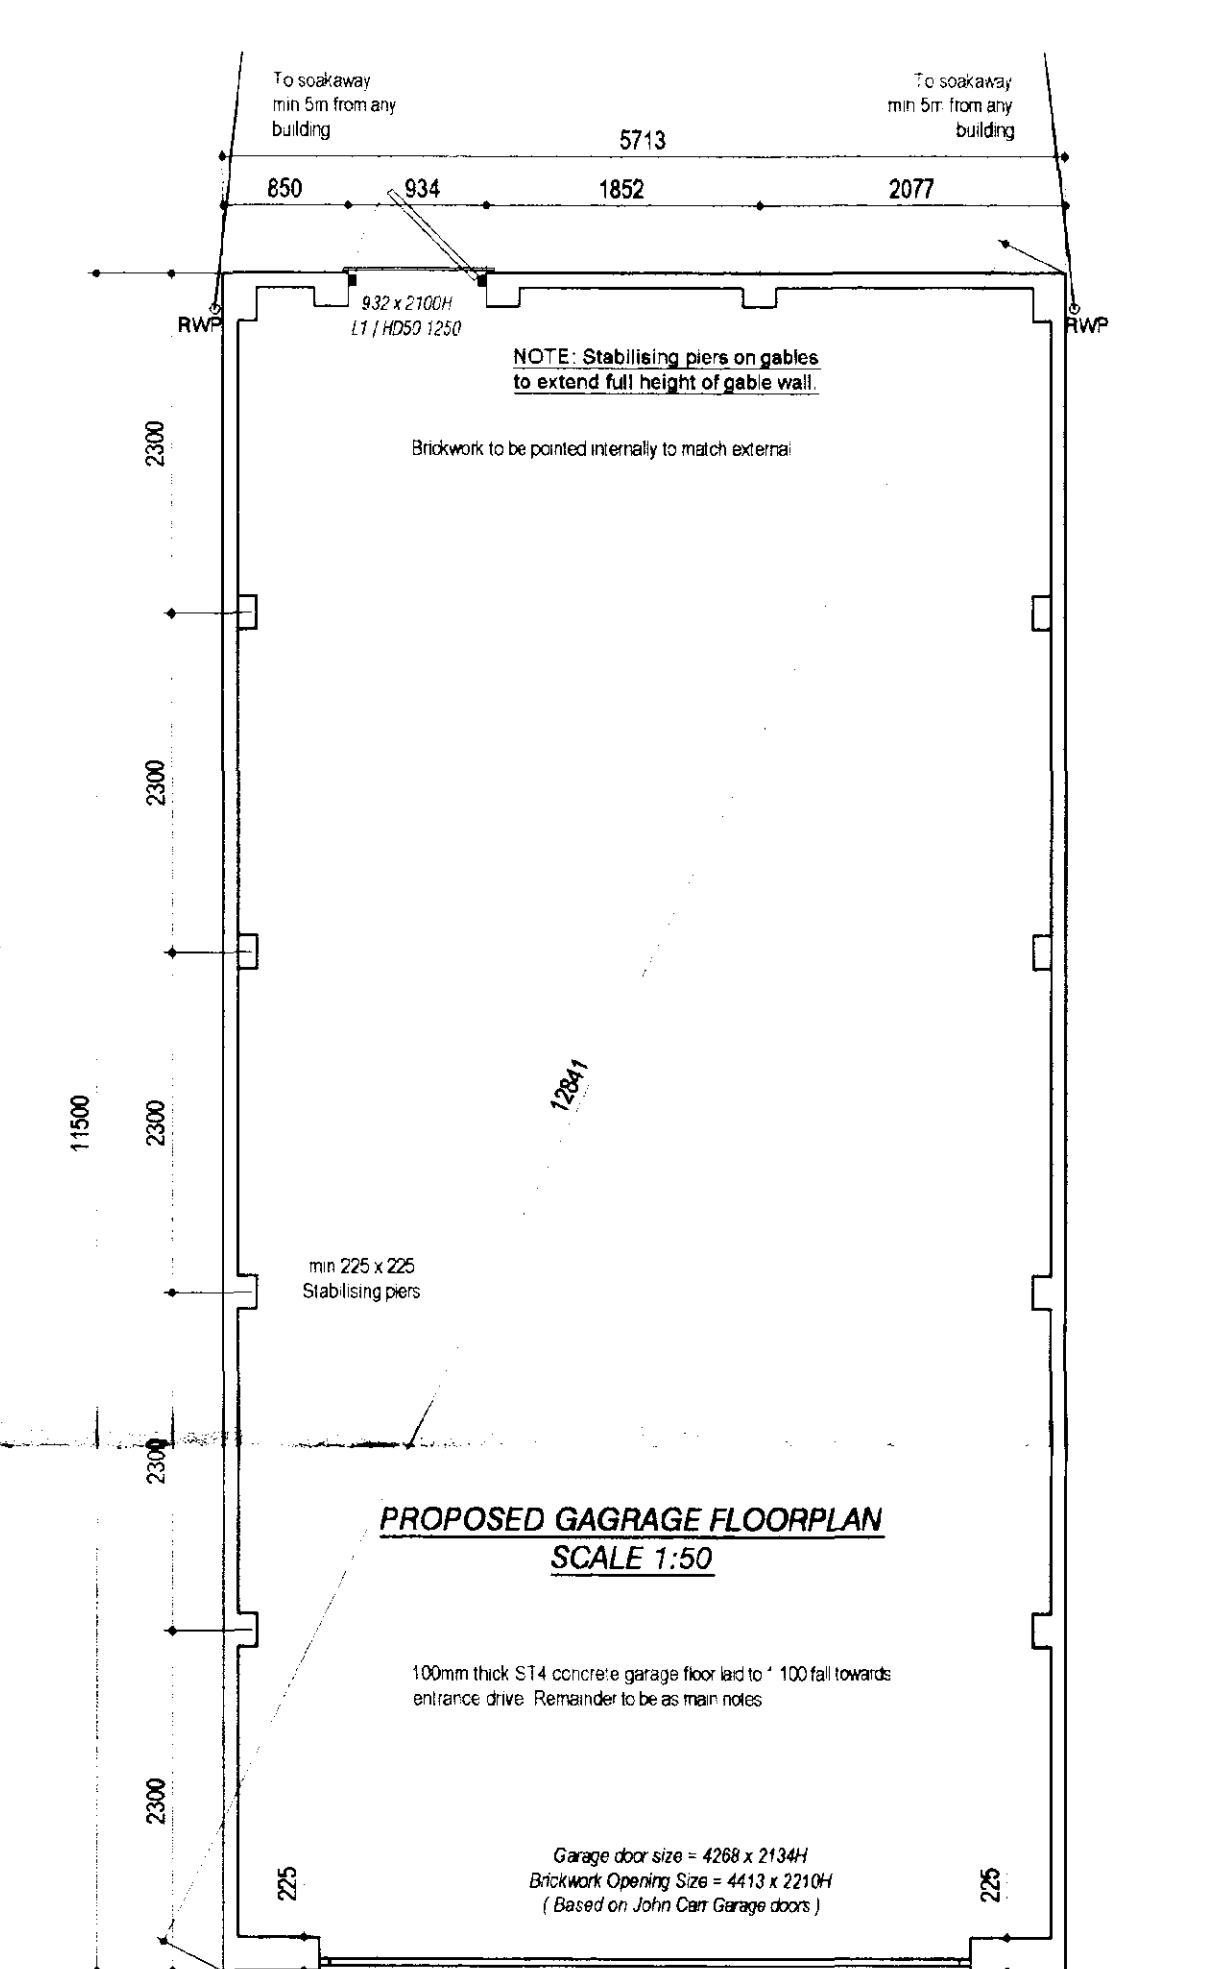
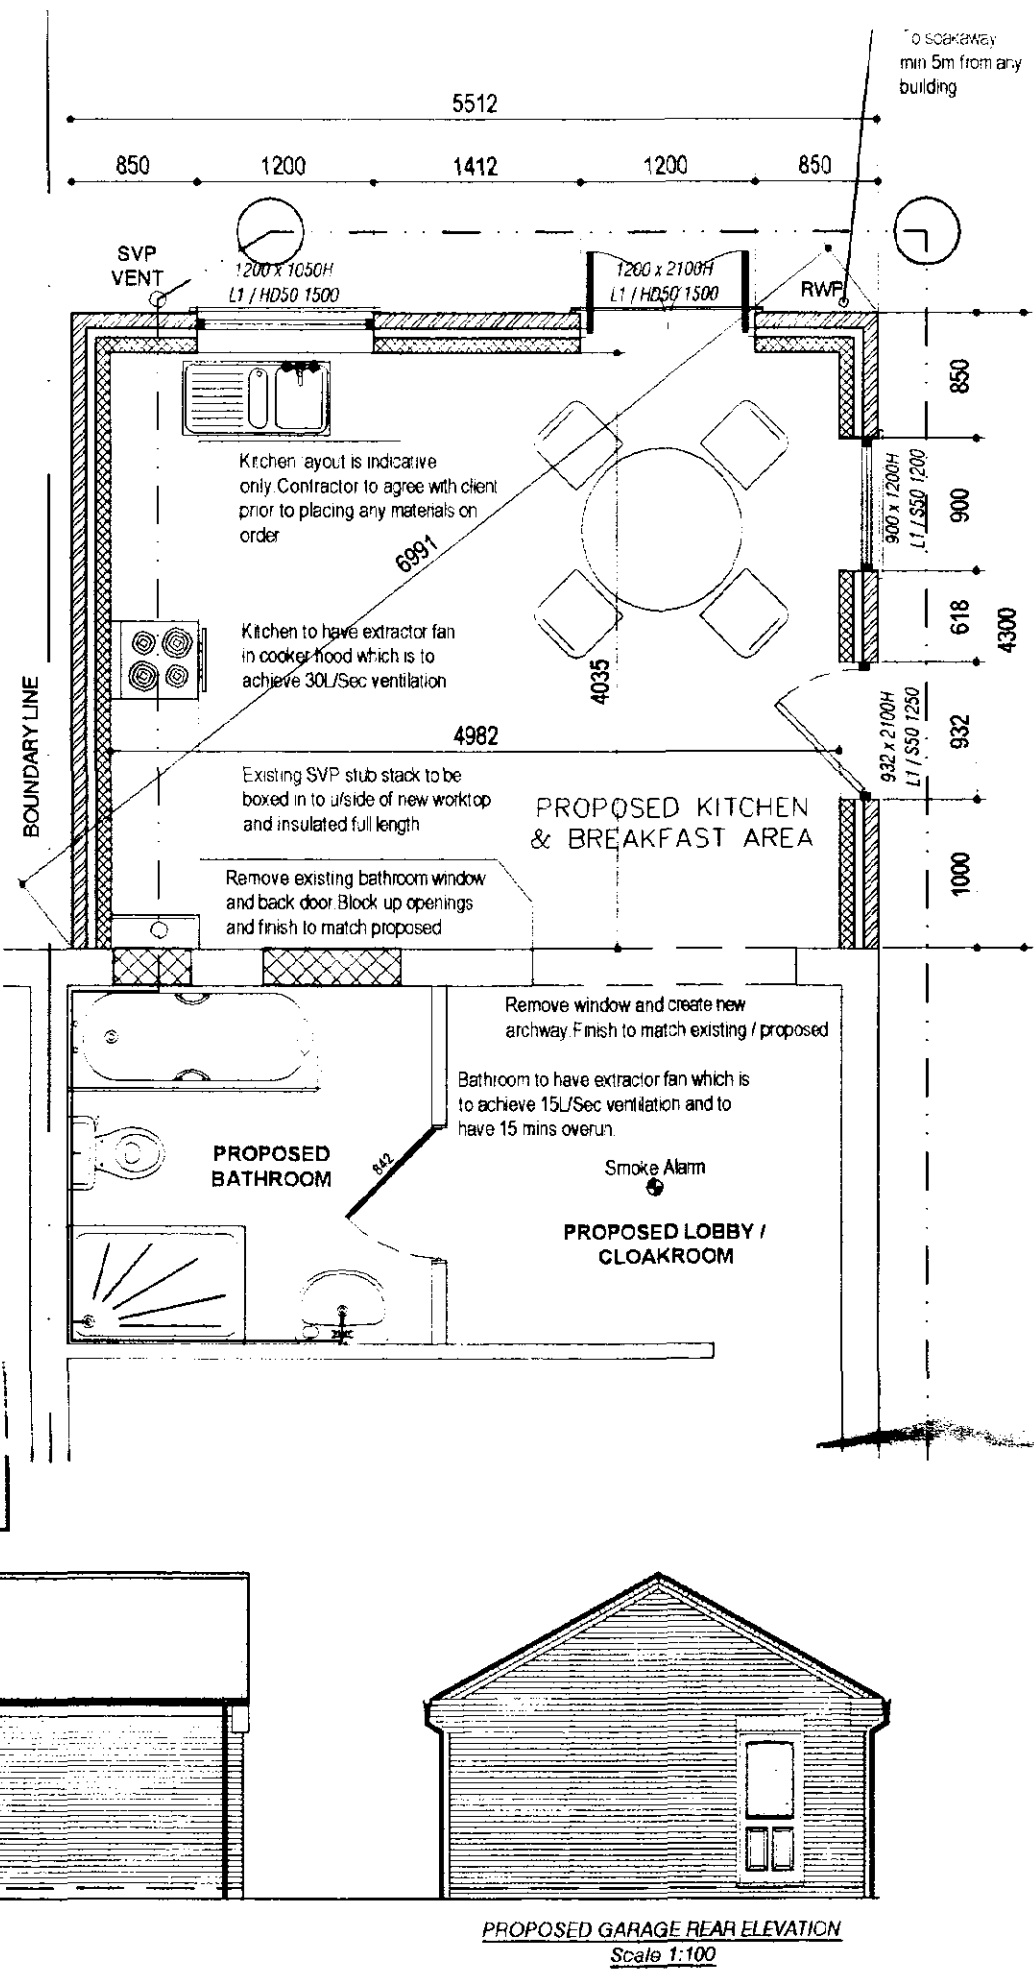


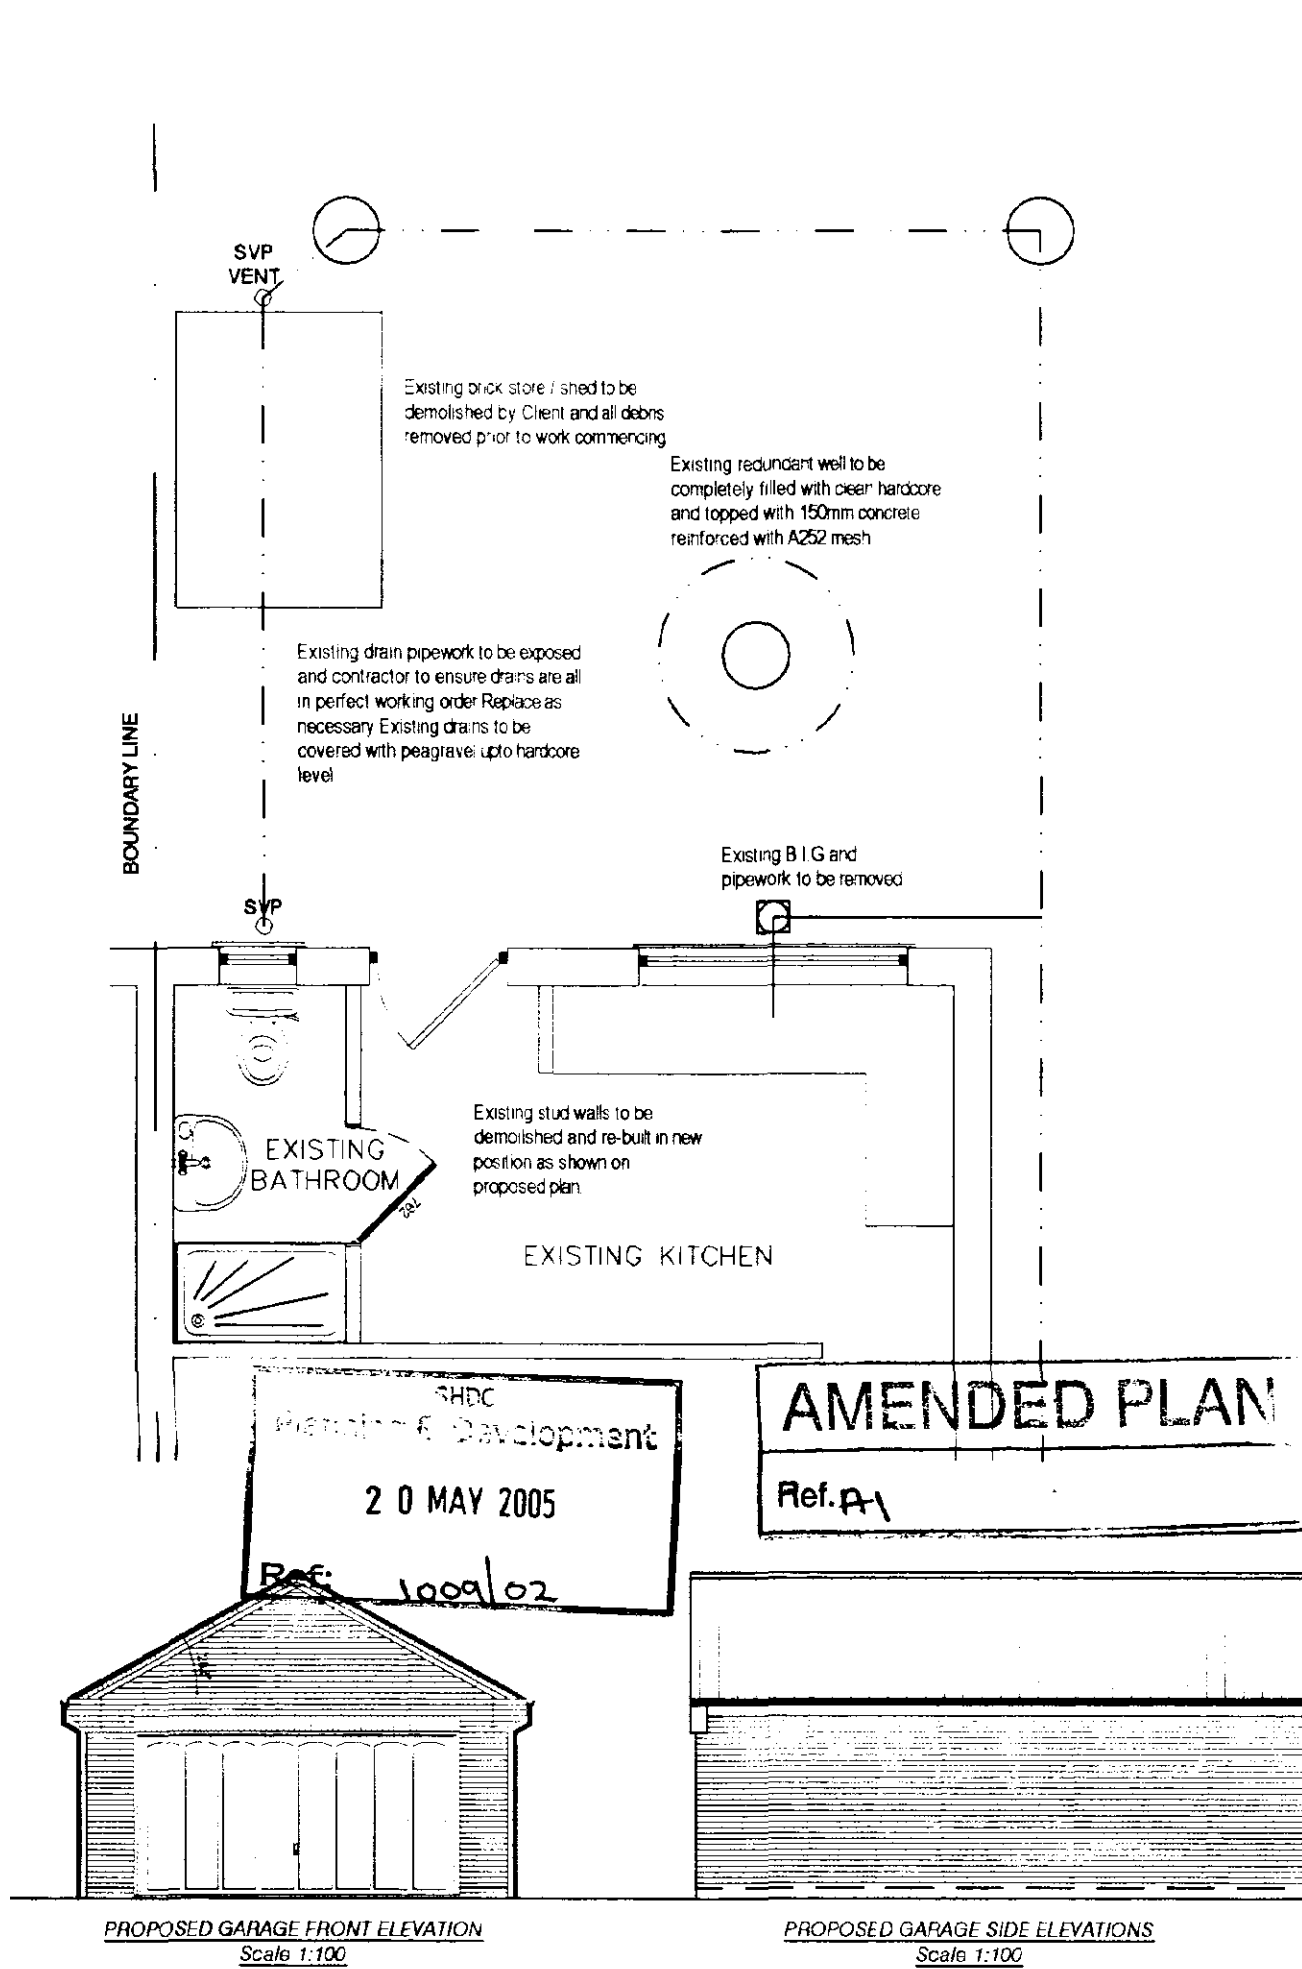

GENERAL CONDITIONS

Contractors are responsible for checking all dimensions on site when work commences and before ordering any materials. Any discrepancies should be brought to the attention of the Client for remedial action before commencing further. All details shown are based on typical site conditions for that area. Any abnormal conditions should be brought to the attention of the Client and Local Authority. The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification. No allowance has been made for Structural Calculations or "SAP" calculation if deemed necessary then these will be a chargeable extra. All materials not specified to be of a standard suitable for the work proposed and be fit for purpose. All work to be in accordance with good building practice and all necessary BS codes for Workmanship on Building Sites.

WASTE SIZES FOR NEW PLUMBING

All new plumbing to have the following waste sizes:
W.C. = 100mm Ø Multi-vent or similar approved
W.H.B. = 32mm Ø uPVC with 75mm Deep sealed trap
SINK = 40mm Ø uPVC with 75mm Deep sealed trap
SHOWER = 40mm Ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction. Provide anti-siphon traps where pipe runs exceed 3m and W.H.B. pipe run exceeds 1.8m

ROOF INSULATION

Lay 300mm mineral fibre insulation to roof area to achieve a 'U' value of 0.16W/m²K. 100mm between rafters and 200mm over rafters at right angles to first layer. Fix Dometal after lay in accordance with manufacturers instructions or similar approved where insulation meets roof slope to maintain roof ventilation

ROOF FINISH

Concrete interlocking roof tiles to match existing in accordance with manufacturers instructions on 38x25 preservative treated timber battens on untearable sarking felt with min 150mm overlaps

REV DESCRIPTION:

'B' 19.08.05 Garage Length increased
'A' 25.09.02 Amended in accordance with SHDC's comments

FOUNDATIONS

Existing building area to be stripped of all vegetable matter and rubbish to a min depth of 150mm before excavation commences. Concrete mix for foundations to be S14 Grade in accordance with BS5328:1991. Foundations to external wall to be min 700mm wide x 225mm deep. Excavate down to solid firm strata i.e. 750mm deep (min 1000mm if soil is of a shrinkable nature). Exact depth to suit conditions on site and to the strict approval of the L.A. Building Inspector. Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer

GROUND FLOOR

65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge polythene separating layer on a 60mm Celotex Double R GA2000 rigid insulation board or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation up to d.p.c. level on 100mm thick S14 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min 150mm clean and well compacted hardcore. Depth of hardcore must not exceed 600mm. All service entries to be sealed with pressure sensitive tape. Floor to achieve a min 'U' Value of 0.25W/m²K

WALLS BELOW D.P.C.

3no Coarse of Class B brickwork below D.P.C. on outer face and 1no coarse of 7N/mm² on inner skin of cavity face. Elsewhere to be either 7N/mm² concrete blockwork or full width trench blocks. Both to be within 225mm of DPC level. Cavity to be filled to within 225mm min. of below DPC with lean concrete mix.

DAMP PROOF COARSE (D.P.C.)

Horizontal heavy duty polythene DPC to all walls in accordance with BS 8515 and set min 150mm above all external ground levels. DPC in walls must be linked / lapped with DPM in ground floor. Provide perforated cavity wall trays above windows & doors with weep vents at a max of 2m centres with a min of 2no per opening

CAVITIES

Close all cavity walls at jambs with Thermabre Insulated cavity closers fitted strictly in accordance with manufacturers instructions. Close top of cavity walls with 75mm Dritherm or similar approved insulation batt supported on wall ties

EXTERNAL WALLS

All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses
-100mm Thermaite Shield insulating blockwork
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties
External wall to achieve a min 'U' value of 0.35W/m²K

MORTAR

All mortar to be 6:1 sand/cement/lime or equally approved and to be a close match to existing as possible

CEILINGS

All ceilings to be 12.7mm plasterboard to BS1230
Ceilings to be have Cove and an Artex finish to match existing or to clients requirements. Plasterboard sheets to be fixed with joints staggered and must be laid perpendicular to all joist runs. Fix boards at a min 150mm centres

NOGGINGS

Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings. Position of light fittings to be advised by client on site

INTERNAL JOINERY, SKIRTING & ARCHITRAVES

All internal finished timber to match existing or to clients requirements

LATERAL RESTRAINT STRAPS

Tie roof structure to blockwork wall with 30X5 galvanised mild steel straps at max 2m ctrs where rafters and ceiling joists run parallel to blockwork walls. Also fit at max 2m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap

WALL TIES

Cavity wall ties to BS1243:1976 To be built into cavity wall as works proceeds and spaced at 900mm centres horizontally, 450mm centres vertically and 300mm staggered around all openings

HEATING

Provided from existing with new radiators to have thermostatic radiator control valves

ELECTRICAL INSTALLATION

To be in strict accordance with the latest I.E.E. Regulations and Engineer to advise if any appliance does not conform

SOAKAWAYS

All soakaways to be min of 5m from any building & a min of 1m³ filled with rubble to within 450mm of external ground level. Overlay rubble with polythene sheet and backfill with clean topsoil. Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions

LINTELS

All lintels to cavity wall to be factory insulated I.G.L. range unless noted otherwise or equal approved. All lintels must have a min 150mm endbearing and installed in accordance with manufacturers instructions. Note: lintels are not to have a continuous baseplate

WINDOWS

All windows to be White uPVC double glazed to match existing with 8000mm² trickle ventilators all in accordance with clients requirements. Opening vents to give 1/10th of floor area rapid ventilation on to all rooms. All glazing to meet the requirements of section N of the Building Regulations and BS6206 class B. All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a Low 'E' glass inner pane to achieve a min 'U' value of 2.0 W/m²K. Note all windows to have a perimeter weatherseal both internally and externally

RAINWATER DRAINAGE

White uPVC gutting and downpipes to match existing. Falls for gutting to be 1:600 and brackets fixed at max 2m ctrs. Downpipes to be connected into underground drains via reducing adapter. Undergound drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surrounds laid to 1:100 falls to new soakaway. Soakaway specification detailed elsewhere

ROOF CONSTRUCTION

To be Trussed Rafters designed and constructed in accordance with BS 5268 Part 3:1985 all by specialist approved manufacturer. Trusses to be set at max 600mm centres with all necessary 100x25 bracing. Truss manufacturer to provide calculations and details to Client for L.A. Building Inspectors approval prior to manufacture

SMOKE ALARMS

To be self contained, interconnected and wired to a separately fused circuit with a battery back up. Smoke alarms to be fitted to outside of plasterboard ceiling to the ground floor: max 7m from the kitchen and lounge

PROPOSED EXTENSION SIDE ELEVATION
Scale 1:100

PROPOSED EXTENSION REAR ELEVATION
Scale 1:100

Roof tile to be a Redland Regent tile which will achieve min 15° at 100mm headlap. Colour of tile to match existing

Approx angle of roof = 16° Exact angle of roof to be confirmed on site to ensure min 150mm lead flashing abutment under first floor bedroom window

Existing RWP to discharge onto proposed extension roof

Provide a continuous Redland Roof Abutment ventilator at roof wall abutment

Self R & Fascia to match existing with 10mm continuous gap with self covered with flymesh

Brickwork to match existing



remway design

3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 01775 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project: Proposed Rear Kitchen Extension & Detached Double Garage

Client: Mr Dean Bingham
321, Westhorpe Road
Gosberton PE11 4ER


Date: Sept 02 DRG No.: 01 REV: B

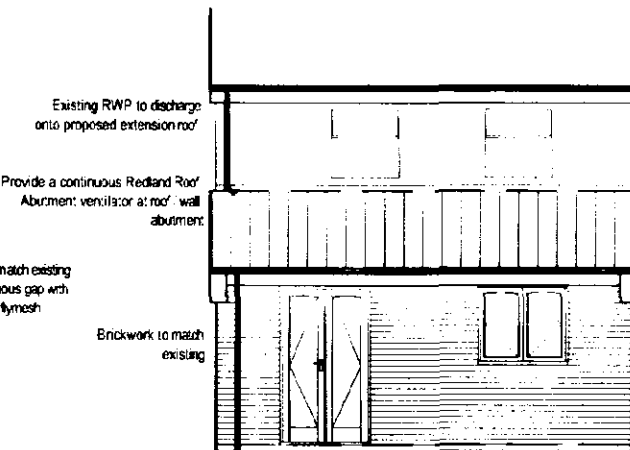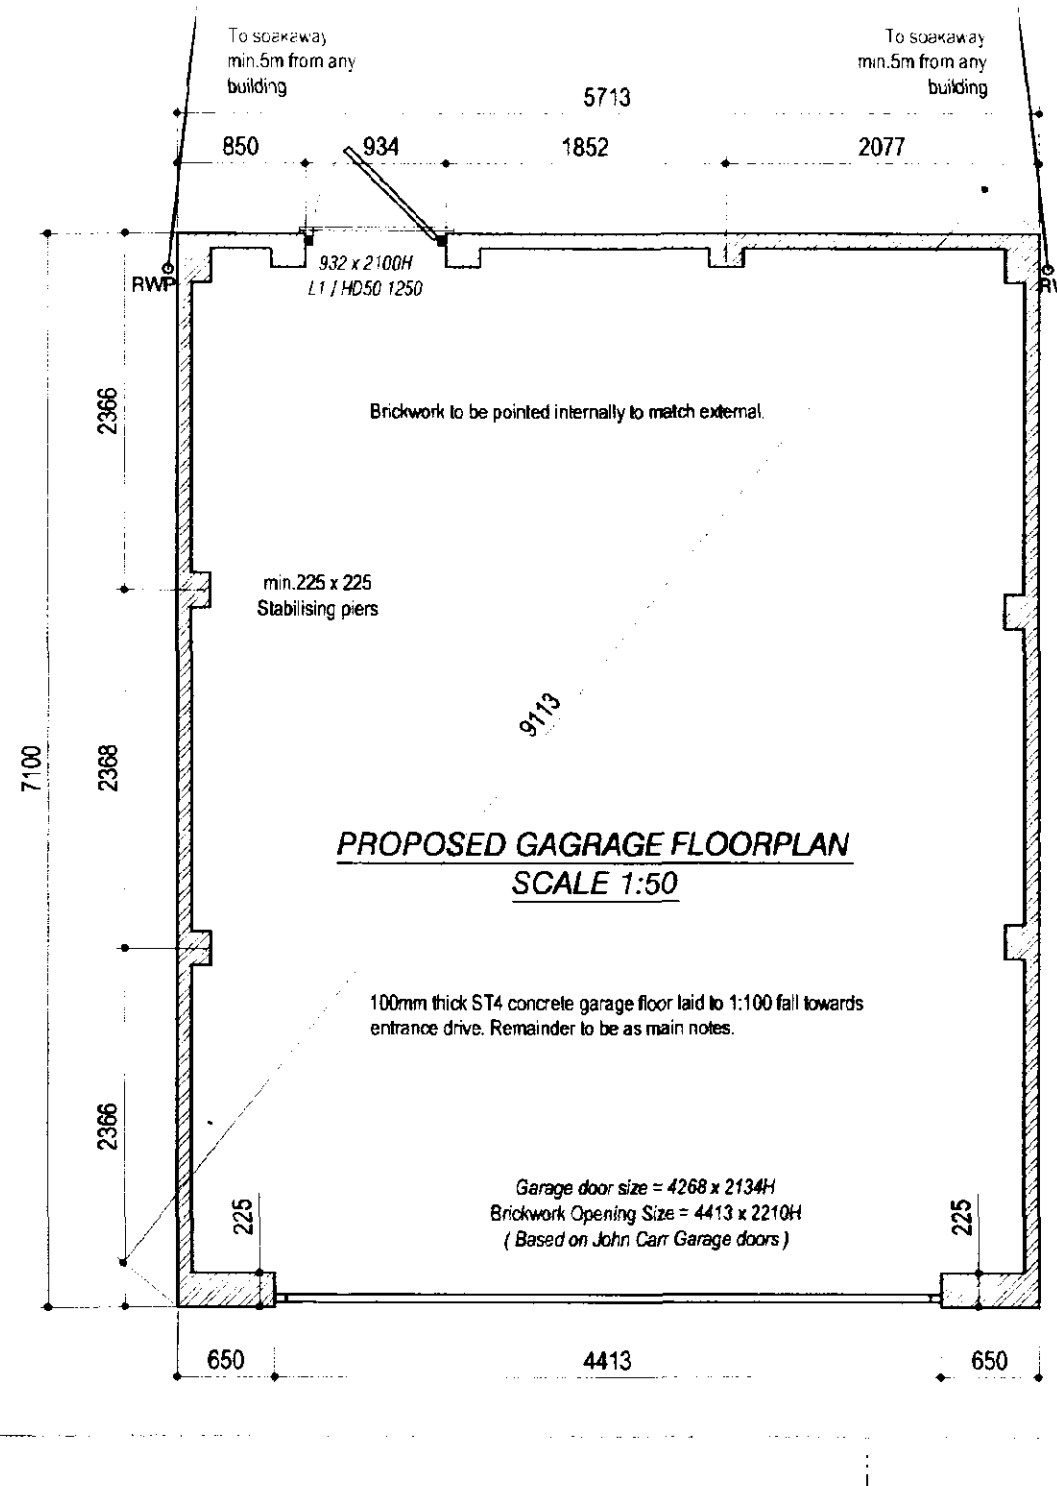

PROPOSED EXTENSION REAR ELEVATION
Scale 1:100

Concrete interlocking roof tiles to match existing in accordance with manufacturers instructions on 38x25 preservative treated timber battens on untearable sarking felt with min.150mm overlaps.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose. All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.



REV DESCRIPTION:

Date: Sept 02	DRG No.: 01	REV
---------------	-------------	-----

SHDS
Planning & Development
11 SEP 2002
100910Z