

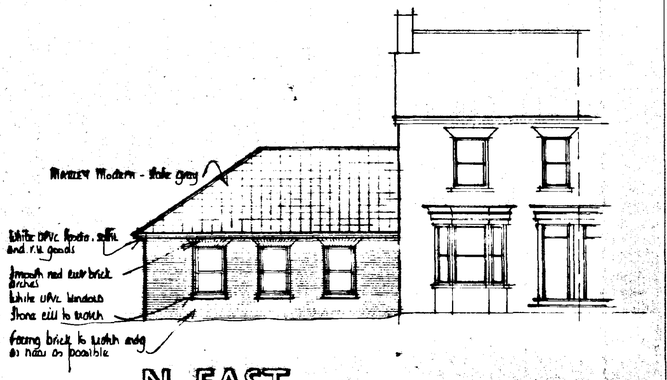



N. EAST

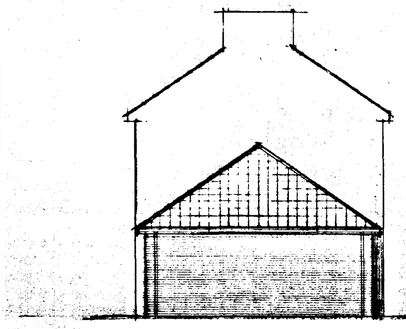

S. EAST

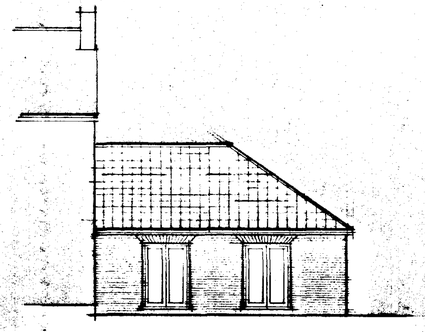

S. WEST

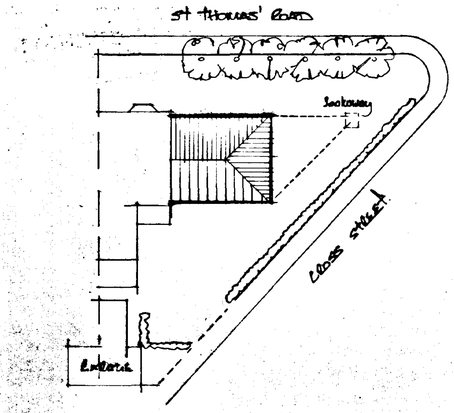

BLOCK PLAN

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 230mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees.
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.
Any investigation work relating to extg foundations should be carried out prior to the commencement of any works.

FLOOR CONSTRUCTION

Ground
65mm sand/cement screed reinforced with chicken wire mesh
150mm ST4 grade oversite concrete
50mm Jablite SD floor insulation (k = 0.037W/m°C) with perimeter insulation to slab
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill, to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm.
Strip off all vegetable soil beneath proposal.

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.

LINTELS

Lintels to be Catnic ref. CG70/100, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels to be protected with min. 15mm gypsum plaster skim finish to give a min. half hour fire protection.

WINDOWS & DOORS

Windows and doors to be purpose made UPVC with 20mm air gap to sealed units and weather stripped.

Windows to habitable rooms are to incorporate a controllable trickle vent of 8000mm².

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

WINDOW/DOOR & LINTEL SCHEDULE

Location	window/door ref. width x height	lintel ref. & length
1	1030 x 1650	CG7 /100 1350
2	1030 x 1650	CG70/100 1350
3	1030 x 1650	CG70/100 1350
4	1500 x 2100	CG70/100 1800
	French doors	
5	1500 x 2100	CG70/100 1800
	French doors	

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

SMOKE DETECTION

Self contained smoke alarms complying with BS5446 Pt 1 : 1990 are to be installed where indicated SD on the drawing. An alarm must be positioned within 3.0m of bedroom doors.

The alarms are to be permanently wired to a separately fixed circuit at the distribution board operating at a low voltage via a mains transformer.

Where more than one smoke alarm is required the units are to be interconnected so that the detection of smoke by one unit operates the alarm signal in all units.

The wiring installation is to comply with the I.E.E. Regulations.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay as where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway.

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

ROOF CONSTRUCTION

Tiles
The roof is to be covered with interlocking concrete roof tiles fixed in strict accordance with manufacturers instructions.

Battens
Approved quality tanalised s/w battens, 38 x 25mm, are to be laid at a gauge suitable for the tiles and fixed with 90 x 3.35mm wire nails. Battens should be at least 1.2m in length and should be of sufficient length to be supported at each end and intermediately by at least three rafters, trusses or walls. Butt joints over intermediate supports should be staggered and the ends must be sawn.

Underlay
Approved reinforced roofing felt, type 1F to BS 747, is to be laid over the rafters lapped 150mm at the joins and secured with clout nails. The underlay should extend over the fascia board and into the eaves gutter. In order to prevent water traps behind the fascia it is recommended that a strip of 6mm marine plywood is provided to support the underlay. The ply is to be laid over the rafters and under the roofing felt positioned as close as possible to the last tiling batten and secured to the fascia.

Eaves
Eaves are to be formed with standard size tiles and purpose made eave fillers must be nailed to the fascia board. Eave tiles must be laid at the same pitch as the main body of tiling and should overhang the fascia by an amount sufficient to ensure that the water discharges into the centre of the gutter.

Ridge
The ridge is to be covered with segmental ridge tiles of the same colour as the main body of tiling, unless specified otherwise, and secured using a proprietary ventilated dry ridge system having ventilation equivalent to a continuous 6mm gap.

Hips
Hips should be covered with interlay segmental ridge tiles of similar colour and texture to that of the main roof tiles. The tiling should be cut closely to the rake of the hip and the ridge tiles bedded, with solid bedding at butt joints, onto the adjacent roof tile.

A galv. hip iron, 6mm thick, should be fixed at the base of the hip tree with 2No. 2.65mm diam. screws.

The first hip tile should be shaped at the foot to the line of tiling at the eaves and the fair end filled with mortar inset with pieces of tile and neatly pointed.

The junction of the hip and ridge should be mitred using a standard three way mitre and solid bedding.

Abutments
The tiling is/to be cut closely at abutments and weathered by Code 4 lead flashing dressed down over the tiles and up the abutment a min. 150mm.

Mortar
All bedding mortar is to consist of 3 parts sharp sand to 1 part Portland cement and should be struck off to give a smooth face and pointed in one operation.

Trusses
Gangnail trusses, 35° pitch, at 400mm centres to be designed, fixed and braced in accordance with BS5268 : pt3 : 1985 and secured to wall plate with proprietary stainless steel clips.

Manufacturers details and calculations in respect of prefabricated trusses, include compound roof trusses, are to be submitted to the Local Authority Building Control Dept. for approval at least 28 days prior to fixing on site.

Truss positions and bracing shown is indicative only and is to be confirmed/superseded by truss manufacturer.

All bracing to be 100 x 25mm.

Insulation
To be Rockwool Rollbatts (k = 0.037 W/mK), 150mm laid between joists with a further layer of 80mm. laid at right angles over the top.

Ceilings
12.7mm foil backed plasterboard, fixed in accordance with manuf. instructions with all necessary noggins etc., and finish with artex/skim finish in accord with clients instructions.

Ventilation
Provide over fascia ventilation (equal to a 10mm continuous gap) to provide cross ventilation to the roof space.


Rainwater Goods
Supply and fix 103mm PVC gutters to fascia with all necessary brackets, stop ends, outlets etc.

Supply and fix 64mm PVC downpipes securely clipped to walls at 1800mm cts with all necessary offsets, swannecks, adaptors etc. and taken into 100mm diam. uptumed bend at base.


STRAPPING

Where rafters, floor joist and ceiling ties run parallel to walls they are to be strapped at 1800mm cts. Straps to be fixed to a min. 3No. rafters etc., having nogged between beforehand, and hooked into the cavity a min. 150mm.
Similar straps to be used at 1800mm cts to hold down the wall plate.

Straps to be 30 x 6mm galv. m.s.

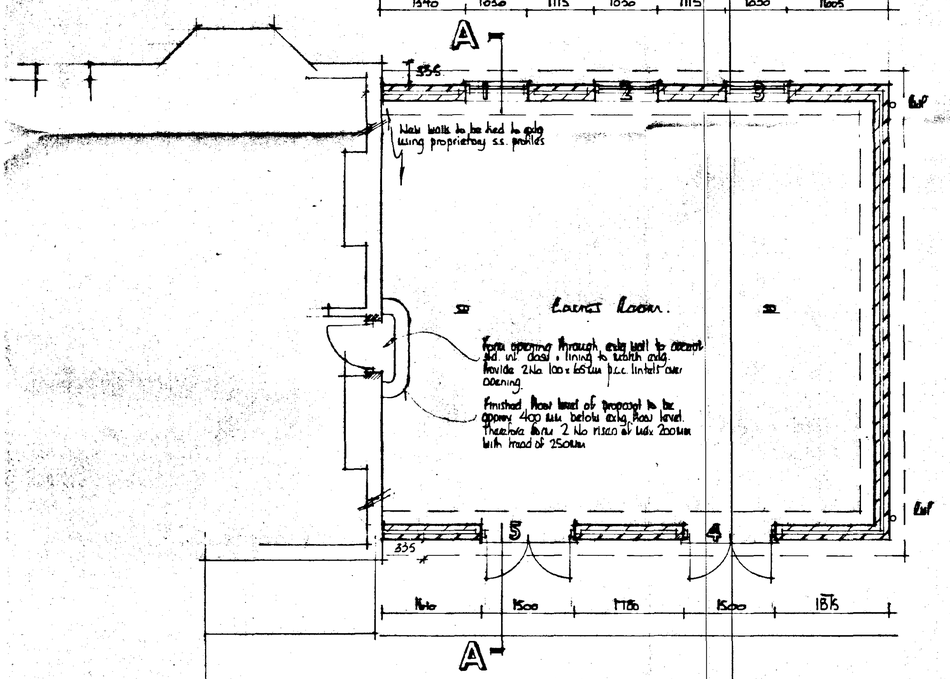

GROUND FLOOR PLAN

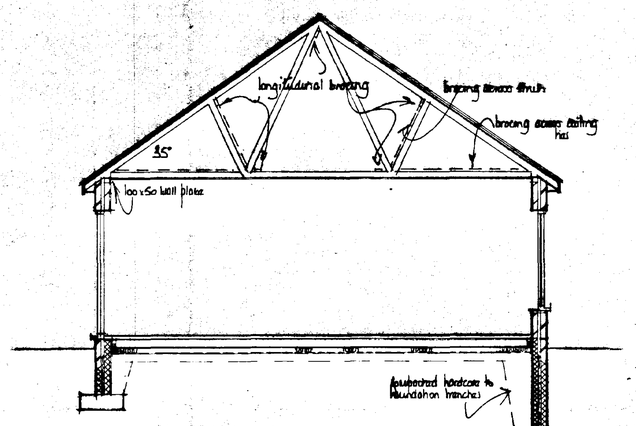

A - A

A. 23-01-2000 The N. east & S. west walls of the proposal are to be set back 335mm from the corners of the gable wall of the extg building.

A		
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding.
Lincs PE11 3JA
Tel: Spalding (0775) 767988

Client
Mr. B. Bolbrook.

Job Title
Proposed Garages Rear of 78 St Thomas' Road Spalding.

DETERMINED PLAN

Drawing Title
Plan, Section & Elevations

SOUTH HOLLAND DC HOUSING & PLANNING 31 JAN 2000 Ref. 0038/00

Scale 1:50, 1:100 & 1:250

Date Jan 2000 Drawn by DL

AMENDED PLAN
Ref.

Drg. No. Ref. A