


Proposed new Roof and Brick Work. DRG 7

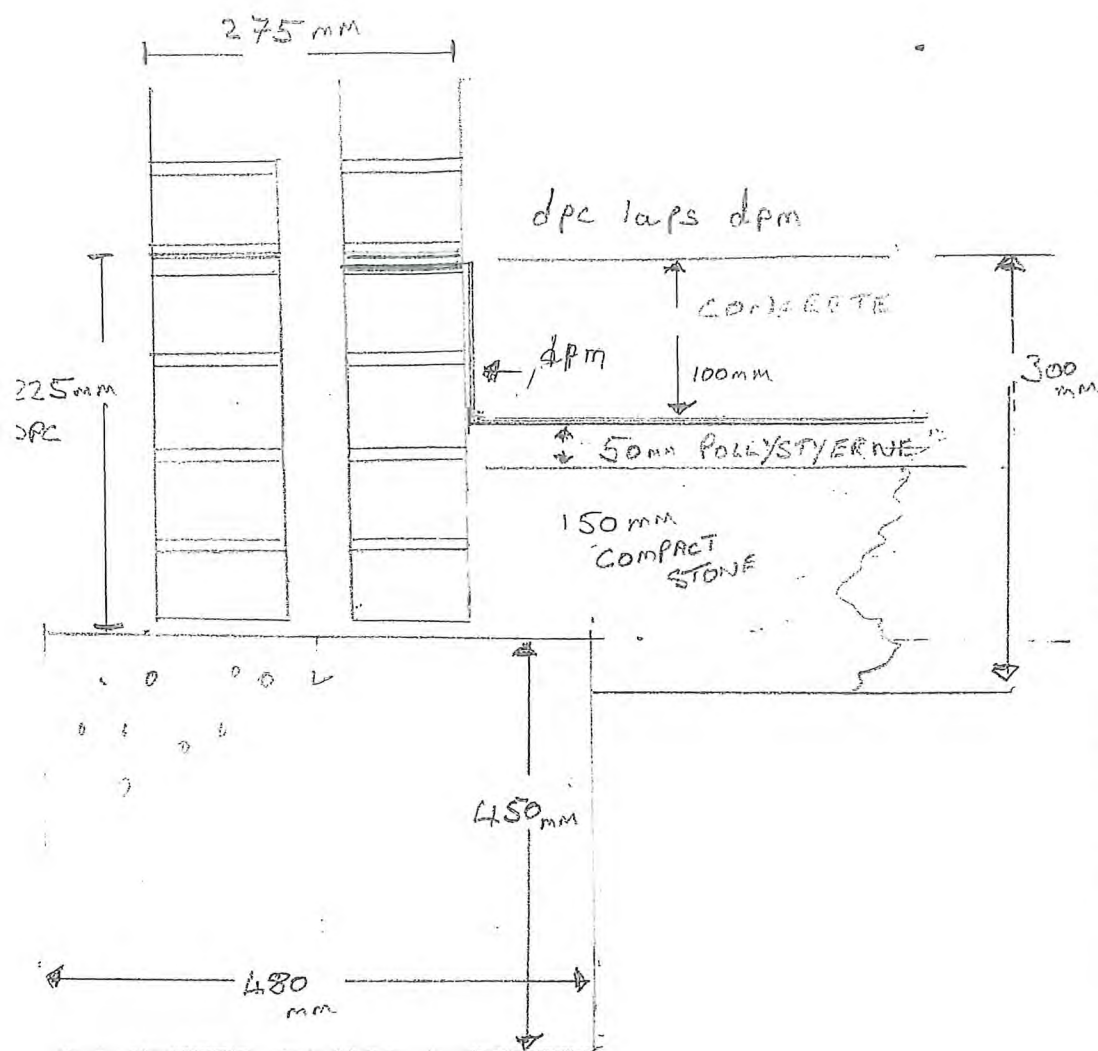

WALLS

External walls to be in cavity construction and comprising 102mm clay facing bricks with 65mm cavity filled with 65mm DRITHERM wall ties to be metal strip type in stainless steel to B.S 1243:1978


DAMP PROOF COURSE

To be in ZEDCOR Polythene and laid at 150mm above finished external ground level



REAR

1:50

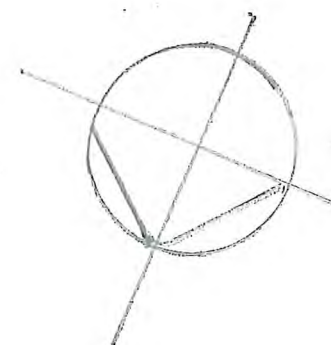

canopy to dete