NOTES


HOLES TO BE LEFT BY BUILDING CONTRACTOR

REF	No. REQD	DESCRIPTION

ALL DIMENSIONS IN mm UNLESS OTHERWISE STATED.

PARTS LIST.		
REF	No. REQD	DESCRIPTION

fencing is around whole of site

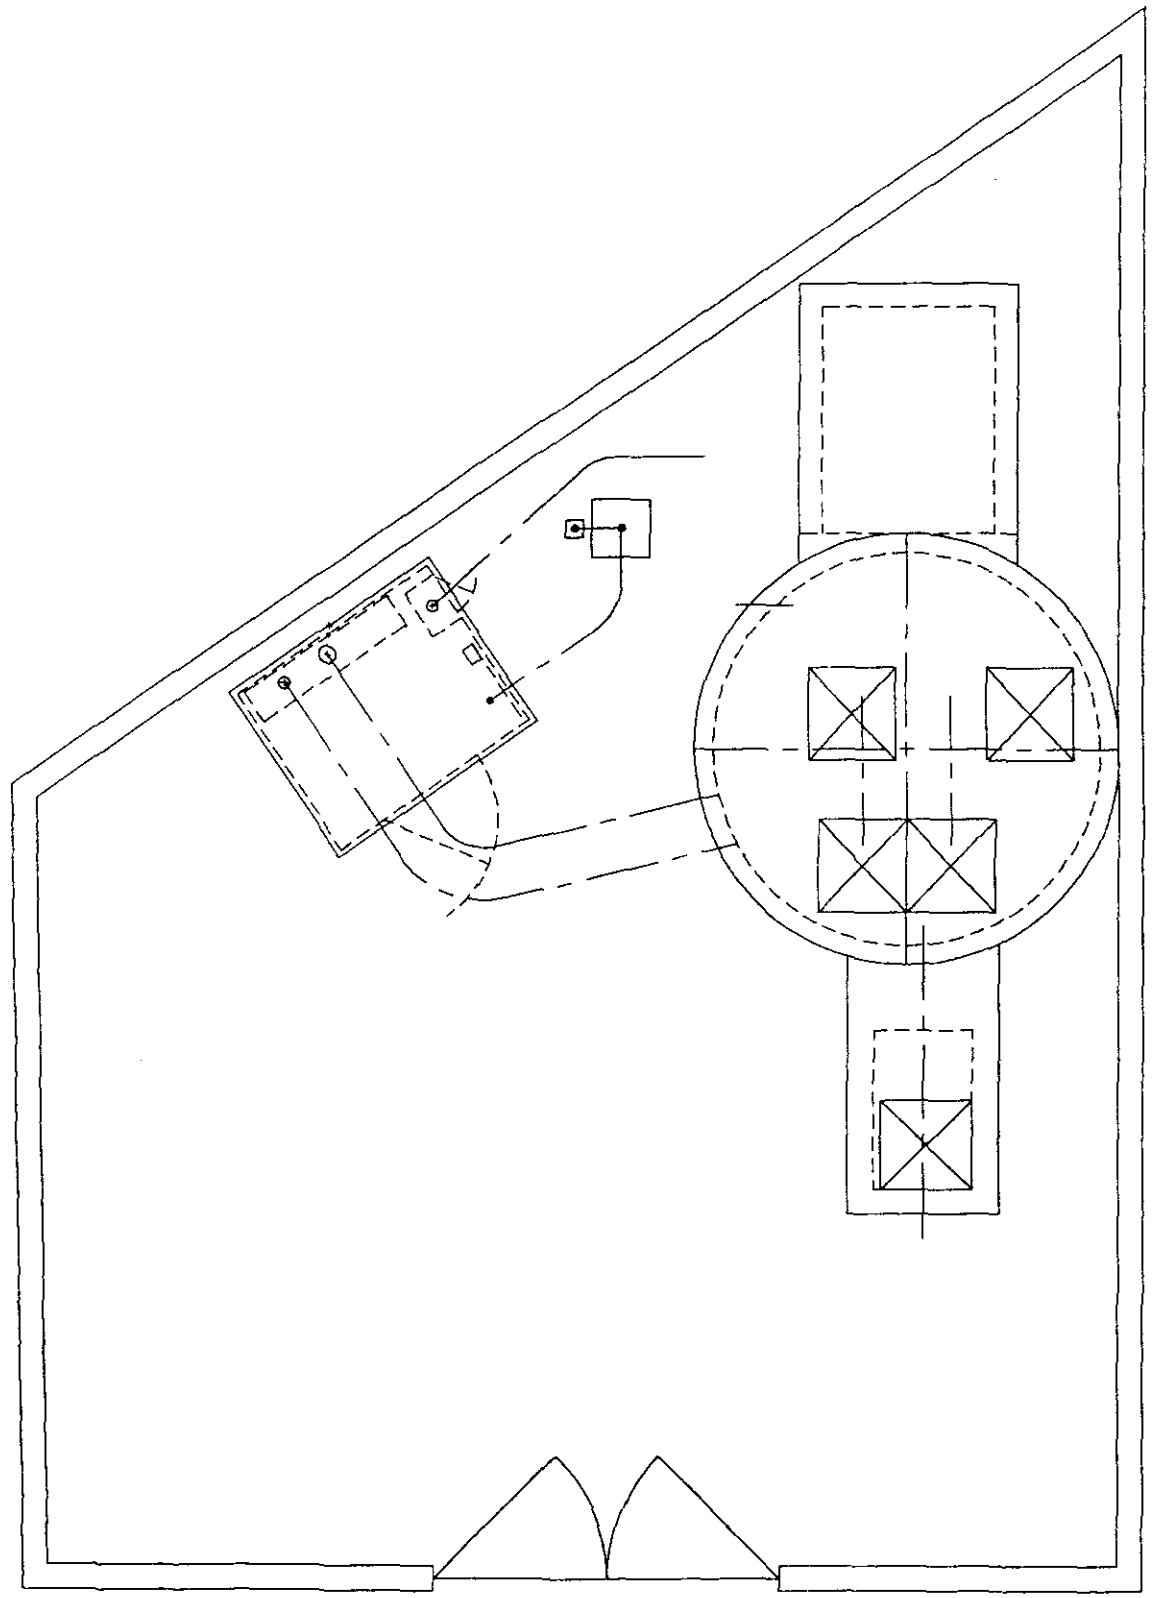

DETERMINED PLAN

22 137/99

NOTE :-
[1] = CUT TO LENGTH ON SITE.
ALL PIPEWORK IN DUCTILE IRON TO B.S. 4772
WITH NP16 FLANGES TO B.S.4504.

Rev	Amendment	By	Date

GILKES
WALLWIN PUMPS

BS 4368 : Part 1 (this item) APPROVED

GILBERT GILKES & GORDON LTD.
CLAY LANE,
OLDBURY,
WARLEY,
WEST MIDLANDS,
B69 4JF.
Tel 0121-544-2740

Consulting Engineers
-

Customer
ANGLIAN WATER SERVICES LTD

Title
REFURBISHMENT OF EXISTING PUMPING STATION FOR:-
PARK ROAD FAR P.S., SPALDING,
LINCOLNSHIRE.
SITE PLAN AT GROUND LEVEL.


Prints from this drawing are UNCONTROLLED unless otherwise stated

Drawn by	Date	Checked	Job No.
-	-		-


Scale	(Plot Ratio)	Dwg No.	Rev
-	-	P4635-1	0

SHEET 1 OF 2

ALL DIMENSIONS IN mm UNLESS OTHERWISE STATED.

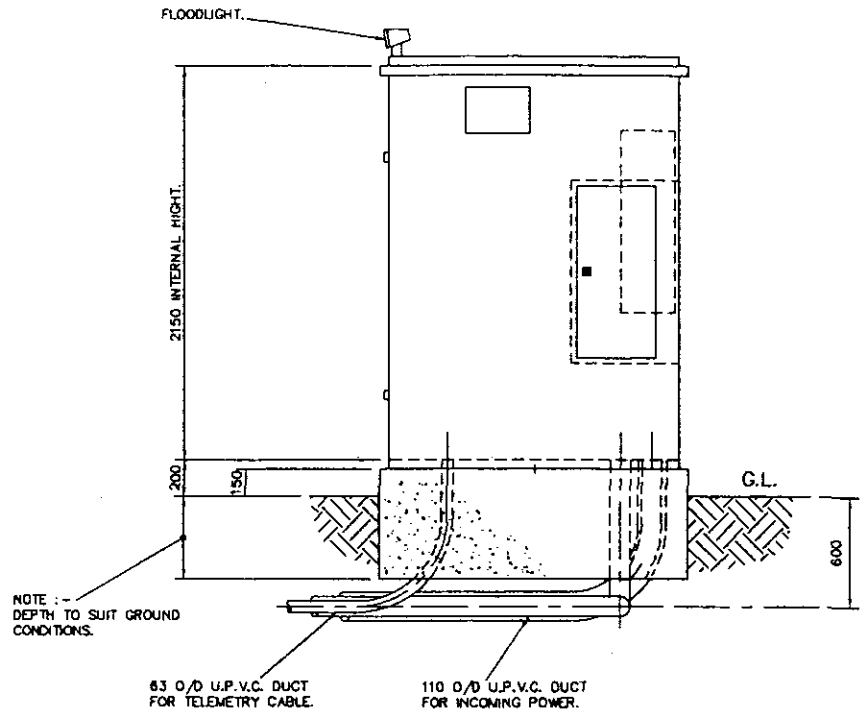


SIDE ELEVATION

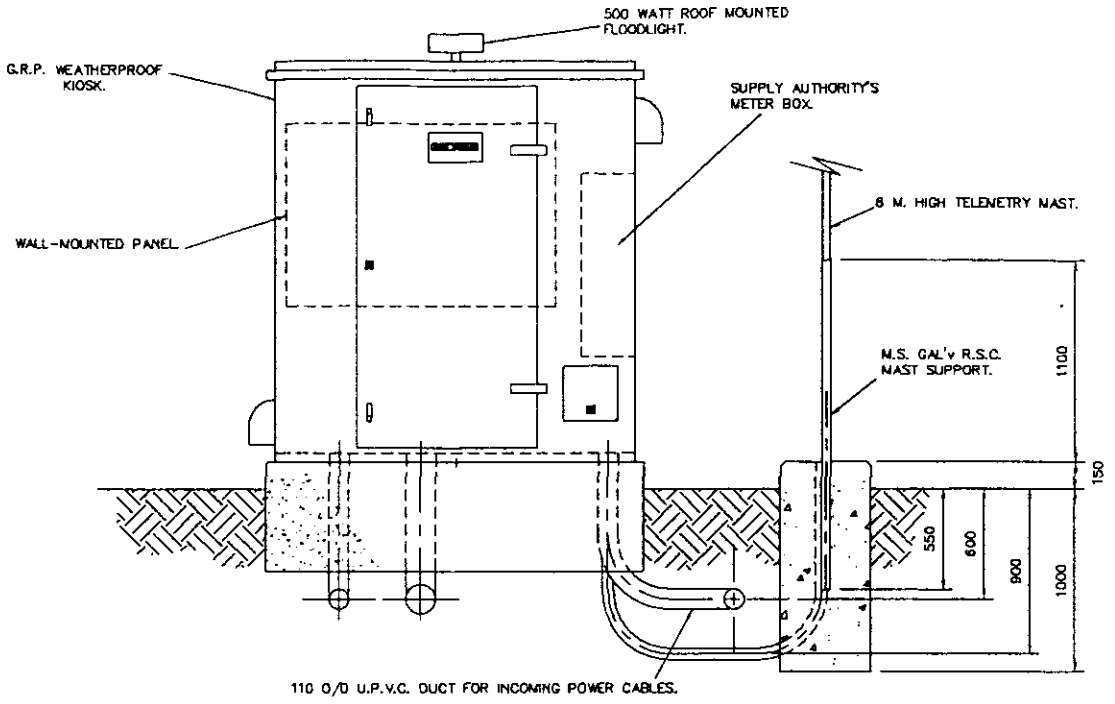


FRONT ELEVATION

NOTE :-
KIOSK TO BE BOLTED DOWN WITH 10 No M12 x 70 PARABOLTS.
KIOSK COLOUR TO BE DARK GREEN TO B.S. 4800 (COLOUR CODE 14.C.39).
TRANSDUCER CABLE TO BE KEPT A MINIMUM OF 300mm FROM ALL POWER CABLES.
TELEMETRY CABLE TO BE KEPT A MINIMUM OF 300mm FROM ALL POWER CABLES.
ALL CABLE DUCTS TO BE SEALED BOTH ENDS, AFTER THE INSTALLATION OF ALL WIRING AND CABLING IS COMPLETE, WITH EXPANDING POLYURETHANE FOAM.

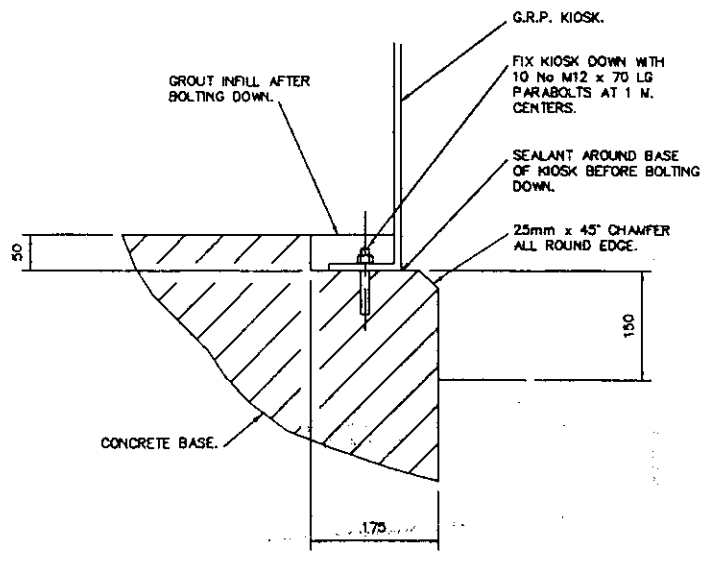

KIOSK FIXING DETAIL

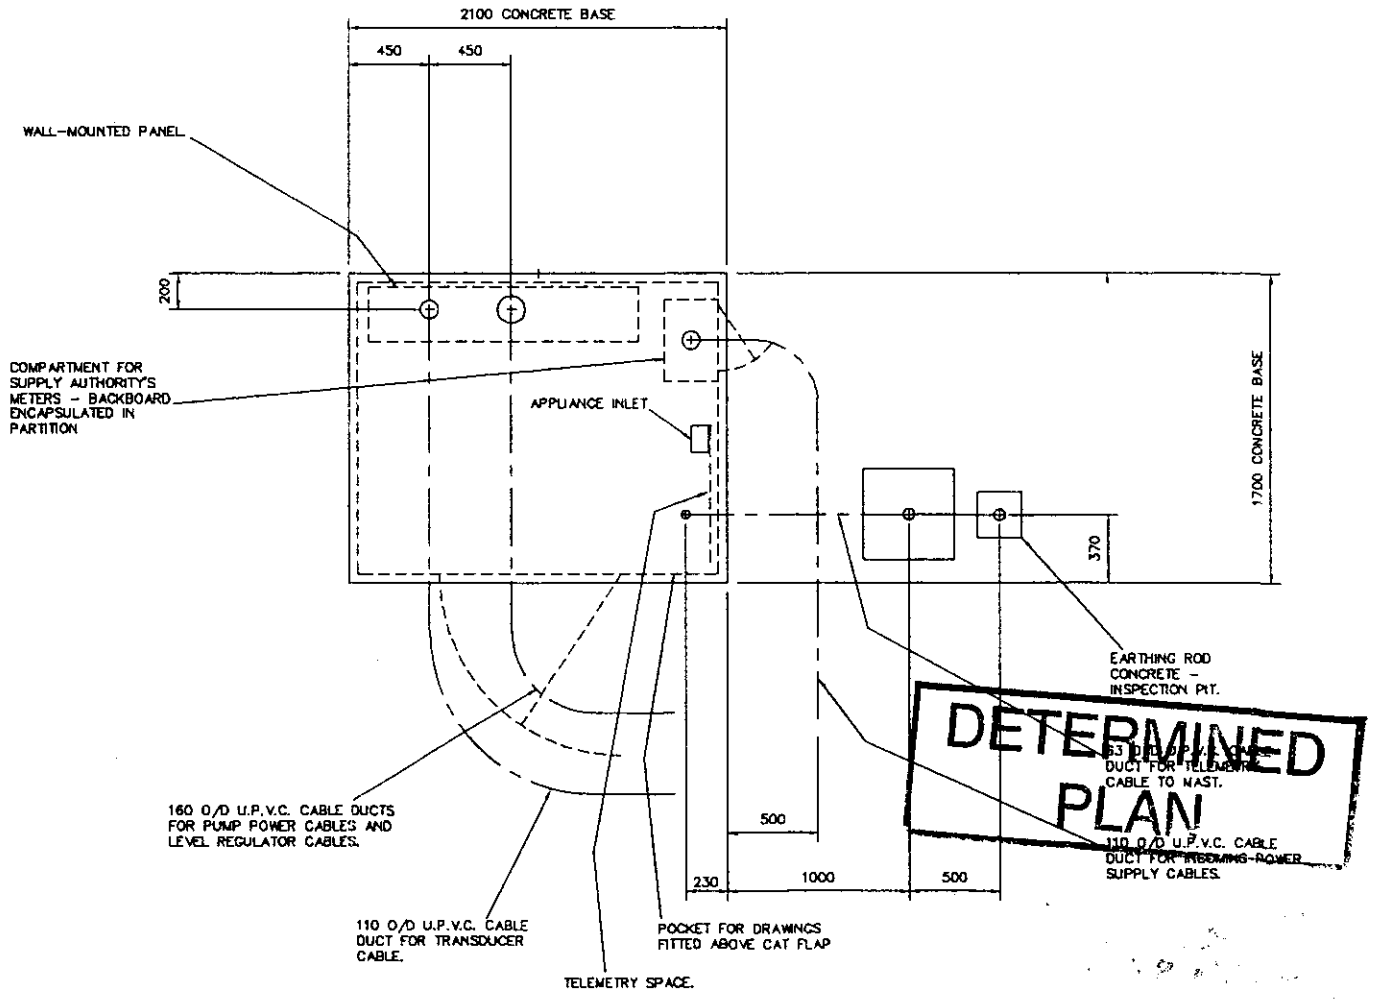

GROUND LEVEL PLAN OF KIOSK BASE.

DETERMINED PLAN

137/99

NOTES

THIS DRAWING TO BE READ IN CONJUNCTION WITH BIWATER DESIGN DRG No.8809-3D

Rev	Amendment	By	Date

GILKES

WALLWIN PUMPS

BS 5750 : Part 1 (ISO 9001) APPROVED

GILBERT GILKES & GORDON LTD.
CLAY LANE,
OLDBURY,
WARLEY,
WEST MIDLANDS,
B69 4TF. Tel 0121-544-2740

Consulting Engineers
-

Customer
ANGLIAN WATER SERVICES LTD


Title
REFURBISHMENT OF EXISTING PUMPING STATION FOR:-
PARK ROAD FAR P.S., SPALDING, LINCOLNSHIRE.
TYPICAL KIOSK BASE DETAILS.

Prints from this drawing are UNCONTROLLED unless otherwise stated

Drawn by	Date	Checked	Job No.
.	.		.

Scale	(Plot Ratio)	Drg No.	Rev
-	-	P4635-2	0

ALL DIMENSIONS IN mm UNLESS OTHERWISE STATED.

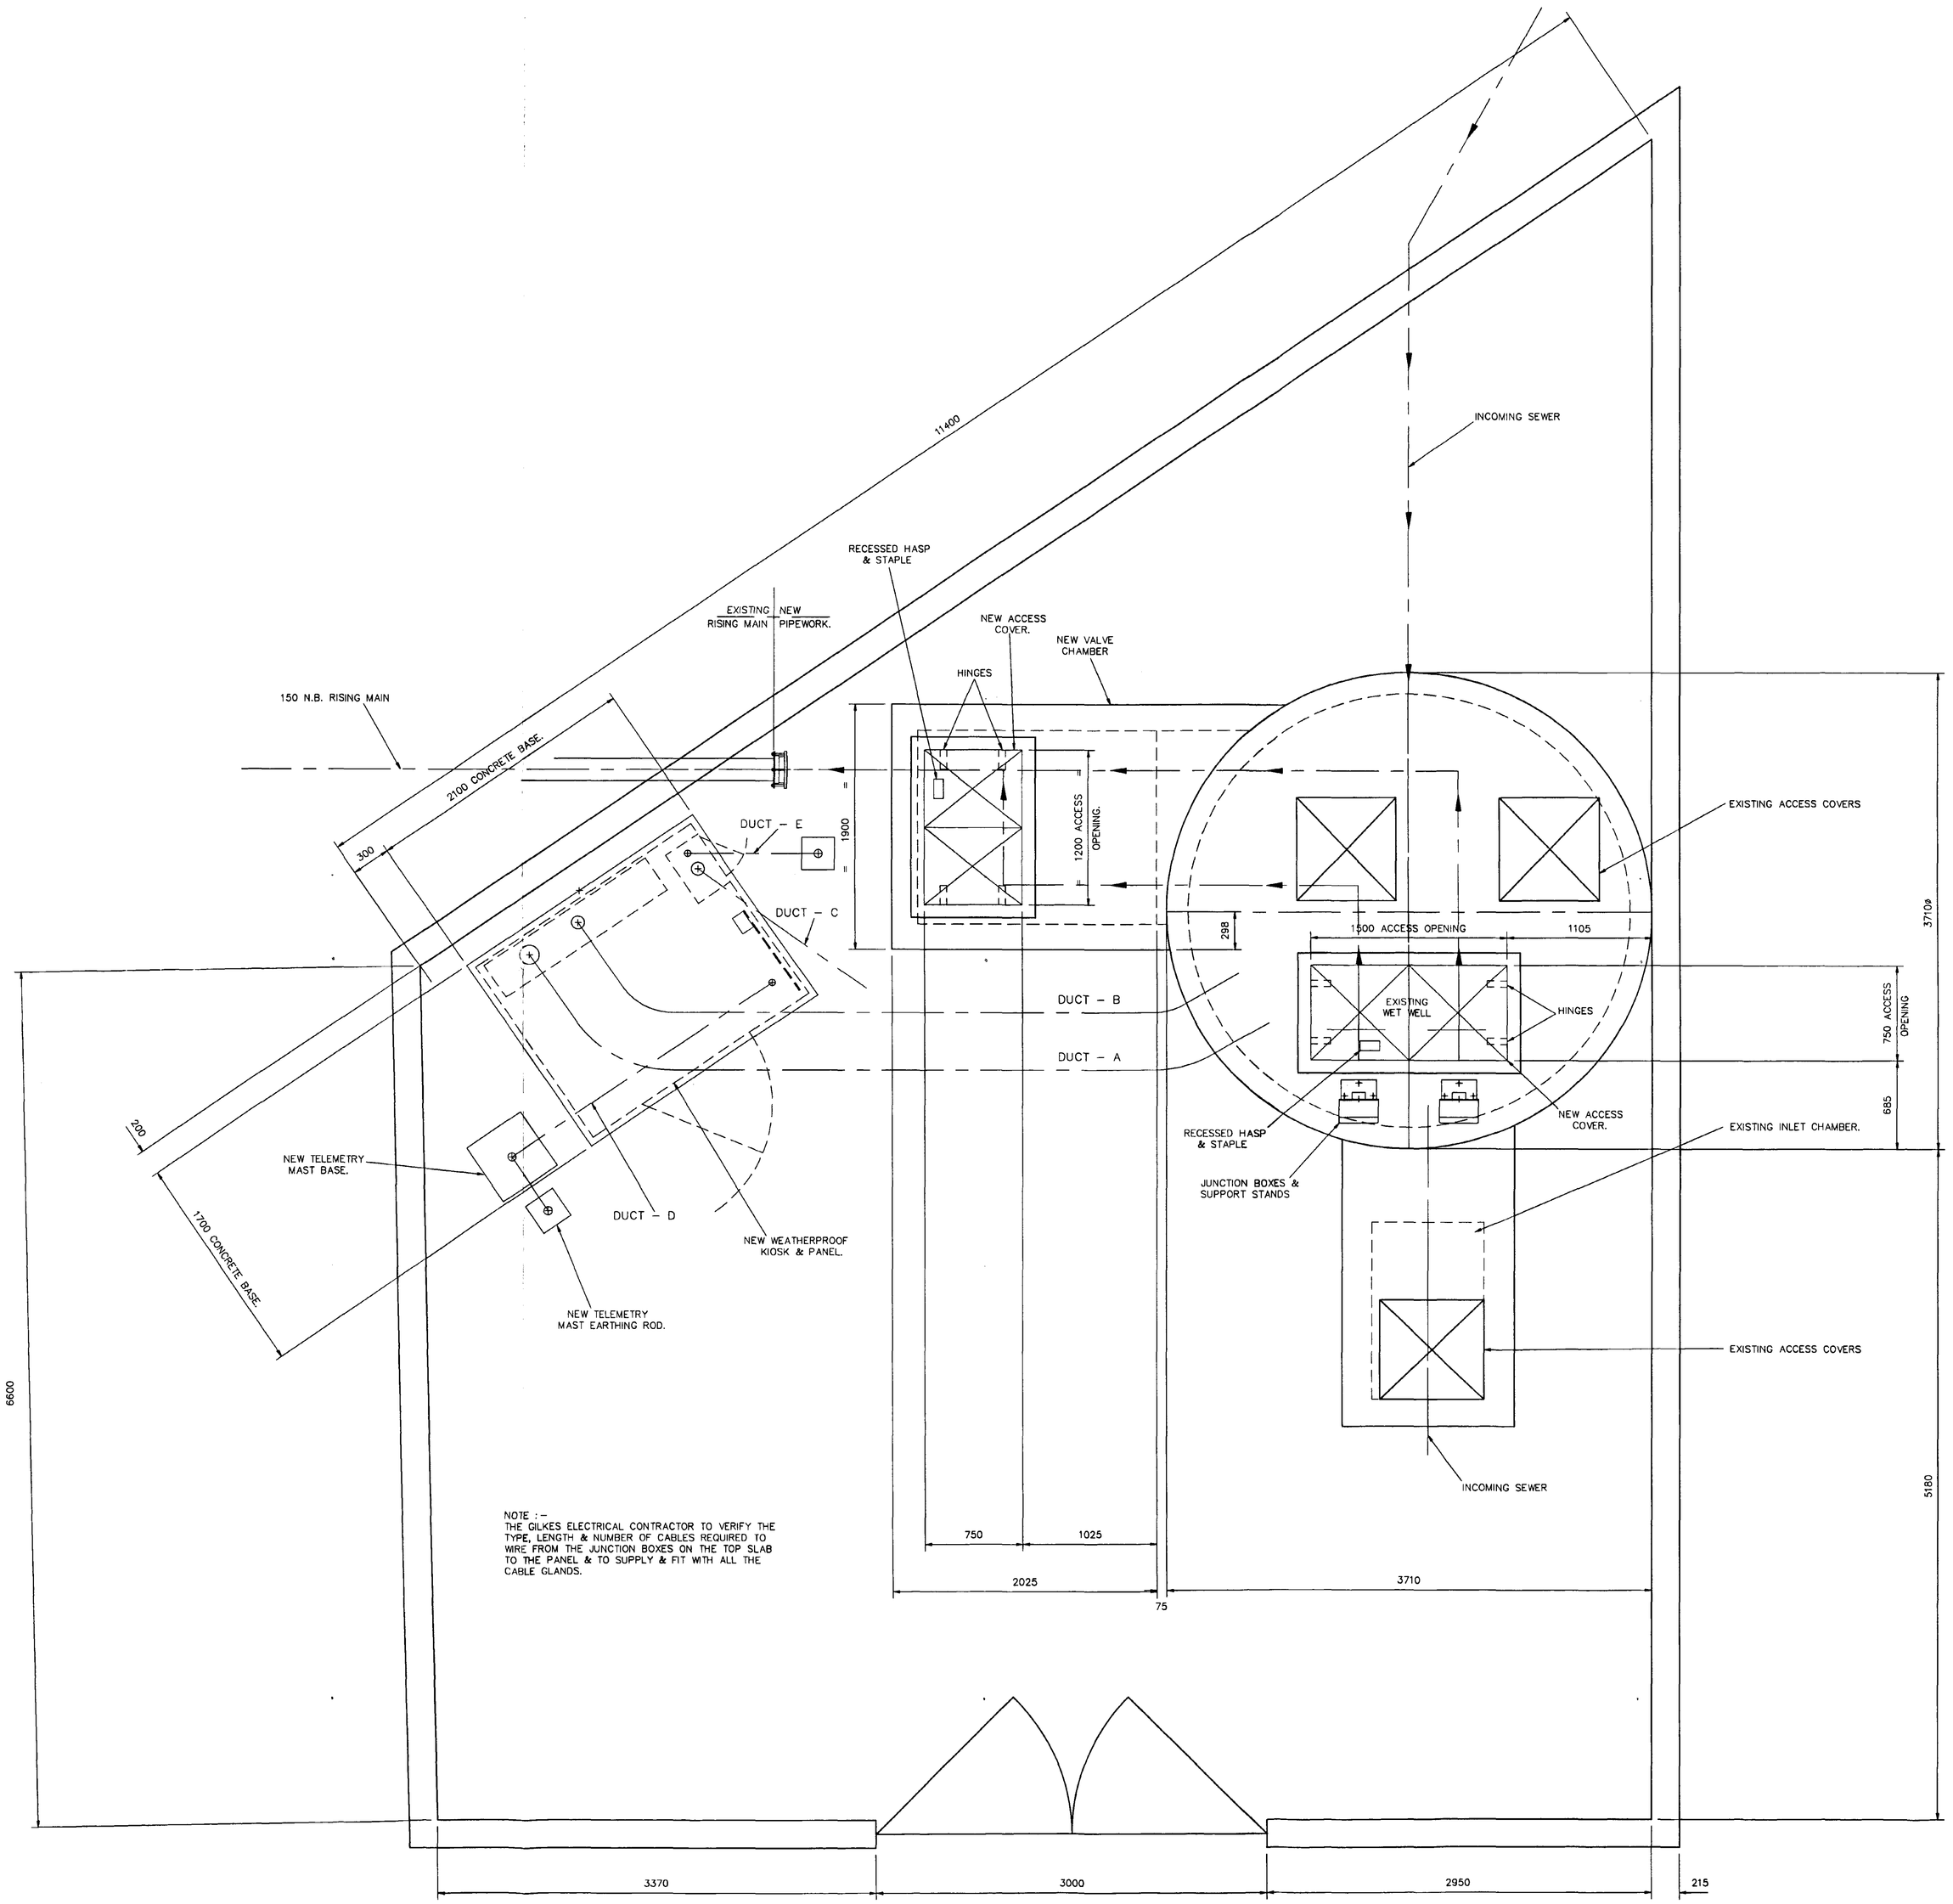

NOTE :-
THE GILKES ELECTRICAL CONTRACTOR TO VERIFY THE TYPE, LENGTH & NUMBER OF CABLES REQUIRED TO WIRE FROM THE JUNCTION BOXES ON THE TOP SLAB TO THE PANEL & TO SUPPLY & FIT WITH ALL THE CABLE GLANDS.

NOTE: -
FOR DETAILS OF PUMP & PIPEWORK REFER TO DRG No 10864-2
FOR DETAILS OF CONTROL KIOSK REFER TO DRG No 10864-3

CABLE DUCT KEY.

DUCT - A
160 O/D U.P.V.C. CABLE DUCT
FOR PUMP POWER CABLES &
LEVEL REGULATOR CABLES.

DUCT - B
110 O/D U.P.V.C. CABLE DUCT
FOR TRANSDUCER CABLE.

DUCT - C
110 O/D U.P.V.C. CABLE DUCT
FOR INCOMING POWER SUPPLY CABLES.

DUCT - D
63 O/D U.P.V.C. CABLE DUCT
FOR TELEMETRY CABLE.

DUCT - E
63 O/D U.P.V.C. CABLE DUCT
FOR EARTHING CABLE.

NORTHAMPTON ENGINEERING SERVICES

DATE	ACTION	INITIALS
BWS		AS
NH		JT
PAL		SON
SS	*	SS
PL		SW

AMENDED PLAN
Ref. A1

CONTROLLED COPY

SOUTH HOLLAND DC
HOUSING & PLANNING
16 JUL 1999
Ref:

Rev	Amendment	By	Date
A	VALVE CHAMBER REPOSITIONED. AS PER V.O.7687.	LS,HR.	06/07/99

GILKES
WALLWIN PUMPS

BS 5750 : Part 1 (ISO 9001)
APPROVED

GILBERT GILKES & GORDON LTD.
CLAY LANE,
OLDBURY,
WARLEY,
WEST MIDLANDS,
B69 4TF. Tel 0121-544-2740

Consulting Engineers
-

Customer
ANGLIAN WATER SERVICES LTD

Title
REFURBISHMENT OF EXISTING PUMPING STATION FOR:-
PARK ROAD FAR P.S. SPALDING, LINCOLNSHIRE.
SITE PLAN AT GROUND LEVEL.

Prints from this drawing are UNCONTROLLED unless otherwise stated

Drawn by	Date	Checked	Job No.
MLO	16/3/99		P4635

Scale	(Plot Ratio)	Drg No.	Rev
1:20	1:20	10864-1	A

SHEET 1 OF 2

CAD DISK REF No 38
FILE REF:- ADDWGHT.DWG