USEFUL INFORMATION

Sustainable Drainage Systems: Many existing urban drainage systems can cause problems of flooding, pollution or damage to the environment and are resilient to climate change in the long term. Therefore our preferred method of surface water disposal is through the use of Sustainable Drainage Systems (SuDS). SuDS are a range of techniques that aim to mimic the way surface water drains in natural systems within urban areas. For more information on SuDS, please visit our website at http://anglianwater.co.uk/developers/sewer-connection/suds.aspx. We also recommend that you contact the future SuDS Approving Body (SAB) for the area to discuss your application.

Water Industry Act – Key Wastewater Sections:

- Section 98: This provides you with the right to requisition a new public sewer. The new public sewer can be constructed by Anglian Water on your behalf. Alternatively, you can construct the sewer yourself under section 30 of the Anglian Water Authority Act 1977.
- Section 102: This provides you with the right to have an existing sewerage asset vested by us. It is your responsibility to bring the infrastructure to an adoptable condition ahead of the asset being vested.
- Section 104: This provides you with the right to have a design technically vetted and an agreement reached that will see us adopt your assets following their satisfactory construction and connection to the public sewer.
- Section 106: This provides you with the right to have your constructed sewer connected to the public sewer.
- Section 185: This provides you with the right to have a public sewerage asset diverted.

Details on how to make a formal application for a new sewer, new connection or diversion are available on our website at www.anglianwater.co.uk/developers/application-form or via our Developer Services team on 08457 60 66 087.

Private Sewer Transfers: Sewers and lateral drains connected to the public sewer on the 1 July 2011 transferred into Water Company ownership on the 1 October 2011. This follows the implementation of the Floods and Water Management Act (FWMA). This included sewers and lateral drains that were subject to an existing Section 104 Adoption Agreement and those that were not. There were exemptions and the main non-transferable assets were as follows:

- Surface water sewers and lateral drains that did not discharge to the public sewer, e.g. those that discharged to a watercourse.
- Foul sewers and lateral drains that discharged to a privately owned sewage treatment/collection facility.
- Pumping stations and rising mains will transfer between 1 October 2011 and 1 October 2016.

The implementation of Section 42 of the FWMA will ensure that future private sewers will not be created. It is anticipated that all new sewer applications will need to have an approved section 104 application ahead of a section 106 connection.

Encroachment: Anglian Water operates a risk based approach to development encroaching close to our wastewater infrastructure. We assess the issue of encroachment if you are planning to build within 400 metres of a Sewage Treatment Works or, within 15 metres to 100 metres of a pumping station. We have more information available on our website at http://anglianwater.co.uk/developers/ encroachment.aspx

Water Industry Act – Key Water Sections:

- Section 41: This provides you with the right to requisition a new water main to connect your site to the public water network.
- Section 45: This provides you with a right to have a connection from a building or part of a building to the public water main.
- Section 51A: This provides you with the right to provide the water main or service connection yourselves and for us to vest them into our company.
- Section 185: This provides you with the right to have a public water asset diverted. Details on how to make an application and the s185 form is available on our website at www.anglianwater.co.uk /developers/application-forms or via our Developer Services team on 08457 60 66 087.

Details on how to make a formal application for a new water main, new connection or diversion are available on our website at www.anglianwater.co.uk/developers/ application-form or via our Developer Services team on 08457 60 66 087.

If you have any other queries on your rights to requisition or connect your housing to the public water and wastewater infrastructure then please contact our developer services team at: Developer Services, Anglian Water, PO Box 495, Huntingdon, PE29 6YY or Tel: 0845 60 66 087 or Email: developerservices@anglianwater.co.uk

Self Lay of Water Mains: A list of accredited Self Lay Organisations can be found at www.lloydsregister.co.uk/schemes/WIRS/providers-list.aspx.

Water pressure and flow rate: The water pressure and consistency that we must meet for your site is laid out in the Water Industry Act (1991). This states that we must supply a flow rate of 9 litres per second at a pressure of 10 metres of head to the external stop tap. If your water pressure requirements exceed this then you will need to provide and maintain any booster requirements to the development site.

Locating our assets: Maps detailing the location of our water and wastewater infrastructure including both underground assets and above ground assets such as pumping stations and treatment works are available from www.digdat.co.uk . All requests from members of the public or non-statutory bodies for maps showing the location of our assets will be subject to an appropriate administrative charge. We have more information on our website at: www.anglianwater.co.uk/developers/our-assets/

Summary of charges: A summary of this year's water and wastewater connection and infrastructure charges can be found at www.anglianwater.co.uk/developers /charges/


Disclaimer: The information provided within this report is based on the best data currently recorded, recorded within the last 12 months or provided by a third party. The position must be regarded as approximate. If there is further development in the area or for other reasons the position may change.

The accuracy of this report is therefore not guaranteed and does not obviate the need to make additional appropriate searches, inspections and enquiries. You are advised therefore to renew your enquiry should there be a delay in submitting your application for water supply/sewer connection to re-confirm the situation.

Any cost calculations provided within the report are estimated only and may be subject to change.

No liability whatsoever including liability for negligence is accepted by Anglian Water Services Limited for any error or inaccuracy or omission including the failure to accurately record or record at all, the location of any water main, discharge pipe, sewer, or drain or disposal main or any item of apparatus.

Contacting us: If you have any comments or suggestions based on the information provided in this report then please feel free to contact me on 01733 414690.

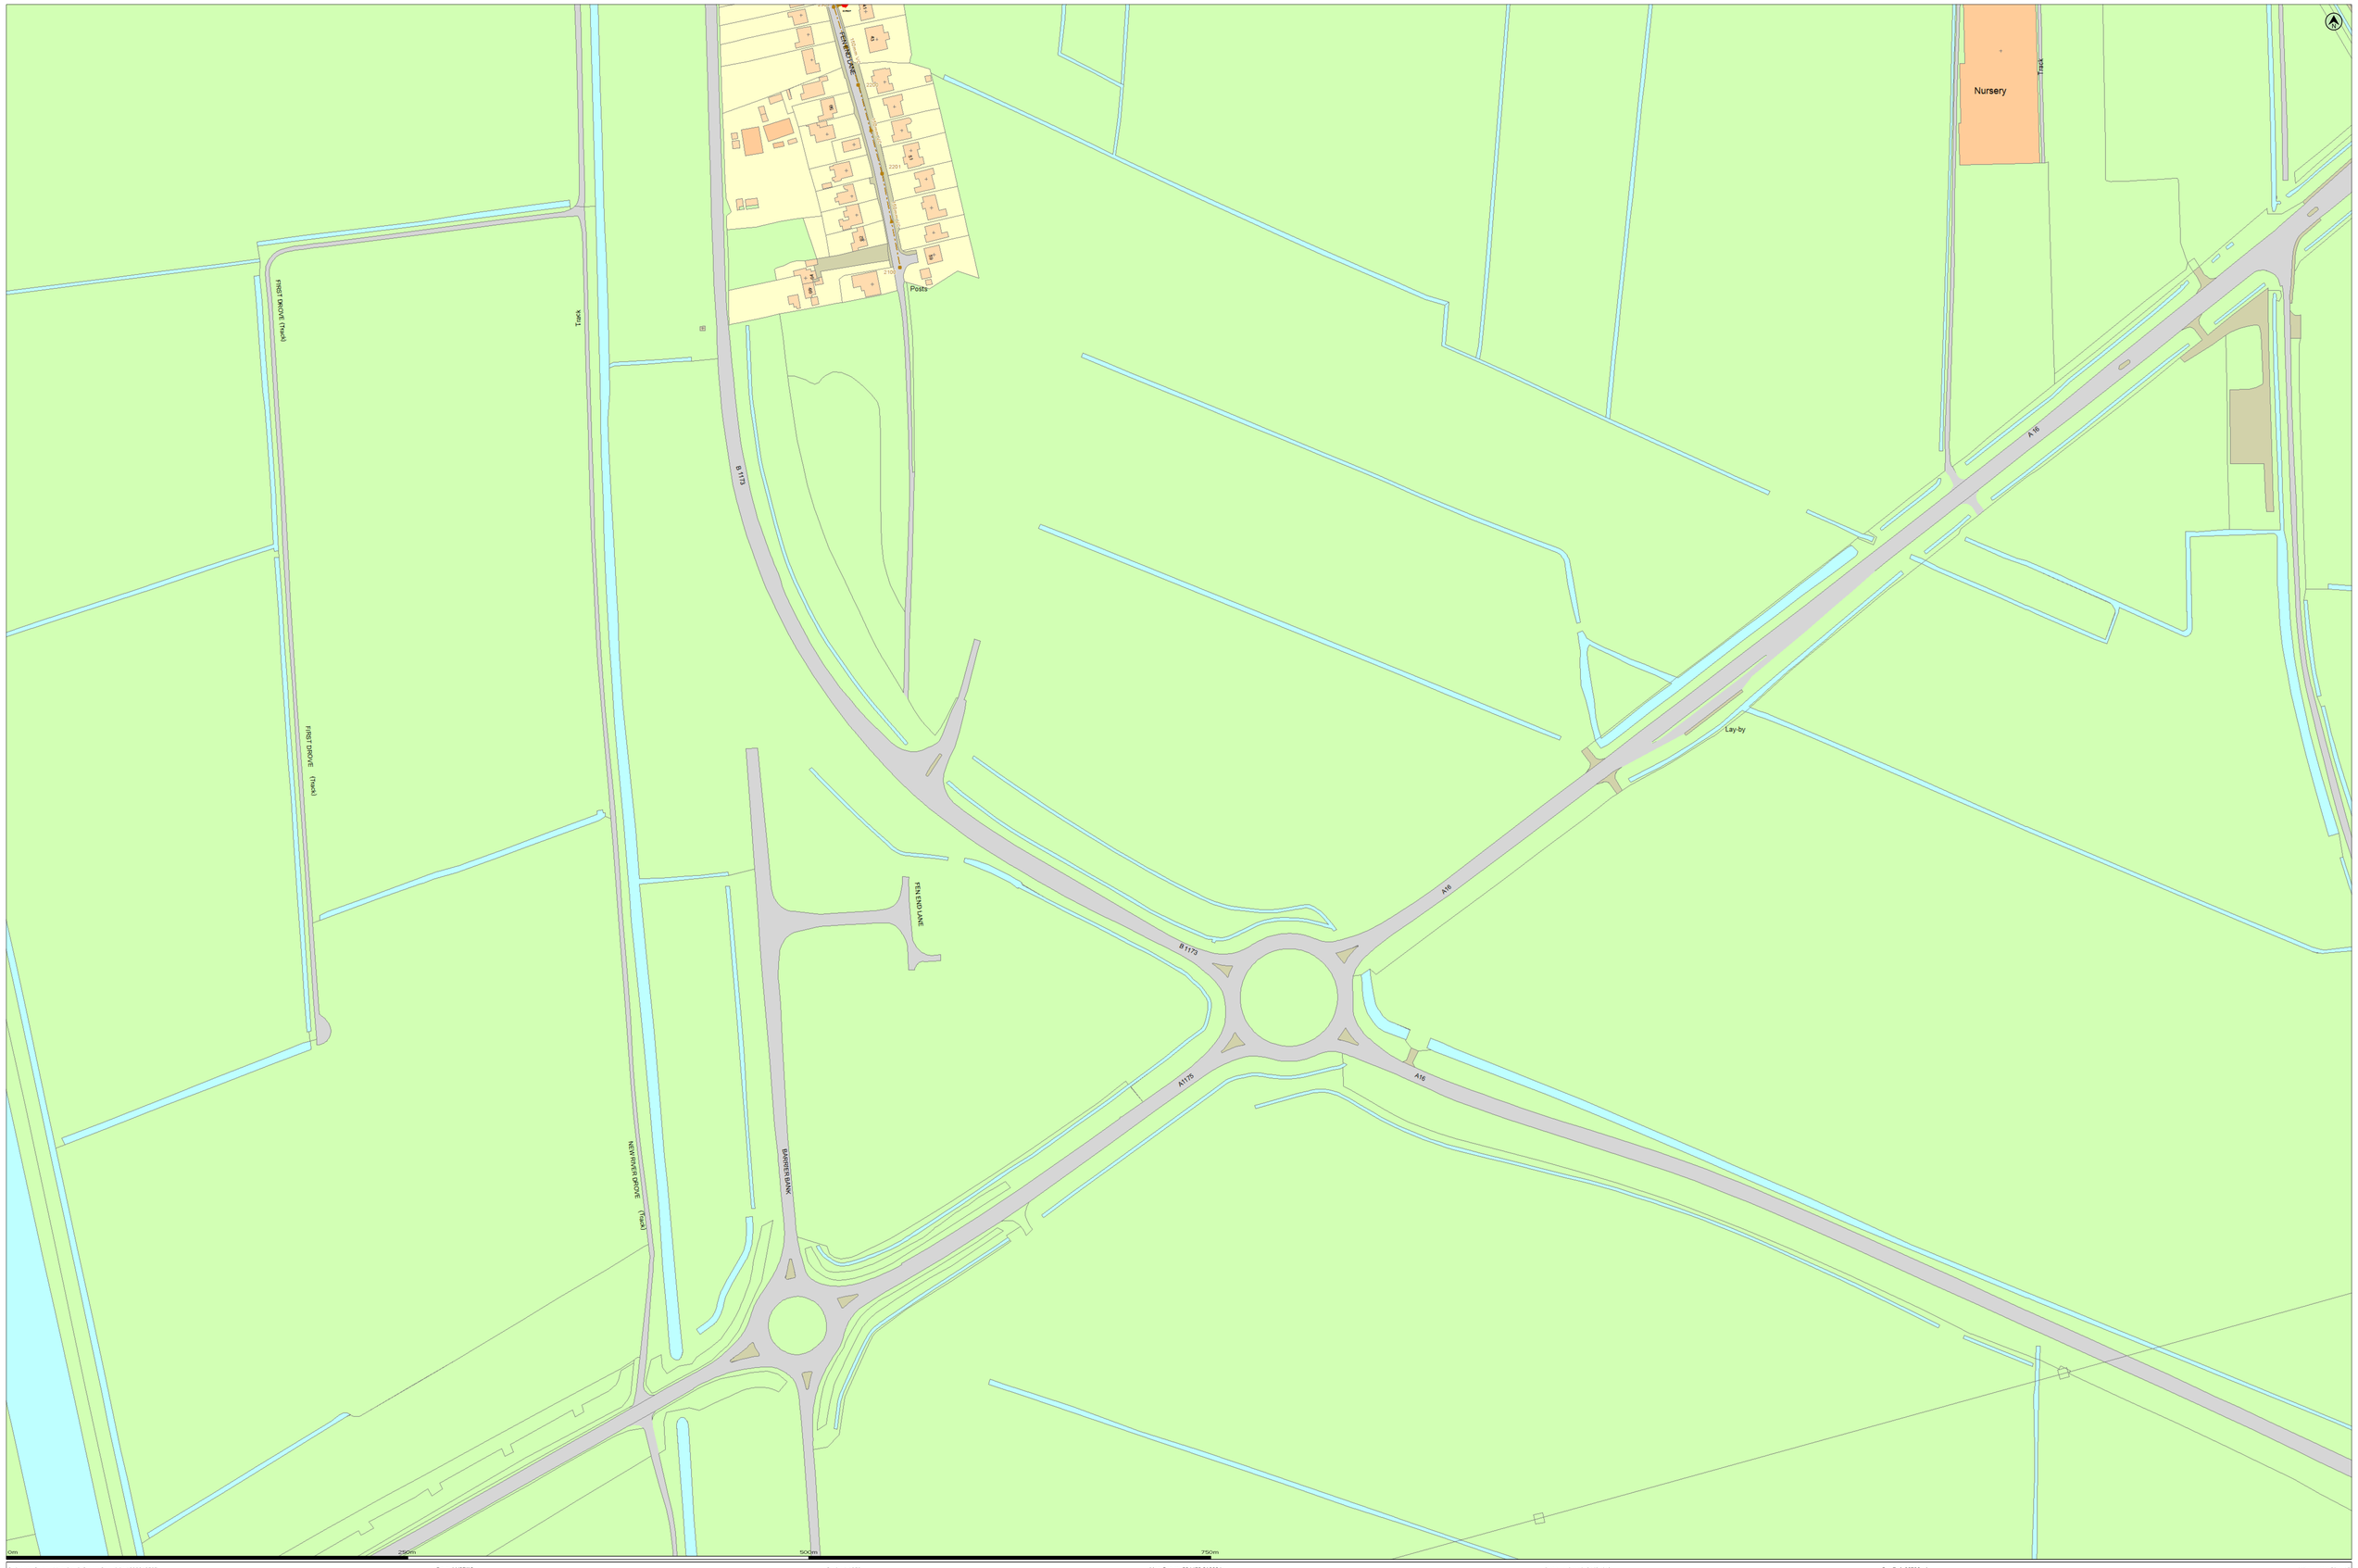

Ordinance Survey Mapping © Crown Copyright 10000818507

Date: 11/07/13

Scale: 1:1250

Map Centre: 524472,319824

Data updated: 01/04/13

Our Ref: 66786 - 1

Wastewater Plan A0


This plan is provided by Anglian Water pursuant its obligations under the Water Industry Act 1991 sections 198 or 199. It must be used in conjunction with any search results attached. The information on this plan is based on data currently recorded but position must be regarded as approximate. Service pipes, private sewers and drains are generally not shown. Users of this map are strongly advised to commission their own survey of the area shown on the plan before carrying out any works. The actual position of all apparatus MUST be established by trial holes. No liability whatsoever, including liability for negligence, is accepted by Anglian Water for any error or inaccuracy or omission, including the failure to accurately record, or record at all, the location of any water main, discharge pipe, sewer or disposal main or any item of apparatus. This information is valid for the date printed. The plan is produced by Anglian Water Services Limited from Ordnance Survey © Crown Copyright, 100018507. This map is to be used for the purposes of viewing the location of Anglian Water plant only. Any other uses of the map data or further copies is not permitted. This notice is not intended to exclude or restrict liability for death or personal injury resulting from negligence.

- Foul Sewer
- Surface Sewer
- Combined Sewer
- Final Effluent
- Rising Main (Colour denotes effluent type)
- Foreign Sewer (Colour denotes effluent type)
- Decommissioned Sewer (Colour denotes effluent type)
- Outfall (Colour denotes effluent type)
- Inlet (Colour denotes effluent type)
- Manhole (Colour denotes effluent type)
- Sewage Treatment Works
- Pumping Station

waynewalker@arpassociates.co.uk

Barrier Bank

anglianwater

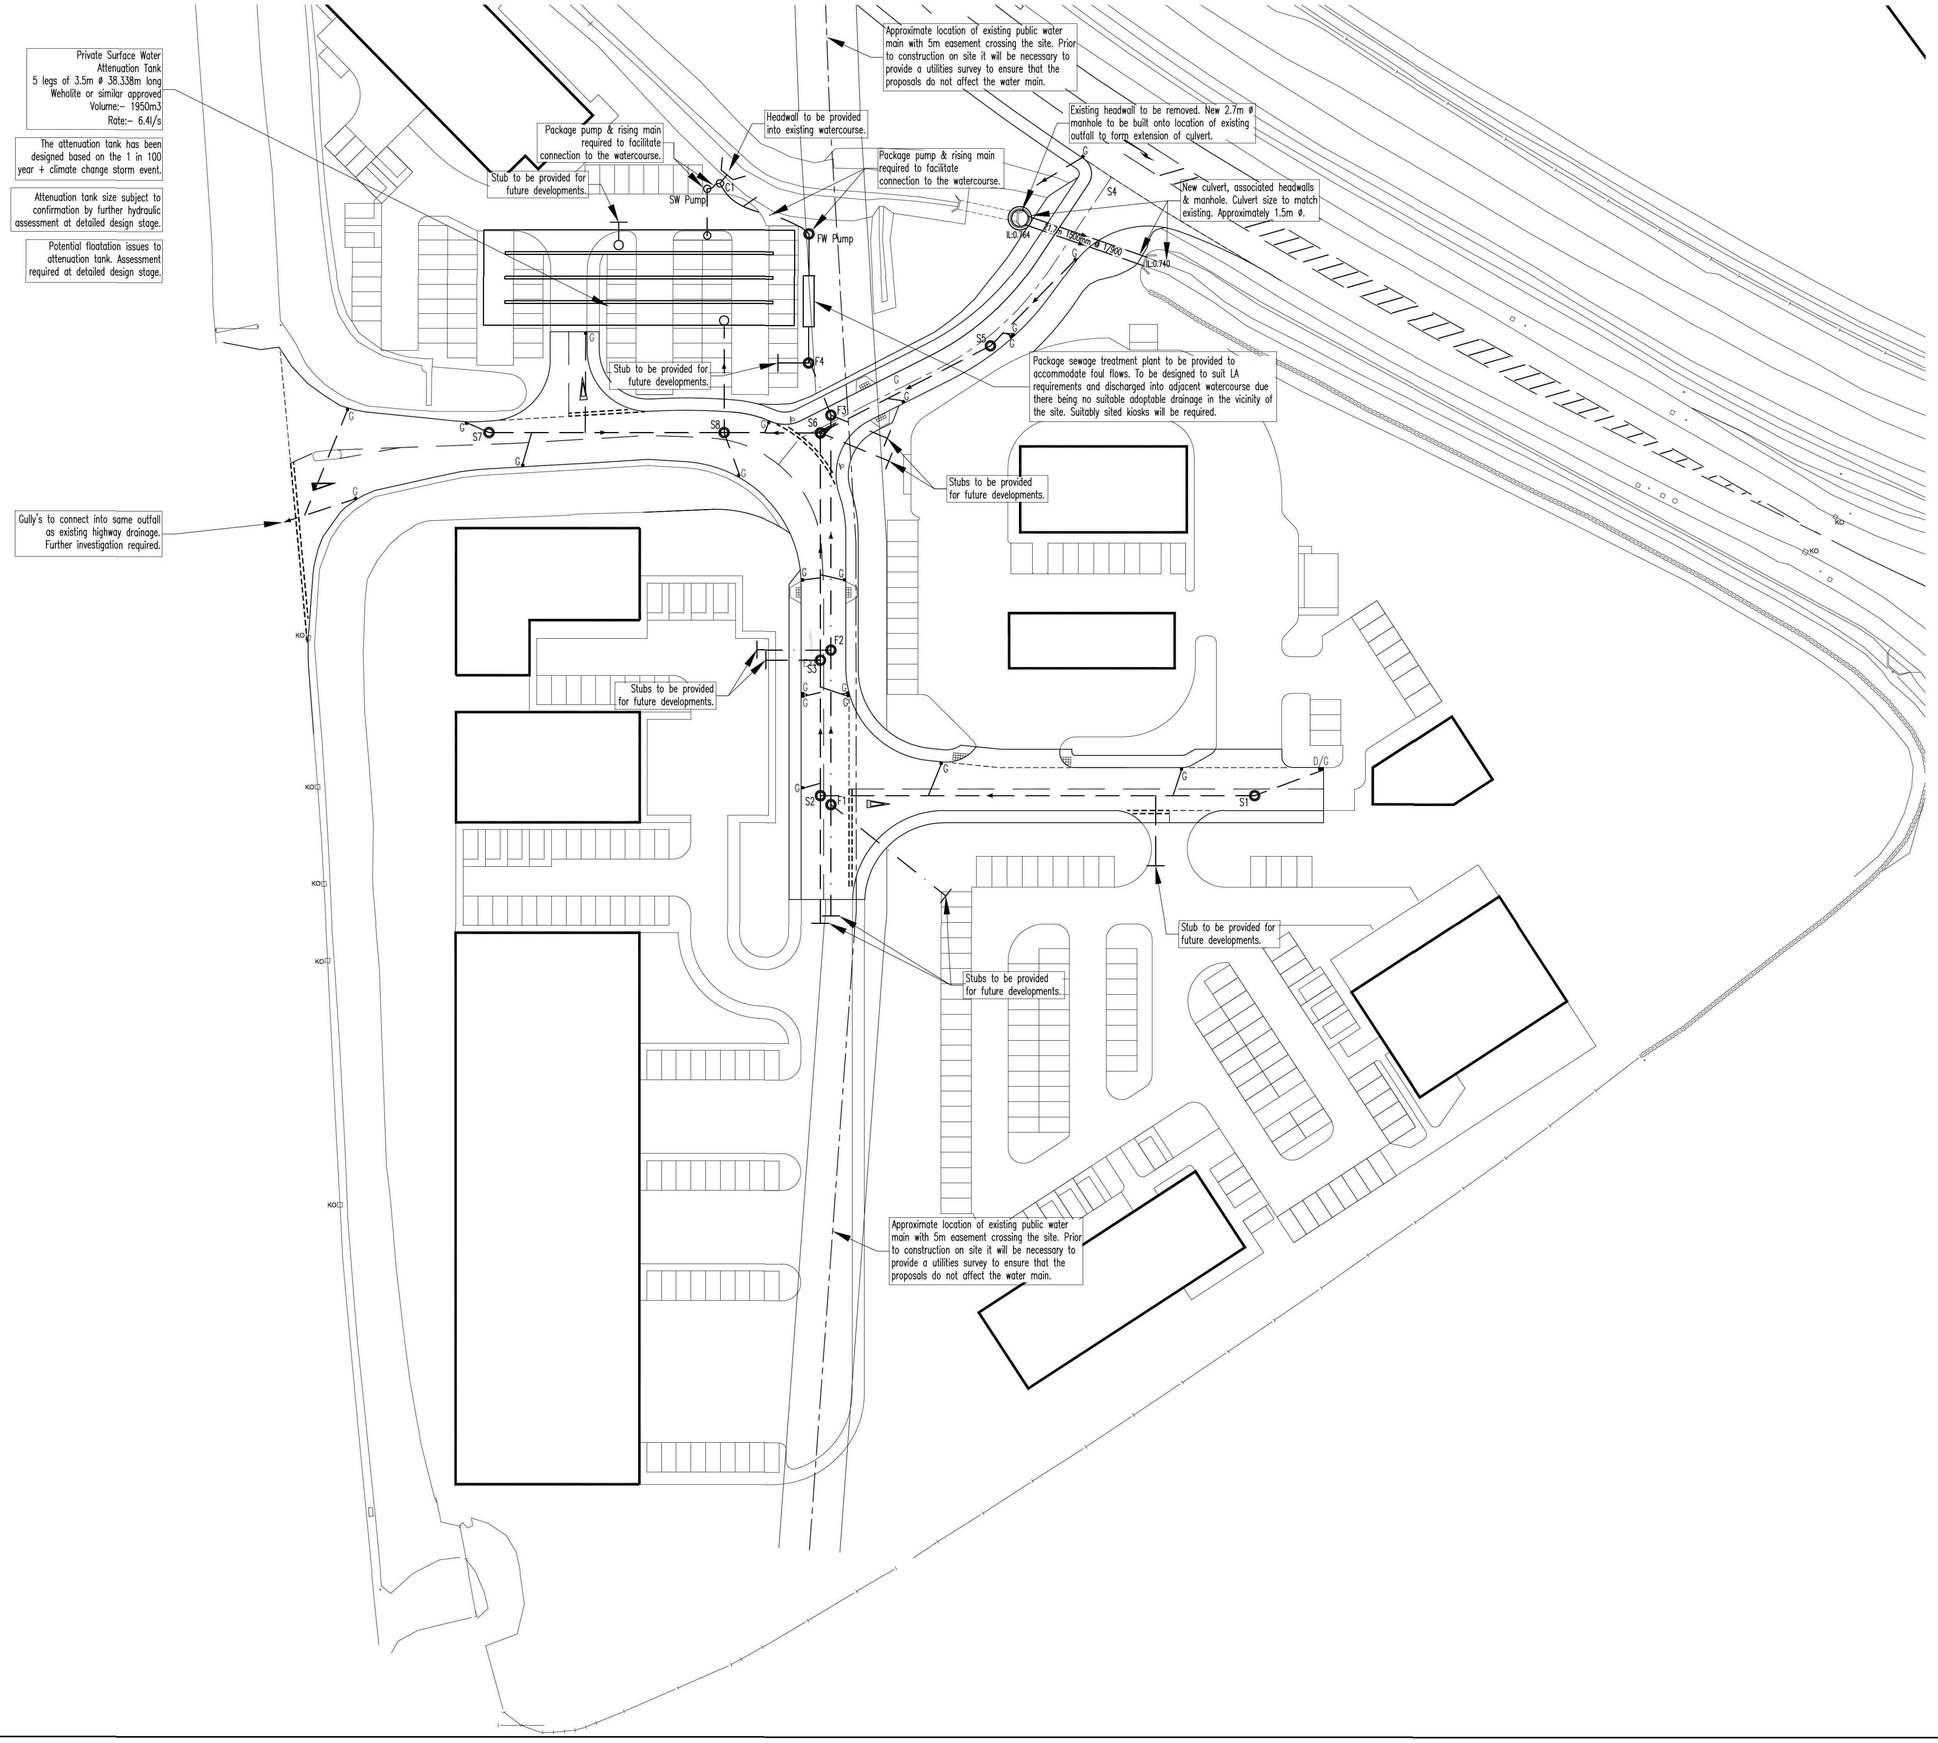

N O T E S

K E Y

- Surface Water Manhole
- Surface Water Sewer
- Foul Water Manhole
- Foul Water Sewer
- G Gully

Notes

– The drainage design shown on this layout is approximate and subject to change at detailed design stage.

– The construction of the headwalls will require consent from South Holland IDB & Environment Agency.

A permit is required from the Environment Agency/IDB to allow a connection to the watercourse from the treatment plant. There is no guarantee that this will be accepted.

Bypass separators will be required in accordance with the Environment Agency Document PPG3 to all individual plots.

SUBJECT TO THE APPROVAL OF ALL RELEVANT AUTHORITIES

Rev	By	Date	Revision	Chk
C	WMW	31.01.14	New architects layout added	ARP
B	WMW	08.01.14	New architects layout added	ARP
A	WMW	23.12.13	Foul drainage updated	ARP
/	WMW	19.09.13	Issued for approval	ARP

ARP ASSOCIATES
CHARTERED CONSULTING ENGINEERS
Northwest House • 5/6 Northwest Business Park • Servia Hill • Leeds LS6 2QH
Telephone: 0113 2458498 • Fax: 0113 2443864 • E-Mail: leeds@arpassociates.co.uk

TITLE
INDICATIVE DRAINAGE STRATEGY (SOUTHERN SITE)

PROJECT
BARRIER BANK, SPALDING
LINCOLNSHIRE

CLIENT
ASHLEY KING
DEVELOPMENT LTD

Scale	Date	Drawn / Chk.
1:500 @ A1	AUG 13	WMW / ARP

Drg. No. 800/235/05–01 Rev C

APPENDIX D

ENVIRONMENT AGENCY CONSULTATION

Flood map for planning

Your reference	Location (easting/northing)	Created
2176/01	**524273/319568**	**30 Mar 2021 22:10**

Your selected location is in flood zone 1, an area with a low probability of flooding.

This means:


- you don't need to do a flood risk assessment if your development is smaller than 1 hectare and not affected by other sources of flooding
- you may need to do a flood risk assessment if your development is larger than 1 hectare or affected by other sources of flooding or in an area with critical drainage problems

Notes

The flood map for planning shows river and sea flooding data only. It doesn’t include other sources of flooding. It is for use in development planning and flood risk assessments.

This information relates to the selected location and is not specific to any property within it. The map is updated regularly and is correct at the time of printing.

The Open Government Licence sets out the terms and conditions for using government data.
https://www.nationalarchives.gov.uk/doc/open-government-licence/version/3/

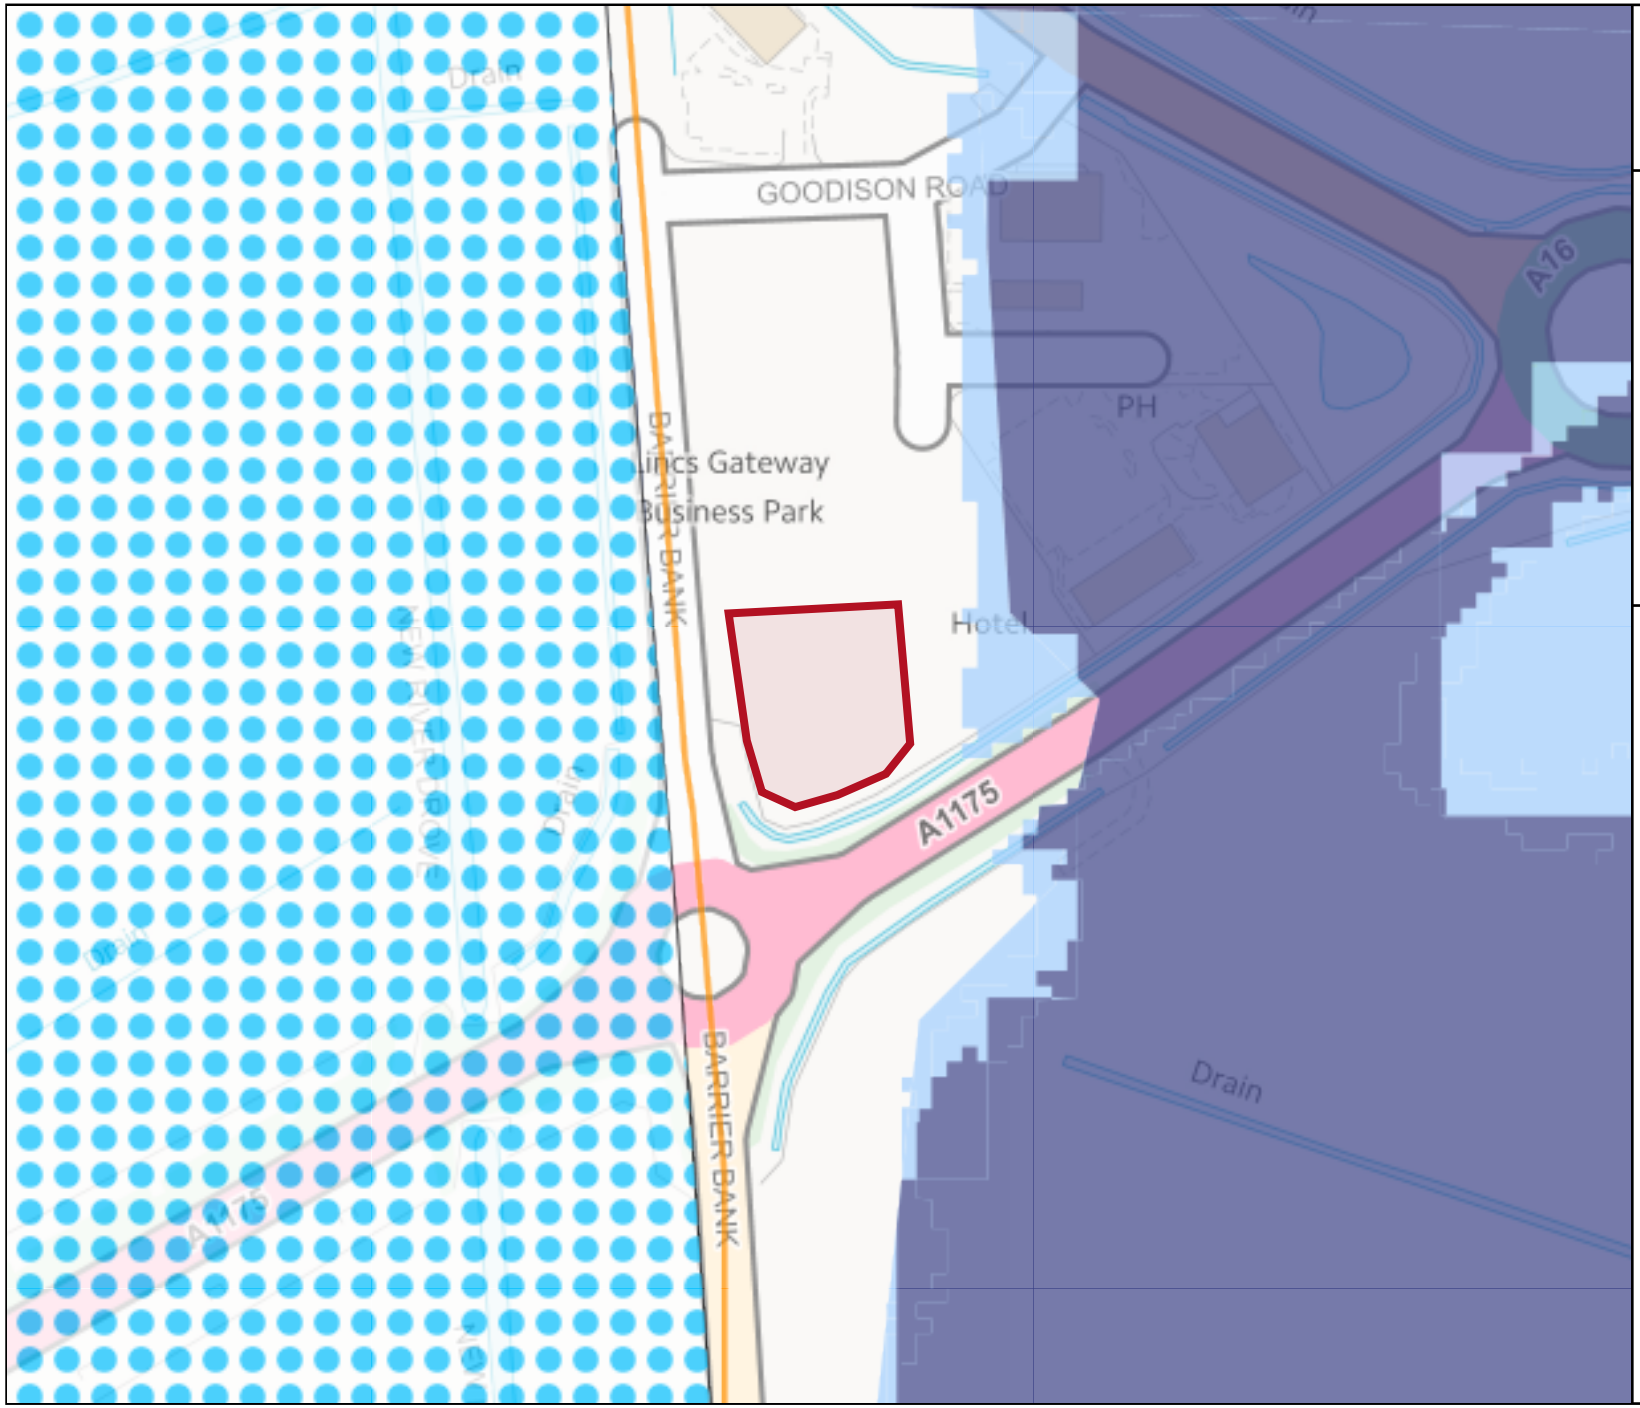

Environment Agency

Flood map for planning

Your reference
2176/01

Location (easting/northing)
524273/319568

Scale
1:2500

Created
30 Mar 2021 22:10

- Selected area
- Flood zone 3
- Flood zone 3: areas benefitting from flood defences
- Flood zone 2
- Flood zone 1
- Flood defence
- Main river
- Flood storage area

0 20 40 60m


© Environment Agency copyright and / or database rights 2018. All rights reserved. © Crown Copyright and database right 2018. Ordnance Survey licence number 100024198.

Flood risk

Extent of flooding

Location

Enter a place or postcode

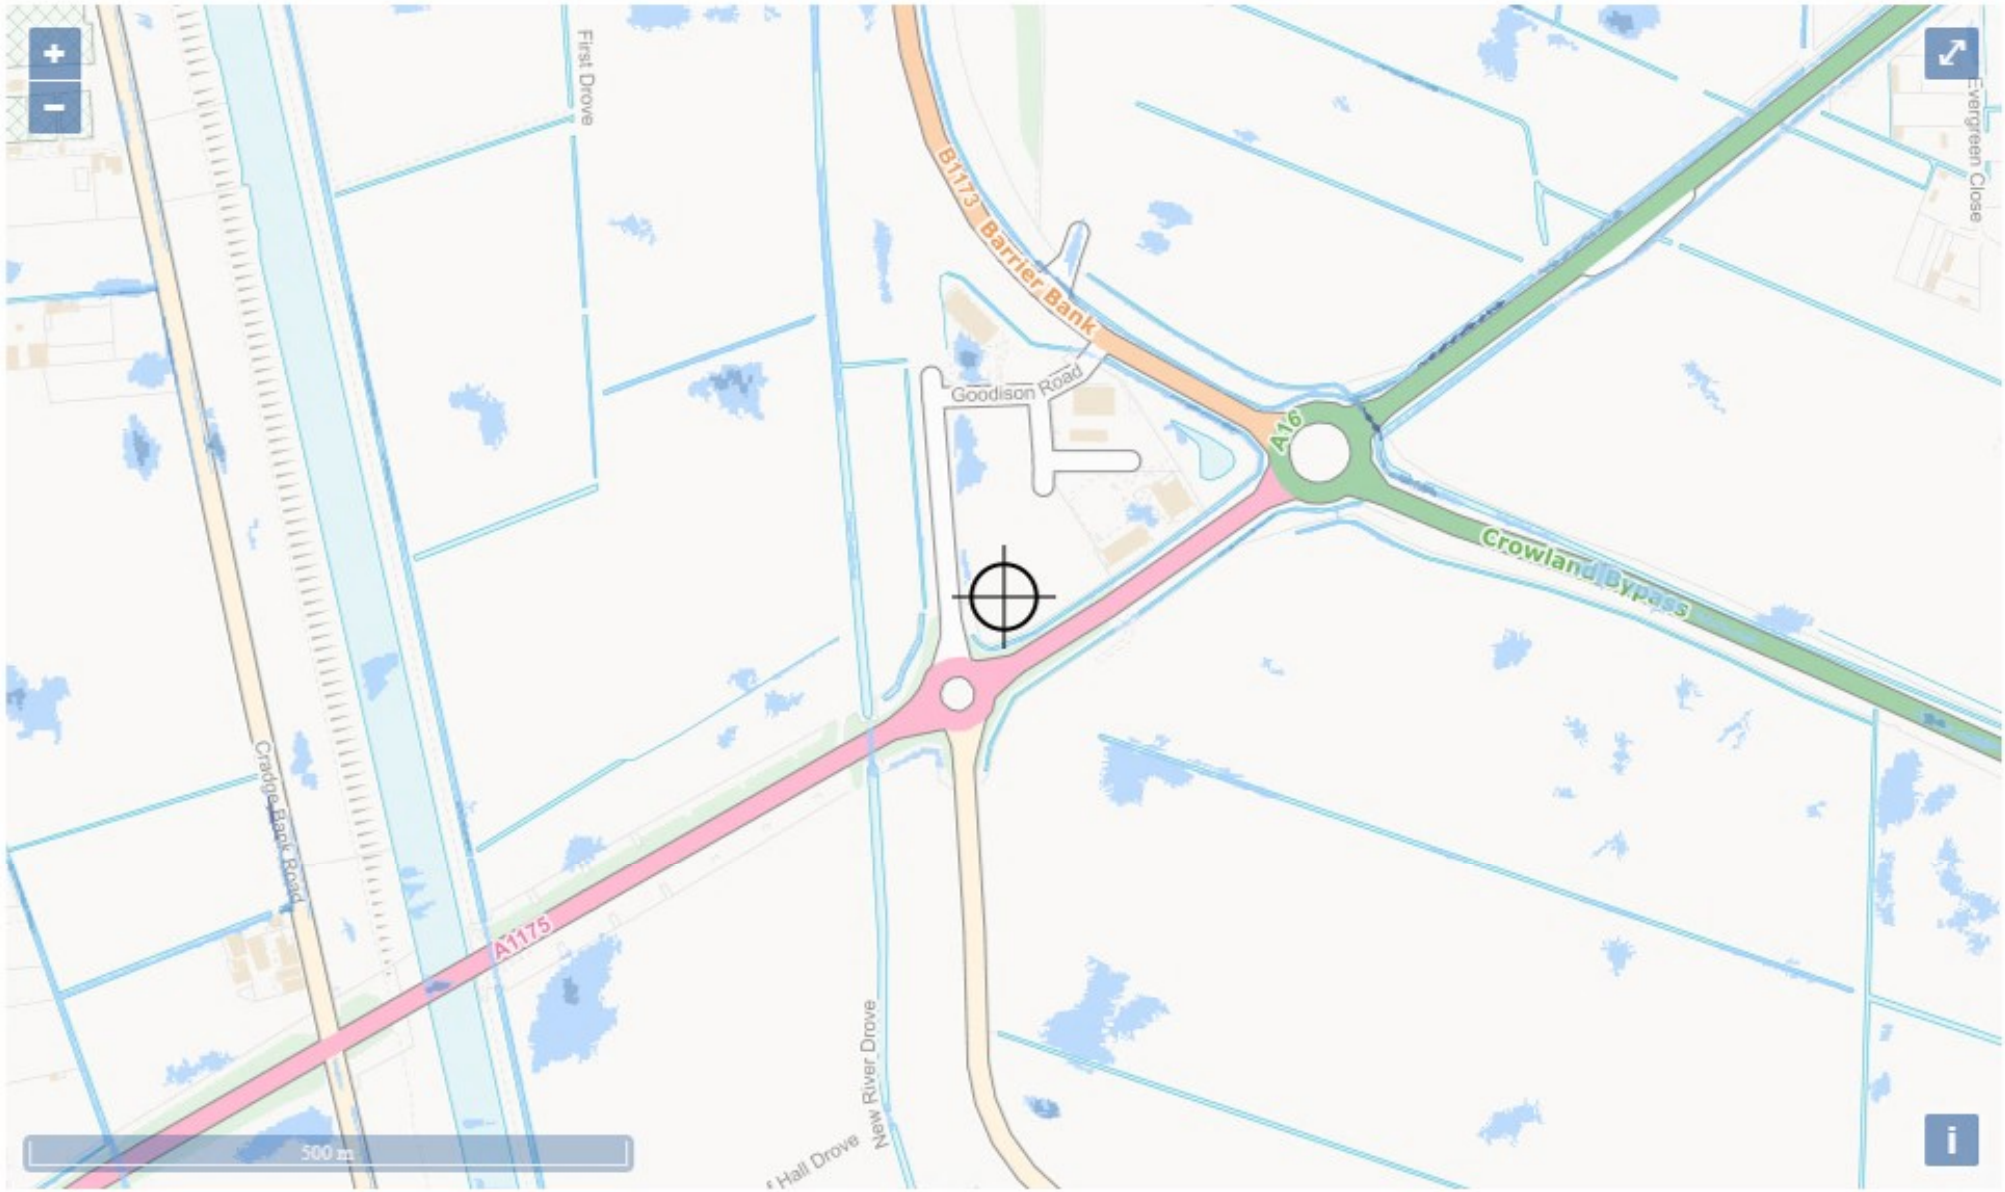

Extent of flooding from surface water


High Medium Low Very low Location you selected

Flood risk

Extent of flooding

Location

Enter a place or postcode

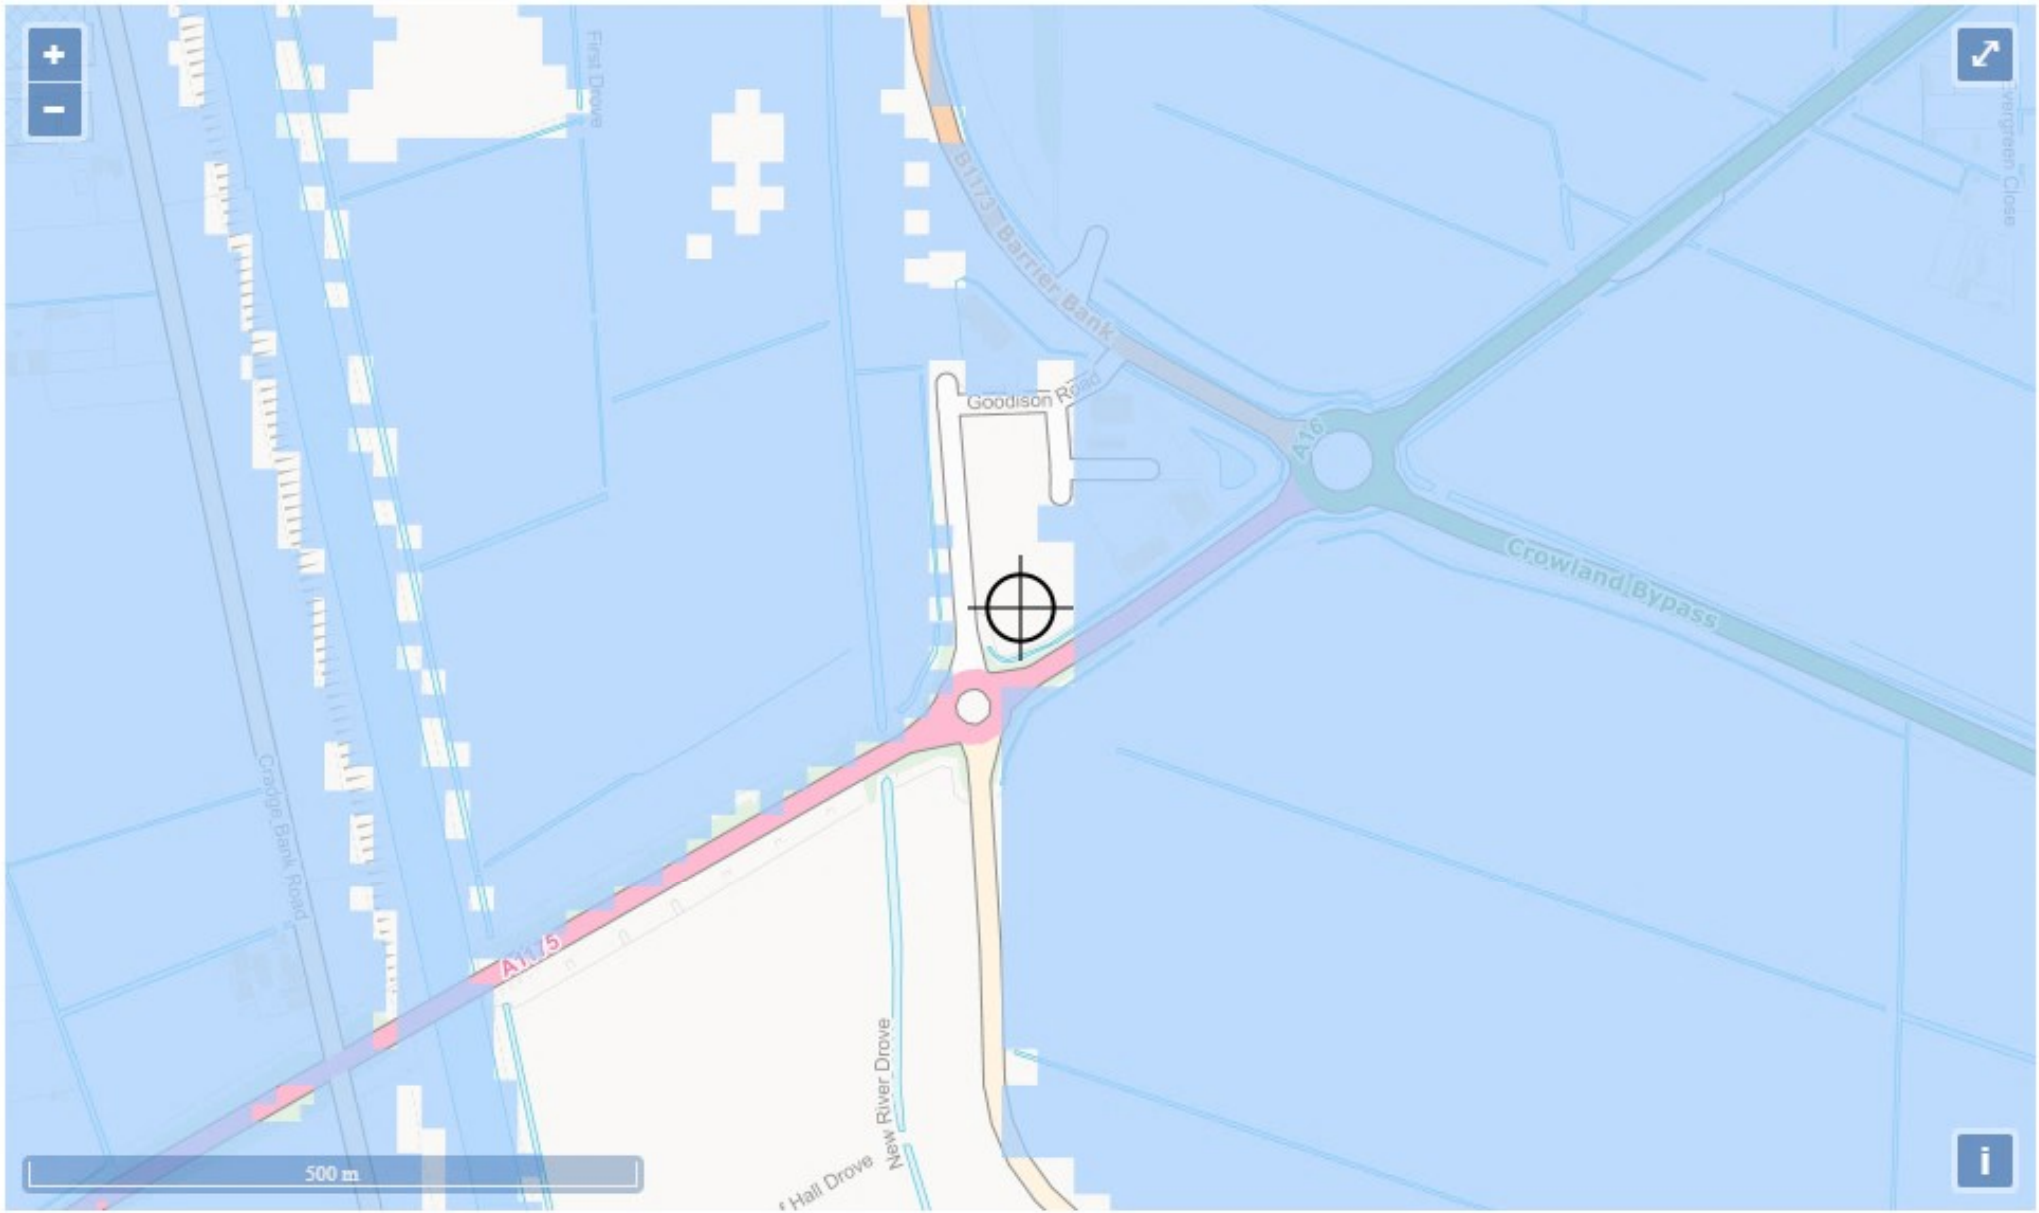

Extent of flooding from reservoirs

Maximum extent of flooding Location you selected

Paul Carter

From: PSOWN <PSOWN@environment-agency.gov.uk>
Sent: Thursday 15 April, 2021 3:50 pm
To: Paul Carter
Cc: Lincs & Northants, Customer Enquiries
Subject: RE: 210331/MB01 RE: 2176/01 EA Consultation - Lincolnshire Gateway Business Park, Spalding CCN/2021/211980
Attachments: CCN-2021-211980.pdf

Dear Paul

Reference: CCN/2021/2211980

Thank you for your email. We respond to requests under the Freedom of Information Act 2000 and Environmental Information Regulations 2004.

I enclose the requested flood data. Please refer to Open Government Licence which explains the permitted use of this information.

Please find a sharefile link below that will enable you to download the Product 5 for Welland Glen (2016).

https://ea.sharefile.com/d-s022eaf7f4eee4ab0a5a1f42102562593

Please note this link will expire in 30 days.

The following information is not available under the Open Government Licence but we may be able to licence it to you under the Environment Agency Conditional Licence:

Please refer to the tables below for the permitted use of the supplied information.

Name	Product 5
Description	Report name Welland Glen (2016)
Licence	Environment Agency Conditional Licence
Conditions	1. You may use the Information for your internal or personal purposes and may only sublicense others to use it if you do so under a written licence which includes the terms of these conditions and the agreement and in particular may not allow any period of use longer than the period licensed to you. 2. Notwithstanding the fact that the standard wording of the Environment Agency Conditional Licence indicates that it is perpetual, this Licence has a limited duration of 5 years at the end of which it will terminate automatically without notice. 3. We have restricted use of the Information as a result of legal restrictions placed upon us to protect the rights or confidentialities of others. In this instance it is because of third party data. If you contact us in writing (this includes email) we will, as far as confidentiality rules allow, provide you with details including, if available, how you might seek permission from a third party to extend your use rights. 4.1 The Information may contain some data that we believe is within the

	definition of "personal data" under the Data Protection Act 1998 but we consider that we will not be in breach of the Act if we disclose it to you with conditions set out in this condition and the conditions above. This personal data comprises names of individuals or commentary relating to property that may be owned by an individual or commentary relating to the activities of an individual. 4.2 Under the Act a person who holds and uses or passes to others personal data is responsible for any compliance with the Act and so we have no option but to warn you that this means you have responsibility to check that you are compliant with the Act in respect of this personal data. 5. The location of public water supply abstraction sources must not be published to a resolution more detailed than 1 km². Information about the operation of flood assets should not be published. 6.1 Where we have supplied model data which may include model inputs or outputs you agree to supply to the Environment Agency copies of any assessments/studies and related outputs, modifications or derivatives created pursuant to the supply to you of the Information, all of which are hereinafter referred to as "the Data". 6.2 You agree, in the public interest to grant to the Environment Agency a perpetual royalty free non-exclusive licence to use the Data or any part thereof for its internal purposes or to use it in any way as part of Environment Agency derivative products which it supplies free of charge to others such as incorporation into the Environment Agency's Open Data mapping products.
Attribution	Contains Environment Agency information © Environment Agency and/or database rights. May contain Ordnance Survey data © Crown copyright 2020 Ordnance Survey 100024198.

However, you MUST first check the supporting information and the above link to determine if the conditions on use are suitable for your purposes. If they aren't, this information is not provided with a licence for use, and the data is provided for read right only.

If you are not satisfied with our response to your request for information you can contact us within 2 calendar months to ask for our decision to be reviewed.

Kind regards

James

James Beckett
Partnerships and Strategic Overview Officer | Lincolnshire and Northamptonshire | Welland and Nene
Environment Agency | Nene House, Pytchley Road Industrial Estate, Pytchley Lodge Road, Kettering, NN15 6JQ

James.Beckett1@environment-agency.gov.uk | psown@environment-agency.gov.uk
External : 02 030 251539 | Team Dial: 020 302 53535 | Mobile: 07825230545



Paul Carter
PaulCarter@arpassociates.co.uk

Our ref: CCN-2021-211980

Date: 15 April 2021

Dear Paul

Provision of Flood Risk Information for Barrier Bank, Spalding.

Thank you for your request to use our flood risk information for the above site. The information is set out below and attached. It is important you read any contextual notes on the maps provided.

If you are preparing a Flood Risk Assessment (FRA) for this site, please note this information may not be sufficient by itself to produce an adequate FRA to demonstrate the development is safe over its lifetime. Additional information may be required to carry out an appropriate assessment of all risk, such as consequence of a breach in defences.

We aim to review our information on a regular basis, so if you are using this data more than twelve months from the date of this letter, please contact us again to check it is still valid.

1. Flood Map

The attached map includes the current Flood Map for your area. The Flood Map indicates the area at risk of flooding, **assuming no flood defences exist**, for a flood with a 0.5% chance of occurring in any year for flooding from the sea, or a 1% chance of occurring for fluvial (river) flooding. It also shows the extent of the Extreme Flood Outline which represents the extent of a flood with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater.

In some locations, such as around the fens and the large coastal floodplains, showing the area at risk of flooding assuming no defences may give a slightly misleading picture in that if there were no flood defences, water would spread out across these large floodplains. This flooding could cover large areas of land but to relatively shallow depths and could leave pockets of locally slightly higher land as isolated dry islands. It is important to understand the actual risk of the flooding to these dry islands, particularly in the event of defence failure.

The Flood Map also shows the location of formal raised flood defences and flood storage reservoirs. It represents areas at risk of flooding for present day only and does not take account of climate change.

The Flood Map only indicates the extent and likelihood of flooding from rivers or the sea. It should also be remembered flooding may occur from other sources such as surface water sewers, road drainage, etc.

2. Historic Flood Event Outlines

A copy of the Historic Flood Event Outlines Map showing the extent of previous recorded flooding in your area is attached. This only covers information we hold and it is possible recent flooding may have occurred which we are currently investigating, therefore this information may be subject to change. It is possible other flooding may have occurred which other organisations, such as the Lead Local Flood Authority (ie top tier council), Local Authority or Internal Drainage Board (where they exist), may have records.

3. Schemes in the area

There are no ongoing capital projects to reduce or sustain the current flood risk to this site.

4. Fluvial Flood Risk Information

4.1 Fluvial Defence Information

The existing fluvial defences reducing the risk of flooding to this site consist of Crowland-cowbit washes and earth embankments. They are in fair condition and reduce the risk of flooding (at the defence) to a 1% (1 in 100) chance of occurring in any year. We inspect these defences routinely to ensure potential defects are identified.

Refer to paragraph 3.1 for details of any ongoing capital projects to reduce the flood risk to this site.

4.1.1 Details of site – Additional

The proposed red line boundary for the site is designated as FZ1.

This proposed development is adjacent to Barrier Bank. This bank is a designated flood defense, it is essential that there are no adjustments or alterations to the bank at this location without prior consultation and approval (including relevant planning and permitting) from the Environment Agency.

4.2 Fluvial Modelled Levels and Flows

Available modelled fluvial flood levels and flows for the model nodes shown on the attached map are set out in the data table attached. This data is taken from the model named on the data table, which is the most up-to-date model currently available.

Please note these levels are “in-channel” levels and therefore may not represent the flood level on the floodplain, particularly where the channel is embanked or has raised defences.

Our models may not have the most up to date climate change allowances. In time we will update our models for the latest allowances. You should refer to 'Flood risk assessments: climate change allowances' to check if the allowances modelled are appropriate for the type of development you are proposing and its location. You may need to undertake further assessment of future flood risk using different allowances to ensure your assessment of future flood risk is based on best available evidence.

4.3 Fluvial Modelled Flood Extents

Please find attached a map showing available modelled flood extents, taking into account flood defences, for your area. This data is taken from the model named on the map, which is the most up-to-date model currently available.

4.4 Fluvial Hazard Mapping

For certain locations we have carried out modelling to map the maximum values of flood depth, velocity and hazard rating (danger to people) resulting from overtopping and / or breaching of defences at specific locations for a number of scenarios.

At present this information is available for fluvial flood risk in Northampton, Lincoln, Wainfleet and some isolated rural locations.

The number of locations we have this information for is expected to increase in time.

Modelled Hazard Mapping
Detailed Hazard Mapping is available within the 2017 Update of South Holland Strategic Flood Risk Assessment. This can be downloaded via the following link:
http://www.southeastlincslocalplan.org/south-east-lincolnshire-strategic-flood-risk-assessment-march-2017

5. Tidal Flood Risk Information

This site is not considered to be at risk from tidal flooding.

6. Development Planning

If you would like local guidance on preparing a flood risk assessment for a planning application, please contact our Sustainable Places team at lnplanning@environment-agency.gov.uk. It will help if you mention this data request and attach your site location plan.

We provide free preliminary advice; additional/detailed advice, review of draft FRAs and meetings are chargeable at a rate set to cover our costs, currently £100 (plus VAT) per hour of staff time. Further details are available on our website at https://www.gov.uk/guidance/developers-get-environmental-advice-on-your-planning-proposals.

General advice on flood risk assessment for planning applications can be found on GOV.UK at https://www.gov.uk/guidance/flood-risk-assessment-for-planning-applications

Climate change will increase flood risk due to overtopping of defences. Please note, unless specified otherwise, the climate change data included has an allowance for 20% increase in flow. Updated guidance on how climate change could affect flood risk to new development - 'Flood risk assessments: climate change allowances' was published on GOV.UK in February 2016. The appropriate updated climate change allowance should be applied in a Flood Risk Assessment.

You should also consult the Strategic Flood Risk Assessment produced by your local planning authority.

7. Data Licence and Other Supporting Information

We respond to requests for recorded information we hold under the Freedom of Information Act 2000 (FOIA) and the associated Environmental Information Regulations 2004 (EIR).

This information is provided in accordance with the Open Government Licence which can be found here: http://www.nationalarchives.gov.uk/doc/open-government-licence/version/3/

Further information on flood risk can be found on the GOV.UK website at:
https://www.gov.uk/browse/environment-countryside/flooding-extreme-weather

8. Other Flood Risk Management Authorities

The information provided with this letter relates to flood risk from main river or the sea. Additional information may be available from other risk management authorities, such as the Lead Local Flood Authority (ie top tier council) or Internal Drainage Board (where they exist).

I hope we have correctly interpreted your request. If you have any queries or would like to discuss the content of this letter further please contact James Beckett using the email address below.


Yours sincerely,



for Alastair Windler
Welland and Nene Partnerships and Strategic Overview Team Leader
e-mail PSOWN@environment-agency.gov.uk

Enc.
Flood Map
Historic Flood Event Outlines Map
Modelled Fluvial Levels and Flows Data Sheet
Modelled Flood Extent Maps

Flood Map centred on TF 24275 19578 - created April 2021 [Ref: CCN-2021-211980]

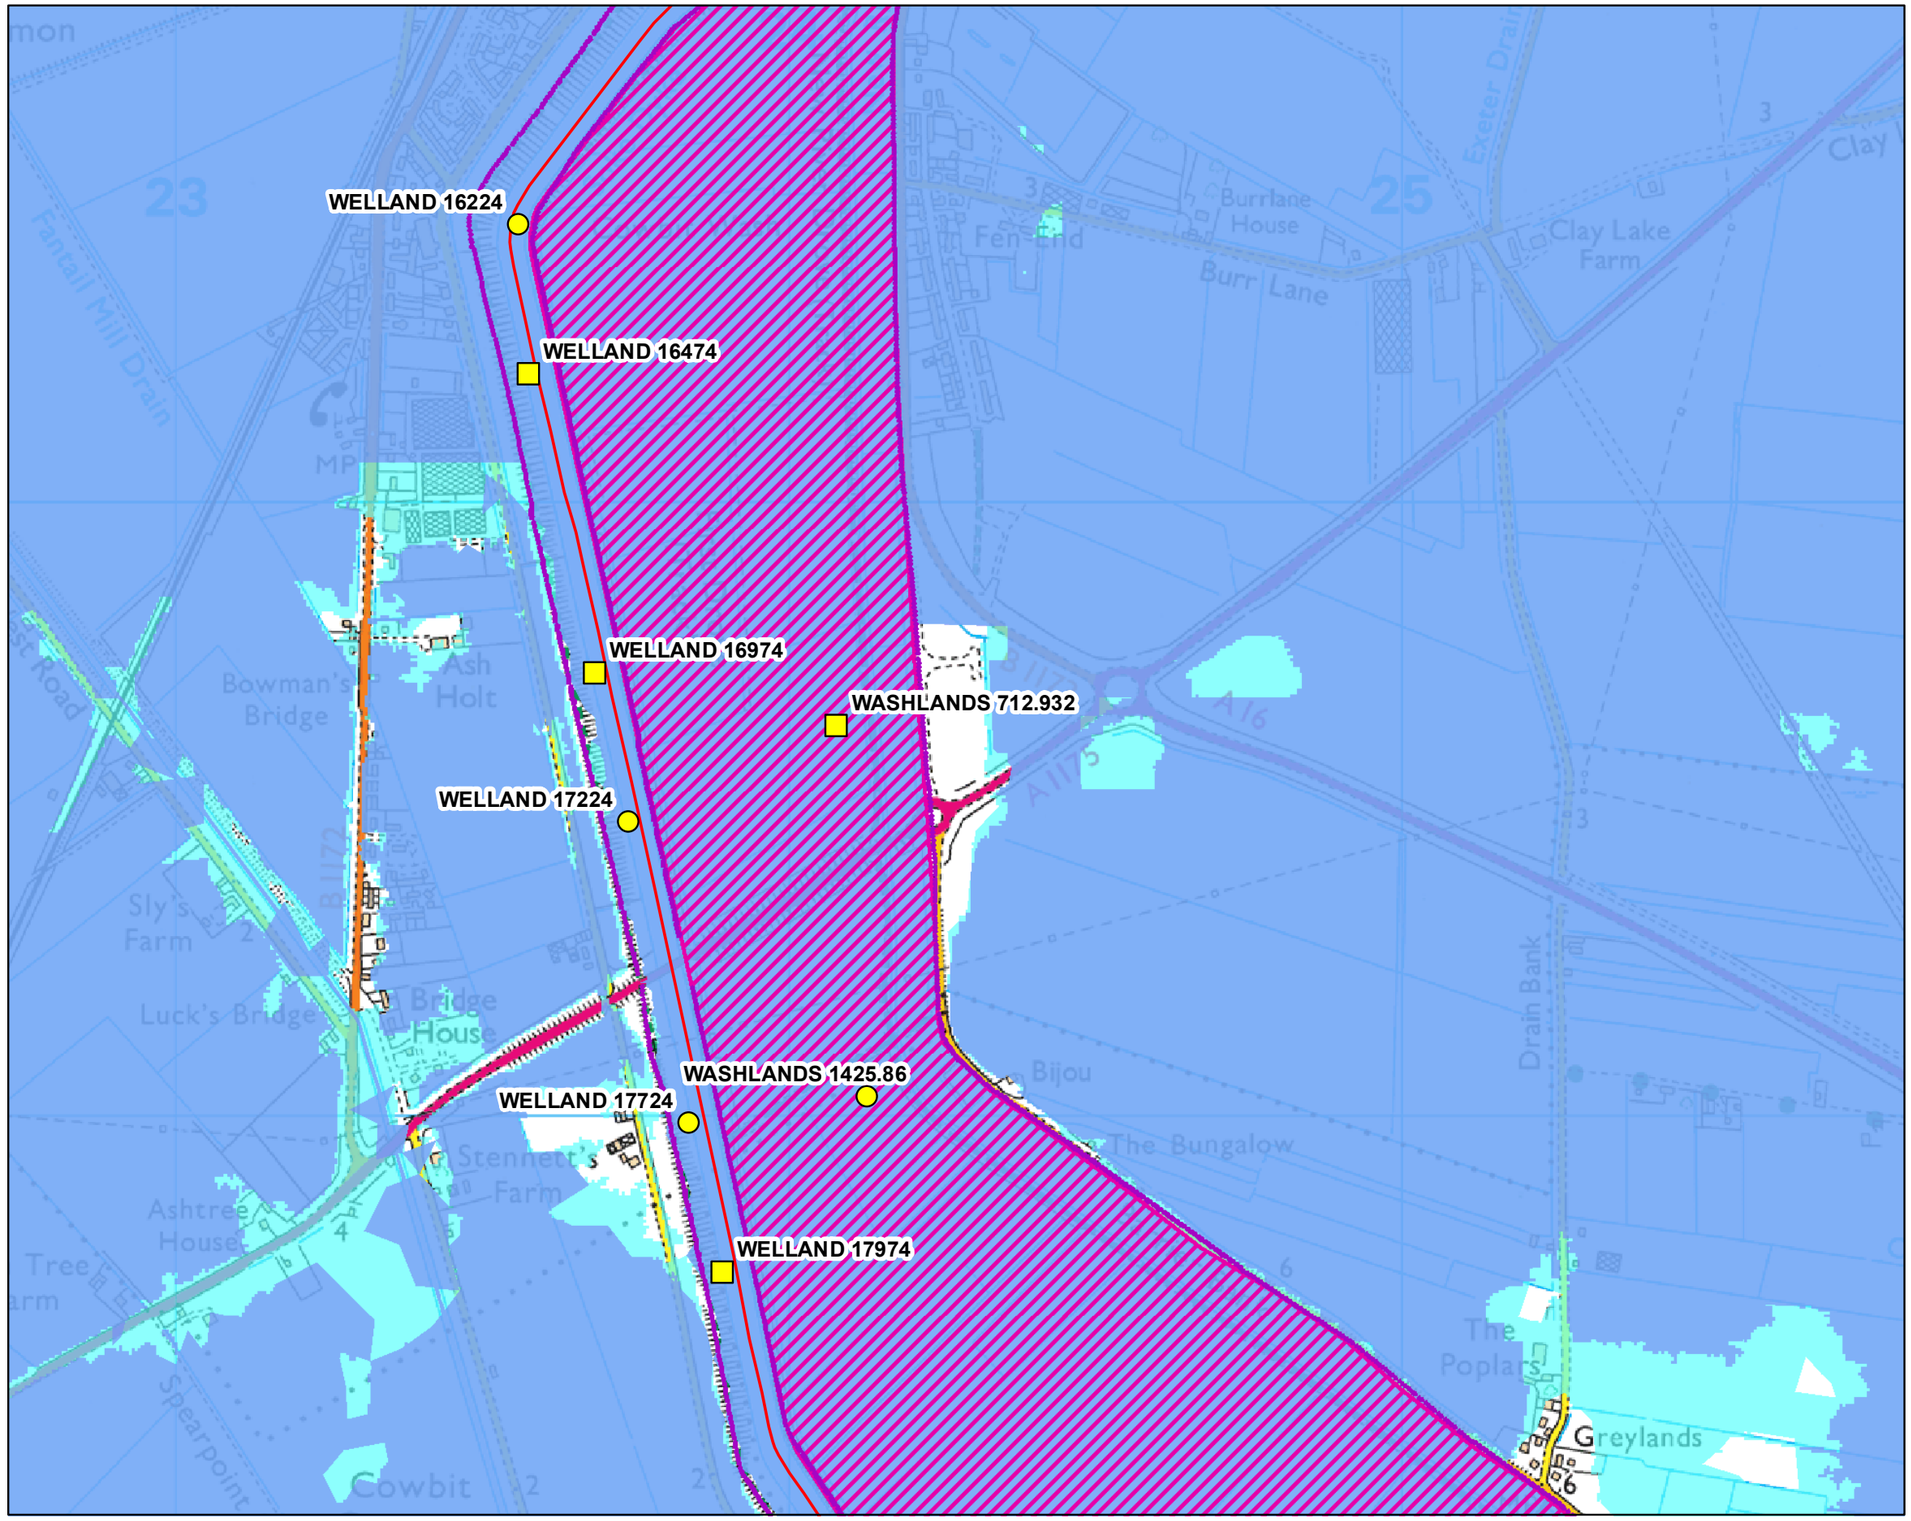

Environment Agency

Scale 1:10,000

N

Legend

- Modelled Node Levels
- Modelled Node Flows
- Main River
- Raised Defences
- Flood Storage Areas
- Area at Risk of Flooding from Rivers or The Sea
- Extreme Flood Outline

Dark blue shows the area that could be affected by flooding, either from rivers or the sea, if there were no flood defences. This area could be flooded:

- from the sea by a flood that has a 0.5% (1 in 200) or greater chance of happening each year.

- or from a river by a flood that has a 1% (1 in 100) or greater chance of happening each year.

Light blue shows the extent of the Extreme Flood Outline, which represents the extent of a flood event with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater.


These two colours show the extent of the natural floodplain if there were no flood defences or certain other manmade structures and channel improvements. Sites outside the two extents, but behind raised defences, may be affected by flooding if the defences are overtopped or fail.

Created by the Partnerships and Strategic Overview Team, Kettering

© Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.

Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY. Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

Historic Flood Map centred on TF 24275 19578 - created April 2021 [Ref: CCN-2021-211980]

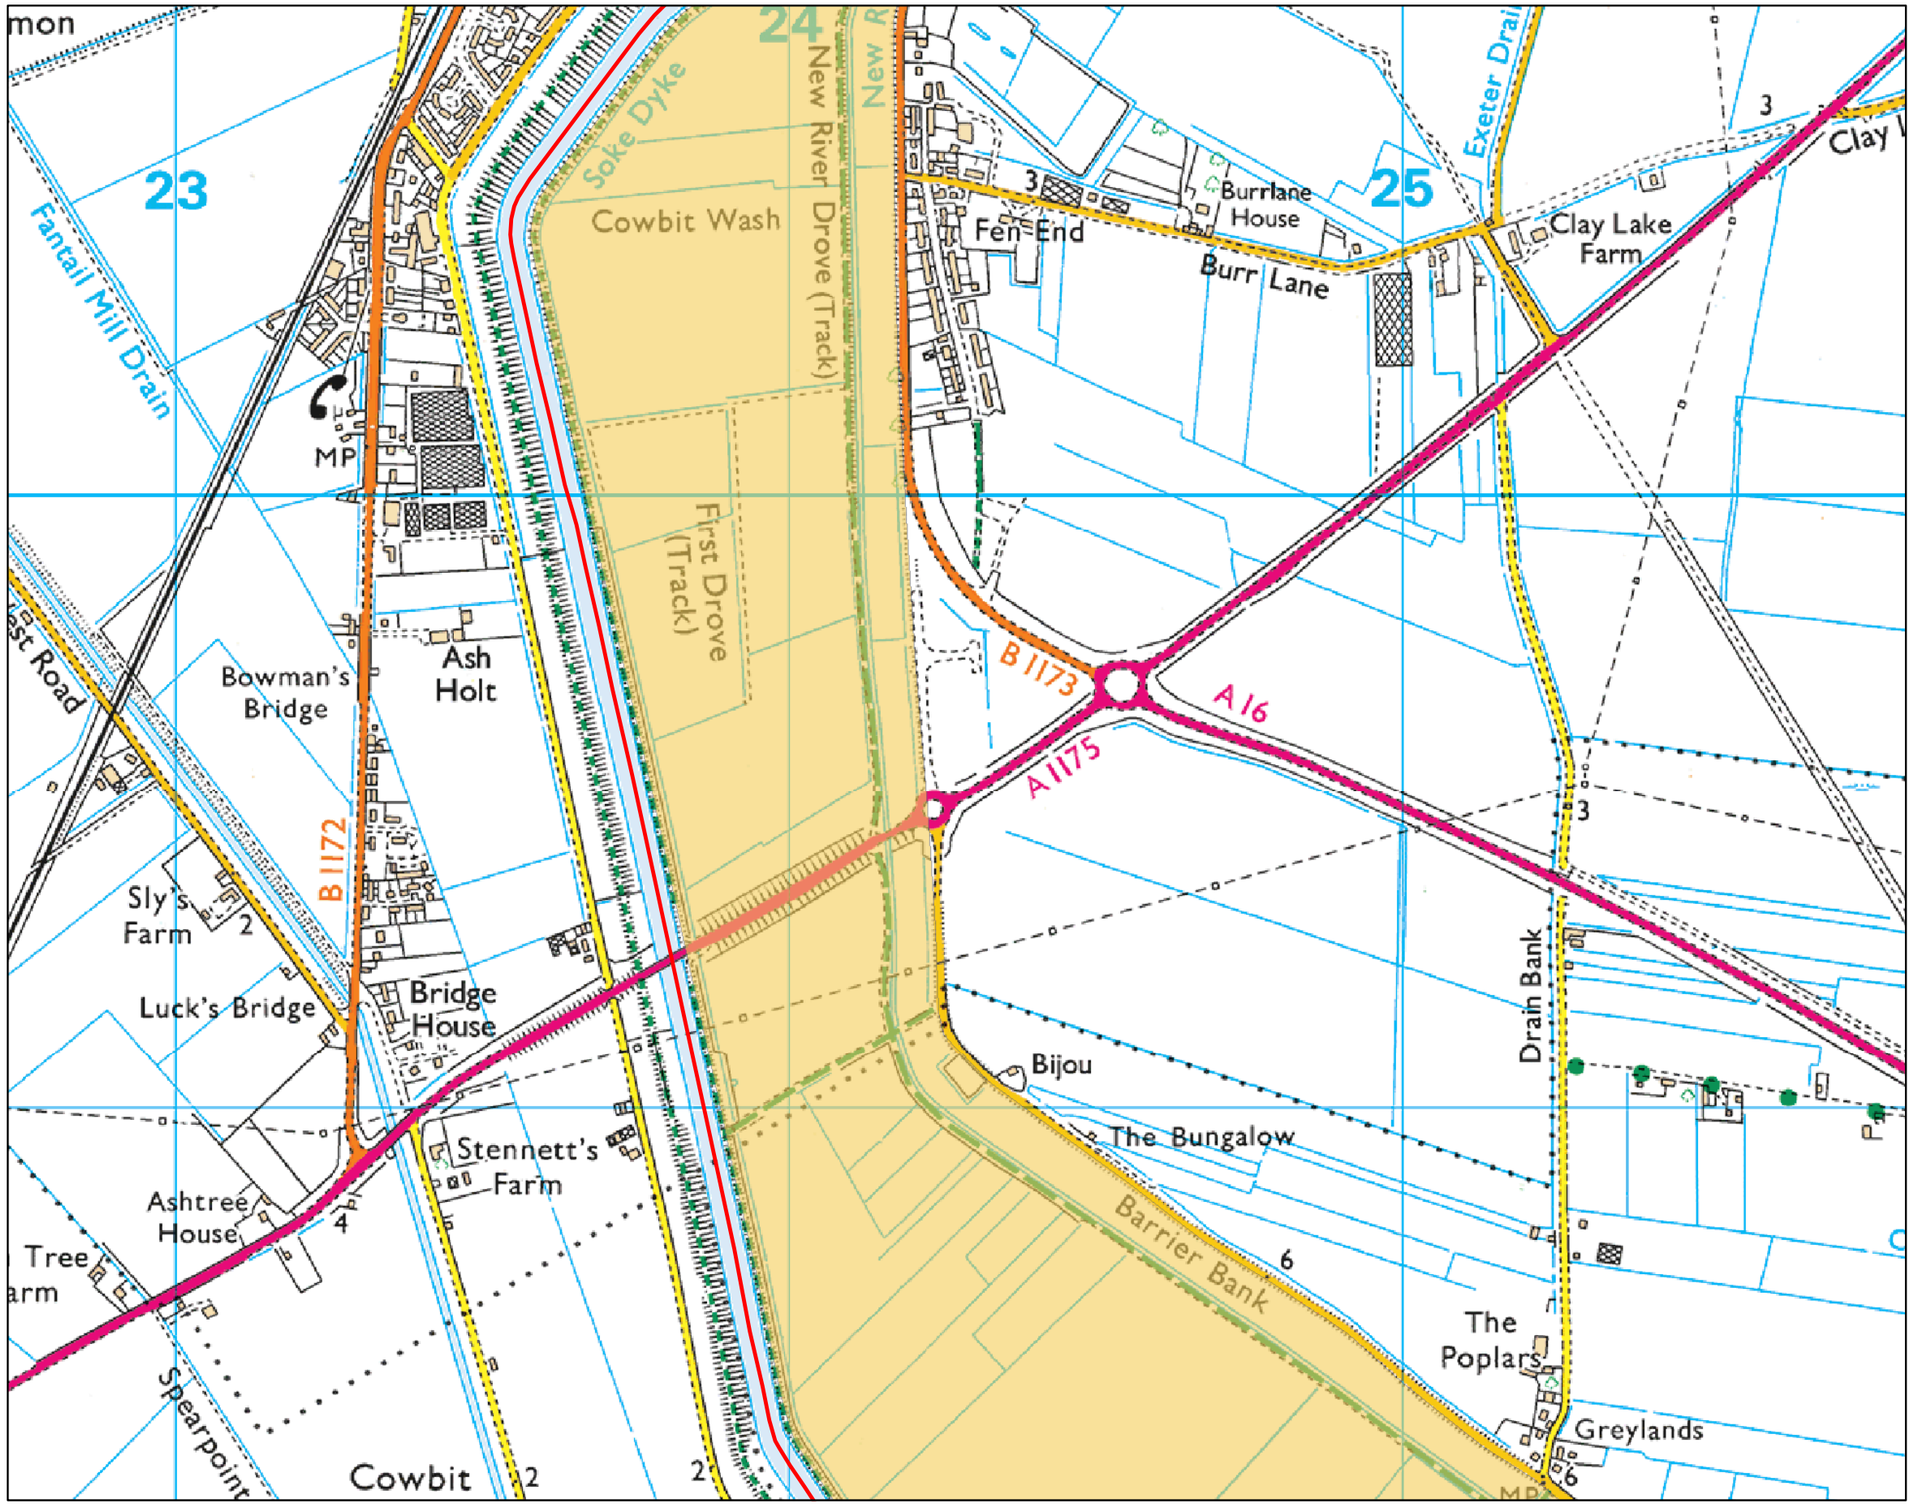

Environment Agency

Scale 1:10,000

N

Legend

- Main River
- March 1947 on the River Welland near Cowbit

Created by the Partnership & Strategic Overview Team, Kettering

© Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.

Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY. Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

Datasheet [Ref: CCN-2021-211980] Model Name: Welland Glen Model Date: 2016

Fluvial Flood Levels (mODN)

The fluvial flood levels for the model nodes shown on the attached map are set out in the table below. They are measured in metres above Ordnance Datum Newlyn (mODN).

			Annual Exceedance Probability - Maximum Water Levels (mODN)										
Node Label	**Easting**	**Northing**	**50% (1 in 2)**	**20% (1 in 5)**	**10% (1 in 10)**	**5% (1 in 20)**	**2% (1 in 50)**	**1.33% (1 in 75)**	**1% (1 in 100)**	**1% (1 in 100) inc 20% Climate Change**	**0.5% (1 in 200)**	**0.1% (1 in 1000)**	**0.1% (1 in 1000) inc 20% Climate Change**
WASHLANDS 1425.86	524130	319030	0.86	0.86	0.94	1.66	2.07	2.27	2.35	2.83	2.48	2.71	3.36
WELLAND 16224	523562	320451	3.70	3.98	4.18	4.43	4.52	4.53	4.53	4.66	4.53	4.55	4.66
WELLAND 17224	523742	319477	3.70	4.00	4.20	4.44	4.53	4.54	4.54	4.66	4.54	4.56	4.66
WELLAND 17724	523840	318987	3.70	4.01	4.20	4.45	4.54	4.54	4.55	4.65	4.55	4.56	4.65

Fluvial Flood Flows (m^3/s)

The fluvial flood flows for the model nodes shown on the attached map are set out in the table below. They are measured in metres cubed per second (m^3/s).

			Annual Exceedance Probability - Maximum Flows (m^3/s)										
Node Label	**Easting**	**Northing**	**50% (1 in 2)**	**20% (1 in 5)**	**10% (1 in 10)**	**5% (1 in 20)**	**2% (1 in 50)**	**1.33% (1 in 75)**	**1% (1 in 100)**	**1% (1 in 100) inc 20% Climate Change**	**0.5% (1 in 200)**	**0.1% (1 in 1000)**	**0.1% (1 in 1000) inc 20% Climate Change**
WASHLANDS 712.932	524080	319635	0.00	0.00	0.00	0.31	0.40	0.69	0.77	4.76	1.21	2.15	8.28
WELLAND 16474	523577	320209	60.03	75.84	86.75	100.18	111.79	112.99	114.34	113.83	114.57	113.66	113.63
WELLAND 16974	523686	319721	59.28	75.10	85.95	99.45	111.74	112.95	114.31	113.94	114.87	113.65	113.62
WELLAND 17974	523893	318743	57.96	73.76	84.47	98.12	111.67	112.88	114.26	114.22	115.46	113.65	113.62