




Luminaire Schedule				
Label	Symbol	Qty	Description	
EXT 1		17	9620640 Eyeball VS 1x42W HF CFL L.Ant	
EXT 2		6	96204137 Arrow 150W HF CFL Ant A206	
EXT 3		6	96008890-96002081 Chalice 100H 2x25W + 1	

Calculation Summary				
Label	Avg	Max	Min	Min/Avg
Building Perimeter	30.69	244	1.7	0.06
Car Park	36.59	90	8	0.22
Spill Lighting	0.62	23	0	N/A
Cycle bay	78.37	161	25.0	0.32

SHDC
Planning & Development
17 MAR 2011
Ref: 0204-11

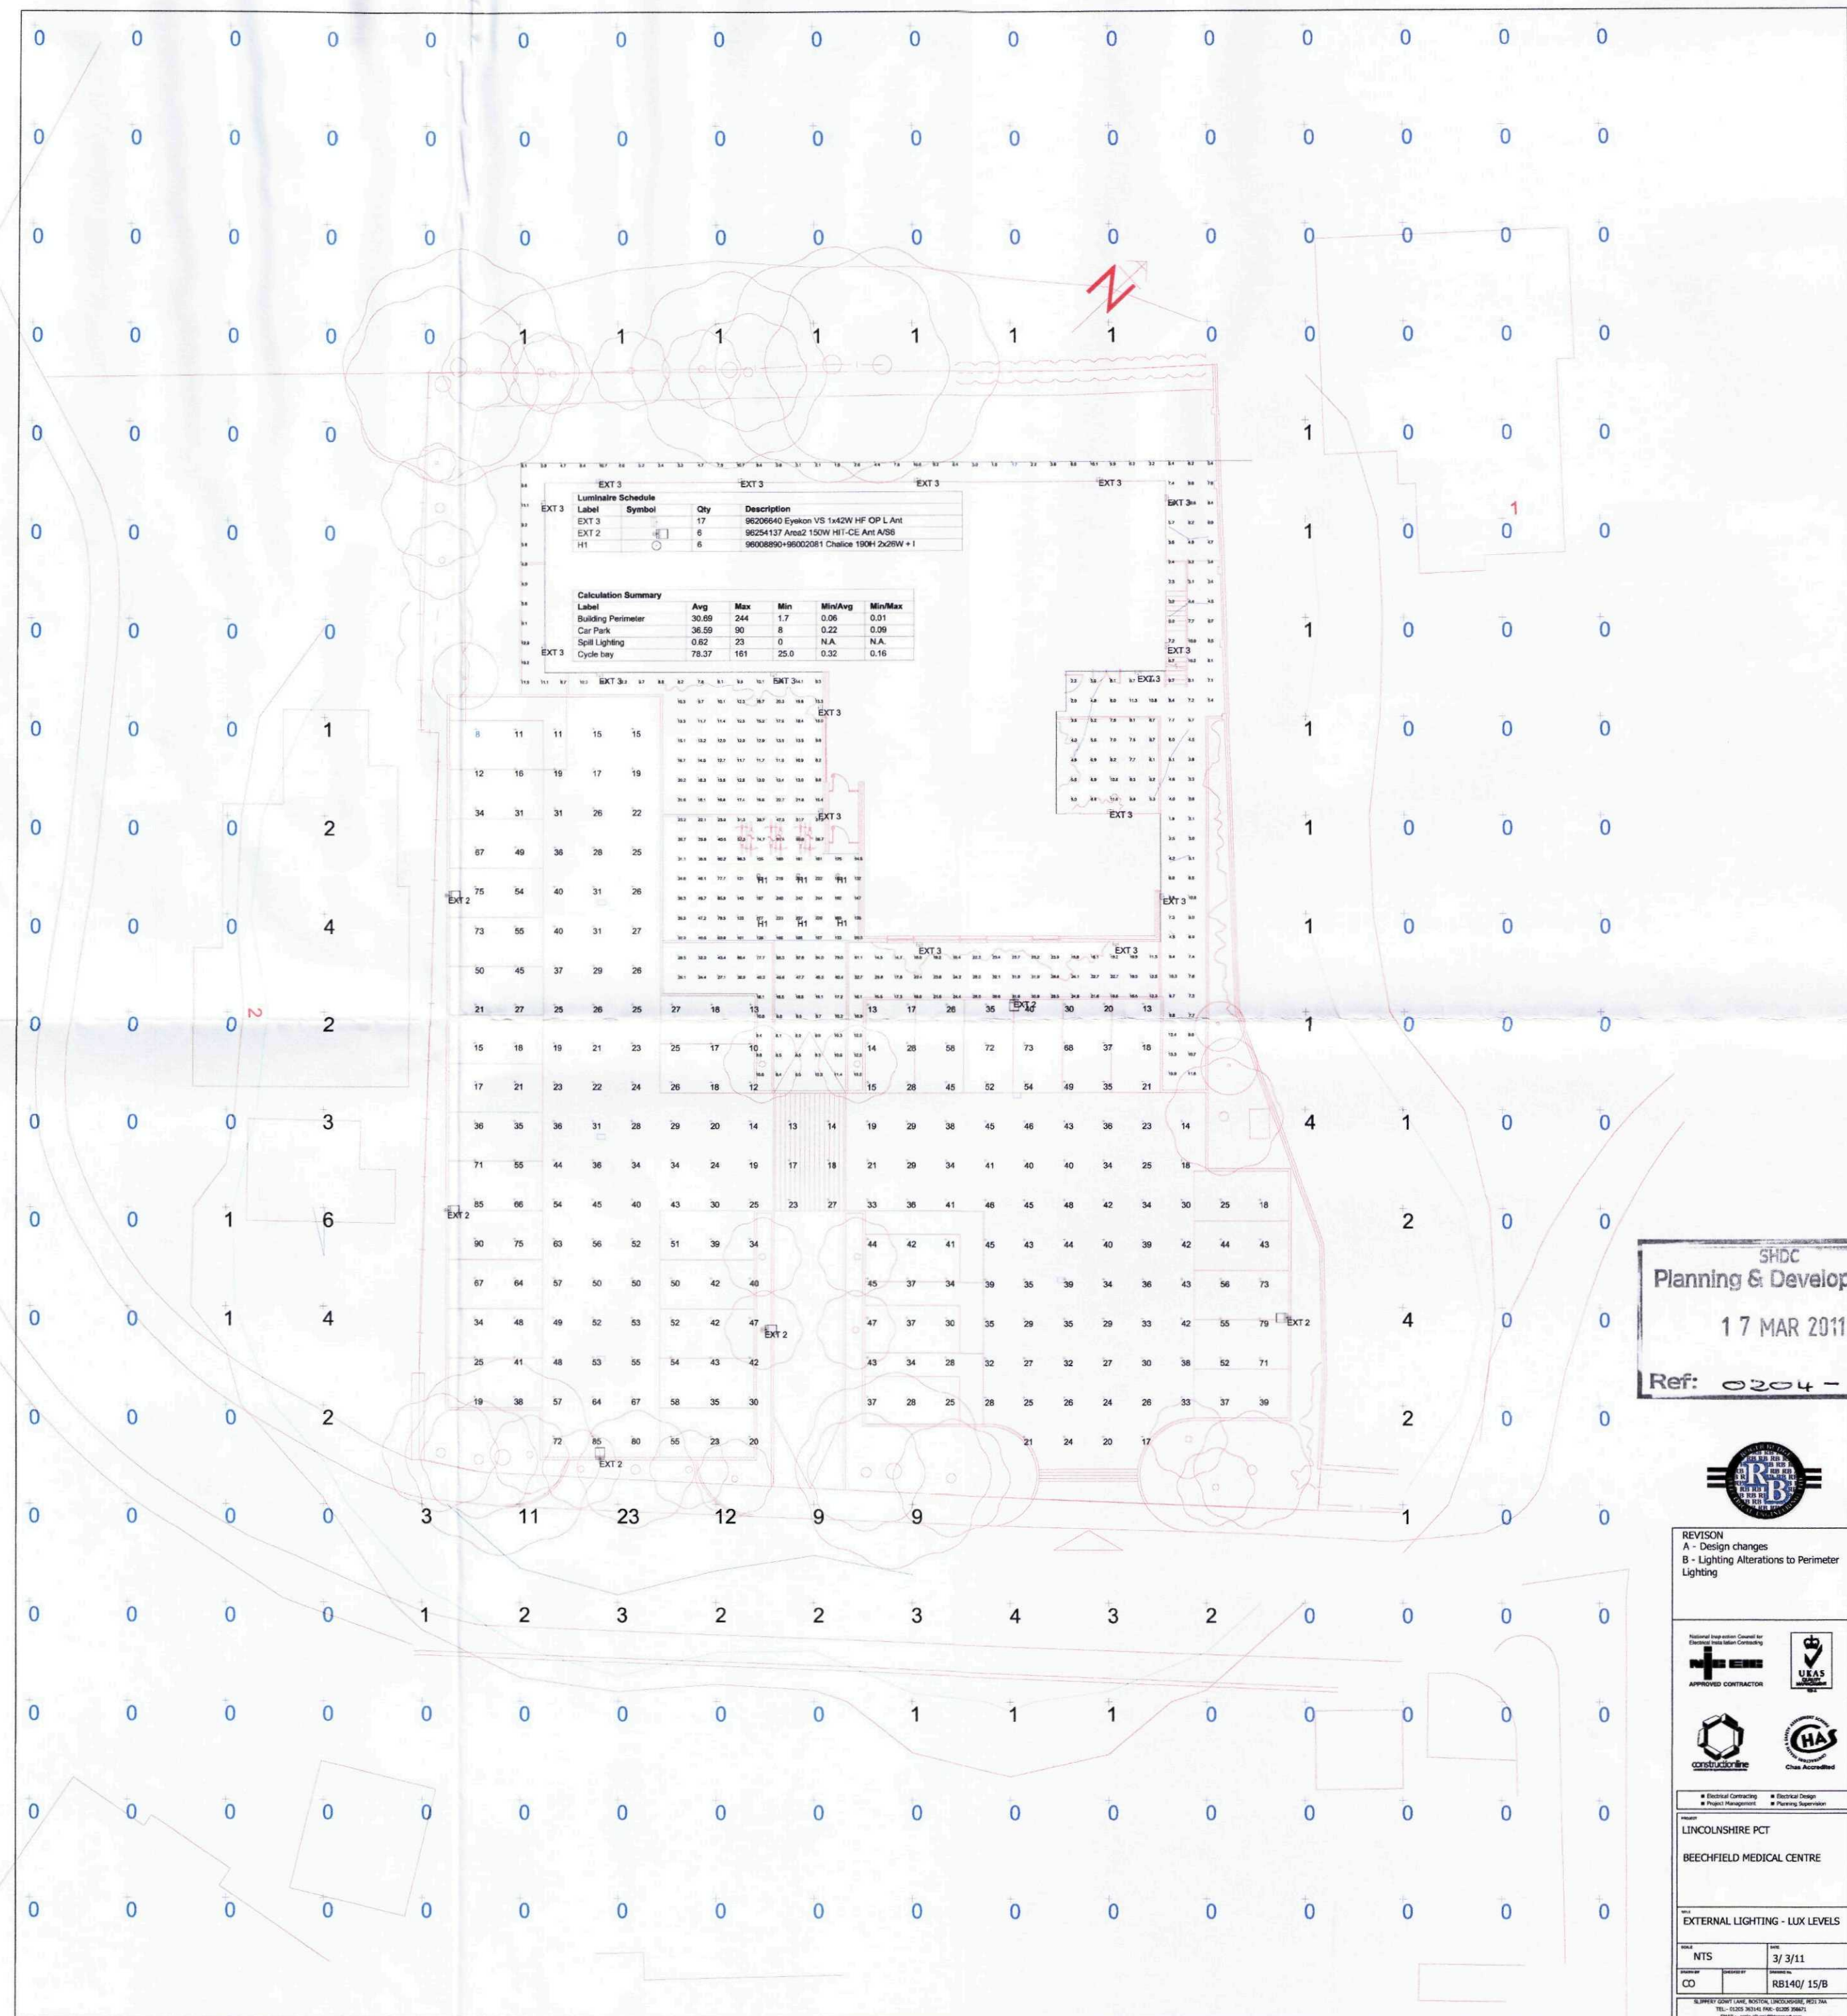

REVISION
A - Design changes
B - Lighting Alterations to Perimeter
Lighting



Lincolnshire PCT
BEECHFIELD MEDICAL CENTRE

EXTERNAL LIGHTING - LUX LEVELS	
NTS	3/3/11
CD	RB140/ 15/B