


SEPARATION DISTANCES
ACCORDING TO ISO 16 924

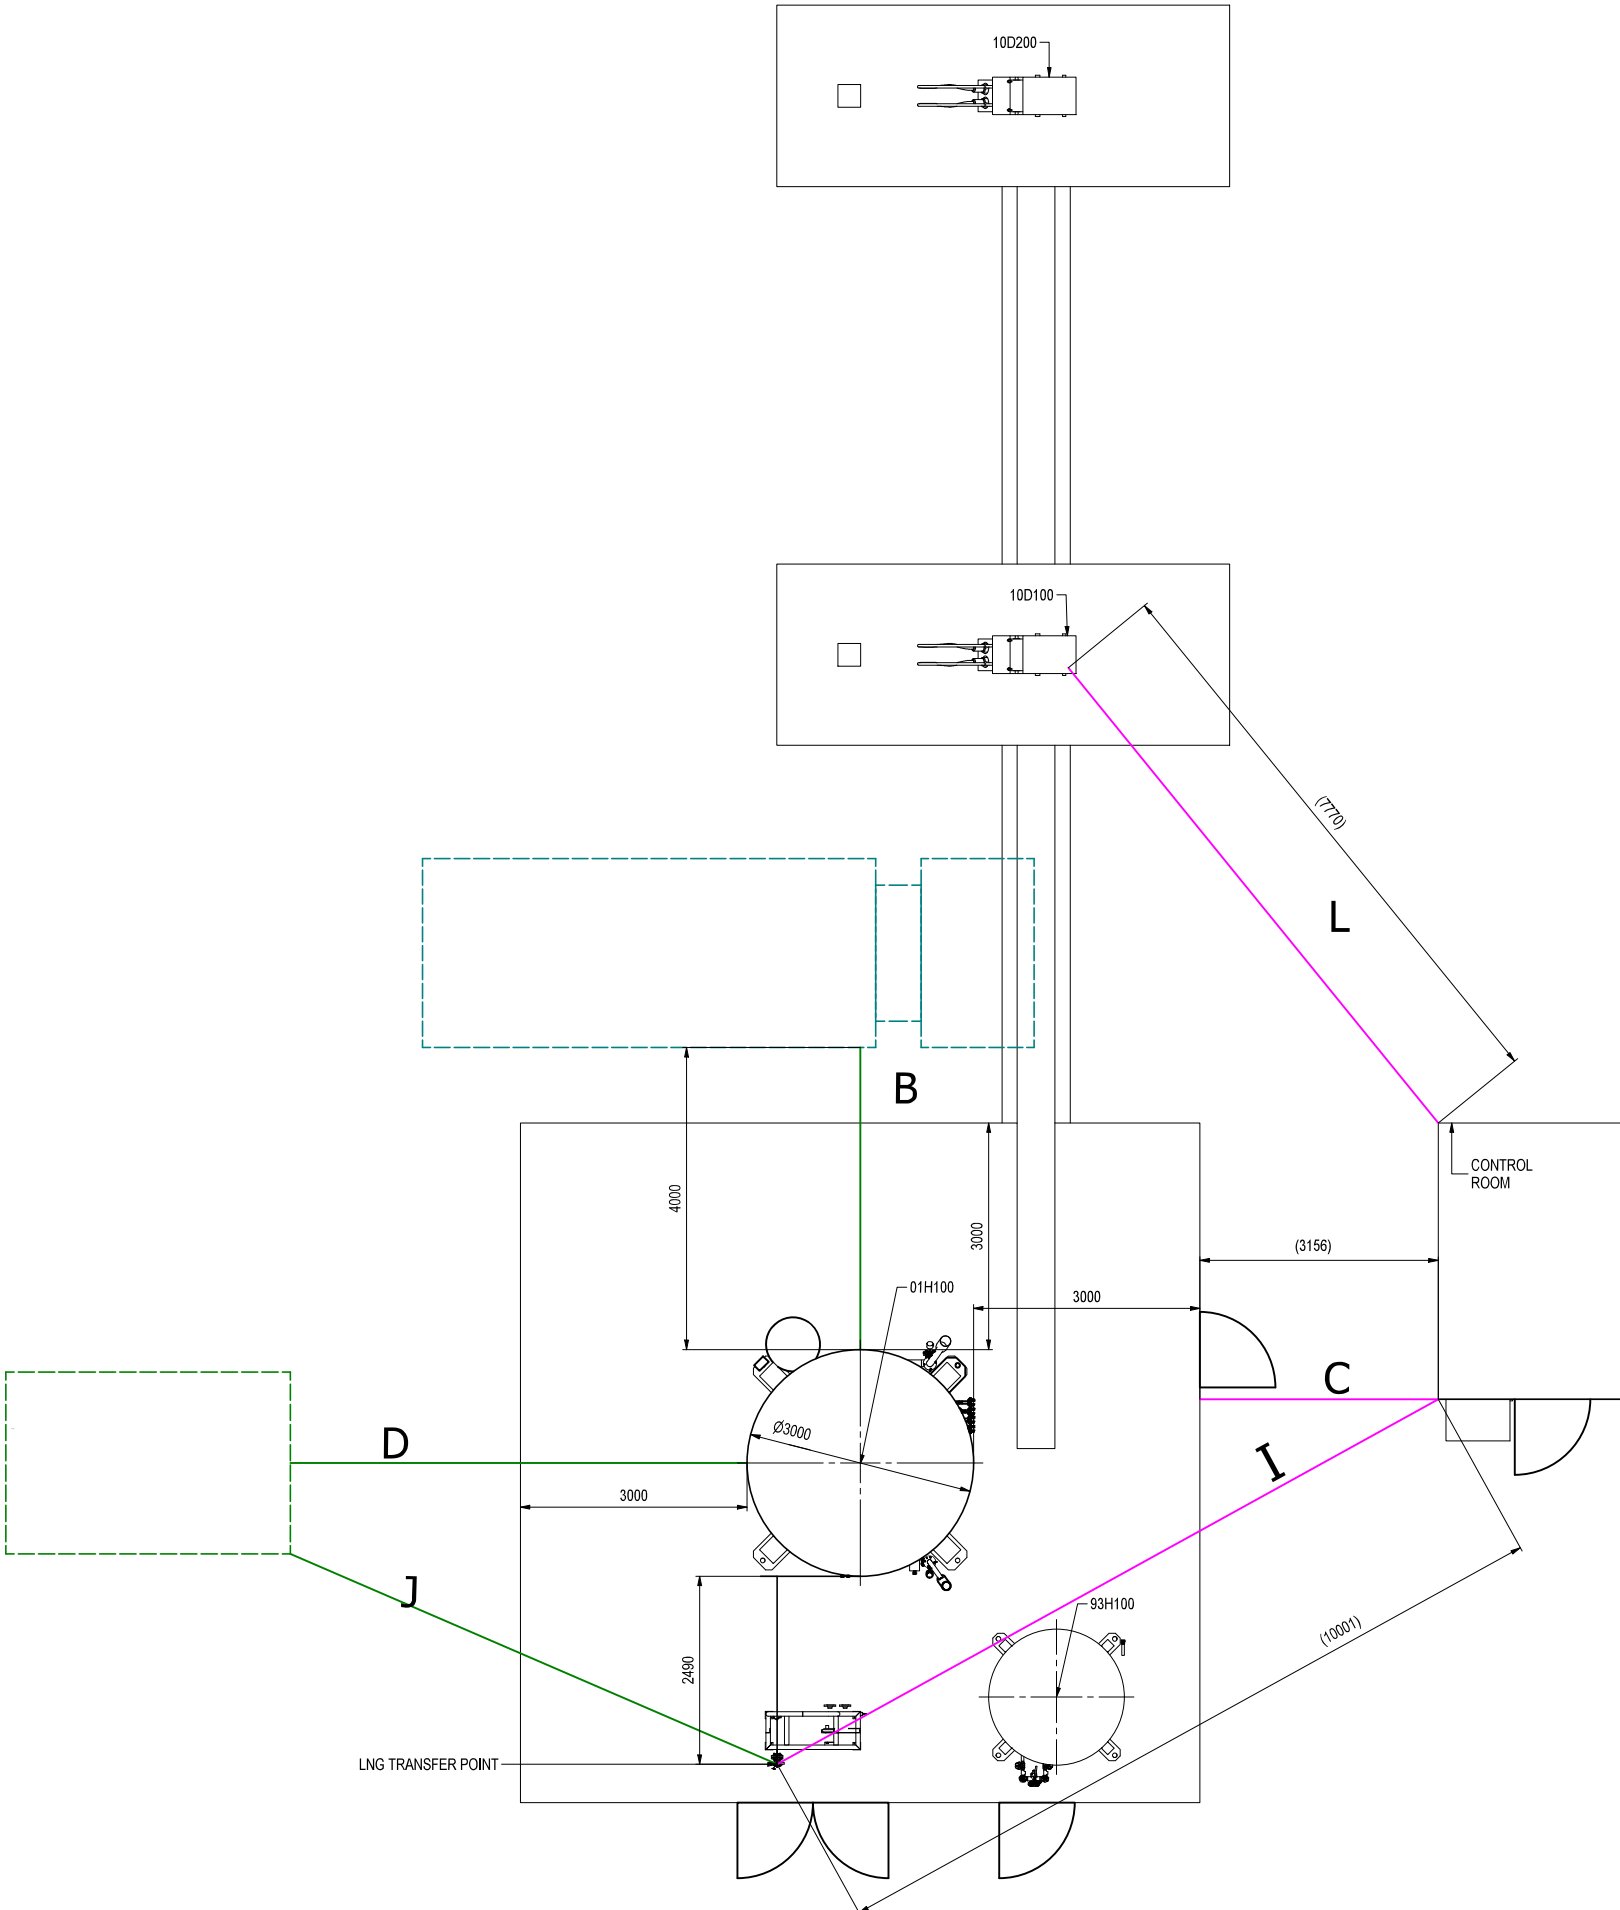

OFFSIDE BUILDINGS			
Number of persons in building	Additional comment	Dimmension	Minimum distance / m
DISTANCE FROM LNG STORAGE AND OTHER CONTAINING LNG			
None		D	3
<10		D	15
10 to 100		D	30
>100		D	30
DISTANCE FROM OFFLOAD CONNECTION			
None	buildings with non-combustible walls	J	3
	buildings with combustible walls	J	10
<10	with ground pump	J	10
	without ground pump	J	20
10 to 100		J	30
>100		J	50
FUELLING VEHICLE - OUTER SHELL OF LNG TANK		B	4

1			09.06.2021	UHLÍŘOVÁ	STEJSKAL	NAVRÁTIL
Rev.č. Revis	ECN č. ECH No.	Popis revize Revisions Description	Datum Date	Proved Drawn	Přezkoušel Checked	Schválil Approved
Měřítko: Scale:	1:100	Poznámka: Note:	Celková hmotnost Total Mass (kg)		0 kg	Formát: Form:
NEPŘEDPISANÉ TOLERANCE DLE SPEC. ZT004322		THE DOCUMENT IS THE PROPERTY OF CHART FEROX, A.S. AND CONTAINS CONFIDENTIAL INFORMATION PROTECTED BY LAW. IN PARTICULAR BY COPYRIGHT, PATENT, UTILITY MODEL, REGISTERED DESIGN, OR TRADEMARK. IT MUST NOT BE REPRODUCED, IN PART OR IN WHOLE, OR USED FOR PURPOSES OTHER THAN IT IS EXPLICITLY SUPPLIED FOR. ANY INFRAINGEMENT WILL BE SUBJECT TO LEGAL PROSECUTION. © 09.06.2021 Chart Ferox, a.s.		Formát: Form:		A1
Chart Ferox		Název: Title:	LAYOUT		Číslo výkresu: Drawing No.:	
				K1007494_R1		Lst: Sheet:
						4
						4