

PLANNING APPLICATION DRAWING

NOTES

This drawing is to be read in conjunction with all relevant project drawings and specifications.

Do NOT scale from this drawing or any other prepared by JDA in connection with this project. Use figured dimensions only. All levels and dimensions to be checked on site. All level and dimensional discrepancies are to be bought to the immediate attention of JDA. This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than for which it has been issued without written permission of the copyright holder.

Responsibility cannot be accepted for alteration and/or deviation from this design without prior acknowledgement of JDA.

Copyright retained in accordance with the copyright design and patents act 1988. This drawing may only be used for the client and location specified in the title block. It may not be copied or disclosed to any other third party without prior written consent from JDA. The Contractor is to check all dimensions on site and report any discrepancies PRIOR TO commencing work.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless they have been reported in detail so that design amendments may be considered.

All relevant dimensions and levels to be ascertained or checked and verified on site before specific areas of work are commenced.

All works and materials are to be in full accordance with current British Standards, Building Regulations, Agreement Certificates and Manufacturers printed instructions.

All Building Regulations inspections are to be carried out at the appropriate stages of work. This drawing is to be read in conjunction with clients specification/employers requirements and structural engineers design.

ACCESSIBILITY

LEVEL DWELLING APPROACH

Provide a level approach to the principal entrance door no steeper than 1:20 and at least 900mm wide, with cross falls no greater than 1:40. Approach surface material to be firm and non-slip, capable of supporting the weight of a wheel chair and its user (loose material such as gravel and shingle would not be suitable).

ACCESSIBLE LEVEL DOOR THRESHOLDS INTO THE BUILDING

Entrance door to have an accessible level threshold provided with a weather bar (maximum height 15mm) with suitable drainage channel. Landings to have a fall of 1:40-1:60 away from the door. Principal entrance door to have a minimum 775mm clear opening between the door leaf and doorstops.

EXTERNAL SURFACE WATER DRAINAGE


Drainage of paving areas to be carried out in accordance with BS 6367:1983 and Approved Document H.

Hard surfaces around the building should be provided with a proprietary non slip permeable surface laid to manufactures details and in compliance with BS6717, to allow adequate drainage or provided with a non slip surface and cross fall of 1:40 – 1:60 draining away from the building (for a minimum of 500mm) to a suitable soakaway.

Paths, driveways and other narrow areas of paving should be free draining away from any buildings to a pervious area such as grasslands or to a suitable soakaway.



MONOBLOCK SEWAGE TREATMENT PLANT

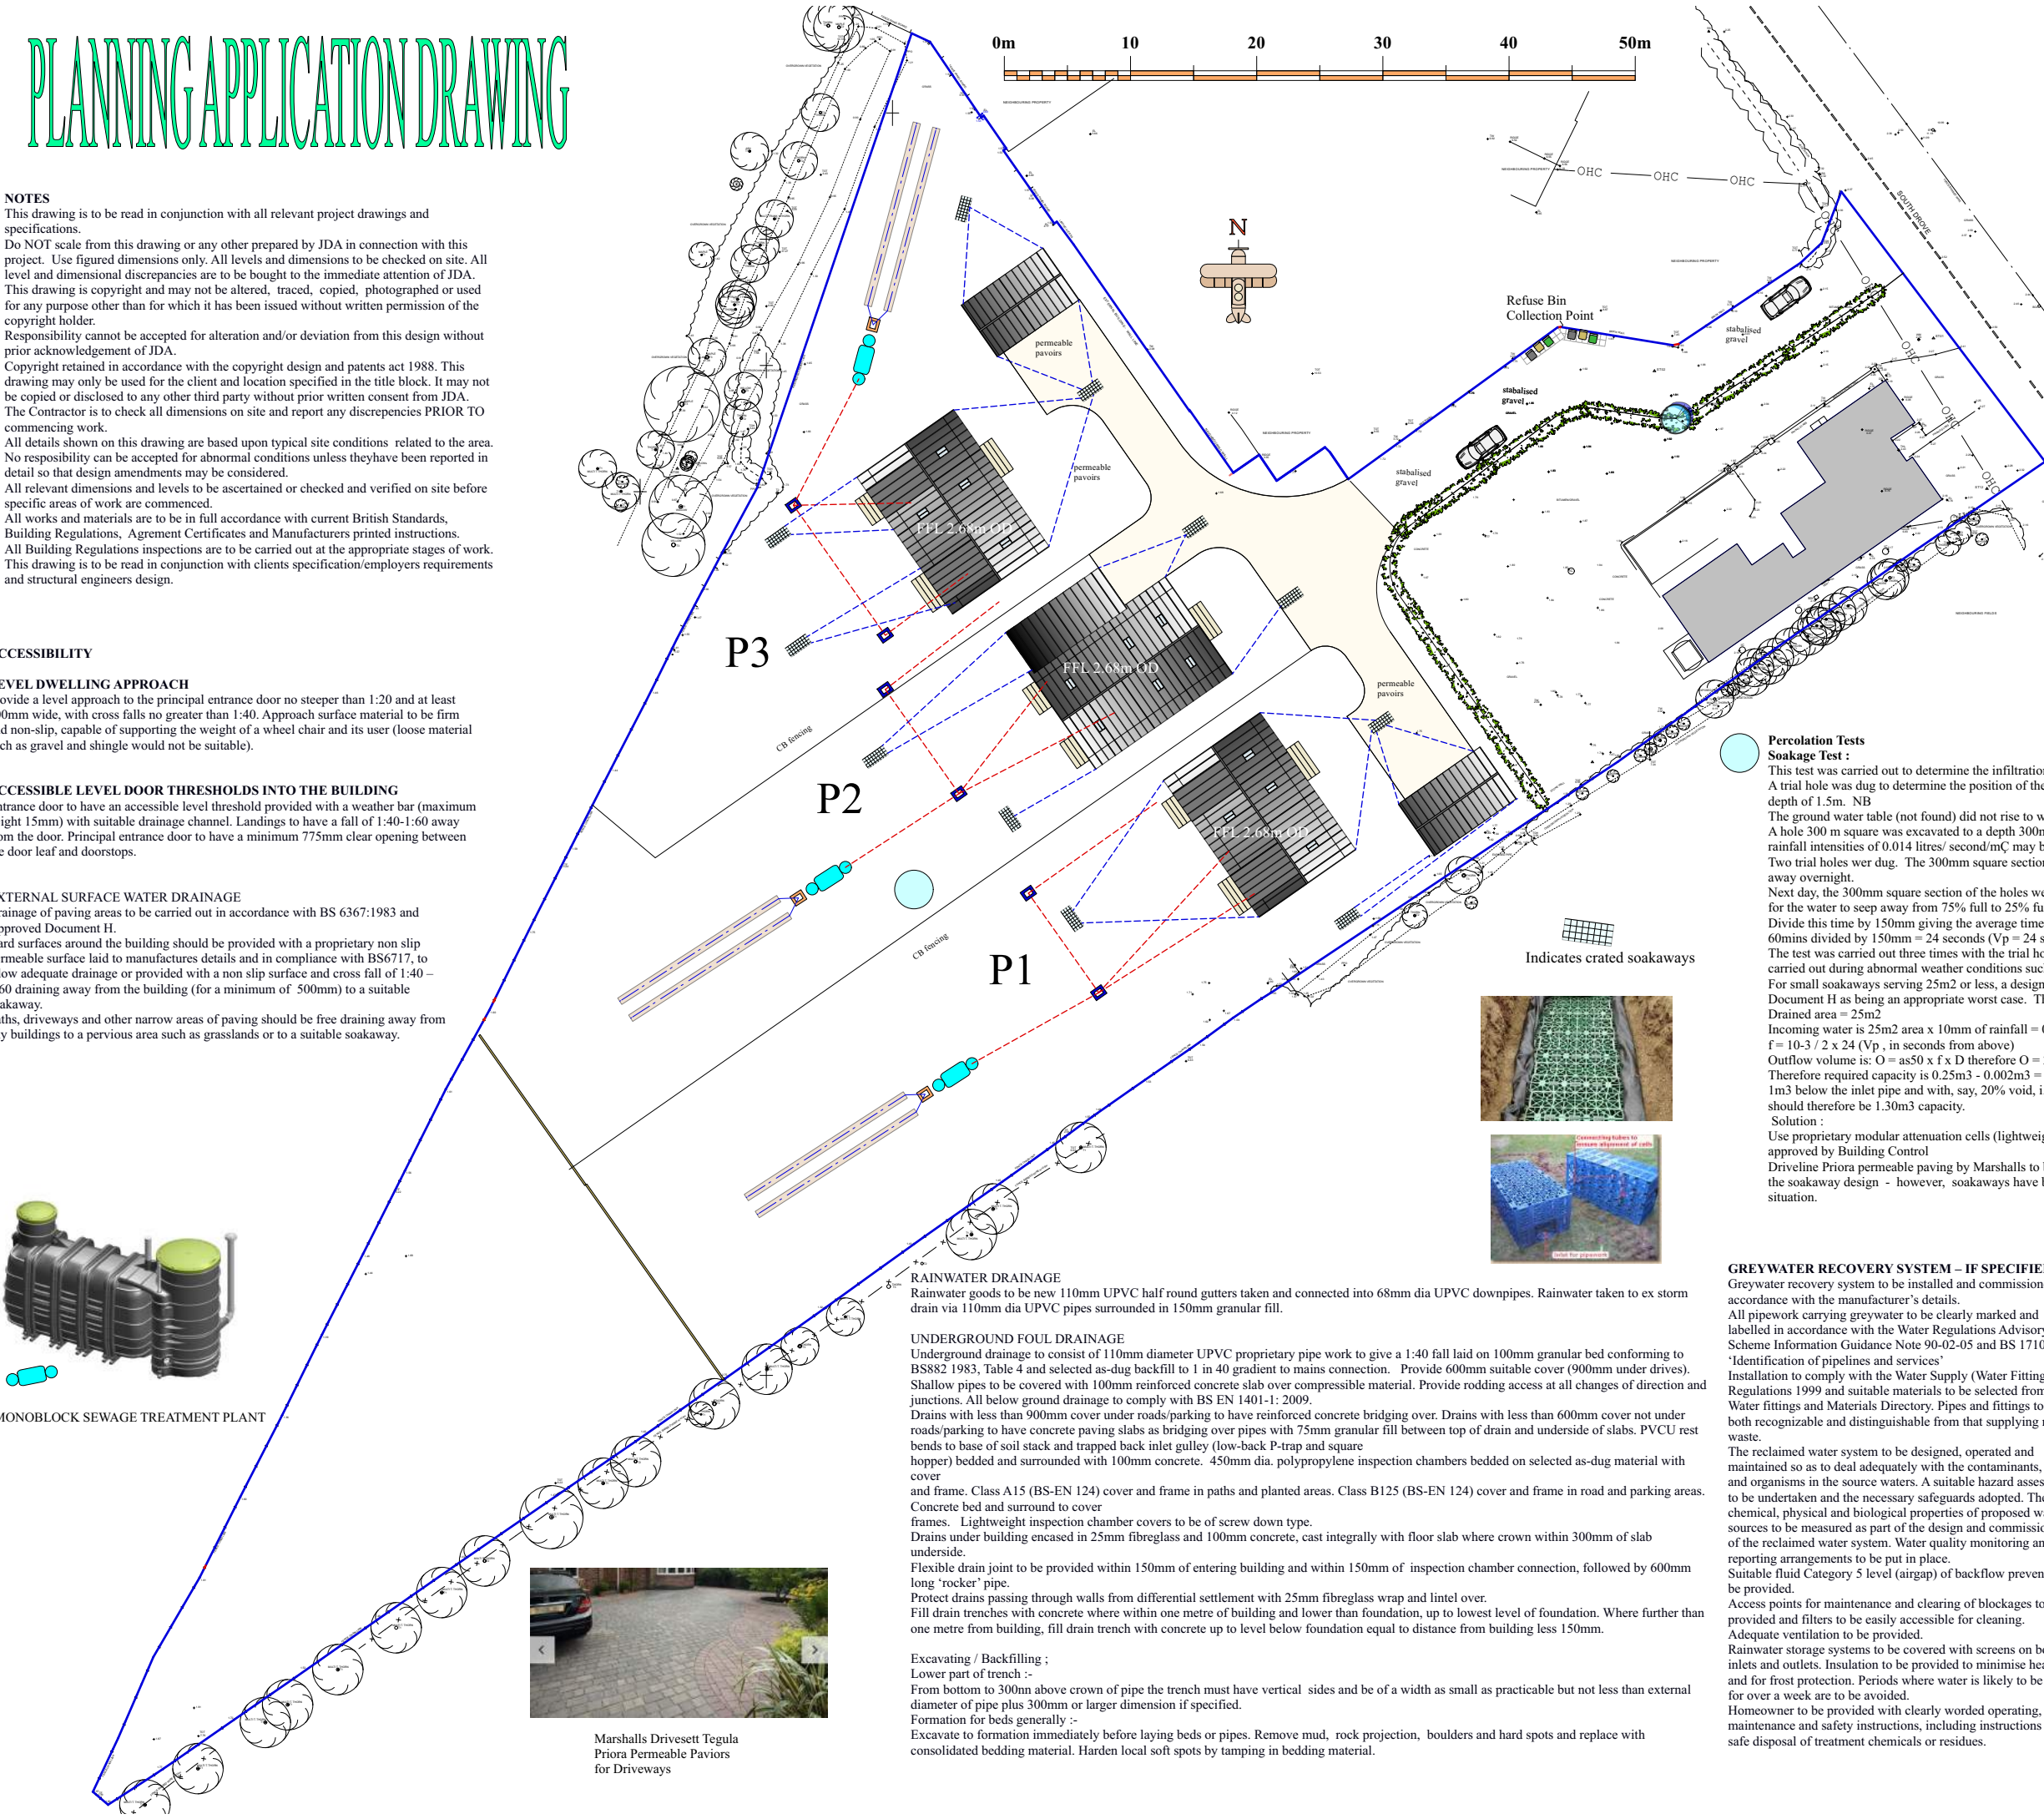


Marshalls Drivesett Tegula Priora Permeable Pavois for Driveways

INSPECTION CHAMBERS

Generally, underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all changes of level, direction, connections and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways. Inspection chambers to be located as shown on drawings. Exact depth and size to be agreed on site with Building Inspector. For chambers with inverts of less than 900mm use Hepworth preformed polypropylene chambers or equal approved. Other chambers to be formed in brickwork. Inspection chambers with inverts greater than 900mm to be purpose built as follows : 225mm thick brick walls in semi-engineering brick laid in English Bond. Bricks with frogs to be laid with frogs uppermost. Heavy duty covers and frames in roads and parking areas, medium duty elsewhere. Joints to be formed with waterproof mortar and to be flush and smooth. Walls to be built of minimum 150mm thick concrete base and dimensions not less than outside dimensions of chamber. Exact depth and size of chambers to be agreed on site with Building Inspector. Back inlet gullies to be bedded and surrounded in 150mm concrete. Gullies to be roddable. Connection to off-site sewers to Local Authority details.

Manhole Covers and Frames :

The manhole covers and frames for roads shall be the heavy duty cast iron non-rocking three point suspension type, constructed in two triangular section and linked together with mild steel bolts, all in accordance with BS 497 (Grade A). They shall be to BS Ref: MA60 or have a 600mm x 600mm clear opening and be either Drainage Castings "Silent Knight" range, cast iron No. DC5037 (Broads No. 70C) or ductile iron No. DC5050 or Stanton and Staveley "Chieftain" ductile iron SS118 or Drainage Castings "Dreadnought" range ductile iron No. DC50553. The medium duty pattern manhole covers and frames for fitment off roads shall be of cast iron and weigh not less than 100kg (2cwt), all in accordance with BS 497 (Grade B). They shall be of the circular type to give clear opening of 600mm (24") or may alternatively be to BS Ref: MB2 - 60/60 with 600mm x 600mm clear opening.



Percolation Tests

Soakage Test :

This test was carried out to determine the infiltration characteristics of the soil and was carried out as follows:

A trial hole was dug to determine the position of the standing ground water table which was not encountered at a max excavation depth of 1.5m. NB

The ground water table (not found) did not rise to within 1.05m of the invert level of the proposed distribution pipes.

A hole 300 m square was excavated to a depth 300mm below the proposed invert level of the incoming drainage pipe. (Design rainfall intensities of 0.014 litres/ second/m² may be assumed for normal situations).

Two trial holes were dug. The 300mm square section of the holes was filled with water to a depth of at 300mm allowed it to seep away overnight.

Next day, the 300mm square section of the holes were again filled with water to a depth of 300mm and time observed, in seconds, for the water to seep away from 75% full to 25% full level (i.e. a depth of 150mm).

Divide this time by 150mm giving the average time in seconds (Vp) required for the water to drop 1mm. In this case - average 60mins divided by 150mm = 24 seconds (Vp = 24 seconds)

The test was carried out three times with the trial hole see plan. The average figure from the tests was taken. The test was not carried out during abnormal weather conditions such as heavy rain, severe frost or drought.

For small soakaways serving 25m² or less, a design rainfall of 10mm in 5 minutes is quoted in the Building Regulation Approved Document H as being an appropriate worst case. The maximum area in this case is 25 sq m.

Drained area = 25m²
Incoming water is 25m² area x 10mm of rainfall = 0.25m³ of water to be disposed of.

f = 10-3 / 2 x 24 (Vp, in seconds from above)

Outflow volume is: O = as50 x f x D therefore O = 2 x 0.0002 x 5 and thus O = 0.002m³

Therefore required capacity is 0.25m³ - 0.002m³ = 0.248m³. Which means that a traditional rubble filled soakaway measuring 1m³ below the inlet pipe and with, say, 20% void, i.e. 0.2m³ storage capacity, will not be adequate and the soakaway volume should therefore be 1.30m³ capacity.

Solution :

Use proprietary modular attenuation cells (lightweight plastic structures with high void ratio) - Polystorm by Polypipe or similar approved by Building Control

Driveline Priora permeable paving by Marshalls to be used for the new driveways - these areas were therefore NOT included in the soakaway design - however, soakaways have been indicated for the private driveway to mitigate against a flash flood situation.



GREYWATER RECOVERY SYSTEM – IF SPECIFIED

Greywater recovery system to be installed and commissioned in accordance with the manufacturer's details.

All pipework carrying greywater to be clearly marked and labelled in accordance with the Water Regulations Advisory Scheme Information Guidance Note 90-02-05 and BS 1710:1984

'Identification of pipelines and services'

Installation to comply with the Water Supply (Water Fittings) Regulations 1999 and suitable materials to be selected from the Water fittings and Materials Directory. Pipes and fittings to be both recognizable and distinguishable from that supplying mains waste.

The reclaimed water system to be designed, operated and maintained so as to deal adequately with the contaminants, solids and organisms in the source waters. A suitable hazard assessment to be undertaken and the necessary safeguards adopted. The chemical, physical and biological properties of proposed water sources to be measured as part of the design and commissioning of the reclaimed water system. Water quality monitoring and reporting arrangements to be put in place.

Suitable fluid Category 5 level (airgap) of backflow prevention to be provided.

Access points for maintenance and clearing of blockages to be provided and filters to be easily accessible for cleaning.

Adequate ventilation to be provided.

Rainwater storage systems to be covered with screens on both inlets and outlets. Insulation to be provided to minimise heat gain and for frost protection. Periods where water is likely to be static for over a week are to be avoided.

Homeowner to be provided with clearly worded operating, maintenance and safety instructions, including instructions for the safe disposal of treatment chemicals or residues.



Stabilised Gravel

John Dickie Associates
Chartered Building Engineers
5, Victor Way, Cherry Holt Road,
Bourne, Lincs PE10 9PT
Tel 07778 297733 jda@ndirect.co.uk

Demolition of Class Q Consented Agricultural Buildings and
Erection of Three Dwellings
Witteman Nurseries
South Drove, Spalding Lincs. PE11 3BD

Drawing Title : Drainage
Date : February 2024
Scales 1 to 500 at A3 Portrait

Drawing No JDA/2024/720/DRAINAGE/001