



Existing velux to be replaced with a fire escape velux
Velux must be 1700mm from the eaves, Between 600 and 1100mm from floor level to the bottom of the openable area.
The velux should have an unobstructed openable area of at least 0.33m2 and be at least 450mm x 450mm.

SECOND FLOOR PLAN

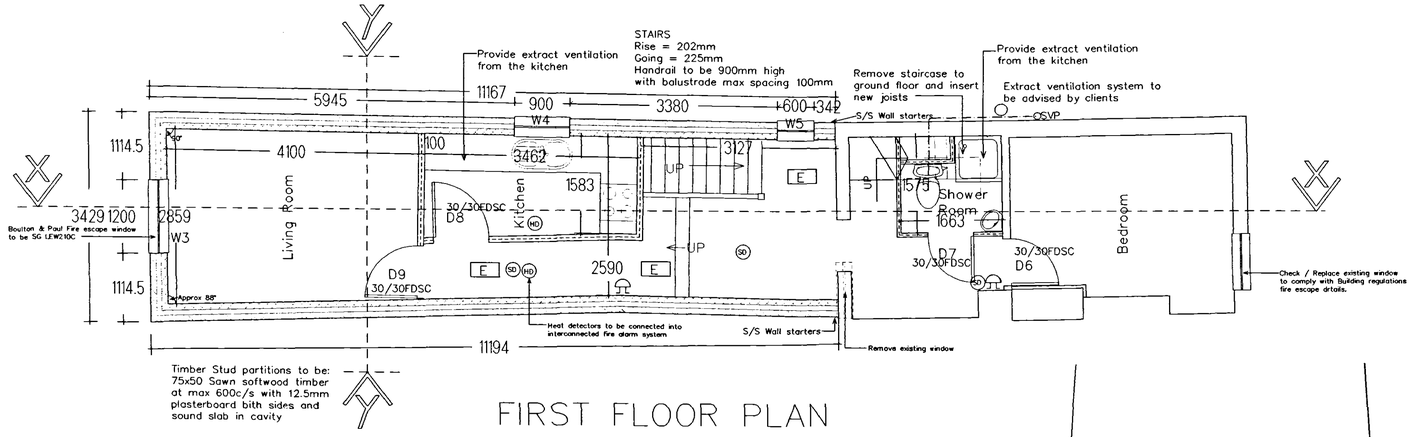

FIRST FLOOR PLAN

ALL DIMENSIONS SUBJECT TO ON SITE CHECKS

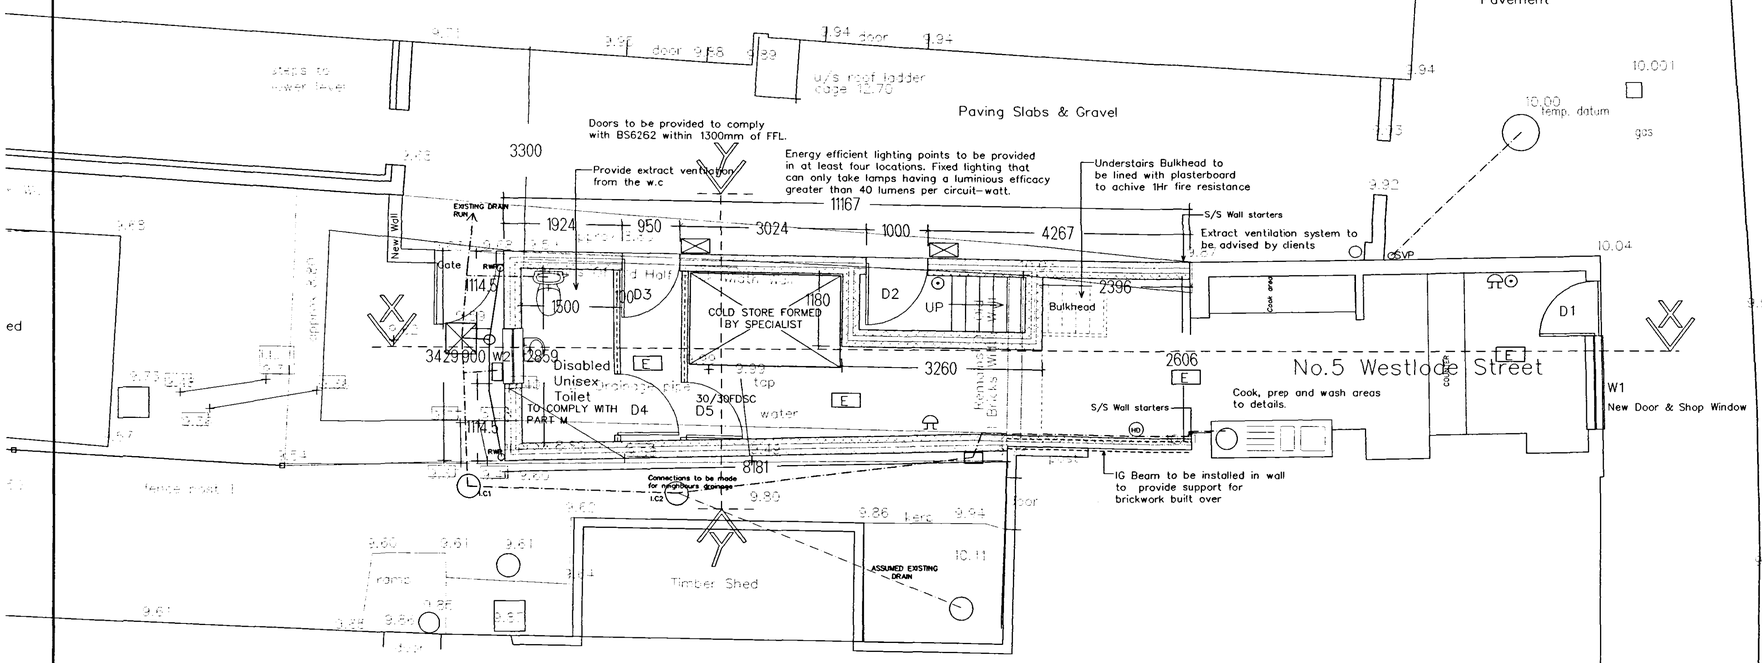

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced photographed, electronicaly copied or used for any purpose other than that for which it is issued, without the written permission from Barry Johnson Architect.

The General Contractor is to check all dimensions on site and report any discrepancy to the Architect.

LEDGEND.
- E — Secondary Lighting
- External Secondary Lighting
- Alarm Sounder
- Alarm Call Point
- Smoke detector
- HD — Heat Detector

SHDC Planning & Development 23 JAN 2006 Ref: 0242/04

AMENDED PLAN
Ref. A3

Revisions

Client
Mrs. Lin. Shi

Job Title
PROPOSED ALTERATIONS
at 5 WESTLODE STREET
SPALDING
LINCOLNSHIRE

Drawing Title
PLANS
AS PROPOSED

Scale	Date	
1:50	17:01:06	C.A.D.

Barry Johnson DipArch, RIBA
Chartered Architect
16 Main Ridge West, Boston
Lincolnshire PE21 6QN
Telephone 01205 367929
Facsimile 01205 358031

Job No.		Drawing No	
1066	A	112	A