


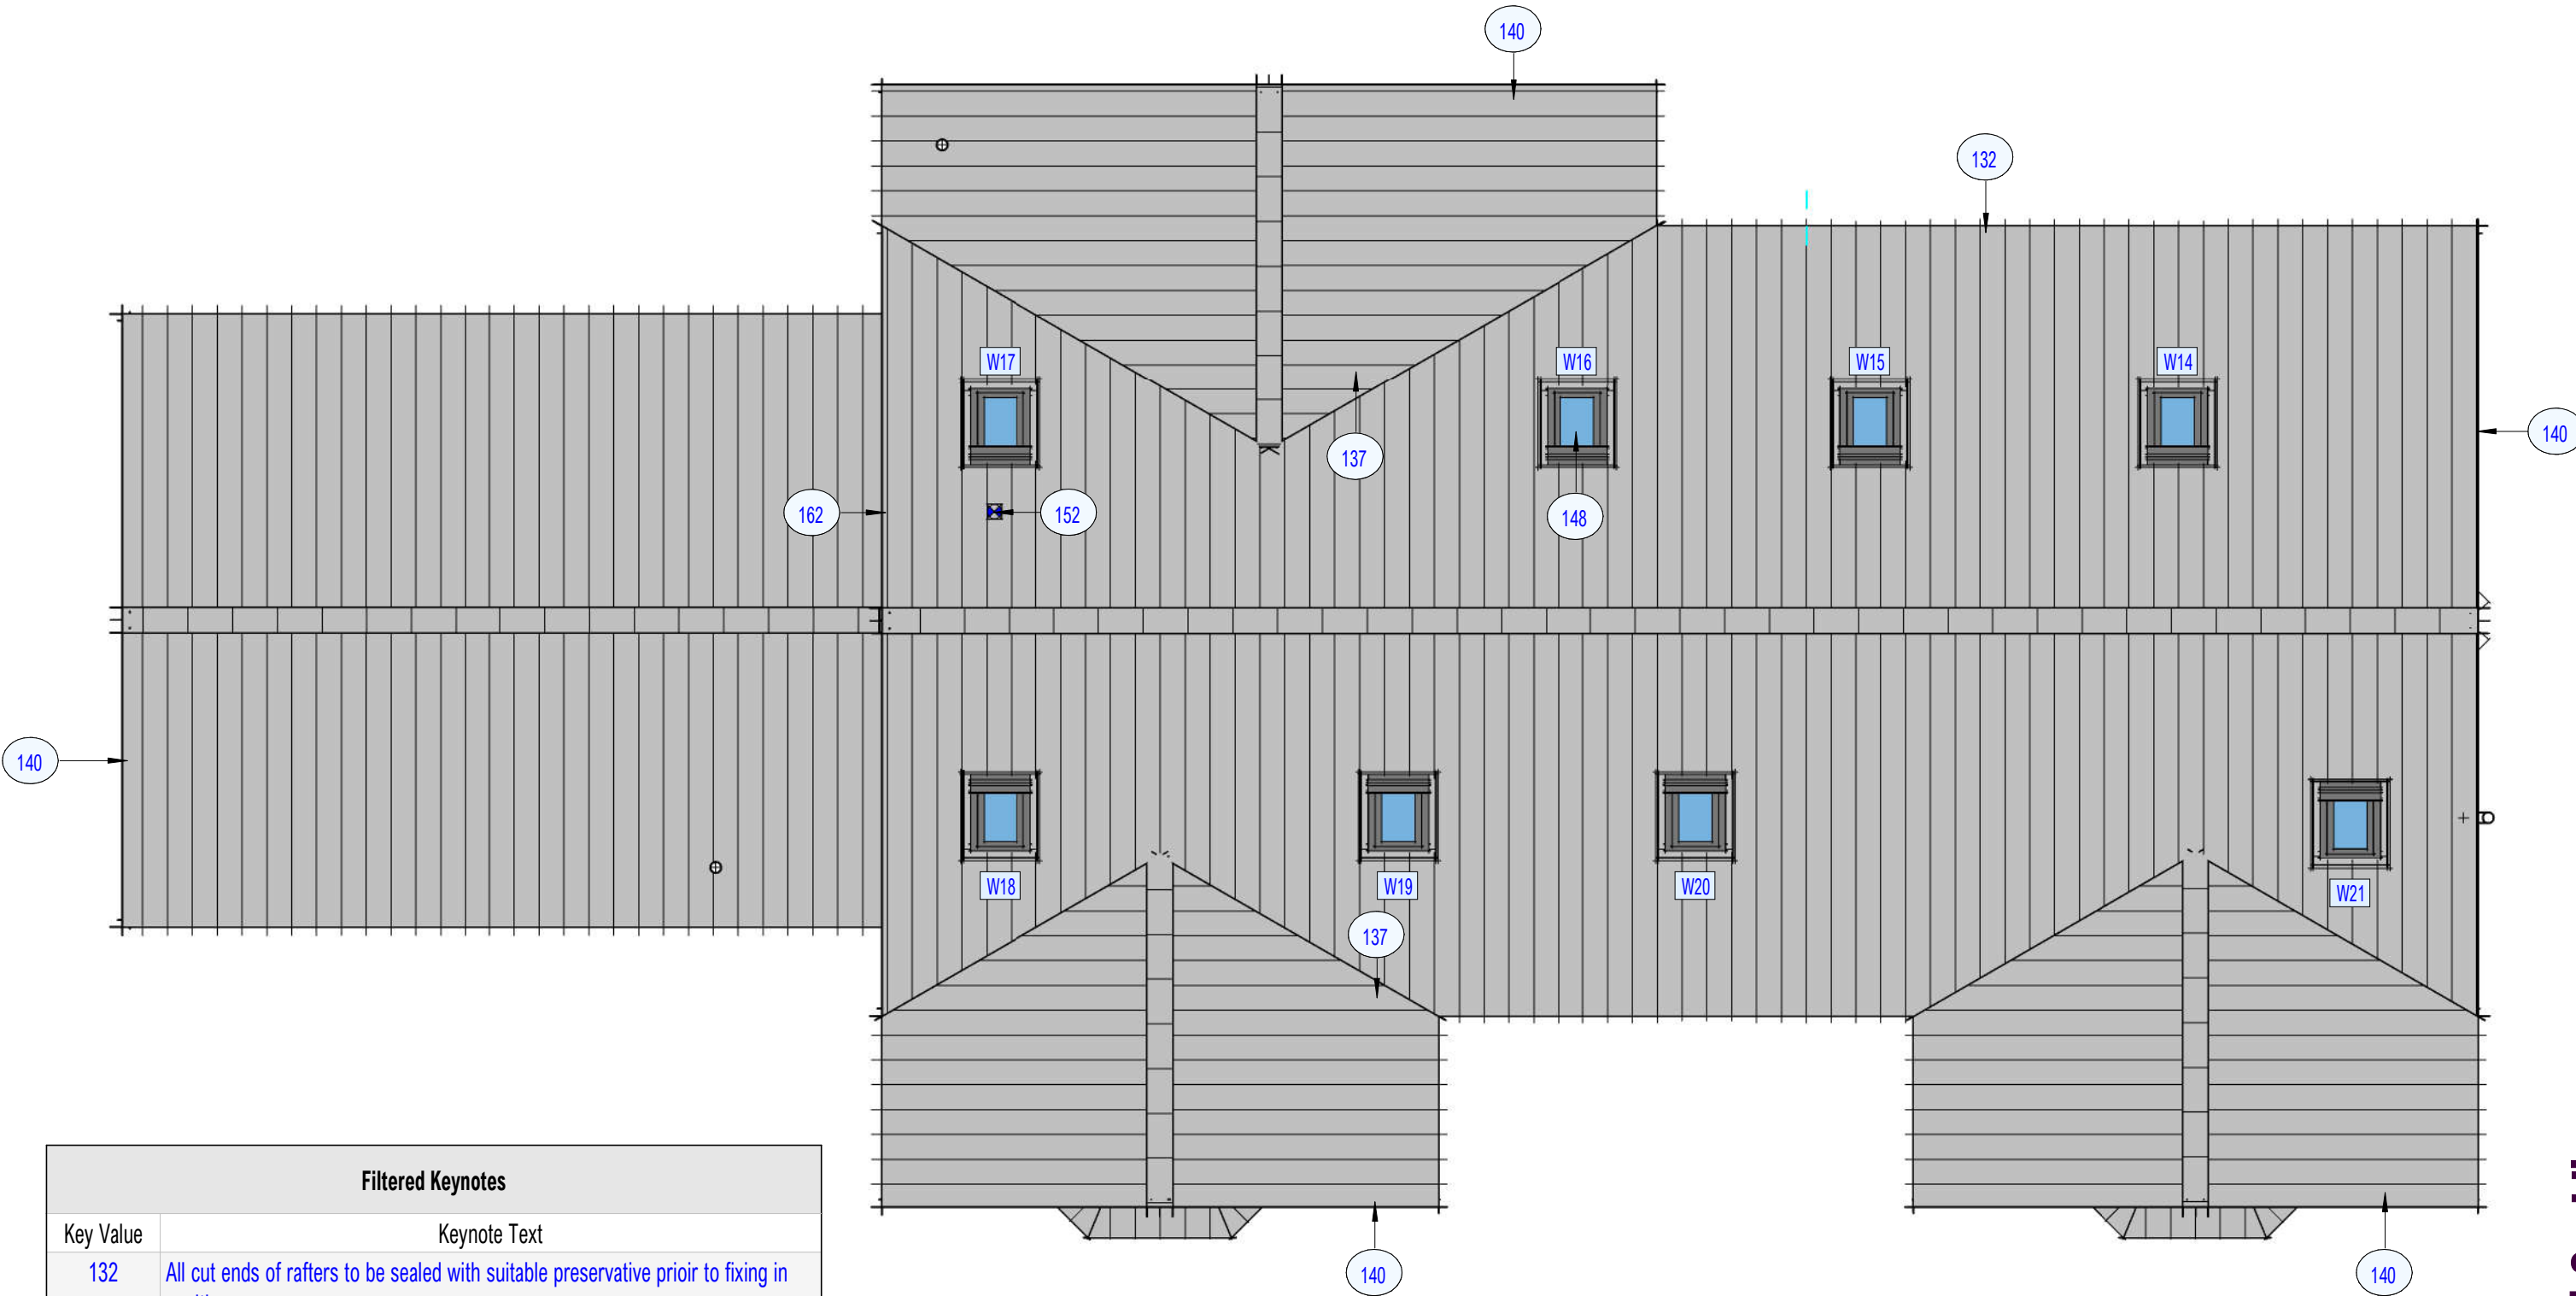

| Filtered Keynotes |                                                                                                                                                                                      |
|-------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Key Value         | Keynote Text                                                                                                                                                                         |
| 132               | All cut ends of rafters to be sealed with suitable preservative prior to fixing in position.                                                                                         |
| 137               | Specialist diminishing trusses built off 100x22 valley boards with Glass Fibre Valley Troughs.                                                                                       |
| 140               | 30x5 m/s straps(S) over 2no. trusses at max 2m ctrs to gable ends and ceiling level. At least 1no. gable strap to be within 500mm of ridge. Provide solid noggings under each strap. |
| 148               | Velux rooflights to be fitted in accordance with manufacturers instructions.                                                                                                         |
| 152               | Tile vent to Extractor fan                                                                                                                                                           |
| 162               | Provide Code 4 Lead flashing with min. 150mm upstand with Preformed Cavity trays and weep holes to all Wall & Roof Abutments, Lead to be oiled prior to placement                    |