SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H16/0330/93 Received:07-APR-93 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 7EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 7EG

Description: Erect 11,000 kV overhead line

Location : Parish of Spalding

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Any installation, renewal or repositioning of electricity lines should conform to the requirements of ESI Standards with particular reference to `clearances'.

Reason: To ensure that adequate vertical clearance is maintained above the trunk road carriageway for vehicular traffic in the interests of road safety.

The finished road levels should be considered when assessing overhead line clearances and also the use of abnormally high construction vehicles.

Reason: To ensure that adequate vertical clearance is maintained above the trunk road carriageway for vehicular traffic in the interests of road safety.

Director of Planning and Building Control Services
26-MAY-93 H16/0330/93

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

H16/0330/93
07 APR 1993

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road
BOSTON

Postcode: PE21 7EG

Telephone Number: 0205 365181

PART I

East Midlands Electricity plc Application Number EM120/21/42714 Date 1 April 1993

To the Chief Executive Planning Department Council South Holland District Council
Priory Road
SPALDING
PE11 2XE

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

D. Tuley.

(D A Tuley)
Designation. Planning Engineer

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The **South Holland** District/[redacted] Council

(i) [redacted]/have no objection to make to the development described overleaf.*

(ii) [redacted]/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date **26 May 93** Signed

*Delete as appropriate

Designation **Director of Planning & Building Control Services**

On behalf of the **South Holland** District/[redacted] Council

(Reasons for objections)

East Midlands Electricity plc Application Number EM120/21/42714

(Application dated 1 April 1993)

PART II—INFORMATION AND OBSERVATION

(To be completed by the District/~~Borough~~ Council)

Planning Reference Number H16/0330/93

1. Names of interested parties consulted about the proposals with details of any observations received.

Ward Members — **No objections**

Highways & Planning Department - **No objections**

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

None

3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?

No

APPLICATION ASSESSMENT

Notes for Case Officer

Spoke to Joe 7-5
He thought should be undergrd
of poles All cables not again
Spoke to Joe 14-5 comments received

Site Inspection

Accuracy :
Neighbours :
Boundaries :
Site Features :

Inspected by PJM
Date 16-5

Site Notice posted by
Date
Expiry

Individual Resident Notices required:

Addresses to be sent to –

Addresses delivered to –

Case Officer Conclusions

No trees or listed buildings appear to be affected

dh

RECOMMENDATION

COMMITTEE

Departure from Policy .....

Ward Member request .....

Recommend approval against material objection .....

Other circumstances viz: .....

Change to Committee recorded:

Decision confirmed as agenda:

DELEGATED/Non-Det

Case Officer Recommendation

Approve ✓ (or equiv)

Refuse (or equiv)

Signed PJM Date 19-5

Notes:

☐ Disabled
☐ Prev conditions
☐ Amended plans – Dwg no: Received:
other ✓

Conditions/Reasons (cont overleaf)

Add DOT comments i) + ii) to notice. as a NOTE

DC INSTRUCTION SHEET

APPLICATION REF:

Directions

Art 7 (Outlines)

☐ RM checklist

	Sit	Des	Ext	Acc	Land
Previous					
Current					
Required					

Reg 4 Scale drawing.... Highway S/W.... Agric appraisal....

☐ Non Std | Precise details:

Direction authorised by Senior Officer..... Date.....

Revalidation after Direction

Information satisfactory Signed..... Date.....

Valid date: Reconsultations:

Amended description | All.....

Specified:

Unsatisfactory – Further direction:
Signed.....
Senior Off.....

Precise details:

Consultation/Publicity Required

P211 14-4.
DT2 14/4

		Publicity:	Consultations:	
Departure		.....	County	.....
Setting of LB		.....	E Heritage	.....
Public Right of Way		.....	Societies	.....
Discretionary		.....		

Extra Consultations:

Transport	D o Transp	✓	*	
	B Rail	.....		
Environment	Env Services	.....		
	NRA	.....		
	Env Assess	.....	G *	Specify:
Conservation	LB Demolish	.....	G *	Standard
	Eng Heritage	.....		
	Archaeology	.....	G	Specify:
	Consultant	.....		
	Other	.....		Specify:
Hazards	HSC Group	.....	G *	Standard
	Specific	.....	G	Specify:
Other		.....		Specify:

Case Officer

Senior Officer Confirmed ..... Date..... Recorded DC....

P4

ADMIN RECORD SHEET

Initial

Submitted Fee £ NIL

Receipt No

Date first Rec'd 07 APR 1993

Registration

Reference H16/0330/93

Cross-Ref N/A

Date 8/4

Validation

TYPE OEL

Site area
No of dwellings
Floorspace

Earlier permission – Ref:
New/Redevelop/Use/Ext/Alt/Works

Description to be recorded

Invalid
Site plans
Certificate

Fee
Fee (not free)

Inaccurate
Incomplete
Unclear

Fees
Correct fee £

Nil fee
Discounted

Previous app – ref:
Type of app
Reason:

Additional £
Refund £

Receipt No
Voucher No

Date
Date

Information

Index sheet 169
Grid ref 526560 324450

Ward Q

Parish SPALDING

Inside IBD NO

Inside LP area YES

Constraints:

N	CA Cons Area	
N	LB Listed – Grade:	
N	ARC Archaeology	
N	AM Ancient Mon	
N	SSI Special Int	

N	TR Rural	
N	BP TR proposed 67m	
N	LC Level Cross	
N	FP Footpath	
N	TPO Tree Pres	

Hazards –

Y	HAZ Site Sugar Beet
N	AIR Safeguard
N	LIN Elect
N	PIP Pipe
N	CON Waste/contamin

Linked to site Ref 1256 — N — Dist Bound

Linked to property Ref — N — Other:

Planning Records: 211/88 EME
Earlier apps

B Reg Records:
Already submitted – Ref:
Request needed
Requested

21st May 1993

NRA

National Rivers Authority
Anglian Region

B Smith Esq
District Planning Officer
South Holland District Council
Council Offices
Priory Road
SPALDING
Lincolnshire
PE11 2XE

Our Ref: 93/1/SH/0135
Contact: G.THORNALLEY

Dear Sir,

Planning Application No. H16/330/93

PROPOSAL: ERECTION OF AN 11,000 KV OVERHEAD LINE
LOCATION: SPALDING & SUTTERTON BYPASS A16 SPALDING
APPLICANT: EAST MIDLANDS ELECTRICITY PLC

I refer to your consultation received on 11th May 1993.

This Authority has no objection to the proposed development, as submitted.

Yours faithfully

P.Morgan
Planning Engineer

S.H.D.C. PLANNING DEPT.
RECEIVED
26 MAY 1993 N
Action by .....
Copies to .....

GRAINGER DAVIES, B.Sc.,
C.Eng., F.I.C.E., F.I.W.E.M.
Regional General Manager

Northern Area
Aqua House
Harvey Street
Lincoln
LN1 1TF
Tel: (0522) 513100
Telefax: (0522) 512927

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H16/0330/93 Received:07-APR-93 Type:ELECTRICITY

Name: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 7EG

Agent: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 7EG

Description: Erect 11,000 kV overhead line

Location : Parish of Spalding

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Any installation, renewal or repositioning of electricity lines should conform to the requirements of ESI Standards with particular reference to `clearances'.

Reason: To ensure that adequate vertical clearance is maintained above the trunk road carriageway for vehicular traffic in the interests of road safety.

The finished road levels should be considered when assessing overhead line clearances and also the use of abnormally high construction vehicles.

Reason: To ensure that adequate vertical clearance is maintained above the trunk road carriageway for vehicular traffic in the interests of road safety.

Director of Planning and Building Control Services
10-AUG-93 H16/0330/93

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H16/0330/93

Applicant: East Midlands Electricity plc
Sleaford Road
Boston
Lincs
PE21 7EG

Agent: East Midlands Electricity p
Sleaford Road
Boston
Lincs
PE21 7EG

Description: Erect 11,000 kV overhead line

Location: Parish of Spalding

Type: ELECTRICITY

APPLICATION DETERMINED BY SECRETARY OF STATE - SUMMARY OF DECISION

Planning permission has been granted by the Secretary of State, or is deemed to have been granted, on conditions set out below or attached.

1 The development to which this permission relates shall be begun not later than the expiration of 5 years beginning with the date hereof.
Reason: To comply with the provisions of Section 91(1) of the 1990 Act.

2 The Company shall dismantle & remove from the site any redundant lines & apparatus within 6 months from the date of commissioning of the lines
Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

S. Holland DC

Department of Trade and Industry
Electricity Division
1 Palace Street
London SW1E 5HE

Fax No. 071 834 3771
Switchboard 071 238 3000
Direct Line 071 238 3634/3711

The Secretary
East Midlands Electricity plc
Boston

Dear Sir

Our Reference OL/266/2392

Date 2 JUL 1993

OVERHEAD LINES
ELECTRICITY ACT 1989
TOWN AND COUNTRY PLANNING ACT 1990.

With reference to the application particulars of which are specified below, I am directed by the Secretary of State to inform you that consent is hereby granted pursuant to section 37(1) of the Electricity Act 1989 ("the 1989 Act") to the installing above ground of electric lines ("the lines") particulars of which are specified below.

Pursuant to section 37(3) of the 1989 Act this consent is given subject to the following conditions:

1. The Secretary of State may review this consent at any time after a period of five years from the date hereof, and upon such review, after giving all persons concerned an opportunity of being heard, he may vary or revoke his consent.

2. If the Secretary of State revokes this consent the lines shall be removed within such period as the Secretary of State may direct.

Pursuant to section 90(2) of the Town and Country Planning Act 1990 ("the 1990 Act") the Secretary of State hereby directs that planning permission for the development shall be deemed to be granted subject to the following condition(s):

1. The development to which this permission relates shall be begun not later than the expiration of five years begining with the date hereof.

Reason: To comply with the provisions of section 91 (1) of the 1990 Act.

2. The Company shall dismantle and remove from the site any redundant lines and apparatus within six months from the date of commissioning of the lines.

Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

PLANNING AUTHORITY REFERENCE: H16/0330/93

APPLICANT COMPANY: East Midlands Electricity plc

DATE AND REFERENCE OF APPLICATION: 2 June 1993 EM 21/120-42714

PARTICULARS OF OVERHEAD LINES:

Situated in the District of South Holland

Route as indicated on Map No 92/42714 or within a distance not exceeding 30 metres on either side thereof.

Voltage 11,000

Yours faithfully

D. R. JOHNSON

Authorised by the Secretary of State

E N SMITH Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

H16/0330/93
ELECTRICITY

Applicant: East Midlands Electricity plc Agent: East Midlands Electricity
Tel: 0205 365181 0205 365181

Description: Erect 11,000 kV overhead line

Location: Parish of Spalding

Valid date:	07-APR-93	Terminal date:	02-JUN-93
Target dates:		Target Committee:	12-MAY-93
To case officer	14-APR-93	Report deadline:	28-APR-93
Inspected by	21-APR-93		
Extra contacts	28-APR-93	Case Officer:	
Report if not clear by	12-MAY-93	P J UDY	

DEVELOPMENT/CONSTRAINTS

Size:
Category: Misc works
Listed building: Other Constraints: HAZ
Conservation Area:

CONSULTATIONS CARRIED OUT

	Sent	Expiry
Cllr E N Davies	15-APR-93	29-APR-93
Cllr J Goodley	15-APR-93	29-APR-93
Vacant	15-APR-93	29-APR-93
Department of Transp 0602 476121	15-APR-93	13-MAY-93 (28 days)

L.C.C. - No objections JCB 26/4/93

SITE DETAILS

Grid ref: 526560 324450
OS Sheets: 165 Parcel:

LK

THE DEPARTMENT OF TRANSPORT

EAST MIDLANDS REGIONAL OFFICE
NETWORK MANAGEMENT AND
CONSTRUCTION DIVISIONS
CRANBROOK HOUSE CRANBROOK STREET
NOTTINGHAM NG1 1EY
SWITCHBOARD 0602 350602
DIRECT LINE 0602 352469
FAX 0602 799743
GTN 6202

The District Planning Officer
South Holland District Council
Council Offices
Priory Road
SPALDING
Lincolnshire
PE11 2EX

Your Ref: H16/0330/93

Our Ref: EMRT F 265238

Date: 17th May 1993

S.H.D.C. PLANNING DEPT.
RECEIVED
18 MAY 1993 PJ

Attention of
DPO
DOPO BS
JC ACP
Action by .....
Discuss with .....
Copy to .....

File Nos.

Acknowledge YES/NO
by
date

For the attention of: P J Udy, Esq

Dear Sir

PROPOSED ERECTION OF 11,000 VOLT OVERHEAD LINE AT THE PARISH OF SPALDING
A16 SPALDING-SUTTERTON IMPROVEMENT

Thank you for the consultation under the D.O.E. Circular 14/90 submitted by East Midland Electricity Plc to erect a new overhead power line on the east side of the Spalding Bypass for the Ashtree Lane/Springfields overhead line alterations and existing overhead line crossing the new trunk road to the north.

I would not wish to raise objection to the proposals or indicated on the deposited plan drawing number 92/42714 dated 3rd December 1992 subject to the following conditions:-

i) Any installation, renewal or repositioning of electricity lines should conform to the requirements of ESI Standards with particular reference to 'clearances'.

ii) The finished road levels should be considered when assessing overhead line clearances and also the use of abnormally high construction vehicles.

Reasons for conditions advised above:-

To ensure that adequate vertical clearance is maintained above the trunk road carriageway for vehicular traffic in the interests of road safety.

Yours faithfully

J J BACH
for Director of Network Management & Construction

cc FAO: C Briggs/Development Control Section, Lincs CC.

H1 0/93330 APR | 93

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road
BOSTON

Postcode: PE21 7EG

Telephone Number: 0205 365181

PART I

East Midlands Electricity plc Application Number EM120/21/42714 Date 1 April 1993

To the Chief Executive Planning Department

Council South Holland District Council
Priory Road
SPALDING
PE11 2XE

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

OFFICE COPY

D. Tuley.

(D A TULEY)

Designation. Planning Engineer

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The District/Borough Council

(i) object on the grounds set out below/have no objection to make to the development described overleaf.*

(ii) request/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date Signed

*Delete as appropriate

Designation

On behalf of the District/Borough Council

(Reasons for objections)

PARTICULARS OF PROPOSED DEVELOPMENT AND REPRESENTATIONS

(To be completed by East Midlands Electricity plc)

Application is being made:

(a) for consent under section 37 of the Electricity Act 1989 to install or keep installed an electric line above ground;

(b) for a direction under section 90(2) of the Town and Country Planning Act 1990 that planning permission for the proposed development be deemed to be granted.

1. Particulars of proposed development. (These particulars should be accompanied by such plans as may be necessary to enable the local planning authority to identify the land affected by the proposals and to appreciate the nature and extent of the proposed development and by a copy of the environment statement if the applicant has prepared one.)

To erect the proposed 11,000 kV overhead line on wooden poles in the parish of Spalding, with a tolerance of 30 metres either side of the route shown on the attached plan no: 42714.

2. Particulars of any representations of objections which have been made to East Midlands Electricity plc.

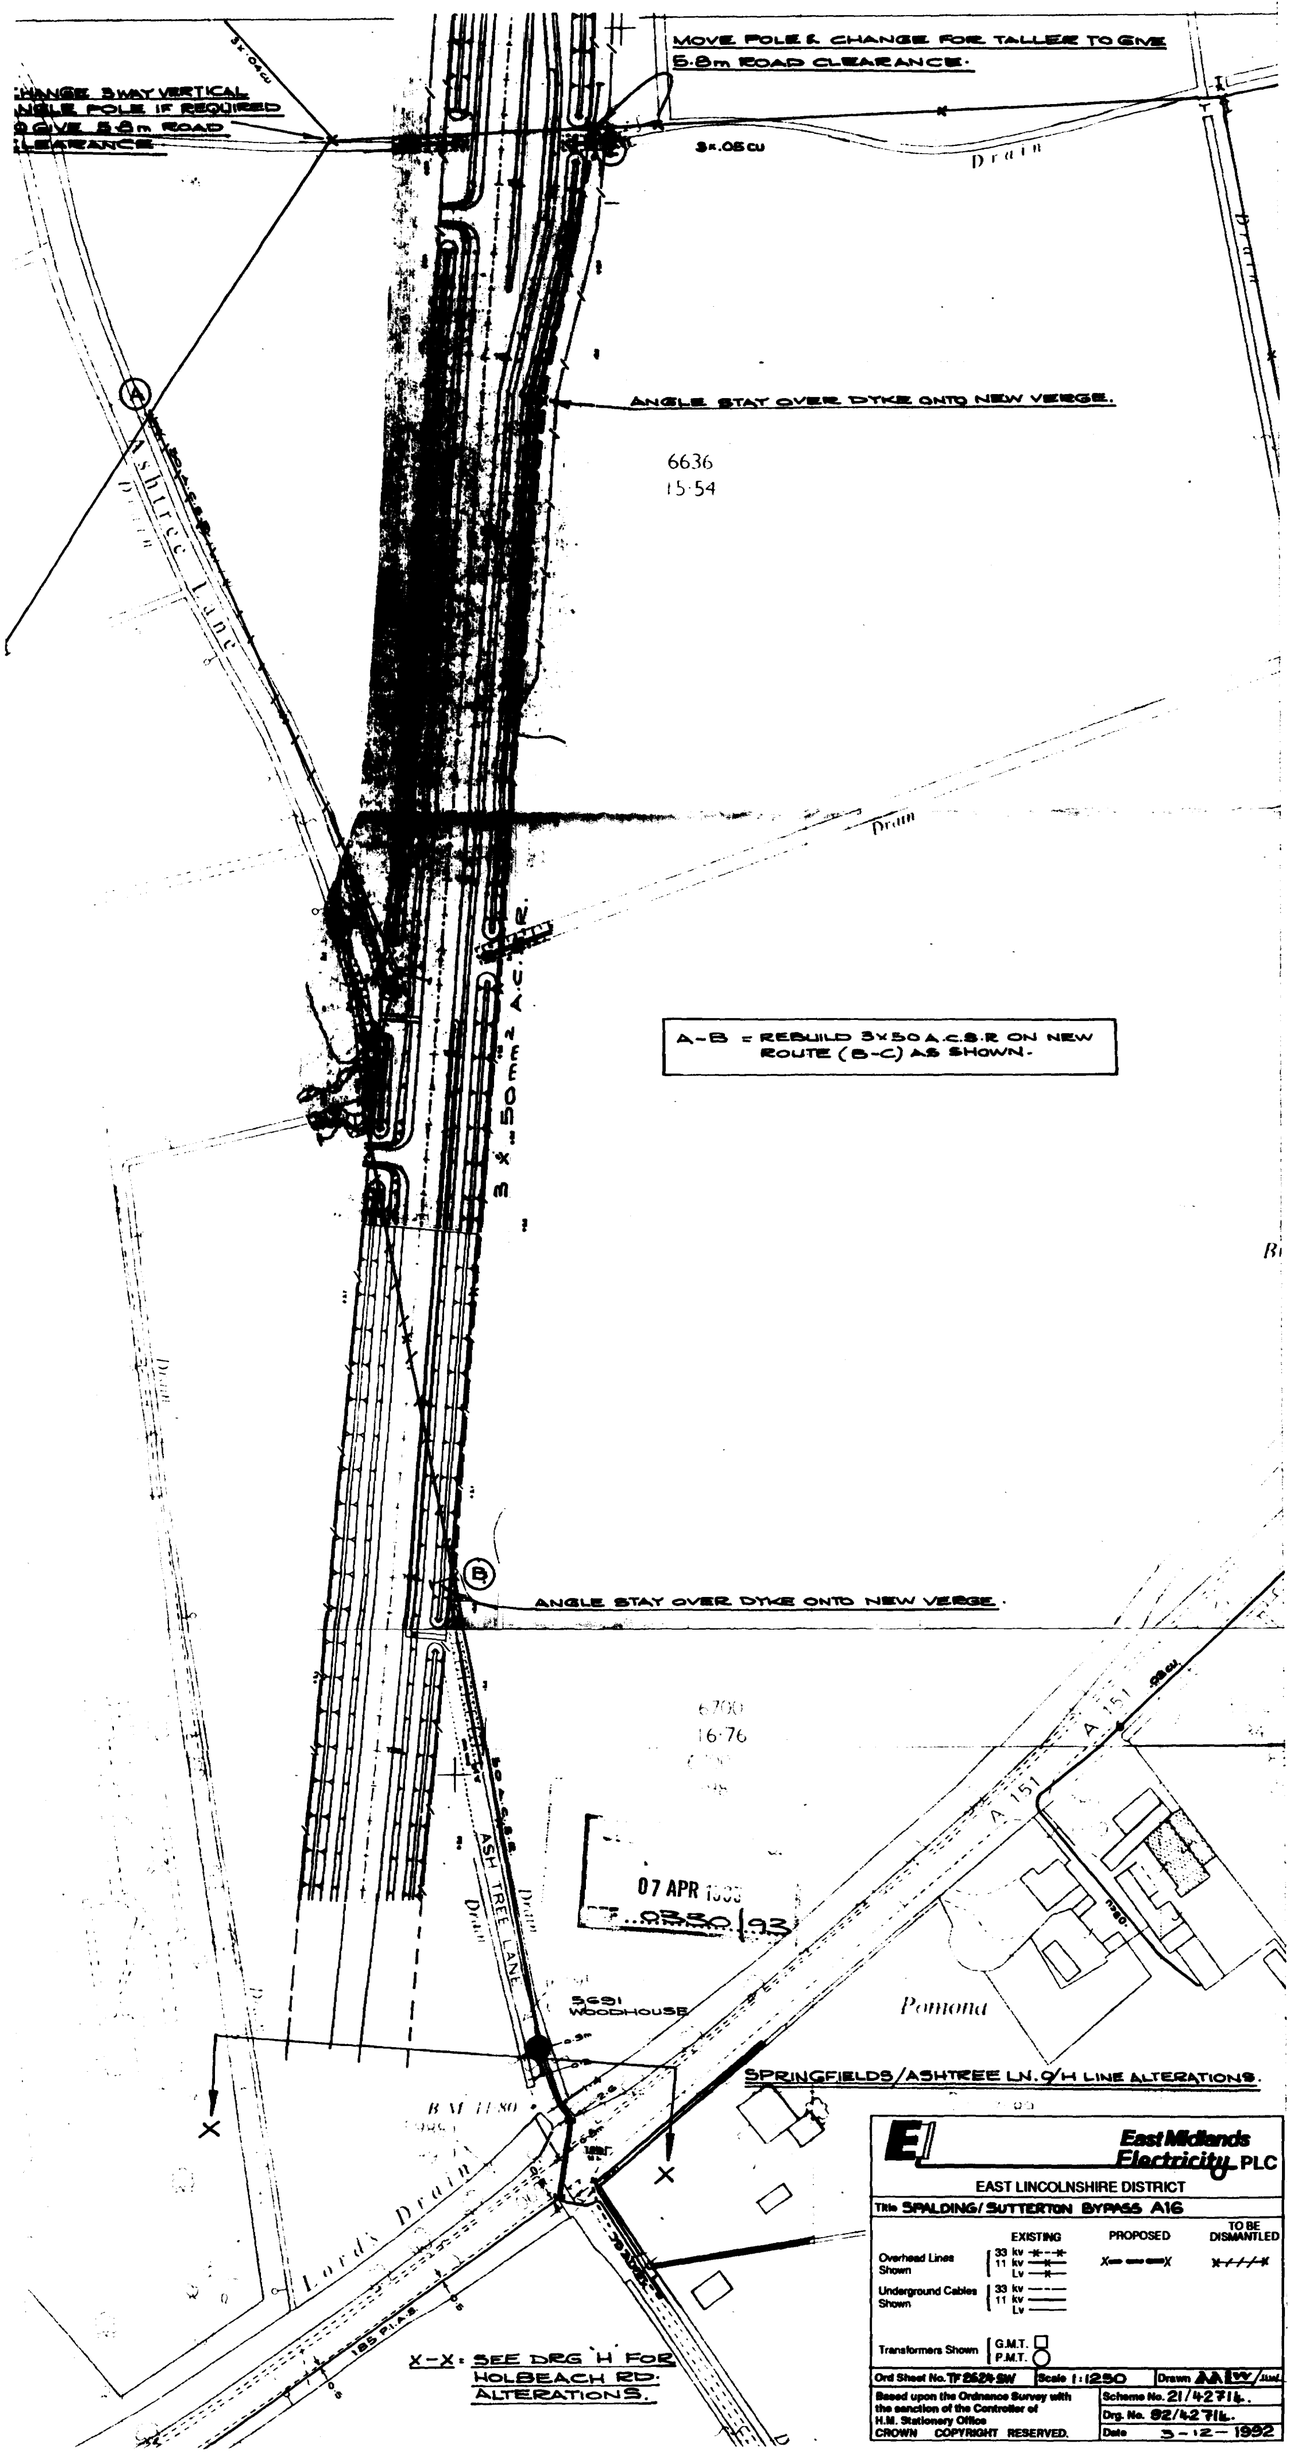
3. Particulars of the applicant's compliance with his duty under paragraph 1 of Schedule 9 to the Electricity Act 1989.

East Midlands Electricity plc consider that the proposed overhead line will not have any significant impact on the surrounding landscape, and that due regard has been paid to their cbligations under Schedule 9.

Date 1 April 19 93 For and on behalf of East Midlands Electricity plc.

Signed D. Tuley (D A Tuley) Designation Planning Engineer

Note: This Part to be completed, dated and signed before submitting to the local planning authority.


MOVE POLE & CHANGE FOR TALLER TO GIVE 5.8m ROAD CLEARANCE.
CHANGE 3 WAY VERTICAL ANGLE POLE IF REQUIRED TO GIVE 5.8m ROAD CLEARANCE.
3x.05 CU
Drain
ANGLE STAY OVER DYKE ONTO NEW VERGE.
6636
15·54
Ashtree Lane
A-B = REBUILD 3x50 A.C.S.R ON NEW ROUTE (B-C) AS SHOWN.
3 x 50 mm² A.C.S.R.
ANGLE STAY OVER DYKE ONTO NEW VERGE.
6700
16·76
A 151
98 CU
ASH TREE LANE
Drain
07 APR 1993
0330/93
5691
WOODHOUSE
Pomona
BM 11·80
Lord's Drain
185 PIAB
X-X = SEE DRG 'H' FOR HOLBEACH RD. ALTERATIONS.
SPRINGFIELDS/ASHTREE LN. O/H LINE ALTERATIONS.
East Midlands Electricity PLC
EAST LINCOLNSHIRE DISTRICT
Title SPALDING/SUTTERTON BYPASS A16
EXISTING
PROPOSED
TO BE DISMANTLED
Overhead Lines Shown
33 kv
11 kv
Lv
Underground Cables Shown
33 kv
11 kv
Lv
Transformers Shown
G.M.T.
P.M.T.
Ord Sheet No. TF 2529 SW
Scale 1:1250
Drawn AA/W/Asst.
Based upon the Ordnance Survey with the sanction of the Controller of H.M. Stationery Office
CROWN COPYRIGHT RESERVED.
Scheme No. 21/42714.
Drg. No. 82/42714.
Date 3-12-1992