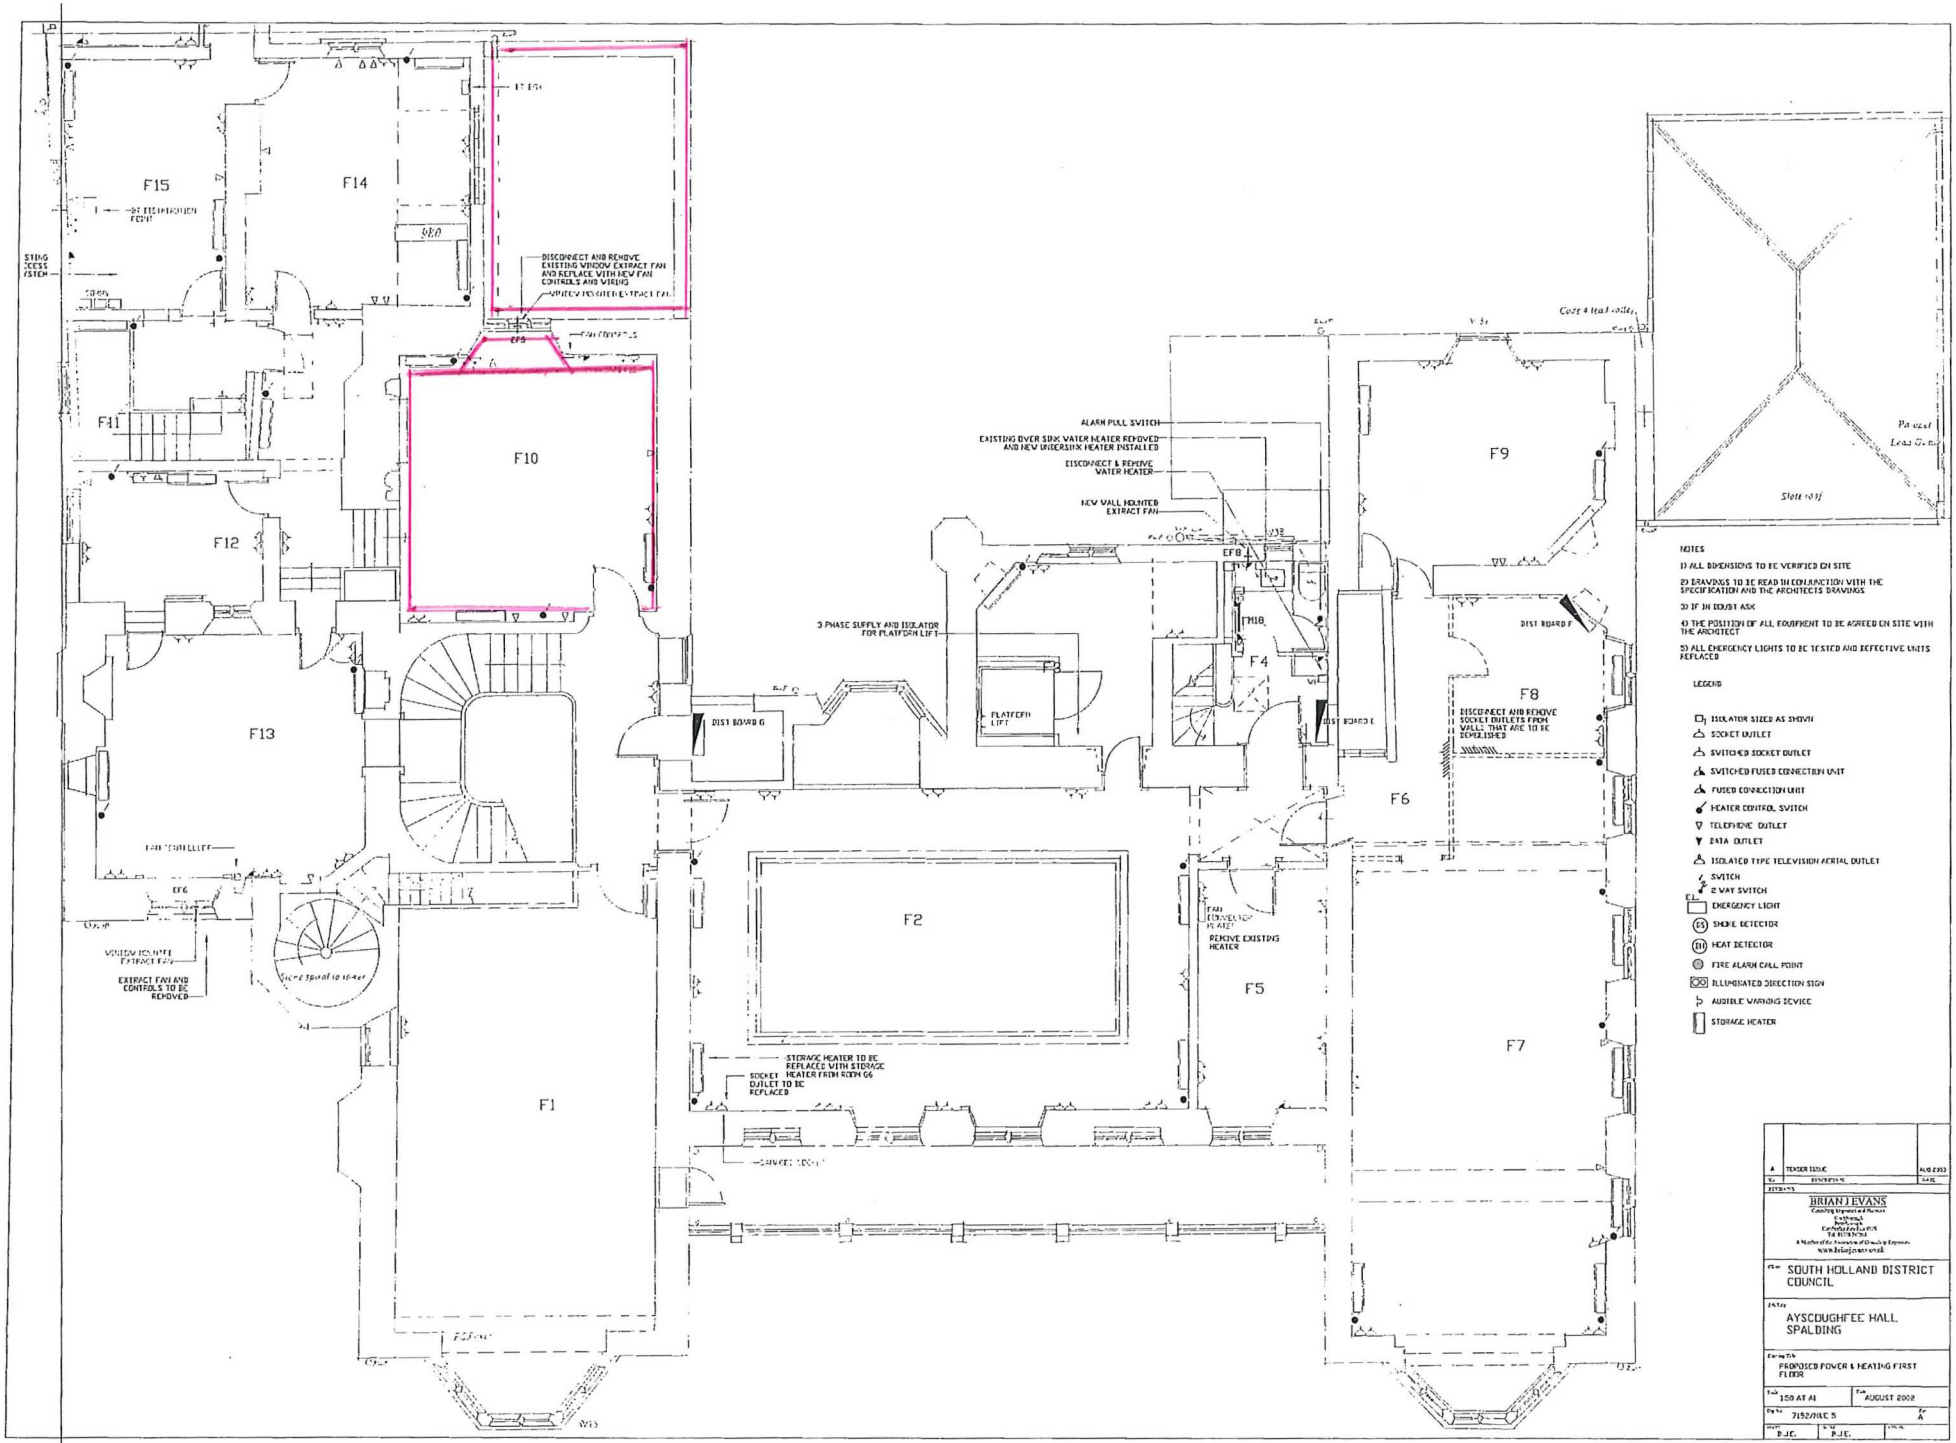

F15
F14
F11
F10
F12
F13
F1
F2
F4
F5
F6
F7
F8
F9
DISCONNECT AND REMOVE EXISTING WINDOW EXTRACT FAN AND REPLACE WITH NEW FAN CONTROLS AND WIRING
WINDOW MOUNTED EXTRACT FAN
ALARM PULL SWITCH
EXISTING OVER SINK WATER HEATER REMOVED AND NEW UNDERSINK HEATER INSTALLED
DISCONNECT & REMOVE WATER HEATER
NEW WALL MOUNTED EXTRACT FAN
3 PHASE SUPPLY AND ISOLATOR FOR PLATFORM LIFT
PLATFORM LIFT
DIST BOARD G
DIST BOARD E
DIST BOARD F
DISCONNECT AND REMOVE SOCKET OUTLETS FROM WALL THAT ARE TO BE REMOVED
REMOVE EXISTING HEATER
STORAGE HEATER TO BE REPLACED WITH STORAGE HEATER FROM ROOM G6
SOCKET OUTLET TO BE REPLACED
EXTRACT FAN AND CONTROLS TO BE REMOVED
WINDOW MOUNTED EXTRACT FAN
Cast 4 leaf valley
Slate roof
NOTES
1) ALL DIMENSIONS TO BE VERIFIED ON SITE
2) DRAWINGS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION AND THE ARCHITECTS DRAWINGS
3) IF IN DOUBT ASK
4) THE POSITION OF ALL EQUIPMENT TO BE AGREED ON SITE WITH THE ARCHITECT
5) ALL EMERGENCY LIGHTS TO BE TESTED AND DEFECTIVE UNITS REPLACED
LEGEND
ISOLATOR SIZED AS SHOWN
SOCKET OUTLET
SWITCHED SOCKET OUTLET
SWITCHED FUSED CONNECTION UNIT
FUSED CONNECTION UNIT
HEATER CONTROL SWITCH
TELEPHONE OUTLET
DATA OUTLET
ISOLATED TYPE TELEVISION AERIAL OUTLET
SWITCH
2 WAY SWITCH
EMERGENCY LIGHT
SMOKE DETECTOR
HEAT DETECTOR
FIRE ALARM CALL POINT
ILLUMINATED DIRECTION SIGN
AUDIBLE WARNING DEVICE
STORAGE HEATER
A TENDER ISSUE AUG 2002
BRIAN J EVANS
SOUTH HOLLAND DISTRICT COUNCIL
AYSCOUGHFEE HALL SPALDING
PROPOSED POWER & HEATING FIRST FLOOR
1:50 AT A1
AUGUST 2002
7152/SKE 5
A
DJE
PJE