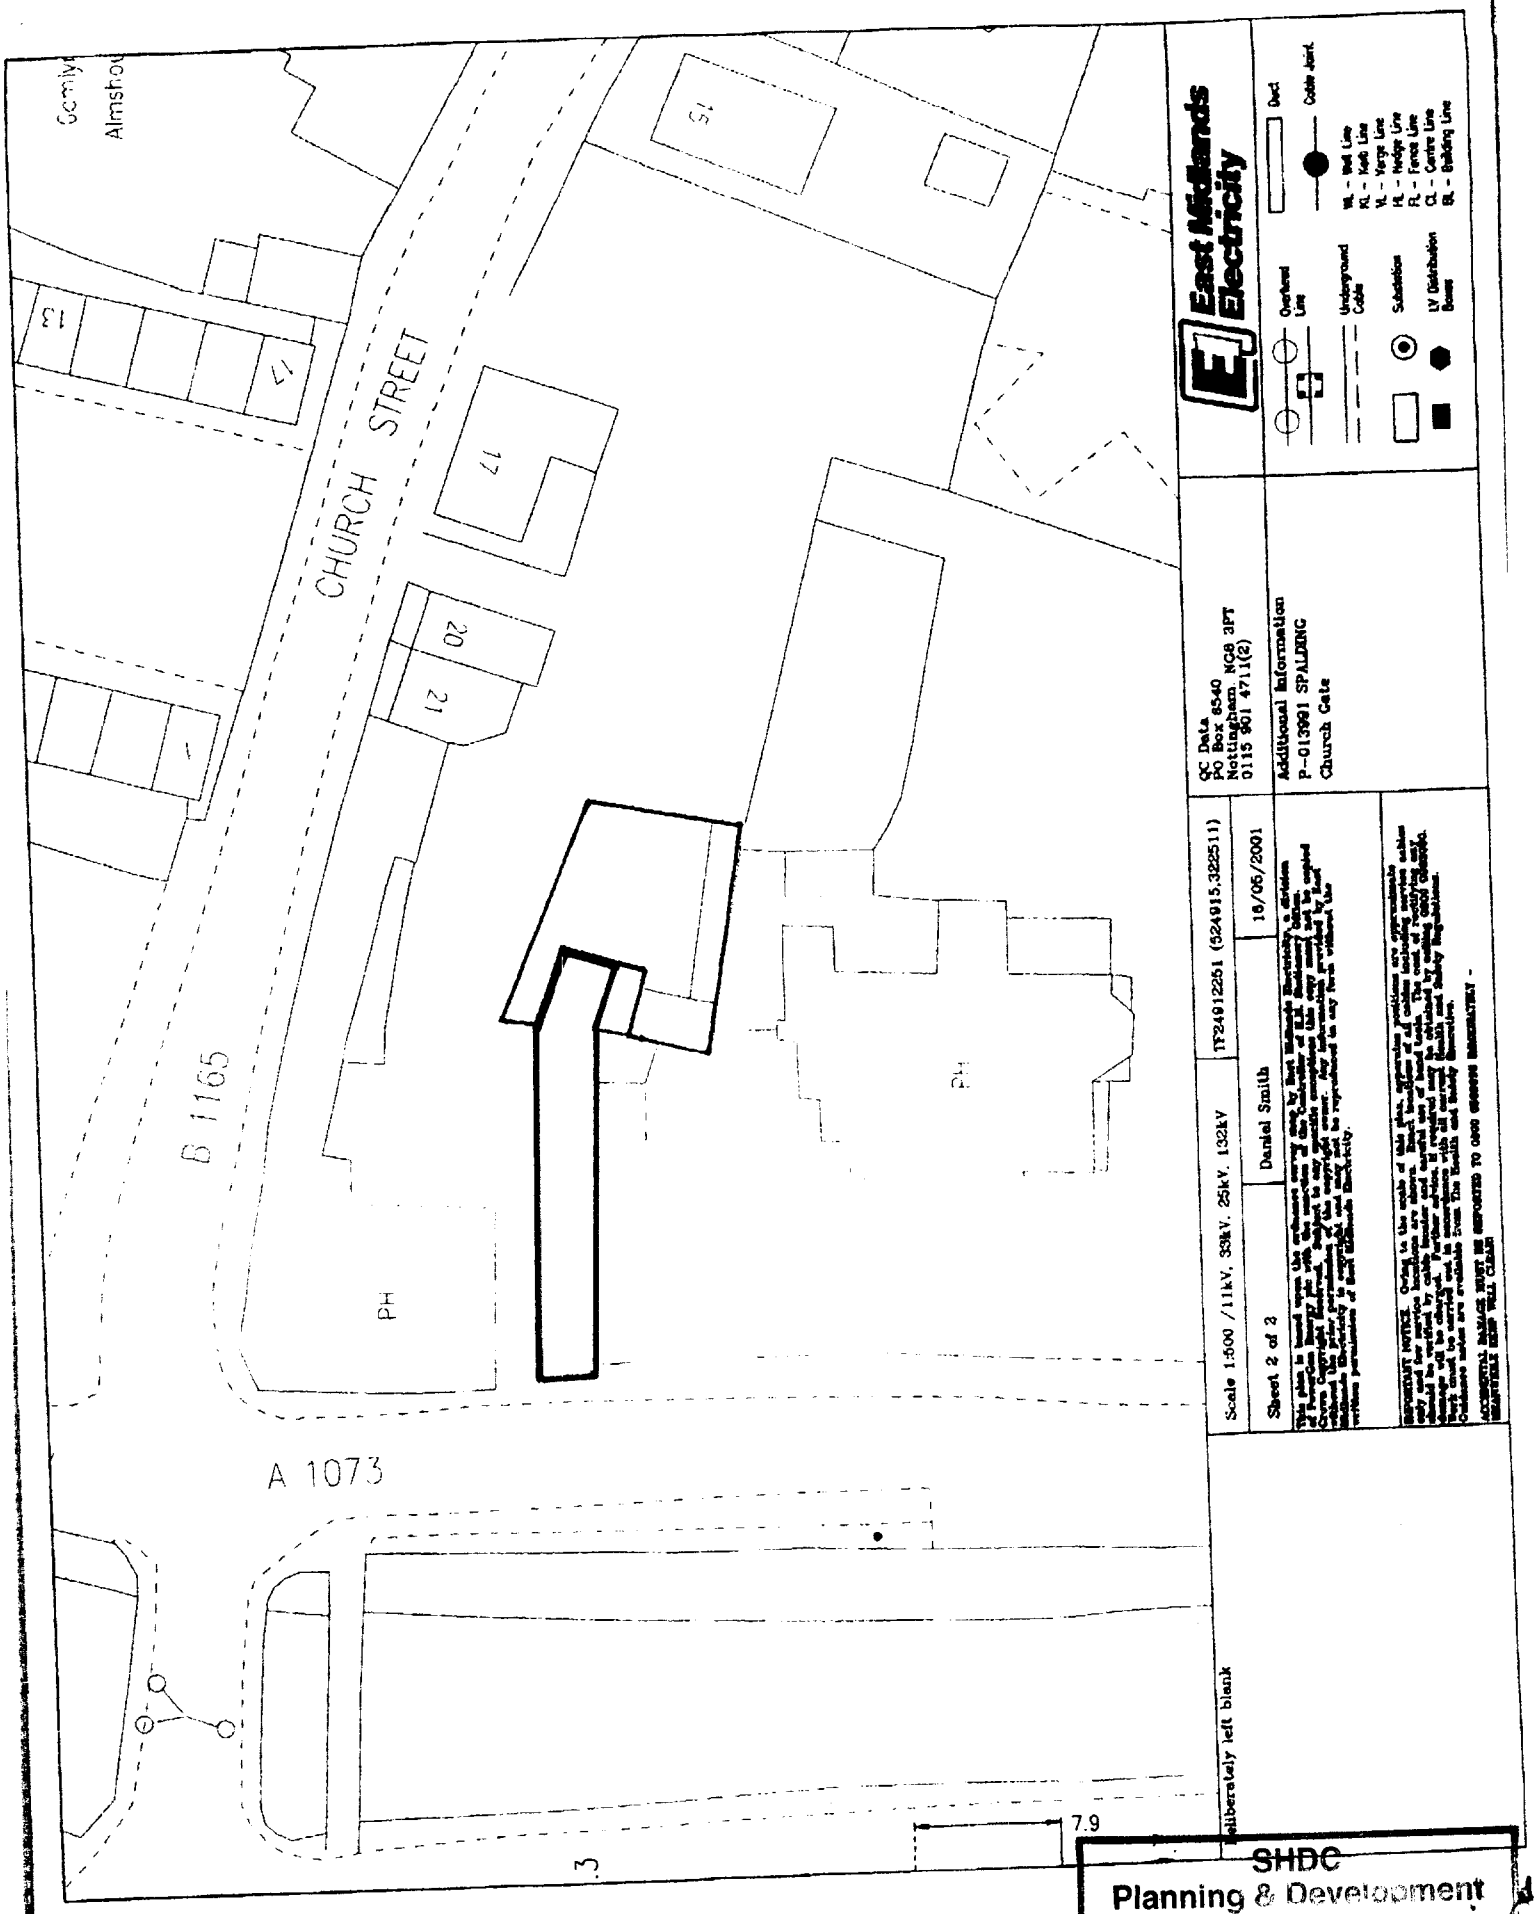


East Midlands Electricity

Duct
Cable Joint
Overhead Line
Underground Cable
Substation
LV Distribution Boxes
WL - Wall Line
HL - Hedge Line
FL - Fence Line
CL - Centre Line
BL - Building Line

QC Data
PO Box 8540
Nottingham NG8 3PT
0115 901 4711(2)

Additional Information
P-013991 SPALDING
Church Gate

Scale 1:500 /11kV, 33kV, 25kV, 132kV

TF24912251 (524915,322511)

18/05/2001

Daniel Smith

Sheet 2 of 3

This plan is based upon the ordnance survey map by East Midlands Electricity, a division of Powergen plc with the permission of H.M. Stationery Office. Crown Copyright reserved. Any unauthorised reproduction may infringe Crown Copyright and may lead to prosecution or civil proceedings. Powergen plc, Powergen House, 16 Westwood Way, Coventry CV4 8LG. Licence number LA 078741. Unauthorised reproduction of this plan is prohibited without the written permission of East Midlands Electricity.

IMPORTANT NOTICE: Owing to the scale of this plan, apparent positions are approximate only and the exact positions of all cables including services and other apparatus must be proved on site before any excavation is commenced. Under the New Roads and Street Works Act 1991 and the Electricity Safety, Quality and Continuity Regulations 2002 (ESQCR), plans will be charged. Further plans, if required, may be obtained from East Midlands Electricity. Cables must be supported and protected during excavation and backfilled with compacted selected material. Safe digging practices, in accordance with HSE guidelines are available from East Midlands Electricity.

ACCIDENTAL DAMAGE MUST BE REPORTED TO 0800 096 3080 IMMEDIATELY - EMERGENCY REPAIR WILL CLEAR

Deliberately left blank

SHDC
Planning & Development
- 4 APR 2002
Ref 0403/02