


North Elevation


All windows to be double glazed with trickle ventilators.

All openings to have horizontal and vertical damp proof courses, jambs to be insulated with Dameor or similar


Lintels to be 1.6 L/S with cavity tray and soldier arches. Minimum end bearing 150mm.

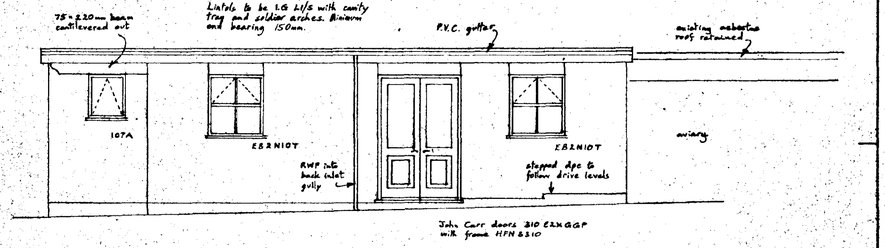

West Elevation

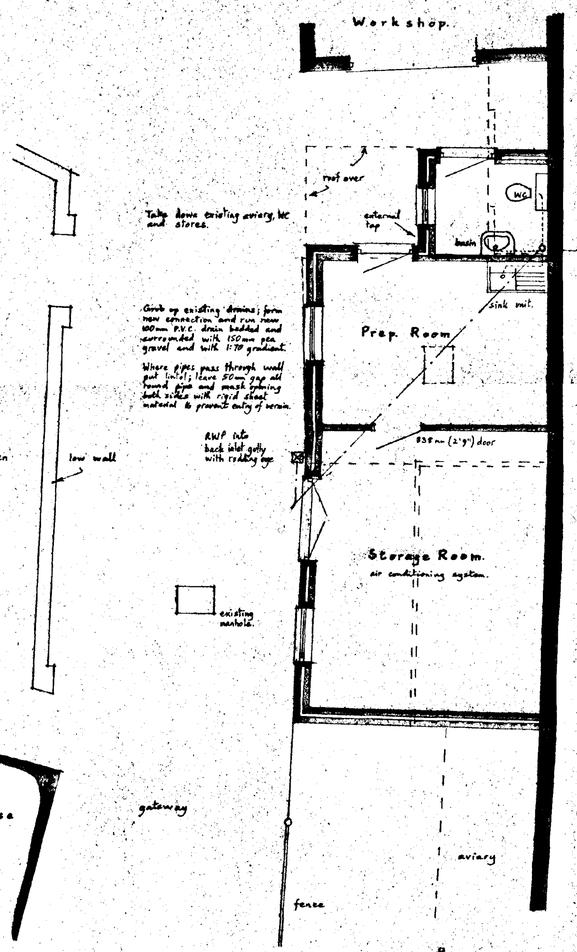


Block Plan 1:500

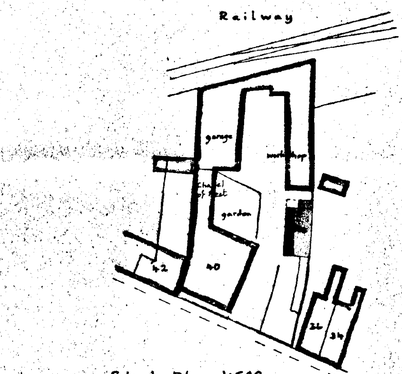


DETERMINED PLAN

SOUTH HOLLAND D.C.
PLAN DEPT.
03 MAY 1994
REF 0428/94

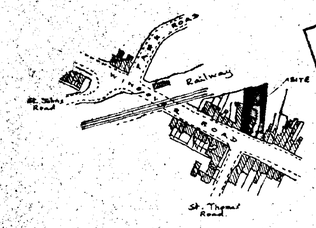

Location 1:2500

O.S. Map ref TF 243 226
Crown Copyright Reserved.

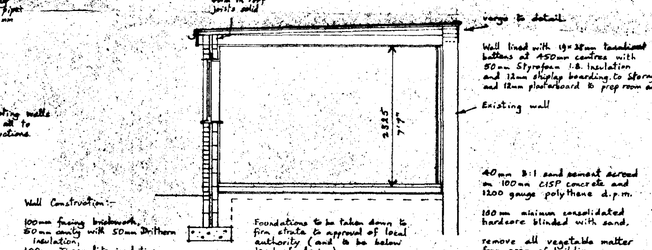

Cross Section.

12mm stone chippings on 3 layers felt & B.S. 747 fall bitumen bed and 18mm nat. grade plywood, with 50mm Styrofoam S.P. insulation. (warm roof construction).

Wall lined with 19 x 38mm treatment battens at 450mm centres with 50mm Styrofoam I.B. insulation and 12mm display boarding to storage, and 12mm plasterboard to prep room and WC.

40mm B:1 sand cement screed on 100mm C15P concrete and 1200 gauge polythene d.p.m.

150mm minimum consolidated hardcore blinded with sand.

remove all vegetable matter from area of building.

Bond new and existing walls with ferfix profiles all to manufacturers instructions.

Wall Construction:-

100mm facing brickwork,
50mm cavity with 50mm Styrotherm insulation,
100mm Thermalite insulating block work.

wall ties at 900mm horizontally 450mm vertically and at 225 vertically to jambs of openings.


mortar to be 1:1:6 cement:lime:sand or equal

walls rendered in 1:1:6 and skimmed in hard plaster or panelled.

D.P.C. to be minimum of 150mm above ground level and to be lapped with d.p.m.

weak cavity fill to ground level.

Frost proof brickwork or Class "A" concrete blocks below d.p.c.

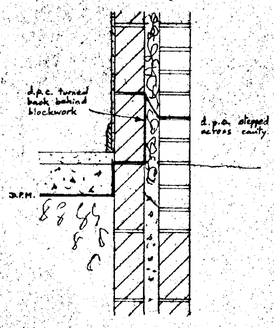

Improvement to facilities,
J. Willson and Sons,
40, Winsover Road, SPALDING.

Scale: 1:50	
Drawing No: 4	L. A. Ref.: Planning Bldg. Regs.
Date: April 1994	

A. ROFFE
BUILDING DESIGN & PLANS
1 Green Lane,
SPALDING,
Lincs. PE11 2YB Tel. (0775) 723680