

Contractor to check all Dimensions on site prior to ordering materials / commencing work.Do Not Scale from this Drawing - If in doubt then please ask

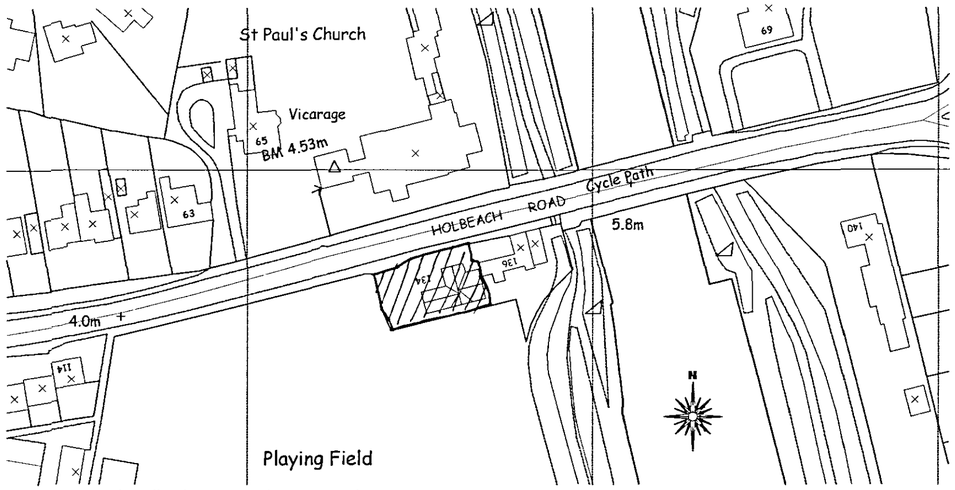

© Crown Copyright. All rights reserved. Licence number 100020449

LOCATION PLAN
Scale 1:1250

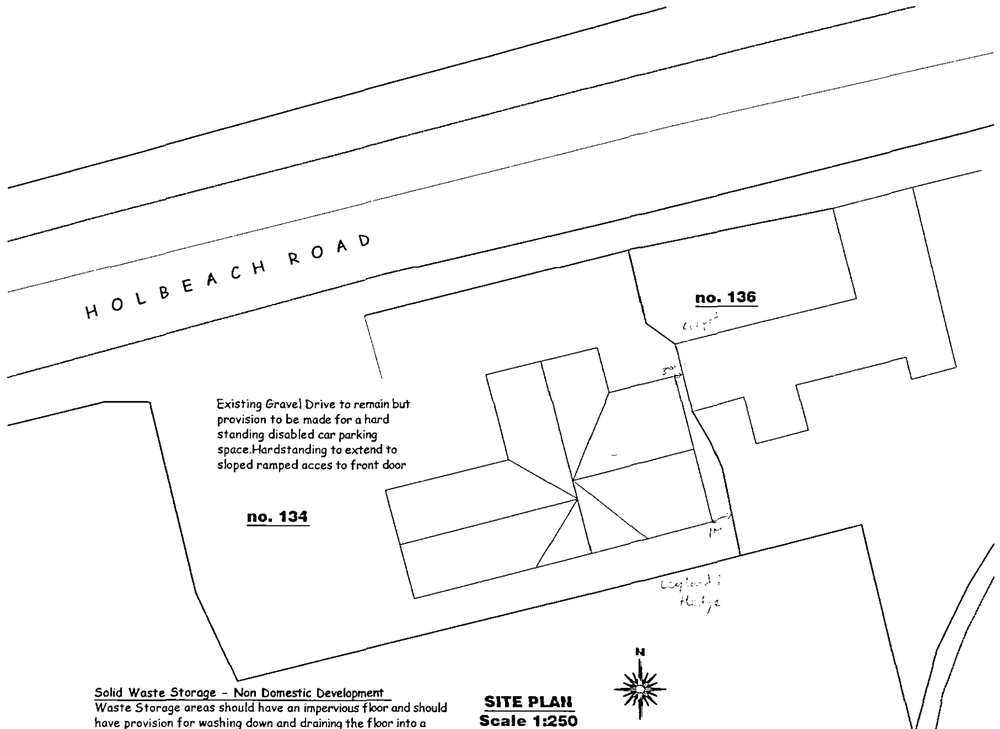

SITE PLAN
Scale 1:250

Solid Waste Storage - Non Domestic Development
Waste Storage areas should have an impervious floor and should have provision for washing down and draining the floor into a system suitable for receiving a polluted effluent.Gullies should incorporate a trap which maintains a seal even during prolonged periods of disuse.

Contractor to consult with the Local Authority for guidance on resolving all points in respect of solid waste storage as set out in Section H6 1.19 a - f of App. Doc. H and confirm to Building Control the conclusions.

ROOF FINISH
Concrete Interlocking Pantiles to match existing fixed in accordance with manufacturers instructions and in accordance with BS 5534:Parts 1 and 2.Set out to give true lines and regular appearance, fitting neatly at all edges, junctions and features.Fix roof covering to make the building sound and weathertight at the earliest opportunity.Repair any defects as quickly as practicable to minimise damage and nuisance & keep gutters and pipes free of debris and clean out at completion.Provide 50x25 preservative treated timber battens.Tiling battens should be not less than 1.2m long and continuous over at least 3 trusses.They should be fixed to every rafter member which they cross, or on which they are joined, with nails in accordance with BS5534: Part 1. The ends of the battens should be sawn square and butt jointed centrally on a rafter member so that adequate bearing and nailing can be provided for each end of each batten.Butt joints in battens should be arranged so that not more than one batten in four is joined on any one rafter.Generally all tiles at perimeter of roof to be clipped and nailed. Use Code 4 Lead flashing to any abutments with min.75mm upstand.

ROOF INSULATION
The whole area of the ceiling to be insulated with two layers of Crown Wool Mineral Fibre Insulation or equal approved of a total thickness 300mm to achieve a 'U' value of 0.16w/m²K. Width of first layer of insulation to be appropriate to the joist spacings and of a thickness equal to joist depth (100mm) . The insulation to be laid between the joists to finish over the wall plate on external walls and pushed up tight to roofing membrane. The second layer (200mm) of Crown Wool to be laid at right angles to the first layer.All joints between the rolls of insulation to be close butted.

ROOF VENTILATION
Install Tyvek® or similar approved Breathable Membrane in accordance with manufacturers instructions which are briefly described below & BBA certificate 99/3635 (fourth issue) breather membranes in non-ventilated pitched roofs of any plan, any shape or any size under all types of roof coverings including tight jointed and fully interlocking tiles and synthetic slates. Installing Tyvek® underlay in accordance with the above certificate will enable a roof to meet all the requirements of the Building Regulations.
Installation Guidelines
Tyvek® SUPRO should be installed with min. 150mm overlaps as a standard bituminous felt underlay and secured with stainless steel staples or large headed galvanised clout nails.
Eaves:
There is no need to provide any vents into the loft at eaves, because a Tyvek® non-ventilated roof system does not rely upon air movement beneath the membrane to avoid damage by condensation.To avoid water ponding behind the fascia of closed eaves and to prevent prolonged exposure of the membrane to ultra-violet radiation, use a Tyvek® Eaves Carrier. Stop the membrane short of the fascia and lap it onto the Eaves Carrier.Pack closed eaves with fibrous insulation to reduce thermal bridging.
Verge detail:
Lap the Tyvek® underlay 50mm onto the gable or flying rafter.
Ridge/ hip detail:
Extend the Tyvek® underlay 150mm from each slope and overlap it at the ridge/ hip line. There is no need to provide vents at the ridge.
Valley detail:
Extend the Tyvek® underlay from each slope by 150mm beyond the valley centre line and seal the lap using Tyvek® Butyl Tape to form a watertight seal.
Abutments:
Turn up the Tyvek® underlay beneath flashings not less than 50mm.
Penetrations:
Seal around all penetrations using Tyvek® Butyl Tape.


ROOF INSULATION - FLAT CEILINGS
The whole area of the ceiling to be insulated with two layers of Crown Wool Mineral Fibre Insulation or equal approved of a total thickness 300mm to achieve a 'U' value of 0.16w/m²K. Width of first layer of insulation to be appropriate to the joist spacings and of a thickness equal to joist depth (100mm) . The insulation to be laid between the joists to finish over the wall plate on external walls and pushed up tight to roofing membrane. The second layer (200mm) of Crown Wool to be laid at right angles to the first layer.All joints between the rolls of insulation to be close butted.

ROOF INSULATION - SLOPED CEILINGS (UNDER RAFTER)
The whole area of the ceiling to be insulated with 25mm thk Multi Layer Tri Iso Super 9 Insulation to achieve a 'U' value of 0.19w/m²K fitted strictly in accordance with manufacturers instructions:
1. Unroll the insulation preferably vertical, starting from the top of the roof.
2. Staple the insulation product at 500mm ctrs on the u/side of the rafters
3. Overlap the widths by min. 50mm and max. 100mm and tape joints with approved tape.
4.At the bottom of the roof slope, staple the insulation directly to the wallplate.
5.Nail 25mm thk cross battens to the rafters to create 25mm cavity / ventilation gap through the insulation and then attach p'board.
Roof Insulation 'U' Value Calculation sheet available on request

RAINWATER DRAINAGE
uPVC guttering and downpipes to clients approval.Falls for guttering to be 1:600 and brackets fixed at max. 2m ctrs.Downpipes to be connected into underground drains via reducing adapter.Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surronds laid to 1:100 falls to new soakaway.Soakaway specification detailed elsewhere.

ELECTRICAL INSTALLATION
All electrical work required to meet the requirements of Part P must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council Building Control Officiers must be satisfied that either:
1. An electrical installation certificate issued under a competent persons scheme has been issued or
2. An appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.The Engineer is to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

WASTE SIZES FOR NEW PLUMBING
All new plumbing to have the following waste sizes:
W.C=100mm ø Multikwik or similar approved
W.H.B=32mm ø uPVC with 75mm Deep sealed trap
SINK=40mm ø uPVC with 75mm Deep sealed trap
SHOWER=40mm ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction.Provide anti-siphon traps where pipe runs exceed 3m and W.H.B pipe run exceeds 1.8m.

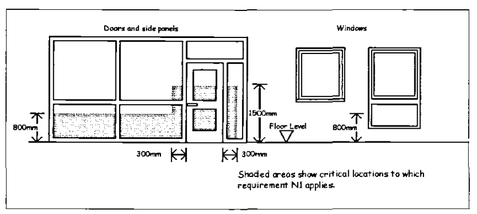

DETERMINED PLAN

SHDC
Planning & Development
- 8 APR 2005
Ref: 0467/05

GENERAL CONDITIONS
Contractors are resonsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are all subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose.All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.

Client : Mr. J Sedge
78 Winsover Road
Spalding
PE11 1HA

Site : Side Office Extension to:
The Image Makers
134 Holbeach Road
Spalding
PE11 2HY

remway design Ltd
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Date : mar05 | Scale : 1:50 / 1:100

Drawing No:
rem 1026-02