


| LUMINAIRE SCHEDULE |       |     |                  |                                                            |                                           |            |
|--------------------|-------|-----|------------------|------------------------------------------------------------|-------------------------------------------|------------|
| Symbol             | Label | Qty | Catalog Number   | Description                                                | Lamp                                      | Lumens LLF |
|                    | C     | 5   | SLF250HTEP.AY60  | SEATTLE MOUNTED OFF THE BUILDING @ 6M                      | 250W CLEAR 4000K POSITIONAL METAL HALIDE  | 23000 0.85 |
|                    | D     | 5   | ASL250HTEP.FWC   | AERIS LARGE FORWARD THROW CUTOFF MOUNTED ON A COLUMN @ 6M  | 250W MH EURO 4000K (POSITION ORIENTED)    | 23000 0.85 |
|                    | E     | 4   | ASM150CDMTF3.AY  | AERIS MEDIUM ASYMMETRIC MOUNTED ON A COLUMN @ 6M           | 150W CLEAR CDM-T 3000K METAL HALIDE (G12) | 14000 0.83 |
|                    | F     | 8   | ASM150CDMTF3.FWC | AERIS MEDIUM FORWARD THROW CUTOFF MOUNTED ON A COLUMN @ 6M | 150W CLEAR CDM-T 3000K METAL HALIDE (G12) | 14000 0.83 |
|                    | G     | 4   | ASM150CDMTF3.AY  | AERIS MEDIUM ASYMMETRIC MOUNTED ON A COLUMN @ 6M           | 150W CLEAR CDM-T 3000K METAL HALIDE (G12) | 14000 0.83 |


| STATISTICS     |        |        |         |        |         |         |
|----------------|--------|--------|---------|--------|---------|---------|
| Description    | Symbol | Avg    | Max     | Min    | Min/Max | Min/Avg |
| Car Park       |        | 32 lux | 86 lux  | 12 lux | 0.14    | 0.38    |
| Car Park Drive |        | 61 lux | 117 lux | 23 lux | 0.20    | 0.38    |
|                |        | 38 lux | 86 lux  | 11 lux | 0.13    | 0.29    |
| Spill Calc     |        | 2 lux  | 19 lux  | 0 lux  | 0.00    | 0.00    |
| Spill Light    |        | 0 lux  | 9 lux   | 0 lux  | 0.00    | N / A   |

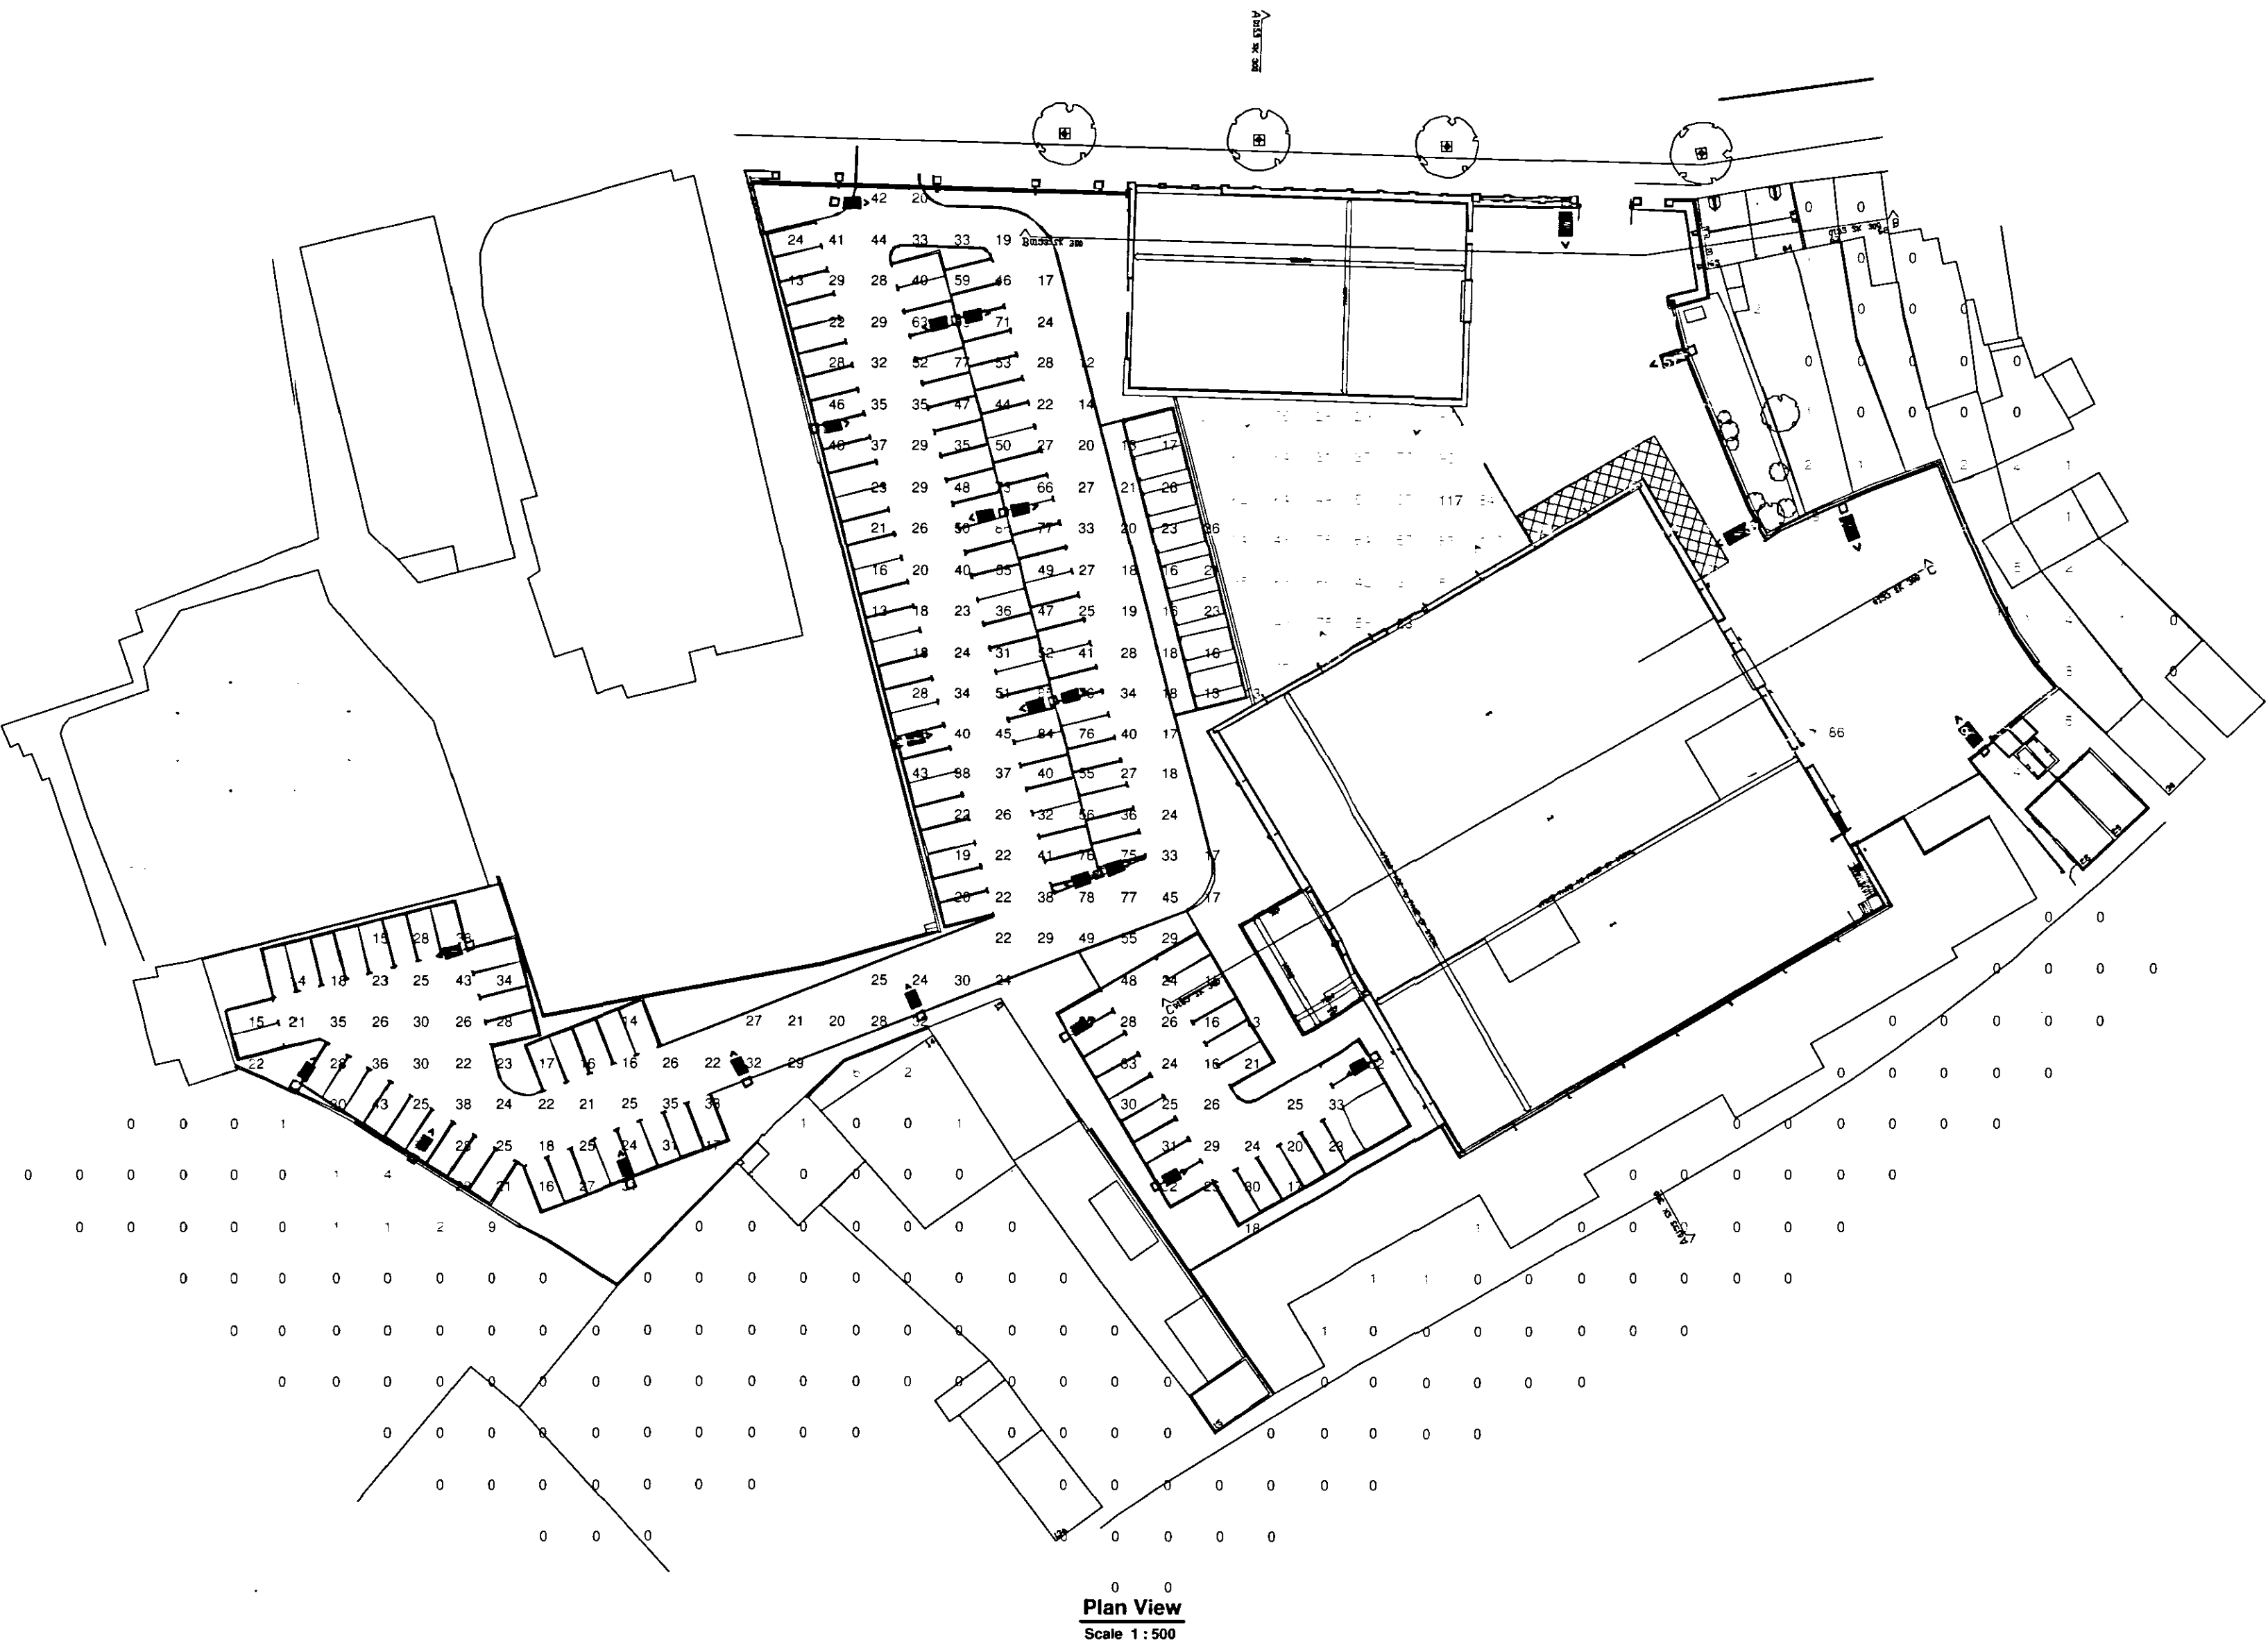

**NOTES**

1. Holophane Europe Limited offer a Lighting Design Service in good faith and without charge. Every effort is made to ensure we interpret design briefs accurately and in-turn provide suitable and detailed proposals. However, the final responsibility for the design and any recommendations offered within lies with the client. Holophane Europe Limited, does not therefore accept any liability for loss, damage incurred or design misinterpretation.

Results provided within this Holophane design are derived from specific product photometry; the substitution of luminaires either with alternative Holophane units or other manufacturers products may not produce the same results.

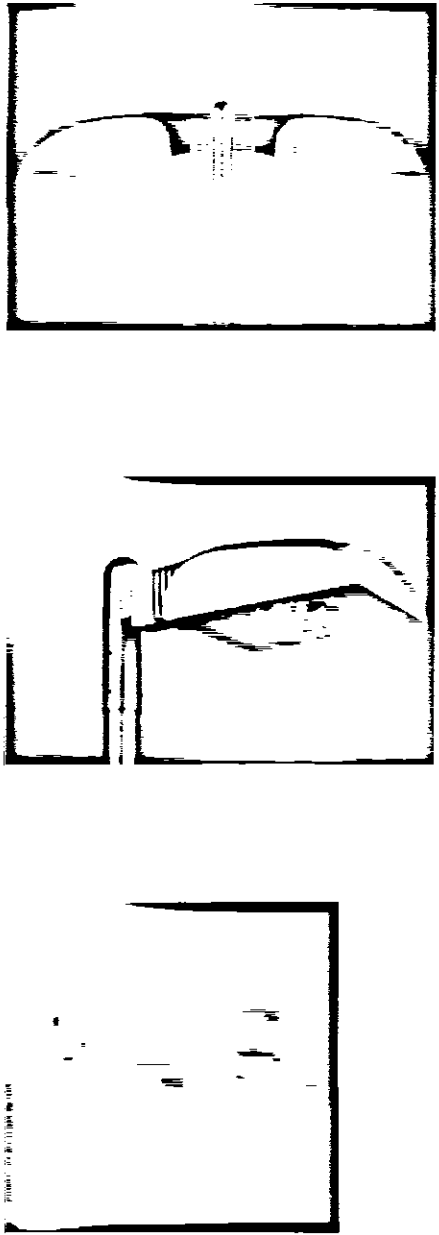

SHDC  
PLANNING & DEVELOPMENT  
16 MAY 2006  
Ref. 0537106

AMENDED PLAN  
Ref. A1

Homebase Spalding Aeris Option  
External Lighting  
Spill Calcs

Designer  
RE/HKW  
Date  
May 12 2006  
Scale  
1:500 @ A1  
Drawing No.  
P142-756-E-R1