



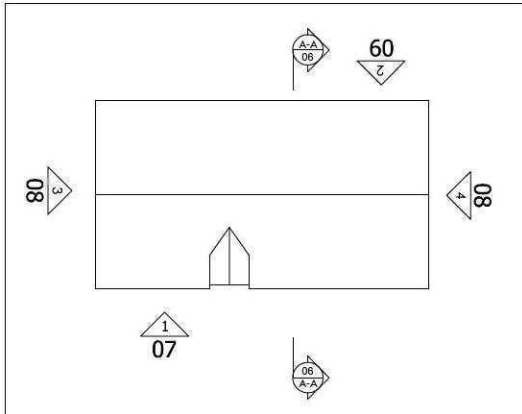

LOCATION PLAN (N.T.S.)

Vented ridge tiles to give ventilation area equivalent to continuous gap of 5mm either side of ridge.

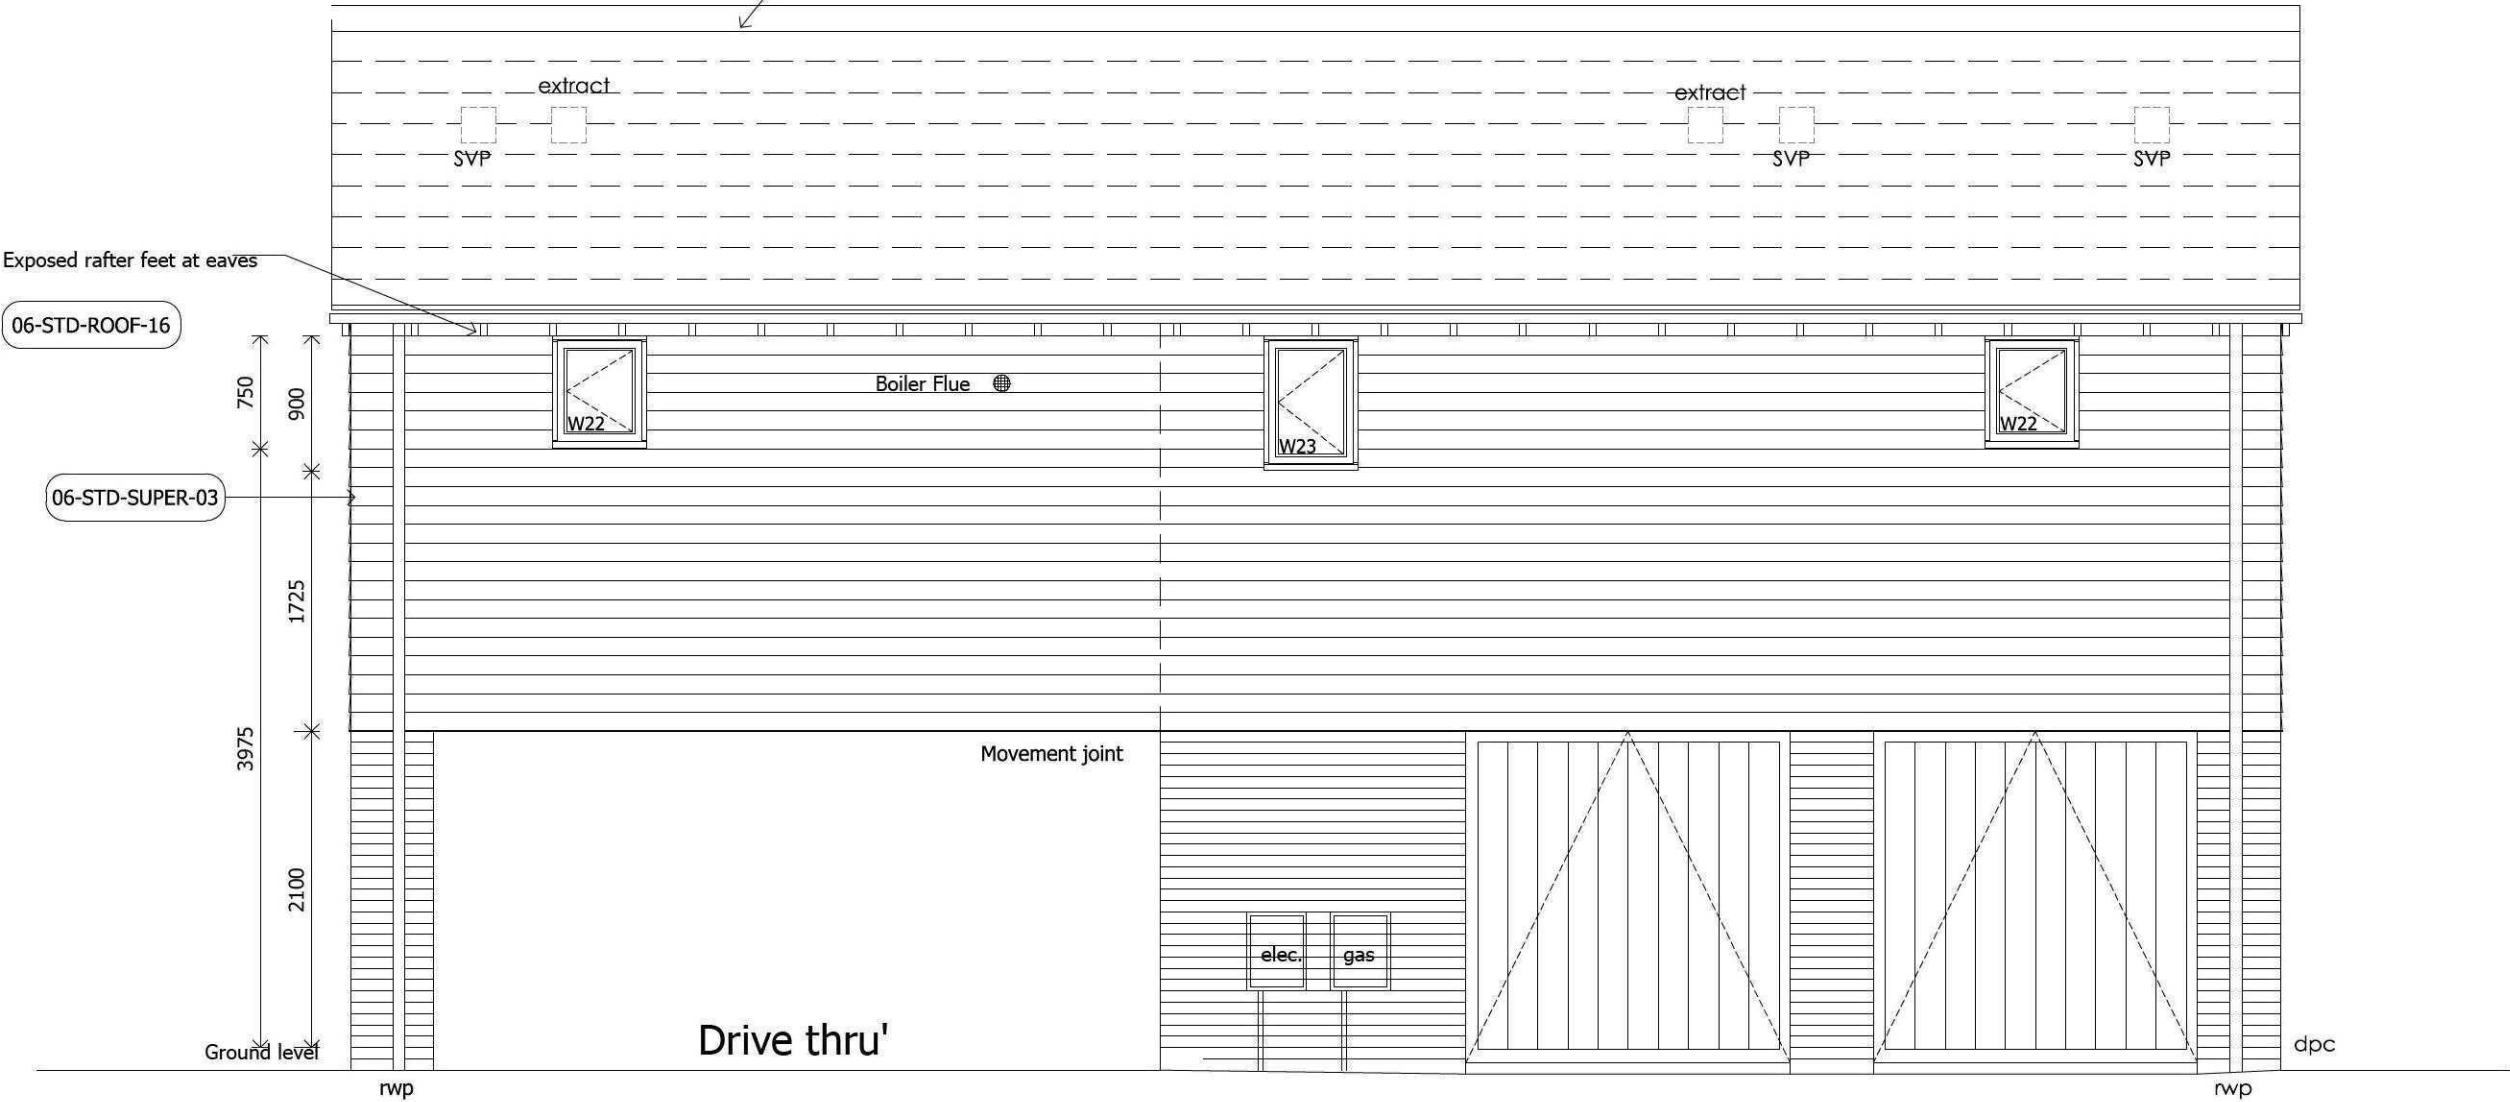

Notes

All drawings are to be read in conjunction with the relevant standard details.

06-STD-SUPER-01 denotes reference to the relevant standard detail.

Ventilation Required to all Plots in accordance with Part F AD 2006.
Background ventilation to total 40,000mm² in accordance with table 1.2a. Background ventilators to be installed to provide minimum 5000mm² equivalent area in all habitable rooms with an external wall. Minimum of 2500mm² equivalent area in all wet rooms with an external wall. If a wet room has no external walls then mechanical intermittent extract with 15min overrun is required.

Minimum Extract Ventilation Rates:
15L/sec to Bathrooms
30L/sec to Kitchen & Utility rooms
6L/sec to sanitary accommodation

C	Bin store door removed, mj updated & step note added	13.10.10	C
B	Garage Doors Added	11.10.10	C
A	Ventilation Note added	4.10.10	C

Rev	Details	Date	By
-----	---------	------	----



Lysander House
Tempsford Hall
Sandy
Bedfordshire
SG19 2BD
Tel: 01767 642500 Fax: 01767 642628

Project: House Type
F069.5

Drawing:

Rear Elevation

Drawing File Location:

Drawn by: CORE	Date: AUG 2010
Scale: 1:50 @ A3	COINS code: C2AA01

This drawing is © copyright protected.
All dimensions to be checked on site.
Any discrepancies to be reported to the Architect immediately.
This drawing should not be scaled.

Drawing no: F069.5 - 09	Revision: C
----------------------------	----------------