


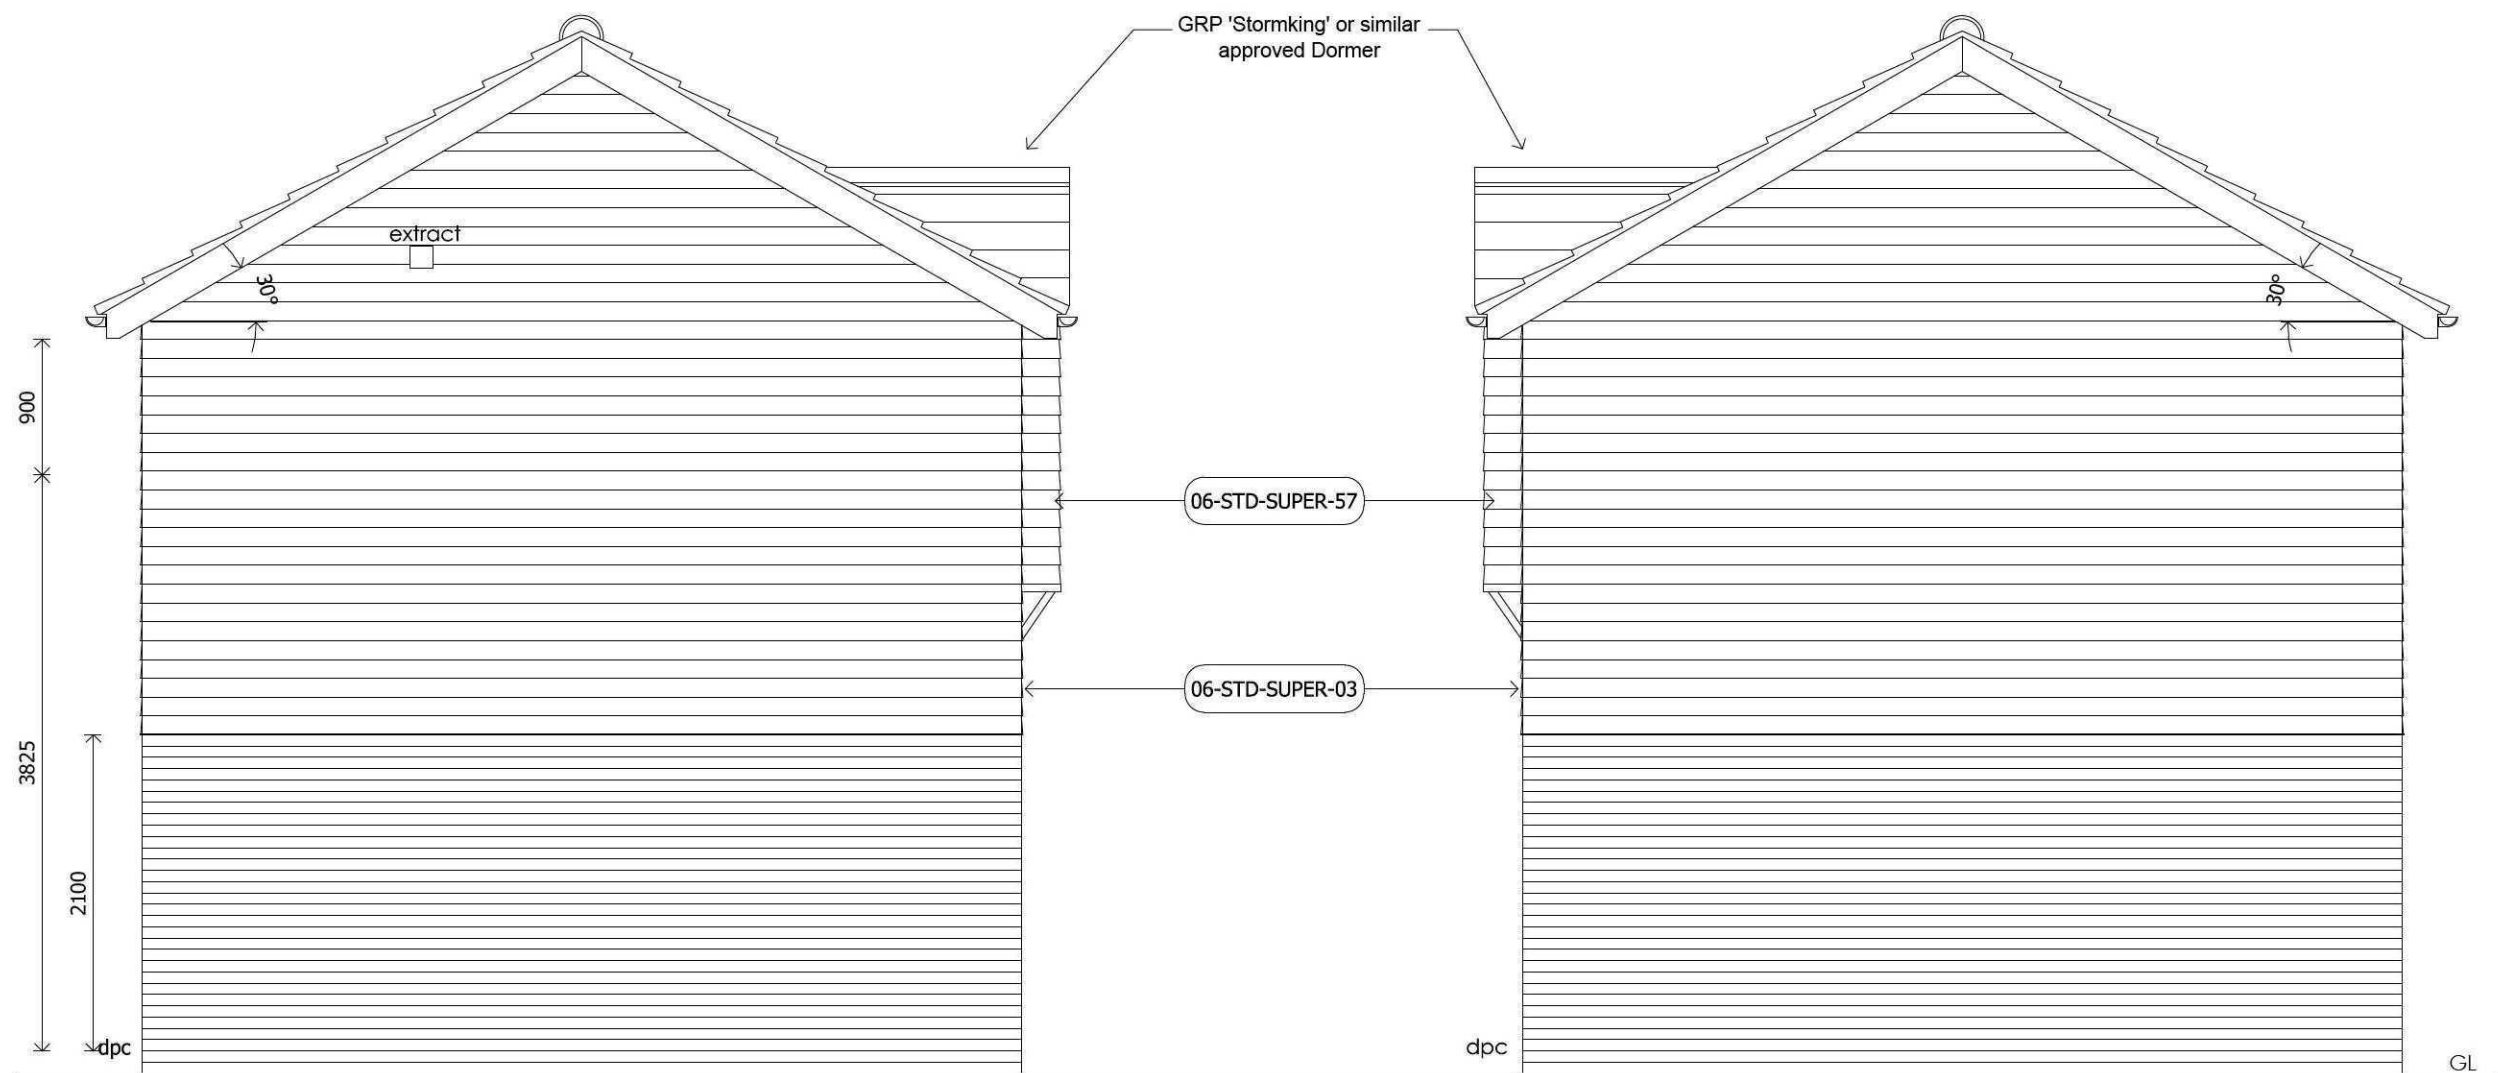

SIDE ELEVATION 1

Front door to have min. clear opening of 775mm. Level threshold required to allow for wheelchair access - refer to standard detail drawing STD-2001-05

SIDE ELEVATION 2

Notes

All drawings are to be read in conjunction with the relevant standard details.

06-STD-SUPER-01 denotes reference to the relevant standard detail.

Ventilation Required to all Plots in accordance with Part F AD 2006.
Background ventilation to total 40,000mm² in accordance with table 1.2a. Background ventilators to be installed to provide minimum 5000mm² equivalent area in all habitable rooms with an external wall. Minimum of 2500mm² equivalent area in all wet rooms with an external wall. If a wet room has no external walls then mechanical intermittent extract with 15min overrun is required.

Minimum Extract Ventilation Rates:

15L/sec to Bathrooms

30L/sec to Kitchen & Utility rooms

6L/sec to sanitary accommodation

B	Meters added to side elevation	11.10.10	C
A	Ventilation Note added	4.10.10	C
Rev	Details	Date	By



Lysander House
Tempsford Hall
Sandy
Bedfordshire
SG19 2BD
Tel: 01767 642500 Fax: 01767 642628

Project: House Type
F069.5

Drawing:

Side Elevation

Drawing File Location:

Drawn by: CORE	Date: AUG 2010
Scale: 1:50 @ A3	COINS code: C2AA01

This drawing is © copyright protected.
All dimensions to be checked on site.
Any discrepancies to be reported to the Architect immediately.
This drawing should not be scaled.

Drawing no: F069.5 - 08 Revision: B