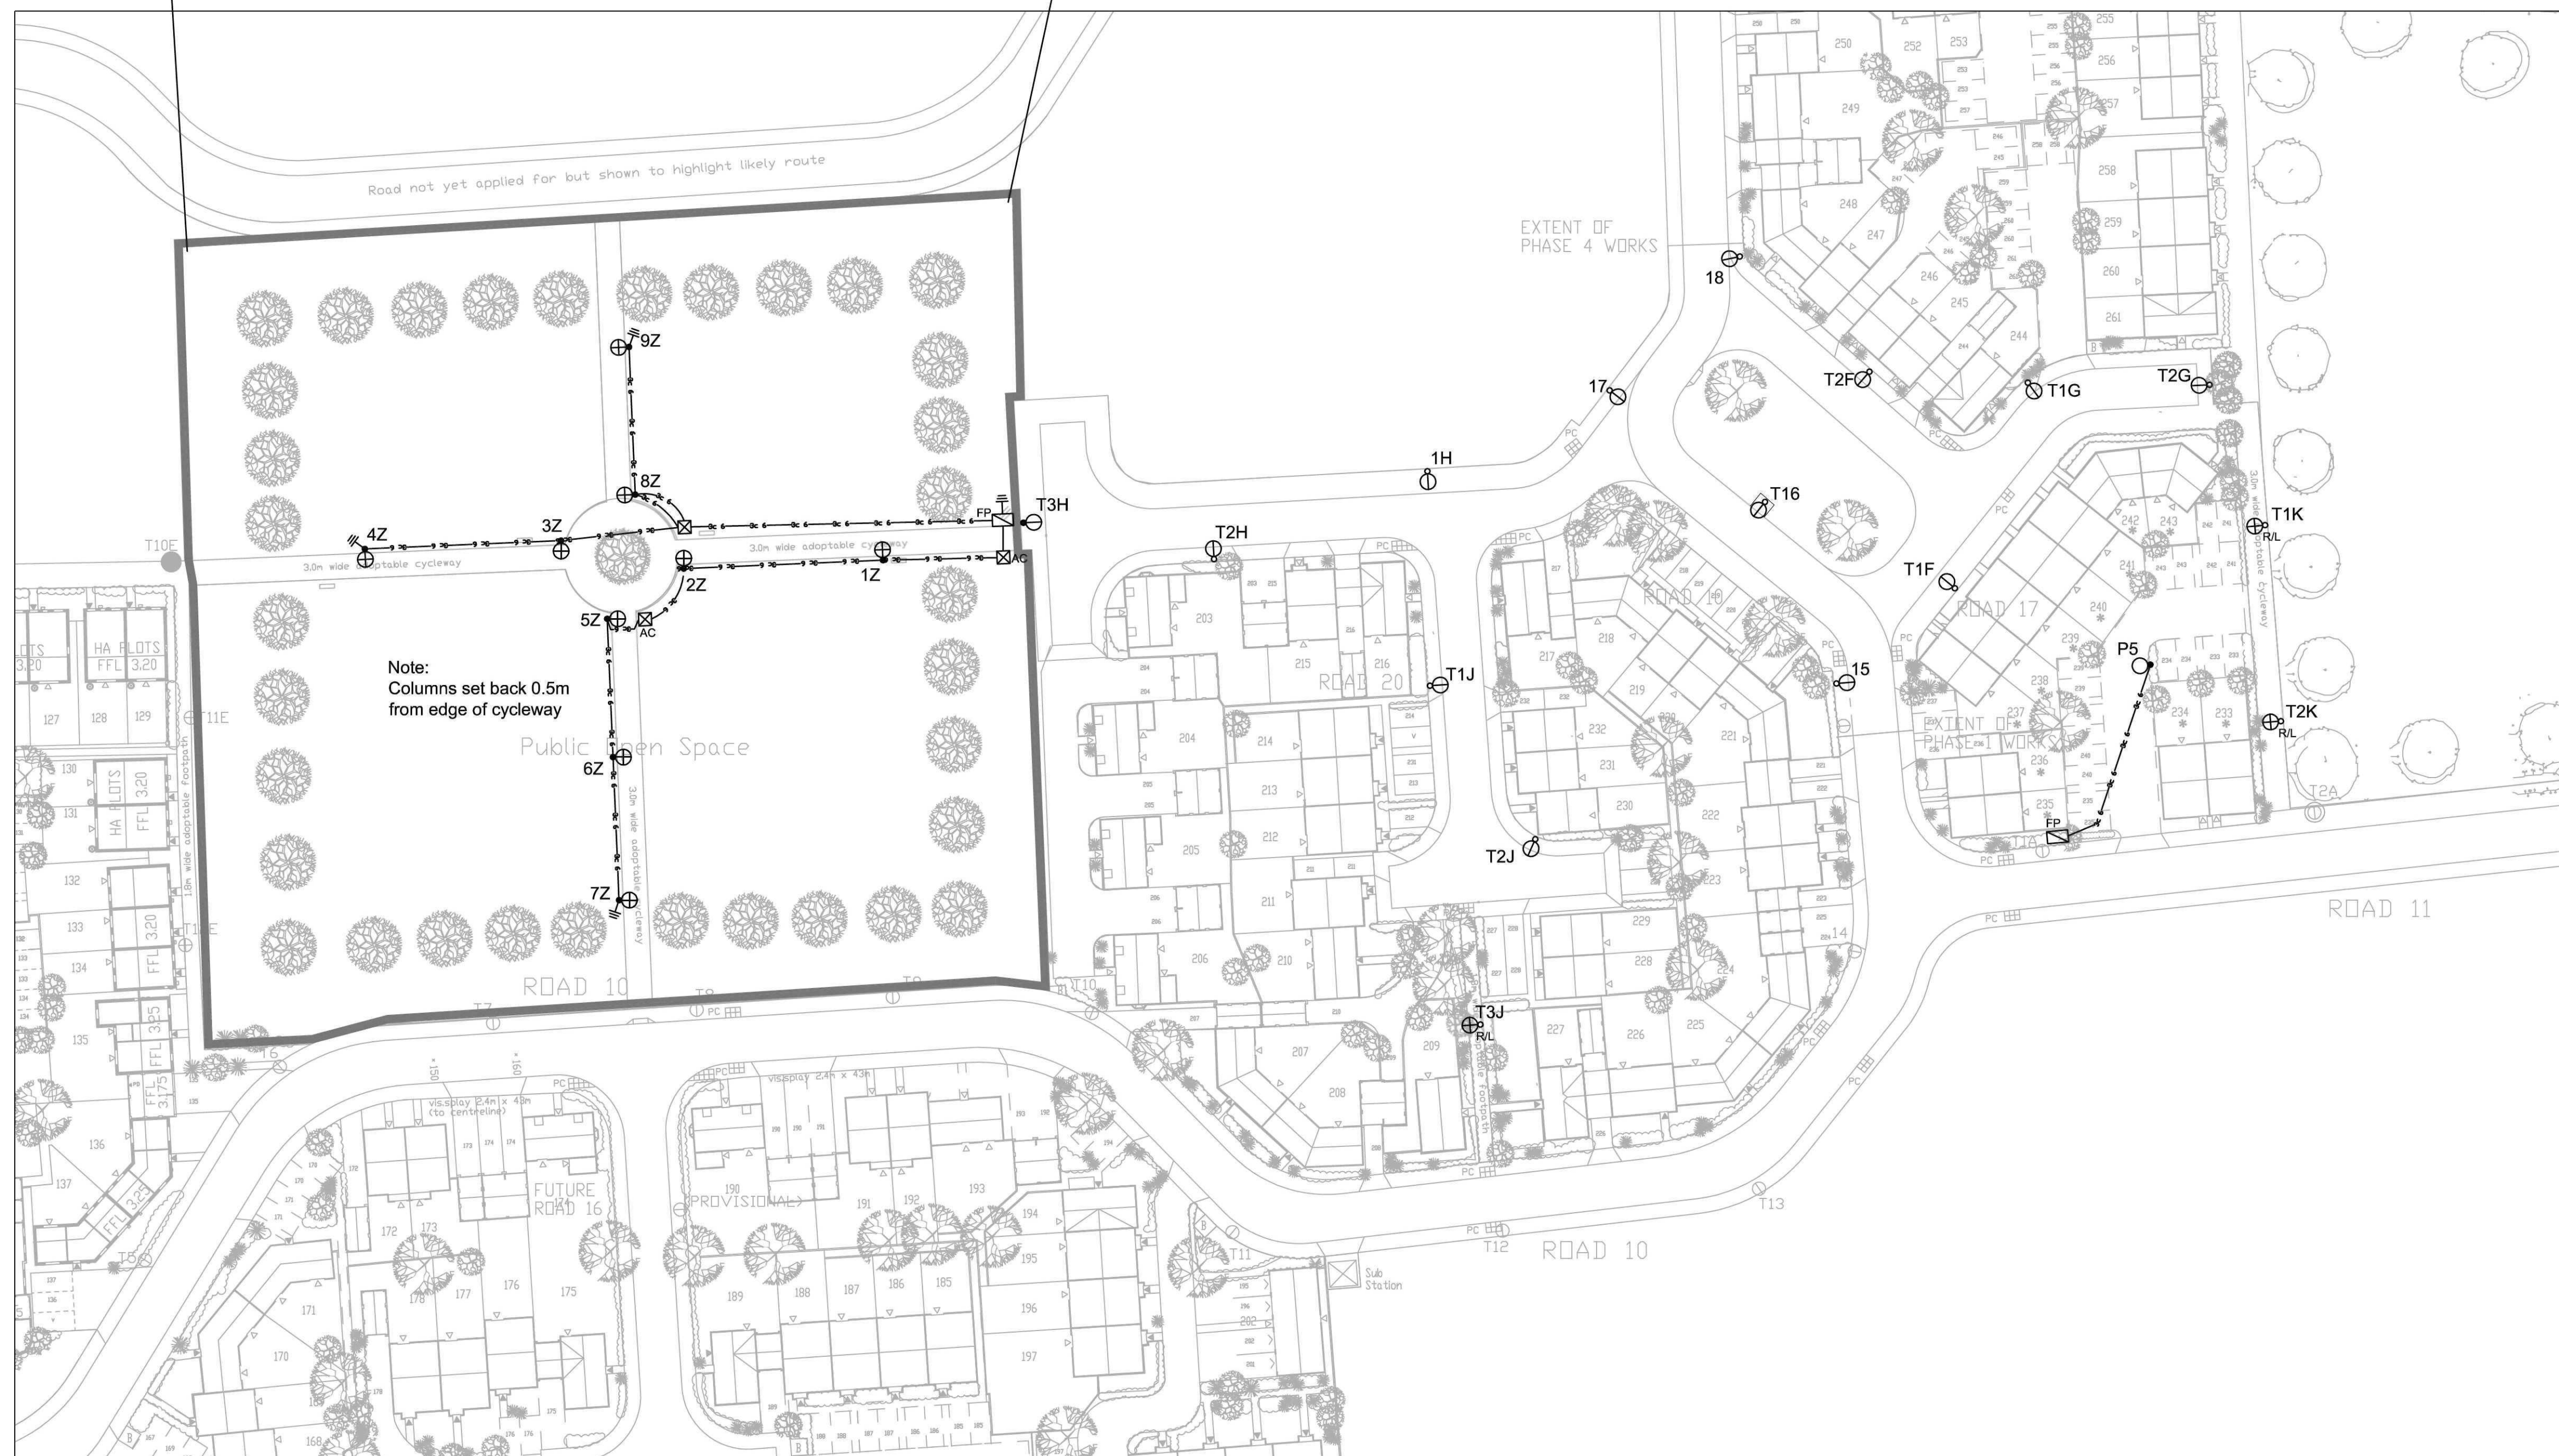
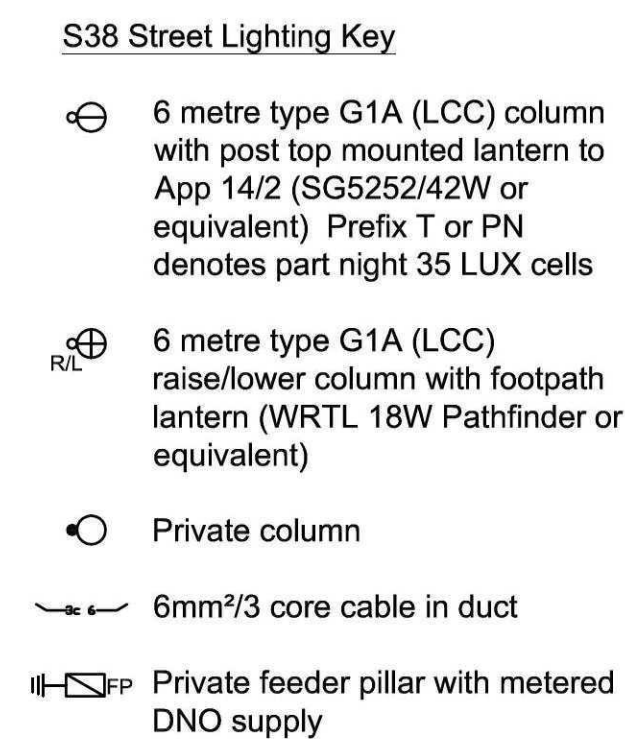
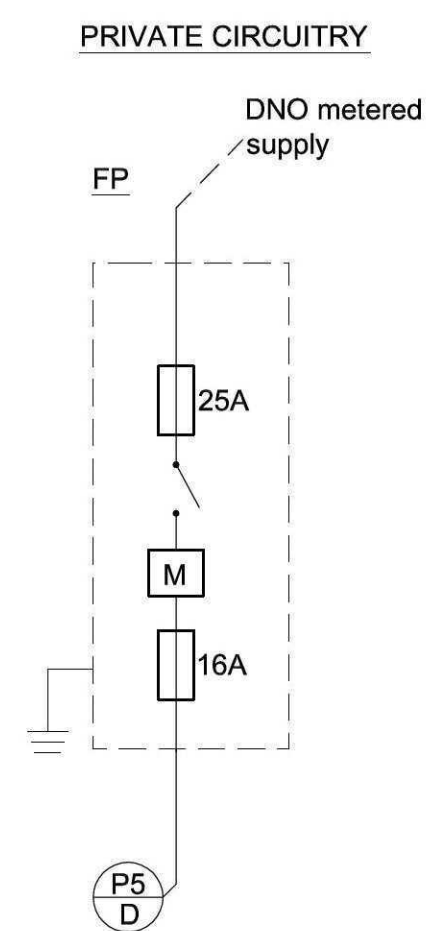


X-Refs & Blocks used in this Drawing

S38 Street Lighting Notes

1. Column foundations to be as per TD7/14/2A
2. All columns to be provided with Electricity Company Services and Termination Type A to LCC Standard Detail TD7/14/4A. DNO Cutouts to be fitted with 16Amp BS88 Fuse Link. Double Pole Isolator to be fitted with BS 88 Fuse Link to L.C.C Appendix 14/4.
3. Column setbacks shall comply with Section 5.2.1.2 of BS 5489-1:2003.
4. Columns shall not be installed within Drop Kerb areas and shall have a minimum clearance of 1.5m from Drives/Accesses.
5. It is preferred that all Street Lighting works are undertaken by L.C.C Approved Contractors.
6. Lanterns to be re-lamped (during maintenance period) prior to adoption as detailed in S38 Agreement.
7. Developer to liaise with Electricity Company with regards to connections and disconnections of columns and appropriate black ducting.
8. It is the Developers responsibility to inform property owners of part night street lighting switching where applicable.
9. Lanterns prefixed 'P' shall be private lights and are not part of LCC adoption process. They shall not be fed from LCC columns.
10. Developer to ensure locations of proposed trees do not inhibit lighting levels and locations. Consult with landscaping plan.
11. Private cable runs are indicative only and may vary on site.
12. Feeder pillars to private columns to be installed with reference to schematic diagram and shall be fitted with a metered DNO supply.
13. It is recommended that private columns are provided with LCC termination types D and E as appropriate.

APPROVED FOR
CONSTRUCTION

FOR THIRD PARTY USE, THIS DRAWING SHALL BE DEEMED
CURRENT ONLY AT THE DATE OF APPROVAL. PLEASE CHECK
FOR AMENDMENTS BEFORE USE

[illegible]

Drawing 1st Approval

1st Approval by: SH		Date: 10/8/11	
Drawn/Designed by: JR		CAD Drawing Creation Created By: DS Date: 04/08/11	

Scale:
(@A1)
Primary: 1:500
Secondary: (Do not scale from this drawing)

Lincolnshire
COUNTY COUNCIL

Highways Alliance

TECHNICAL SERVICES PARTNERSHIP
WITHAM PARK HOUSE,
WITHAM PARK,
WATERS OF SOUTH
LINCOLN LN6 7JN
Customer Services Centre (01522) 762070

Contract No 140098

Customer Service Center: (07552) 729270		Rev. A2	
B/HREXD6150		/01/5000	
Paper Size	Scheme Reference	ID Number	Drawing Series No.
			Revision

Project Name	Quantities / Materials	For Material	Drawing / Details No.	Revision
Alternative Scheme Code:				
Parish: SPALDING				
Road No:		Structure No:		
Description: WYGATE PARK - PHASE 4 STREET LIGHTING WORKS				

LINCOLNSHIRE COUNTY COUNCIL - Reproduced from Ordnance Survey material with the permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationery Office © Crown copyright. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings. OS Licence 100025370