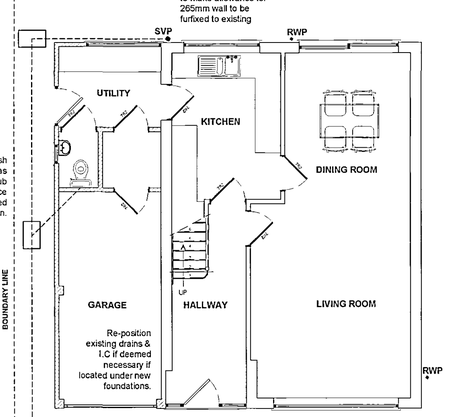



Carefully demolish walls / floors to areas shown shaded, grub up floor and replace with new as proposed plan / specification.

BOUNDARY LINE


SVP to be moved over to make allowance for 265mm wall to be furfixed to existing

Create new cavity wall at entrance as shown on proposed plan & detail.Provide temporary hoarding / dust cover in existing hallway to extent as req'd by client.

EXISTING GROUND FLOOR PLAN
Not to Scale

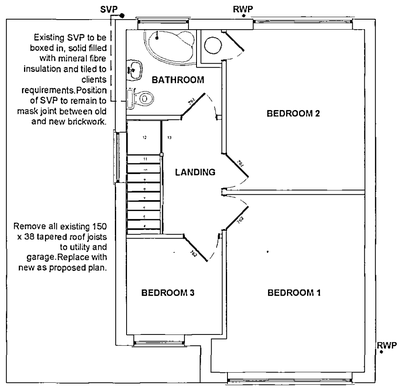


EXISTING FIRST FLOOR PLAN
Not to Scale

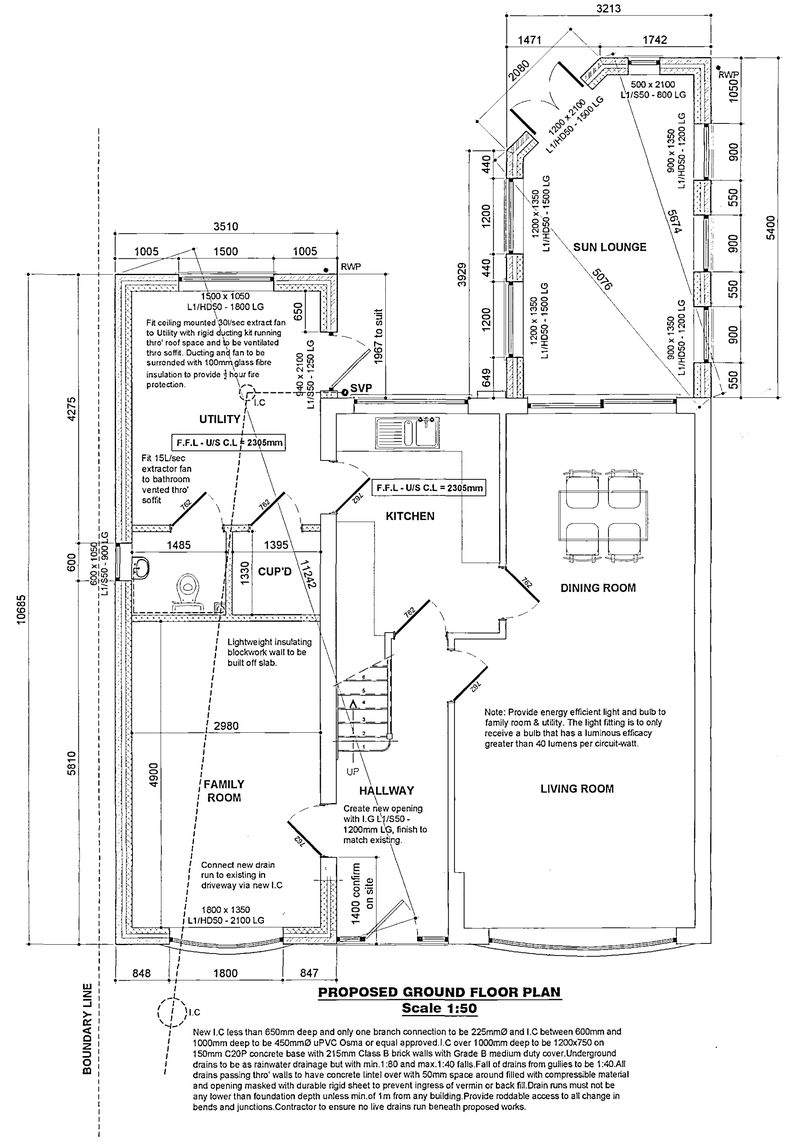

PROPOSED GROUND FLOOR PLAN
Scale 1:50

New I.C less than 650mm deep and only one branch connection to be 225mmØ and I.C between 600mm and 1000mm deep to be 450mmØ uPVC Osma or equal approved.I.C over 1000mm deep to be 1200x750 on 150mm C20P concrete base with 215mm Class B brick walls with Grade B medium duty cover.Underground drains to be as rainwater drainage but with min.1:80 and max.1:40 falls.Fall of drains from gullies to be 1:40.All drains passing thro' walls to have concrete lintel over with 50mm space around filled with compressible material and opening masked with durable rigid sheet to prevent ingress of vermin or back fill.Drain runs must not be any lower than foundation depth unless min.of 1m from any building.Provide roddable access to all change in bends and junctions.Contractor to ensure no live drains run beneath proposed works.

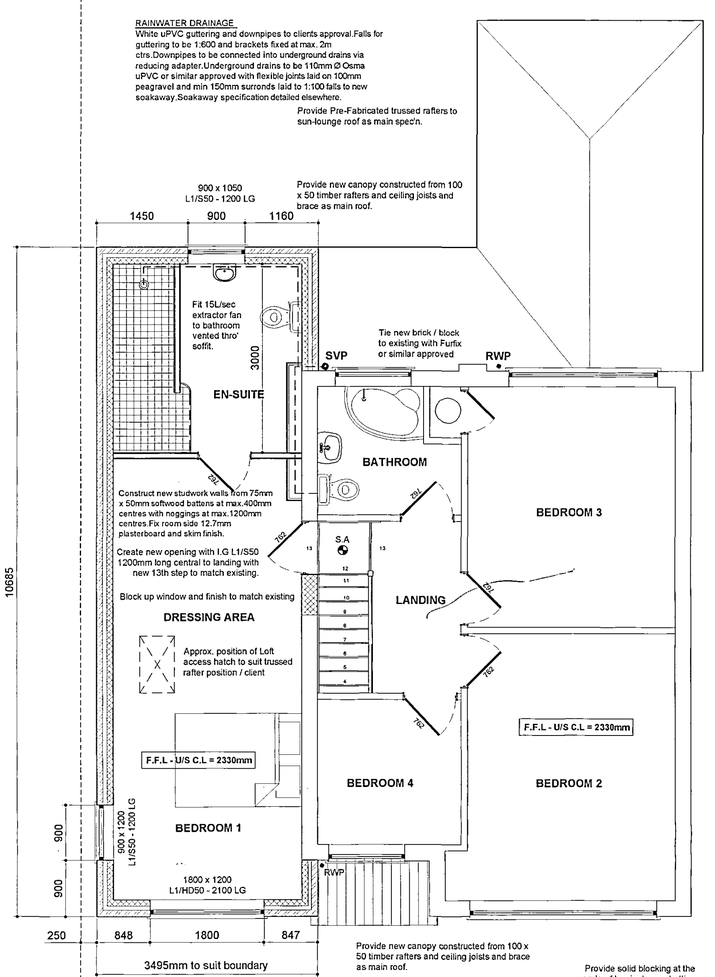

PROPOSED FIRST FLOOR PLAN
Scale 1:50

ROOF INSULATION
Lay 300mm mineral fibre insulation to roof area to achieve a min 'U' value of 0.16w/m²K.100mm between rafters and 200mm over rafters at right angles to first layer.Fix Dovetail rafter tray in accordance with manufacturers instructions or similar approved where insulation meets roof slope to maintain roof ventilation.

ROOF FINISH
Concrete interlocking roof tiles to Clients requirements / approval in accordance with manufacturers instructions on 50x25 preservative treated timber battens on untearable sarking felt type IF with min.150mm overlaps.Generally all tiles at perimeter of roof to be clipped and nailed.

ROOF VENTILATION
Roof ventilation to be achieved via soffit level ventilators complete with integral insect proof screens which will supply the roof space with ventilation gap equivalent to continuous 10mm gap.Provide at both sides of roof to ensure cross ventilation.

CEILINGS
All ceilings to be 12.7mm plasterboard to BS1230.
Ceilings to be have Coving and an Artex finish to clients requirements.Plasterboard sheets to be fixed with joints staggered and must be layed perpendicular to all joist runs.Fix boards at a min.150mm centres.

SMOKE ALARMS
To be self contained,interconnected and wired to a separatly fused circuit with a battery back up.Smoke alarms to be fitted to w/side of plasterboard ceiling to the ground floor max 7m from the kitchen / lounge and to be max. 3m from any bedroom door. All alarms to be strictly in accordance with BS 5446 and to be wired that when one alarm is triggered all alarms are activated.

WASTE SIZES FOR NEW PLUMBING
All new plumbing to have the following waste sizes:
W.C=100mm ø Multikwik or similar approved
W.H.B=32mm ø uPVC with 75mm Deep sealed trap
SINK=40mm ø uPVC with 75mm Deep sealed trap
SHOWER=40mm ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction.Provide anti-siphon traps where pipe runs exceed 3m and W.H.B pipe run exceeds 1.8m.

Provide solid blocking at the ends of herringbone strutting between last joist and wall and underneath all restraint straps

First and last joists to all areas to be clear of wall by 25-50mm to assist in service and floor laying.


Double up joists (D) underneath studwork wall.

Provide twisted restraint strap fixed to joists held tight against blockwork either side of joist to provide lateral restraint to wall.Ensure strap doen't bear on perpend joint in blocks.

All cut ends of joists to be sealed with suitable preservative priorir to fixing in position.

Lay 22mm Weyroc Tongue and Grooved flooring grade wood particle boarding or equal approved on top of first floor joists with staggered joints

175x50 joists @ max.400mm ctrs. Solid herringbone strutting (H) @ mid point to spans over 2m. Strutting at third points to span over 4m. Joists to be supported at all junctions with approved Joist Hangers with 75mm min bearing on masonry and joist.Joist to be cut accurately for a tight fit in hanger with max.6mm gap. Joist bottom to be notched to keep ceiling line level.

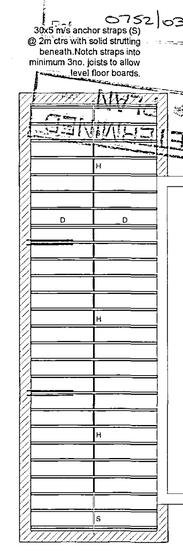

ALL TIMBER TO BE SC3 GRADE

JOIST PLAN
Not to Scale

ROOF / LOFT ACCESS
Provide insulated roof access trap door with a fully weathered sealed frame and a 38mm brass bolt or to clients requirements.

NOGGINGS
Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings.Position of light fittings to be advised by client on site.

INTERNAL JOINERY ,SKIRTING & ARCHITRAVES.
All internal finished timber to be free from all defects and to clients approval prior to ordering any materials.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E Regulations and Engineer to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

HEATING SYSTEM:
Provided from existing but all radiators are to be fitted with thermostatic radiator valves. All space heating pipework located outside the building fabric insulation layers to be wrapped with insulation material having a thermal conductivity at 40°C not exceeding 0.035 W/m*K and a thickness equal to the outside diameter of pipe upto max. of 40mm.It should be noted that central heating and hot water pipework in unheated areas may need increased insulation thicknesses for the purpose of protection against frost, refer to BRE Report No. 262 2002 Edition.

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min.depth of 150mm before excavation commences.Concrete mix for foundations to be GEN3 in accordance with BS5328:1981.Foundations to external wall to be min.700mm wide x 225mm deep.Excavate down to solid firm strata i.e 750mm deep (min.1000mm if soil is of a shrinkable nature).Exact depth to suit conditions on site and to the strict approval of the L.A. Building Inspector.Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building inspector & advice to be sought from a Chartered Structural Engineer.

WALLS BELOW D.P.C
3no.Coarses of Class B brickwork below D.P.C on outer face and 1no.coarse of 7N/mm2 on inner skin of cavity face Elsewhere to be either 7N/mm2 concrete blockwork or full width trench blocks.Both to be within 225mm of DPC level.Cavity to be filled to within 225mm min. of below DPC with lean concrete mix.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge poythene separating layer on a 60mm Celotex Double R GA2000 rigid insulation board or 100mm thk.Jablite Jabfior 70 or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation upto d.p.c level on 100mm thick GEN3 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min.150mm clean and well compacted hardcore.Depth of hardcore must not exceed 600mm and must be compacted in 150mm thick layers.All service entries to be sealed with pressure sensitive tape. Floor to achieve a min 'U' Value of 0.25w/m²K.

DAMP PROOF COARSE (D.P.C)
Horizontal heavy duty polythene DPC "Hyload" or similar approved to all walls in accordance with BS 6515 and set min.150mm above all external ground levels.DPC in walls must be linked / lapped with DPM in ground floor.Provide performed cavity wall trays above windows & doors with weep vents at a max.of 2m centres with a min.of 2no.per opening.

EXTERNAL WALLS
All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses.
-100mm Thermalite Shield insulating blockwork.
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min 'U' value of 0.35w/m²K.

CAVITIES
Close all cavity walls at jambs with Thermabate or similar approved Insulated cavity closers fitted strictly in accordance with manufacturers instructions. Roof insulation to be continuous with wall cavity insulation.

MORTAR
All mortar to be 6:1:1 sand/cement/lime or equally approved and to be a consistent colour throughout duration of contract.Finish mortar joints as agreed with Client on site.

WALL TIES
Stainless steel cavity wall ties to BS1243:1978.To be built into cavity wall as works proceeds and spaced at 900mm centres horizontally,450mm centres vertically and 300mm staggered around all openings.Ensure wall ties are level or at least sloping to the outside leaf.Bed ties a minimum of 50mm into each leaf and ensure wall ties are completely free from mortar droppings.

LINTELS
All lintels to cavity wall to be factory insulated I.G L1 range unless noted otherwise or equalled approved.All lintels must have a min.150mm endbearing and installed in accordance with manufacturer's instructions.Do not allow masonry to overhang lintel by more than 25mm. Note: lintels are not to have a continuous baseplate.

WINDOWS & DOORS
All windows to be White uPVC to clients requirements based on styles shown on elevations.Fit with 4000mm² trickle ventilators to Kitchen, Utility,Bathroom & En-Suite windows and 8000mm² elsewhere all in accordance with manufacturer's recommendations.Patio doors to be fitted with 10000mm² ventilators.Opening vents to give 1/20 th of floor area rapid ventilation to all rooms.All glazing within 800mm of floor level and within 300mm of a door to a height of 1500mm of ground level to have toughened glass in accordance with Section N of the Building Regulations and BS6206 class B.All doors & glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a soft Low 'E' coating on glass inner pane to achieve a min 'U' value of 2.0 w/m²K.Note all windows to have a perimeter weatherseal both internally and externally and to be fully draught sealed.Provide frosted glass to all Bathroom, W.C's and En-Suite windows.Ensure windows & doors are fitted within masonry reveal to overlap cavity closer by min.10mm to avoid cold bridging.Provide reconstituted stone subcills to windows as shown.Subcill to clients approval. Ensure subcills are fully protected throughout duration of building works.

ROOF CONSTRUCTION
To be Trussed Rafters designed and constructed in accordance with BS 5268 Part 3:1985 all by specialist approved manufacturer.Trusses to be set at max.600mm centres with all necessary 100x25 bracing.Truss manufacturer to provide all necessary calculations and details to the Client / Contractor for L.A. Building Inspectors approval prior to installation of any roof truss.

TIMBER WALLPLATES
All timber wallplates supporting roof trusses to be 100mm x 50mm bedded on top of wall.Timber to be SC3 grade and use a min. length of 3m and half-lap plates at joints and corners..Provide anchor straps as described in notes elsewhere.

LATERAL RESTRAINT STRAPS
Tie roof structure to blockwork wall with 30X5 galvanised mild steel straps at max 1.8m ctrs where rafters and ceiling joists run parallel to blockwork walls.Also fit at max 1.8m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap.


SOAKAWAYS
All rainwater to discharge into soakaways and to be min.of 5m from any building & a min.of 1m³ filled with rubble to within 450mm of external ground level.Overlay rubble with polythene sheet and backfill with clean topsoil.Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions.




EXISTING FRONT ELEVATION
Scale 1:100



EXISTING REAR ELEVATION
Scale 1:100

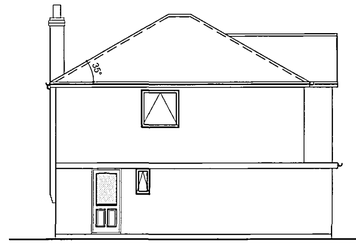

EXISTING SIDE ELEVATION
Scale 1:100

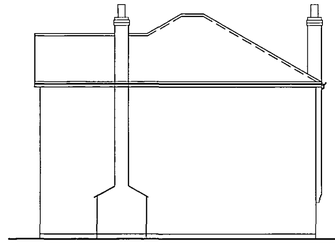

EXISTING SIDE ELEVATION
Scale 1:100




Canopy to be formed from 100 x 50 Rafters @ 450mm ctrs and ceiling binders at approx. 35°.Brace roof with 100 x 22 in accordance with BS5268 Part 3 1985 as sun lounge spec'n.Roof ventilation to be achieved via soffit level ventilators complete with integral insect proof screens which will supply the roof space with ventilation equivalent to a continuous 10mm gap and Top Abutment Ventilation system which will supply the equivalent of continuous 5mm gap as detail.Insulation as main spec'n.

PROPOSED FRONT ELEVATION
Scale 1:100




Ensure opening vents to extension will allow means of escape in an emergency situation.Opening vent to be min.450 wide in each direction with an area of 0.33m² Cill level to be within 800mm & 1100mm of FFL and fitted with egress hinges.

PROPOSED REAR ELEVATION
Scale 1:100

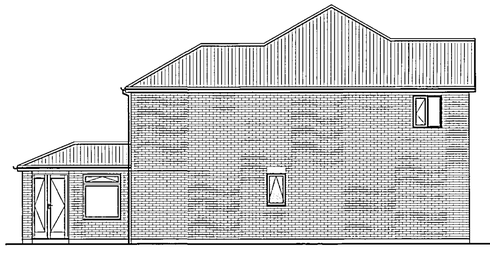

PROPOSED SIDE ELEVATION
Scale 1:100

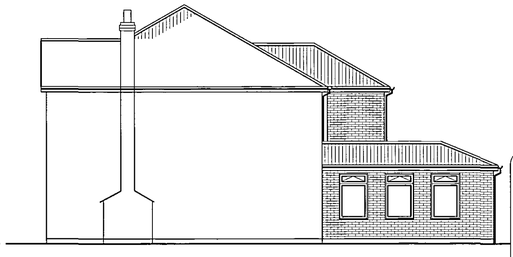

PROPOSED SIDE ELEVATION
Scale 1:100

GENERAL CONDITIONS
Contractors are resonsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment.If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are ell subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose.All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.

Planning Development
12 JUN 2003
0752/03

REV DESCRIPTION:

remway design
Plans drawn for: Local Authority - Planning permission & Building Control.
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project: Proposed Utility & First Floor Bedroom Extension

Client: Mr & Mrs S Compton
17, Oakley Drive
Spalding
PE11 2BN

Date:	DRG No. :	REV:
may'03	SC.01	