

FLOOD RISK ASSESSMENT

Proposed Change of Use of Agricultural Barns
to Residential Use,
The Hollies,
Pilmore Lane,
Fulney.
PE12 6EG



RM ASSOCIATES

10 Main Street
Thorpe on the Hill
Lincoln
LN6 9BG
Mobile 07967 304737
Email: ray.rmassociates@gmail.com
September 2024 Version 1

RMA

Contents

INTRODUCTION	1
APPLICATION SITE.....	1
Table 1: Flood Zones Definition	2
Table 2: Flood Risk Vulnerability Classification.....	2
Site Levels.....	3
DRAINAGE AUTHORITIES	3
Environment Agency	3
Flood Zones	3
Flood Map for Planning (Source EA).....	3
Risk of Flooding from Rivers & Sea	4
Risk of Flooding from Rivers & Sea Map (Source EA)	4
The Tidal Defences	4
Tidal Flooding.....	4
Breach Analysis to the Tidal Defences.....	5
Tidal Breach Maps for 1 in 1000year Event Present Day (Source EA)	6
Tidal Breach Maps for 1 in 1000year Event 2115 (Source EA).....	6
Fluvial Flooding	6
Fluvial Defences.....	6
Node Map.....	7
Simple Breach Analysis.	7
Lidar Floodplain Section.....	8
Finished Floor Levels	9
South Holland Internal Drainage Board.....	9
Extract from South Holland IDB Drainage Map	9
FLOODING FROM OTHER SOURCES	10
SURFACE WATER FLOODING	10
Risk of Flooding from Surface Water Map (Source EA)	11
RESIDUAL RISKS.....	11
SEQUENTIAL APPROACH.....	11
Table 3: Flood risk vulnerability and flood zone 'compatibility'	12
Sequential Test and Exceptions Test.....	12
CLIMATE CHANGE	12
Peak River Flow Allowances.....	12
Table 1 Peak Rainfall Intensity.....	13
Table 2 Peak Sea Level Rise	13
DRAINAGE STATEMENT	13
Surface Water Drainage.....	14
Foul Water Drainage	14
FLOOD RESILIENCE CONSTRUCTION	14
CONCLUSION	15

Figures

Map 1	Tidal Model Analysis 2006 Map & Table
Plan 1	Location Plan
Plan 2	Existing Site Plan
Plan 3	Proposed Site Plan
Plan 4	Proposed Ground Floor Plan Unit 1 & 2
Plan 5	Proposed Ground Floor Plan Unit 3 & 4
Plan 6	Proposed Ground Floor Plan Unit 5
Plan 7	Topographical Survey

FLOOD RISK ASSESSMENT FOR PROPOSED CHANGE OF USE OF AGRICULTURAL BARNs TO RESIDENTIAL USE, THE HOLLIES, PILMORE LANE, FULNEY. PE12 6EG.

INTRODUCTION

The Government has placed increasing priority on the need to take full account of the risk associated with flooding at all stages of the planning and development process. This seeks to reduce the future damage to property and the risk to life from incidents of flooding. Their expectations relating to flooding are contained in the National Planning Policy Framework December 2023, (NPPF), which identifies how the issue of flooding is dealt with in the drafting of planning policy and the consideration of planning applications by avoiding inappropriate development in areas at risk from flooding and to direct development away from areas at highest risk.

The NPPF provides that development in areas at risk of flooding should be avoided and seeks to direct development away from areas at highest risk. There is a sequential, risk-based approach to the location of development avoiding where possible, flood risk to people and property managing any residual risk and taking account of the impacts of climate change.

This document has been prepared solely as a flood risk assessment and drainage statement on behalf of the client, Miss, Veronica Frohock, to support the planning application. RM Associates accepts no responsibility or liability for any use of this document other than by the client, for the purposes for which it was originally commissioned and prepared. If any unauthorised Third Party comes into possession of this report; they rely on it at their own risk and RM Associates owe them no duty of care or skill. All comments contained in this report, including any conclusions are based upon information available at the time of writing the report. RM Associates accepts no liability if additional information exists or becomes available after the time of writing this report. This document is the copyright of RM Associates. The reproduction or transmission of all or part of this document, whether by photocopying or storing in any medium by electronic means or otherwise, without the prior written consent of RM Associates is prohibited.

This report contains public sector information licensed under the Open Government Licence v3.0.

APPLICATION SITE

The proposed site is located at The Hollies, Pilmore Lane, Fulney, Spalding, PE12 6EG within the administrative area of South Holland District Council. The National Grid Reference is TF26694 23292. **Plan 1**

This flood risk assessment has been prepared for a planning application for the change of use of 3No Agricultural barns to 5No residential dwellings, under Prior notification Part 3 Class Q for *a change of use of a building and any land within its curtilage from a use as an agricultural building to a use falling within Class C3 (dwelling houses) of the Schedule to the Use Classes Order*. **Plans 2, 3, 4 5 & 6**

The National Planning Policy Framework Guidance NPPG defines three levels of flood risk depending upon the

annual probability of fluvial flooding occurring.

Zone 1 – Low Probability (<0.1%)

Zone 2 – Medium Probability (0.1 – 1.0%)

Zone 3 – High Probability (>1.0%)

The proposed development site is shown mainly to be within Flood Zone 3a High 'Probability' as detailed on the Environment Agency's Flood Zone Maps **without defences**, and as defined in Table 1 of NPPG.

Table 1: Flood Zones Definition

Flood Zone 3- High Probability
Definition. Land assessed as having a 1 in 100 or greater annual probability of river flooding (>1%) or a 1 in 200 or greater annual probability of flooding from the sea (>0.5%) in any year. The water-compatible and less vulnerable uses of land are appropriate in this zone. The highly vulnerable uses should not be permitted in this zone. The more vulnerable and essential infrastructure uses should only be permitted in this zone if the Exception Test is passed. Essential Infrastructure permitted in this zone should be designed and constructed to remain operational and safe for uses in times of flood Flood Risk Assessments requirements. All proposals in this zone should be accompanied by a Flood Risk Assessment. Policy aims. Developers and local authorities should seek opportunities to: • reduce the overall level of flood risk in the area through the layout and form of the development and the appropriate application of sustainable drainage techniques. • relocate existing development to land with a lower probability of flooding. • create space for flooding to occur by allocating and safeguarding open space for flood storage.

Applying the Flood Risk Vulnerability Classification in Table 2 of NPPG, the proposed residential use for the site is classified as "More Vulnerable," Table 1 of NPPG states that such uses are permitted in this zone, subject to the exceptions test.

Table 2: Flood Risk Vulnerability Classification

More Vulnerable
• Hospitals • Residential institutions such as residential care homes, children's homes, social services homes, prisons, and hostels. • Buildings used for: dwelling houses; student halls of residence; drinking establishments; nightclubs; and hotels • Non-residential uses for health services, nurseries, and educational establishments • Landfill and sites used for waste management facilities for hazardous waste. • Sites used for holiday or short-let caravan and camping, subject to a specific warning and Evacuation Plan.

Within Flood Zone 3, generally "more vulnerable" developments such as residential are discouraged, however, due to this being a change of use to existing buildings, the Sequential Test and Exception Test are not applicable as moving the existing building is not an option. As set out in the National Planning Policy Framework (para.174) change of use should not be subject to the sequential and exception tests but will still need to meet the requirements of a site-specific flood risk assessment.

Site Levels

From the topographical survey, the site levels vary from low of 3.15mODN to a high of 3.80mODN, with Pilmore lane at the site entrance at 3.30mODN. The existing floor levels for the barns are as follows:- Open Cart Shed, 3.57mODN, Atcost Building, 3.79mODN and the Traditional Barn 3.49mODN. **Plan 7**

DRAINAGE AUTHORITIES


Environment Agency

The Environment Agency has permissive powers for reducing the risk of flooding from designated main rivers and from the sea.

The following potential source of flooding affecting the development site has been identified as:

- River Welland/ The Wash (Tidal)
- River Welland (Coronation Channel) (Fluvial)

Flood Zones

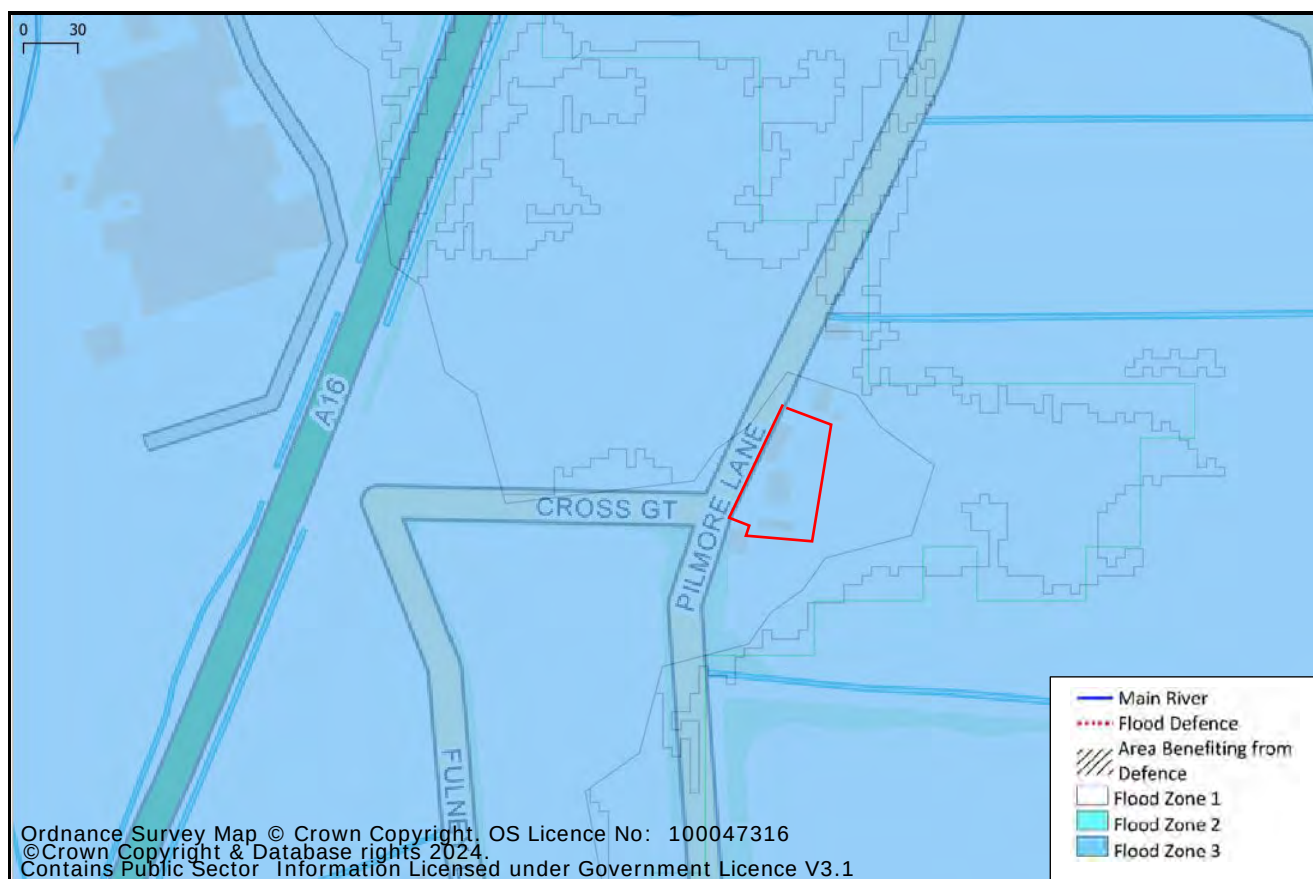

These maps show that the site is considered at risk from tidal flooding as it is all located within an area zoned as Flood Zone 3a. The maps indicate that the area would be flooded without flood defences, which are in place, (with an annual probability of more than 0.5% i.e., return frequency of less than 1 in 200 years for tidal flooding or more than

1.33% return frequency of less than 1 in 100 years for fluvial flooding).

Risk of Flooding from Rivers & Sea

The Risk of flooding from Rivers and Sea shows that the site is at Medium risk. **Medium risk** means that each year this area has a chance of flooding of between 0.1% and 1.0%. This takes into account the effect of any flood defences in the area. These defences reduce but do not completely stop the chance of flooding as they can be overtopped or fail.



Risk of Flooding from Rivers & Sea Map (Source EA)

The Tidal Defences

The existing tidal defences protecting this site consist of earth embankments. They are in fair condition and reduce the risk of flooding (at the defence) to a 1% (1 in 100) chance of occurring in any year. We inspect these defences routinely to ensure potential defects are identified. Regular inspection and maintenance is carried out routinely by the Environment Agency to ensure potential defects are identified. The probability of major structural failure is very low, less than 0.5%.

Tidal Flooding.

From Lincolnshire & Northamptonshire Area Tidal Modal Analysis, levels for East Coast and Wash: Immingham to the West Lighthouse have an assessment date of 2017, which should be used in any consideration of future increases due to climate change. **Map 3**

Peak tide levels (2017) for the 1 in 200-year 50% confidence bound tide level is 5.98mODN at Marsh Lane, the

table does not show the 1 in 1000-year levels. The 1 in 1000-year 50% confidence level at Fosdyke Bridge present day is 5.98mODN and this level is assumed to be the same at Marsh Lane.

The base date for the data is 2017 for the still water levels, the Peak tide levels Present Day (2017) at Marsh Lane for the 50% confidence bound 0.5% (1 in 1000year) is 5.98mODN.

Higher Central Peak tide levels (2124) for the 0.5% (1 in 1000) = 6.29mODN plus climate change from Table 3 (2017 – 2124) of 1090mm = 7.07mODN

Breach Analysis to the Tidal Defences

Taking the precautionary approach, the Hazard Rating following a breach which in Flood Risk Assessment (FD 2320) Guidance for New Development Phase 2 R& D Technical Report these are classified as low <0.75, moderate 0.75-1.25, significant 1.25-2.50 and extreme >2.50 based upon an empirical measure of velocity and depth.

Flood Hazard			Description
	<0.75	Low	Caution – Flood Zone with shallow flowing water or deep standing water.
	0.75 – 1.25	Moderate	Danger for Some - (i.e. children) Danger Flood Zone with deep or fast flowing water.
	1.25 – 2.0	Significant	Danger for Most – Danger Flood Zone with deep fast flowing water.
	>2.0	Extreme	Danger for All – Extreme Danger Flood Zone with deep fast flowing water.


$$HR = d \times (v + 0.5) + DF$$

Where V = Flood flow velocity (m/sec) D = Flood depth (m)

DF = A debris factor included to represent the greater damage, or risk of injury to people, that can occur if debris is swept along with the water. = 0.5 for depths <0.25 or 1.0 for depths

The Environment Agency has carried out a Tidal Hazard Mapping for the Wash following a breach to the defences.

Following a breach to the defences, the Lincolnshire & Northamptonshire Area Tidal Hazard Maps (2009), Scenario year 2006, for the 1 in 1000-year event. The maps show that the site is not within in a Hazard rating area. With climate change up to year 2115 the maps show that for Scenario annual chance 1 in 1000 year, the site is within in a Hazard rating Less than 0.75 (Low hazard) with a maximum predicated depth of flow 0 – 0.25m and velocity of flow 0 – 0.3m/sec.

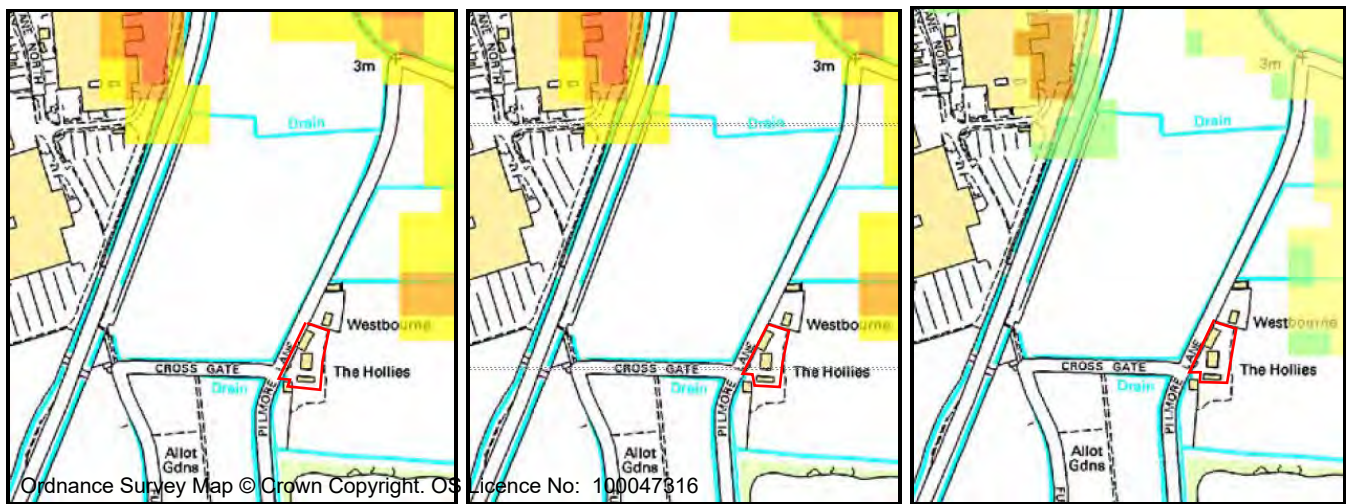

Tidal Breach Maps for 1 in 1000year Event Present Day (Source EA)

Max Hazard (Flood Risk to People - FD2320)	Max Depth (m)	Max Velocity (m/s)
Less than 0.75 (Low Hazard)	0 - 0.25	0 - 0.3
Between 0.75 and 1.25 (Danger for Some)	0.25 - 0.50	0.3 - 1.0
Between 1.25 and 2.0 (Danger for Most)	0.50 - 1.0	1.0 - 1.5
Greater than 2.0 (Danger for All)	1.0 - 1.6	1.5 - 2.5
	1.6 +	2.5 +



Tidal Breach Maps for 1 in 1000year Event 2115 (Source EA)


Fluvial Flooding

The site is however also subject to fluvial flooding following a breach to the Coronation Flood defences, Coronation Channel is a bypass to the River Welland is located some 485m west of the site.

Fluvial Defences

The existing fluvial defences reducing the risk of flooding to this site consist of earth embankments. They are in fair condition and reduce the risk of flooding (at the defence) to a 2% (1 in 50) chance of occurring in any year. The Environment Agency inspect these defences routinely to ensure potential defects are identified.

The fluvial levels flow for these node points are taken from the Welland catchment Strategic Model 2016. and are the most up-to-date currently available. The Environment Agency aims to review their models on a regular basis.

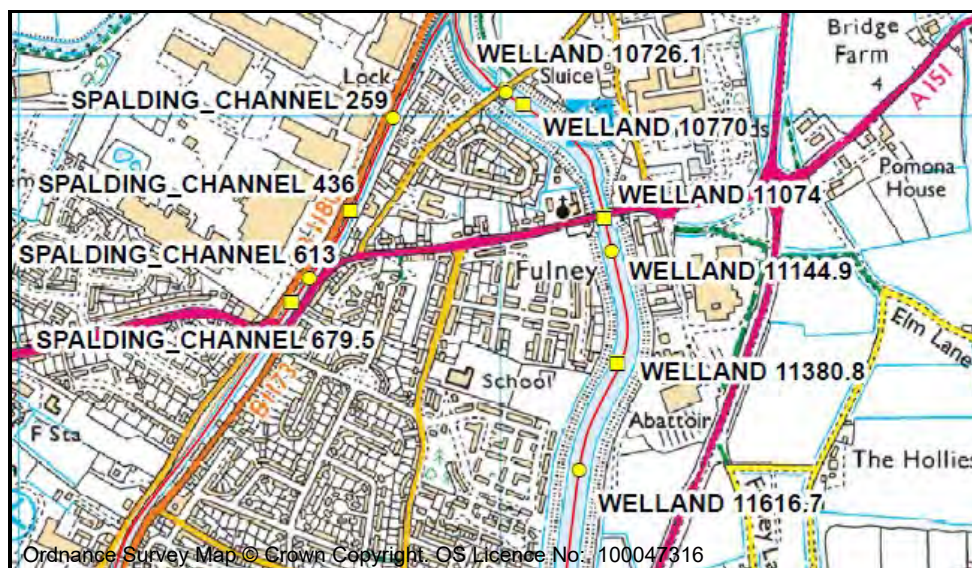

Node Map

Fluvial Flood Levels (mODN)

The fluvial flood levels for the model nodes shown on the attached map are set out in the table below. They are measured in metres above Ordnance Datum Newlyn (mODN).

Node Label	Easting	Northing	Annual Exceedance Probability - Maximum Water Levels (mODN)											
			50% (1 in 2)	20% (1 in 5)	10% (1 in 10)	5% (1 in 20)	3.3% (1 in 30)	2% (1 in 50)	1.33% (1 in 75)	1% (1 in 100)	1% (1 in 100) inc 20% Climate Change	0.5% (1 in 200)	0.1% (1 in 1000)	0.1% (1 in 1000) inc 20% Climate Change
SPALDING_CHANNEL 259	525779	323995	3.70	4.00	4.17	4.45	4.50	4.51	4.52	4.52	4.68	4.53	4.56	4.68
SPALDING_CHANNEL 613	525605	323662	3.70	4.00	4.17	4.45	4.50	4.51	4.52	4.52	4.68	4.53	4.55	4.68
WELLAND 10726.1	526013	324049	4.33	4.33	4.40	4.42	4.46	4.47	4.45	4.44	5.49	4.43	4.43	5.50
WELLAND 11144.9	526232	323719	3.65	3.91	4.10	4.36	4.39	4.39	4.42	4.44	4.68	4.45	4.46	4.68
WELLAND 11616.7	526165	323266	3.66	3.92	4.11	4.36	4.40	4.41	4.42	4.45	4.68	4.46	4.47	4.68

Fluvial Flood Flows (m³/s)


The fluvial flood flows for the model nodes shown on the attached map are set out in the table below. They are measured in metres cubed per second (m³/s).

Node Label	Easting	Northing	Annual Exceedance Probability - Maximum Flows (m³/s)											
			50% (1 in 2)	20% (1 in 5)	10% (1 in 10)	5% (1 in 20)	3.3% (1 in 30)	2% (1 in 50)	1.33% (1 in 75)	1% (1 in 100)	1% (1 in 100) inc 20% Climate Change	0.5% (1 in 200)	0.1% (1 in 1000)	0.1% (1 in 1000) inc 20% Climate Change
SPALDING_CHANNEL 436	525690	323802	0.71	1.06	0.91	1.06	1.02	1.03	1.15	1.17	1.65	1.10	1.07	1.93
SPALDING_CHANNEL 679.5	525567	323613	1.30	1.99	1.77	2.06	2.01	1.93	2.24	2.31	3.19	2.18	2.06	3.61
WELLAND 10770	526048	324023	74.58	91.64	102.46	116.08	120.26	121.43	121.70	123.79	124.12	122.86	123.37	236.17
WELLAND 11074	526216	323788	73.88	89.28	100.54	115.25	119.36	118.58	119.51	123.31	124.59	121.86	124.52	119.07
WELLAND 11380.8	526243	323488	73.26	88.29	99.60	113.62	116.57	117.69	118.52	120.34	123.53	119.44	119.22	118.30

The above results have a climate change increase of 20% added to the peak river flows whereas the updated guidance (20 July 2021) the Central allowance (17%) should be used for More Vulnerable uses in flood zone 3a should be added for developments in Anglian RBD/ Welland management catchment. This 3% reduction in river levels has been discounted within this flood risk assessment.

Simple Breach Analysis.

Given the scale and nature of the proposed development it is considered that additional hydraulic modelling is not appropriate to determine the breach level at the site. Coronation Channel flood level with climate change for node Welland 11616.7 is 4.68mODN.

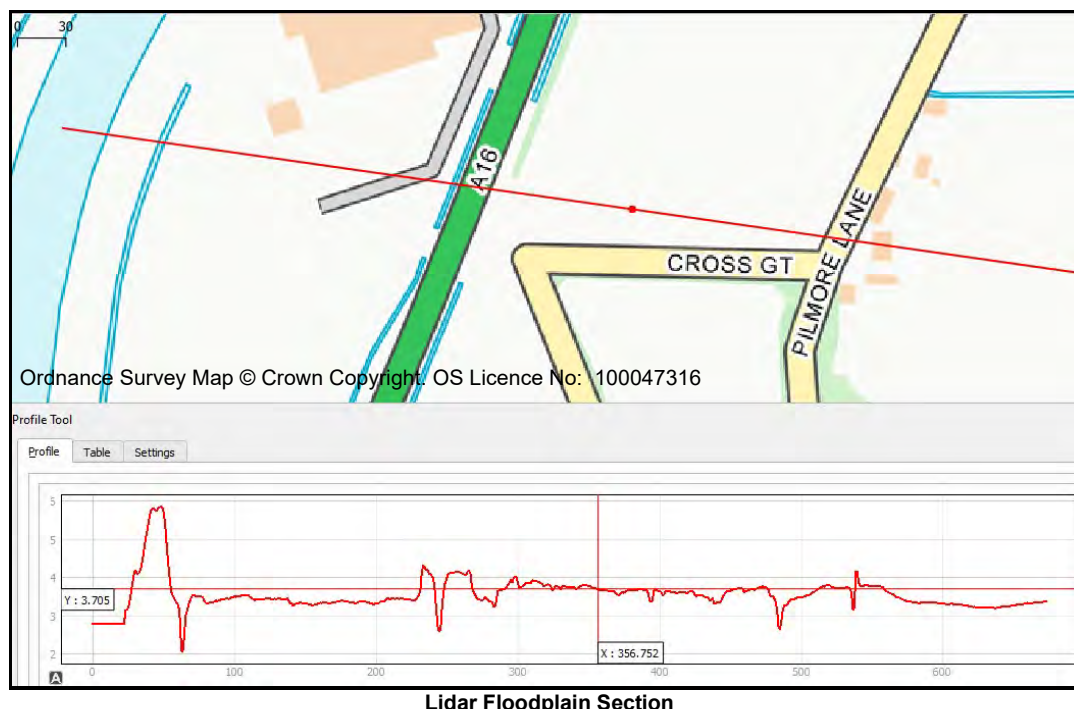

Lidar data reveals that the A16 Spalding Bypass is at a level of 4.17mODN and this road bisects the flood cell into two areas, the road will therefore act as a weir, this area would fill first up to the level of the road and then spill over into the remaining flood cell, giving a head of 0.51m, assuming the western cell fills to the river level. The general floodplain level between the A16 and the site is taken to be 3.70mODN.

Using the Simple Breach Tool, for the 1 in 1000-year event (Central)

Reference (number, site name etc.):	The Hollies, Fulney
Date:	10.08.2024
Model:	Coronation Chancel
In-channel node:	Welland11616.7
River Basin	Welland
Time Horizon	2080's
AEP Scenario	1000
Extrapolated Water Levels at Node Welland 11616.7	
Central Scenario	4.68mODN
Ground Level / Floodplain information	
At breach	4.17mODN
Floodplain Type	Unconfined
General Floodplain Level	3.7mODN
Defence Type	Fluvial River - Earth Bank
Breach Width	40m
Distance to site from A16	260m

	Central	
Depth at site	0.09	metres
Velocity at site	0.50	m/s
Hazard value at Site	0.59	
Hazard rating at Site	Low	
Generalised FLOOD LEVEL	3.79	mODN
FLOOR LEVEL REQUIRED (inc. 0.3m freeboard)	4.09	mODN

Finished Floor Levels

The design of the buildings has taken the above flood predictions into account

The Environment Agency recommends that appropriate mitigation measures / flood resilience techniques are incorporated in the design of developments in flood risk areas. The minimum mitigation measures required for single storey developments or developments that do include ground floor sleeping shall be determined by the flood depths arising from the 2115 0.1% breach scenario. Any developments that do not include ground floor sleeping can be informed by the flood depths arising from the 1 in 100-year 1% breach scenario.

With the main risk of flooding being from a breach to the Coronation Channeel, it is proposed that the finished floor level for all the proposed dwellings be set at a minimum of 4.09mODN which is 300mm above the predicted breach flood level.

South Holland Internal Drainage Board

The site lies within the administrative area of the South holland Internal Drainage Board who has powers under the Land Drainage Act to carry out measures to alleviate flooding in Districts with special drainage needs other than Main River.

The Board does not have any maintained drains close to the site.



Extract from South Holland IDB Drainage Map

FLOODING FROM OTHER SOURCES

Flooding is a natural process and can happen at any time from sources other than watercourses and the sea.

- Flooding from land can occur from intense rainfall, often over short duration of time that is unable to soak into the ground or enter the drainage system. However, with the natural topographic nature of the ground being flat, with no high ground around the site this will not cause any rapid inundation of the site and is likely only lead to local ponding of shallow depth and low velocity. The ground floor level for the buildings is to be raised well above the surrounding ground level. It is concluded that flooding from this source is limited to minor isolated cases and is not of strategic significance as regards to flood risk.
- Groundwater flooding occurs when groundwater levels increase sufficiently for the water table to intersect the ground surface. Groundwater flooding can occur in a variety of geological settings including valleys, in areas underlain by chalk, and in river valleys with thick deposits of alluvium and river gravels. The area is not known to suffer from any groundwater problems.
- Flooding from sewers can occur from overloading from heavy rainfall caused by blockages or having inadequate capacity. There are no public sewers within 150m of the site.
- Non-natural or artificial sources of flooding such as reservoirs, lakes, or canals where water is stored above natural ground level could cause flooding if the structure fails or is over topped. There are no known sources within the vicinity of the site.


SURFACE WATER FLOODING

The proposed development site is shown on the Low-Risk scenario Surface Water flood maps, for the 1 in 1000-year event, not to be affected from surface water flooding.

The maps for surface water and revised maps for river and sea flooding define the risk as High, Medium, Low and Very Low. The chance of flooding for the area defined in any given year is shown below:

- **High:** greater than 1 in 30 (3.3%).
- **Medium:** between 1 in 100 (1%) and 1 in 30 (3.3%).
- **Low:** between 1 in 1000 (0.1%) and 1 in 100 (1%).
- **Very Low:** less than 1 in 1000 (0.1%)

Unlike the fluvial mapping, which is based on a detailed hydraulic model, this mapping is based purely on applying rainfall to a digital terrain model. As such this mapping serves to represent a worst-case scenario which may well overstate the actual probability of flooding in this area with low depressions shown to be affected.

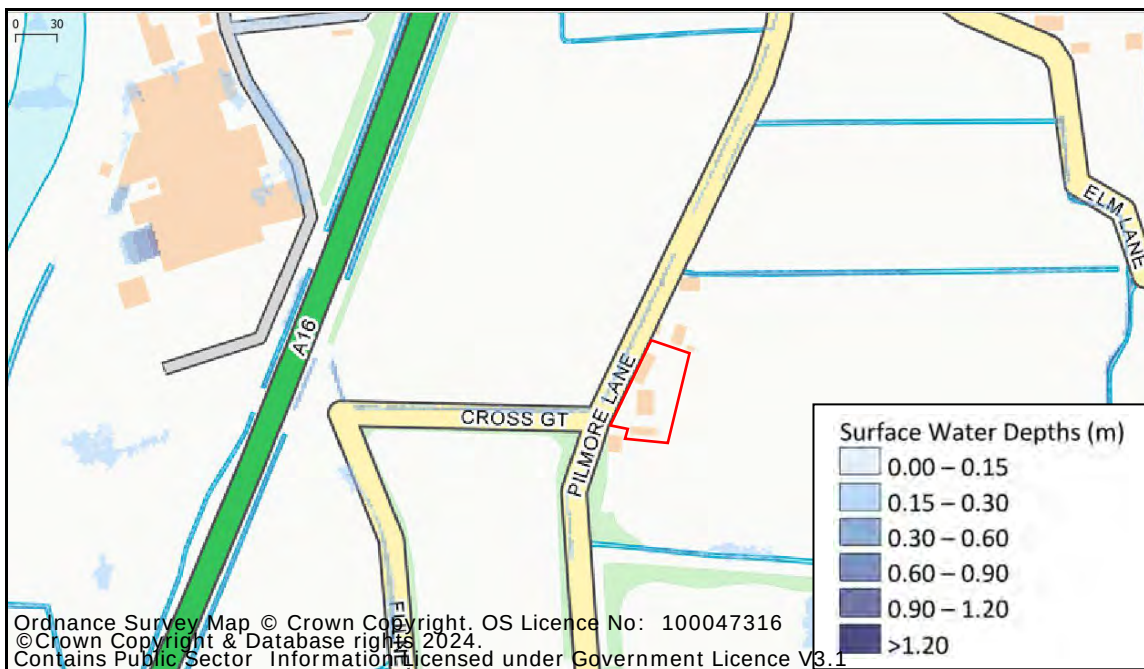

Risk of Flooding from Surface Water Map (Source EA)

There is a caveat contained in the Environment Agency “What is the Risk of Flooding from Surface Water Map Report version 2.0, April 2019, as to the use of these maps, which states that:- *“the map does not contain sufficient information for it to be used to determine flood risk to individual properties, but it does give you an indication of whether your area may be affected by surface water flooding and to what extent.”*

RESIDUAL RISKS

There is always a possibility of a flood more than that allowed for which might conceivably cause some flooding to the properties. However, such an event would have a very low probability and the risk of flooding to the properties would be extremely small. It is therefore considered that the residual risks associated with flooding are not significant.

SEQUENTIAL APPROACH

When applying the sequential approach for flood risk in accordance NPPF the site of the development would fall into Flood Zone 3 (High Probability) as the site is shown to be within the fluvial/tidal flood plain as shown on the Environment Agency’s Flood Map without defences in place.

The Environment Agency categorise land into one of three Flood Zones.

- Flood Zone 1 is land outside the 0.1% floodplain (with a chance of flooding of less than 0.1% chance in any given year).
- Flood Zone 2 is land that falls between the 1 in 100-year extent and the 1 in 1000-year extent (a chance of flooding between 1% and 0.1% in any given year).
- Flood Zone 3a is land which falls within the 1 in 100-year flood extent (has a 1% chance of a flood

occurring in any given year).

Applying the Flood Risk Vulnerability Classification in Table 2 of NPPG, the proposed development for residential use is classified as, “More Vulnerable” with Table 1 of NPPG stating that such uses are appropriate in this zone (as summarised in Table 3 NPPG).

Table 3: Flood risk vulnerability and flood zone ‘compatibility’

Flood Risk Vulnerability Classification		Essential Infrastructure	Water Compatible	Highly Vulnerable	More Vulnerable	Less Vulnerable
Flood Zone	Flood Zone 1	✓	✓	✓	✓	✓
	Flood Zone 2	✓	✓	Exception Test Required	✓	✓
	Flood Zone 3a	Exception Test Required	✓	✗	Exception Test Required	✓
	Flood Zone 3b Functional Floodplain	Exception Test Required	✓	✗	✗	✗

Sequential Test and Exceptions Test

NPPF Guidance Paragraphs 157 - 179 requires development within high areas of flood risk be determined using a sequential risk-based approach to the location of development to avoid where possible flood risk to people and property and manage any residual risk, taking account the impacts of climate change.

The aim of the Sequential Test is to steer new development to areas with the lowest probability of flooding. The NPPF states that development should not be permitted if there are reasonably available sites appropriate for the proposed development in areas with a lower probability of flooding. It is important to note that the Sequential Test does not specifically mean that sites such as this cannot be developed, rather that sites at less risk should be developed first.

As set out in the National Planning Policy Framework Technical Guidance (para.174), change of use should not be subject to the sequential and exception tests but will still need to meet the requirements of a site-specific flood risk assessment.

CLIMATE CHANGE

Global warming is now recognised that it is likely to affect the frequency and severity of extreme events as both tidal and fluvial flooding. The Climate change allowances in the NPPF Guidance was updated on the 20th of July 2021.

Peak River Flow Allowances

For flood risk assessments use the Management Catchment Climate Changes for the peak river flow map.

Management catchments are sub-catchments of River Basin Districts.

The site is located within the Welland Management Catchment within the Anglian River Basin District, for sites within Flood Zone 2 or 3a and for “More Vulnerable” land uses, the Central allowances figures, in the Table below, should be used.

Peak River flow allowances within the Management Catchment Allowances				
River Basin District /Management Catchment	Allowance category	Total potential change anticipated for '2020s' (2015 to2039)	Total potential change anticipated for '2050s' (2040 to2069)	Total potential change anticipated for '2080s' (2070 to2115)
Anglian/Welland	Upper End	22%	26%	53%
	Higher Central	10%	10%	28%
	Central	5%	4%	17%

The effect of global warming on peak rainfall allowances is given in Table 1.

Table 1 Peak Rainfall Intensity

Table 1 Peak rainfall intensity allowance in small and urban catchments (1961 to1990 baseline)			
Applies across all of England	Total potential change anticipated for 2010 to 2039	Total potential change anticipated for 2040 to 2059	Total potential change anticipated for 2060 to 2115
Upper End	10%	20%	40%
Central	5%	25%	40%

The annual sea rise due to climate change is given in NPPF and the recommended contingency allowances are stated in Table 2.

Table 2 Peak Sea Level Rise

Table 2 Peak Sea level allowance for each epoch in (mm) per year with cumulative sea level rise for each epoch in brackets (use 1981to 2000 baseline)						
Area of England) (Use River Basin	Allowance	2000 to 2035	2036 to 2065	2066 to 2095	2096 to 2125	Cumulative Rise 2000 to 2125 (m)
Anglian	Higher Central	5.8 (203mm)	8.7 (261mm)	11.6 (348mm)	13 (390mm)	1.20m
Anglian	Upper End	7 (245mm)	11.3 (339mm)	15.8 (474mm)	18.1 (543mm)	1.6m

DRAINAGE STATEMENT

In accordance with recognised guidance, National Planning Policy Framework & Building Regulations, there is a hierarchy of where surface water should discharge. This hierarchy should be followed where practicable, and is as follows:

- 1) Infiltration
- 2) Watercourse
- 3) Public sewer

Surface Water Drainage

Applications for developments where the proposals will result in the increase the amount of surface water run-off require that an appropriate drainage strategy to be undertaken to ensure that the surface water discharge mimics the existing pre-development regime.

With the application being a change of use of three existing buildings, the roof water will continue to be discharged to the existing drainage system which will be cleaned out and repaired as necessary.

The access and parking areas will be constructed using permeable materials such as hardcore with gravel topping.

These arrangements are the same as those which have served the existing buildings for many years, without causing any problems.

Foul Water Drainage

It is proposed to provide a gravity private foul drainage network within the curtilage of the properties which will discharge to a package treatment unit, as there are no public sewers within 150m of the site. The treatment plant and drainage network will be maintained by a management company consisting of the five property owners.

As there is a positive drainage system capable of receiving flows from the development there is no likely impact on neighbouring property.

FLOOD RESILIENCE CONSTRUCTION

Any impact of damage to the properties can be foreseen and mitigated against by relatively simple design and construction techniques. There are two forms of flood protection works: -

- **Flood-resistance or proofing works**- these try to reduce the amount of water entering a building.
- **Flood-resilient works**: - these reduce the amount of damage caused by water entering the building.

The proposed dwellings will have the following resilient materials that have low permeability to at least 600mm above the estimated flood level incorporated in the construction in accordance with "Improving the flood performance of new buildings" CLG (2007).

- o The ground floor living/sleeping accommodation for the proposed dwellings is to be raised to a minimum of 4.09mODN.
- o Water, electricity, and gas meters: should be located above the predicted flood level. Electrical services: electrical sockets, heating systems: boiler units and ancillary devices should be installed at least 500mm above the habitable floor level to minimise damage to electrical services Electric ring mains should be installed at high level with drops to ground floor sockets and switches.

- o The ground floor to be constructed with a solid concrete floor with no voids beneath and no low-level wall vents. However, if a beam type floor is to be used, provision should be incorporated for draining the under-floor void. The wall vents are to be fitted with 'Flood Angel' air bricks which allow air to free pass through as a usual, (complying with BS493:1995) but under flood conditions it shuts down when in contact with water. A removable mesh prevents the passage of debris which may otherwise impinge on the moving part.
- o Provide facilities for water to drain away after flooding such as installing a sump and a pump
- o Avoid the use of mineral fibre insulation to the ground floor level (walls & floor) and use a rigid closed cell material as these retain integrity and have low moisture take-up.
- o Where possible, all service entries should be sealed (e.g., with expanding foam or similar closed cell material). Closed cell insulation should be used for pipes which are below the predicted flood level.
- o As this site is in an area that is capable of receiving flood warnings from the Environment Agency Floodline Warning Direct system. It is recommended that the property Owner contact the Environment Agency's Floodline on 0345 988 1188 to register the property to receive advance warning of flooding by telephone, mobile, fax, SMS text, email or pager. The Environment Agency aim to issue a 'severe flood warning' approximately 2 hours before existing defences are overtopped.

CONCLUSION

- o The site does have the protection of flood defences which are well maintained by the Environment Agency.
- o The site for the proposed dwellings is shown to be within Flood Zone 3 'High Probability' as detailed on the Environment Agency's Flood Zone Maps without defences.
- o The main risk of flooding is from a breach to the Coronation Channel earth flood bank.
- o The ground floor living accommodation for the proposed dwellings is to be raised to a minimum of 4.09mODN.
- o The Flood Risk Vulnerability Classification in Table 2 of NPPG the proposed residential development is classified as "More Vulnerable", with Table 1 of NPPG stating that such uses are appropriate in this zone subject to the Exception Test.
- o As set out in the National Planning Policy Framework Technical Guidance (para.174), change of use should not be subject to the sequential and exception tests but will still need to meet the requirements of a site-specific flood risk assessment.
- o Any impact of damage to the property can be foreseen and mitigated against by relatively simple

design and construction techniques. They will be constructed using materials which are flood resilient construction as outlined in the report.

- o Flooding from other sources is unlikely to affect the site.
- o No obvious constraints have been identified that may impact the proposed development and the type of mitigation measures that can be used to reduce the flood risk, there is no increase in the flood risk to others. Following the guidelines contained within the NPPF, the proposed development is considered to be suitable assuming appropriate mitigation is maintained for the lifetime of the development.
- o It is therefore concluded that the proposed development can be constructed, safely and sustainably, to meet the requirements of NPPF and the policies of South Holland District Council.

East Coast and Wash: Immingham to the West Lighthouse

2018 Coastal Flood Boundary Extreme Sea Levels

CFB REF	LOCATION	EASTING	NORTHING	ANNUAL CHANCE (1 IN X) OF TIDE LEVEL IN METRES ODN																						
				1			10			50			100			200			300			1000				
				Confidence Bound			Confidence Bound			Confidence Bound			Confidence Bound			Confidence Bound			Confidence Bound			Confidence Bound				
				2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%	97.5%	2.5%	50%
3888	Immingham	520440	417625	4.16	4.17	4.19	4.50	4.53	4.62	4.73	4.80	5.00	4.83	4.93	5.19	4.93	5.06	5.41	4.98	5.14	5.55	5.15	5.38	6.01		
3890	Haborough Marsh	522100	416512	4.14	4.15	4.17	4.48	4.51	4.60	4.70	4.77	4.97	4.80	4.90	5.16	4.90	5.03	5.38	4.94	5.10	5.51	5.11	5.34	5.97		
3898	Grimsby	529295	413162	3.98	3.99	4.01	4.31	4.34	4.43	4.53	4.60	4.80	4.61	4.71	4.97	4.71	4.84	5.19	4.74	4.90	5.31	4.88	5.11	5.74		
3906	Buck Beck	534709	407369	3.87	3.88	3.90	4.19	4.23	4.31	4.41	4.50	4.68	4.50	4.61	4.86	4.61	4.75	5.10	4.64	4.82	5.22	4.80	5.05	5.66		
3910	Tetney	538035	405537	3.85	3.86	3.89	4.17	4.22	4.30	4.40	4.50	4.67	4.49	4.61	4.86	4.60	4.75	5.10	4.63	4.82	5.21	4.80	5.06	5.66		
3918	Donna Nook	544641	401997	3.82	3.83	3.86	4.14	4.19	4.27	4.38	4.48	4.65	4.47	4.60	4.85	4.58	4.74	5.10	4.63	4.82	5.22	4.81	5.08	5.68		
3928	Saltfleet	549131	393360	3.78	3.79	3.82	4.11	4.16	4.26	4.36	4.46	4.64	4.47	4.59	4.86	4.57	4.74	5.11	4.63	4.83	5.25	4.83	5.11	5.74		
3942	Boygrift	555131	380860	3.72	3.74	3.77	4.06	4.11	4.22	4.33	4.43	4.65	4.43	4.57	4.87	4.56	4.73	5.13	4.62	4.83	5.28	4.85	5.15	5.82		
3968	Gibraltar Point	557652	356181	4.16	4.17	4.20	4.51	4.56	4.67	4.76	4.85	5.08	4.85	4.97	5.27	4.94	5.10	5.49	4.99	5.18	5.63	5.14	5.41	6.09		
3992_14	Hobhole	535990	340116	4.96	4.97	5.01	5.40	5.44	5.56	5.66	5.76	5.98	5.78	5.90	6.20	5.88	6.04	6.44	5.92	6.11	6.57	6.03	6.31	6.99		
	Grand Sluice*	532366	344510	4.93	4.94	4.98	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3	5.3		
3992_9	Boston Barrier	532754	342852	4.93	4.94	4.98	5.41	5.45	5.57	5.73	5.83	6.05	5.85	5.97	6.27	5.93	6.09	6.49	5.94	6.13	6.59	5.98	6.26	6.94		
3992_5	Fosdyke Bridge	531886	332234	4.87	4.88	4.92	5.31	5.35	5.47	5.58	5.68	5.90	5.71	5.83	6.13	5.82	5.98	6.38	5.87	6.06	6.52	6.01	6.29	6.97		
4008	West Lighthouse	550094	329971	4.87	4.88	4.91	5.21	5.26	5.37	5.46	5.56	5.78	5.56	5.68	5.98	5.66	5.82	6.21	5.71	5.90	6.35	5.86	6.14	6.81		
-	Marsh Road	525988	324065	-	5.04	-	-	5.44	-	-	5.73	-	-	5.85	-	-	5.98	-	-	-	-	-	-	-		
-	Wisbech	546110	309940	-	4.83	-	-	5.25	-	-	5.53	-	-	5.66	-	-	5.78	-	-	-	-	-	-	-		
-	Dog-in-a-Doublet	527200	299287	-	3.67	-	-	4.00	-	-	4.22	-	-	4.32	-	-	4.42	-	-	-	-	-	-	-		

See next page for notes

2018 Coastal Flood Boundary Extreme Sea Levels

NOTES:

The following notes apply to all CFB sites (ie all on table excluding Marsh Road, Wisbech, Dog-in-a-Doublet)

- The base date for the data is 2017.
- The levels are still water levels. Depending on the use of the data it may be necessary to consider wave heights and / or joint probability analysis of water level and other variables.
- Levels for other annual chance probabilities are available if required.
- For additional information relating to the 2018 Coastal Flood Boundary Extreme Sea Levels or to access the full dataset for the above sites or intermediate locations refer to the Defra Metadata Catalogue at <https://deframetadadata.com/geonetwork/srv/eng/catalog.search#/metadata/84a5c7c0-d465-11e4-b0bd-f0def148f590>


The following notes apply to all Marsh Road, Wisbech, Dog-in-a-Doublet

- The base date for the data is 2006
- The levels are still water levels. Depending on the use of the data it may be necessary to consider wave heights and / or joint probability analysis of water level and other variables.
- Levels for other annual chance probabilities are available if required.
- These levels will be updated as their respective tidal river models are updated.

The following notes apply to Grand Sluice

- Grand Sluice remains the tidal limit for the River Witham.
- The data is based on CFB 2018 data for Boston Barrier site, capped at 5.3mAOD to reflect use of the barrier which raises for tides above this level.
- The base date for the data is 2017
- The levels are still water levels. Depending on the use of the data it may be necessary to consider wave heights and / or joint probability analysis of water level and other variables.
- For additional information relating to the 2018 Coastal Flood Boundary Extreme Sea Levels or to access the full dataset for the above sites or intermediate locations refer to the Defra Metadata Catalogue at <https://deframetadadata.com/geonetwork/srv/eng/catalog.search#/metadata/84a5c7c0-d465-11e4-b0bd-f0def148f590>

Plan 1

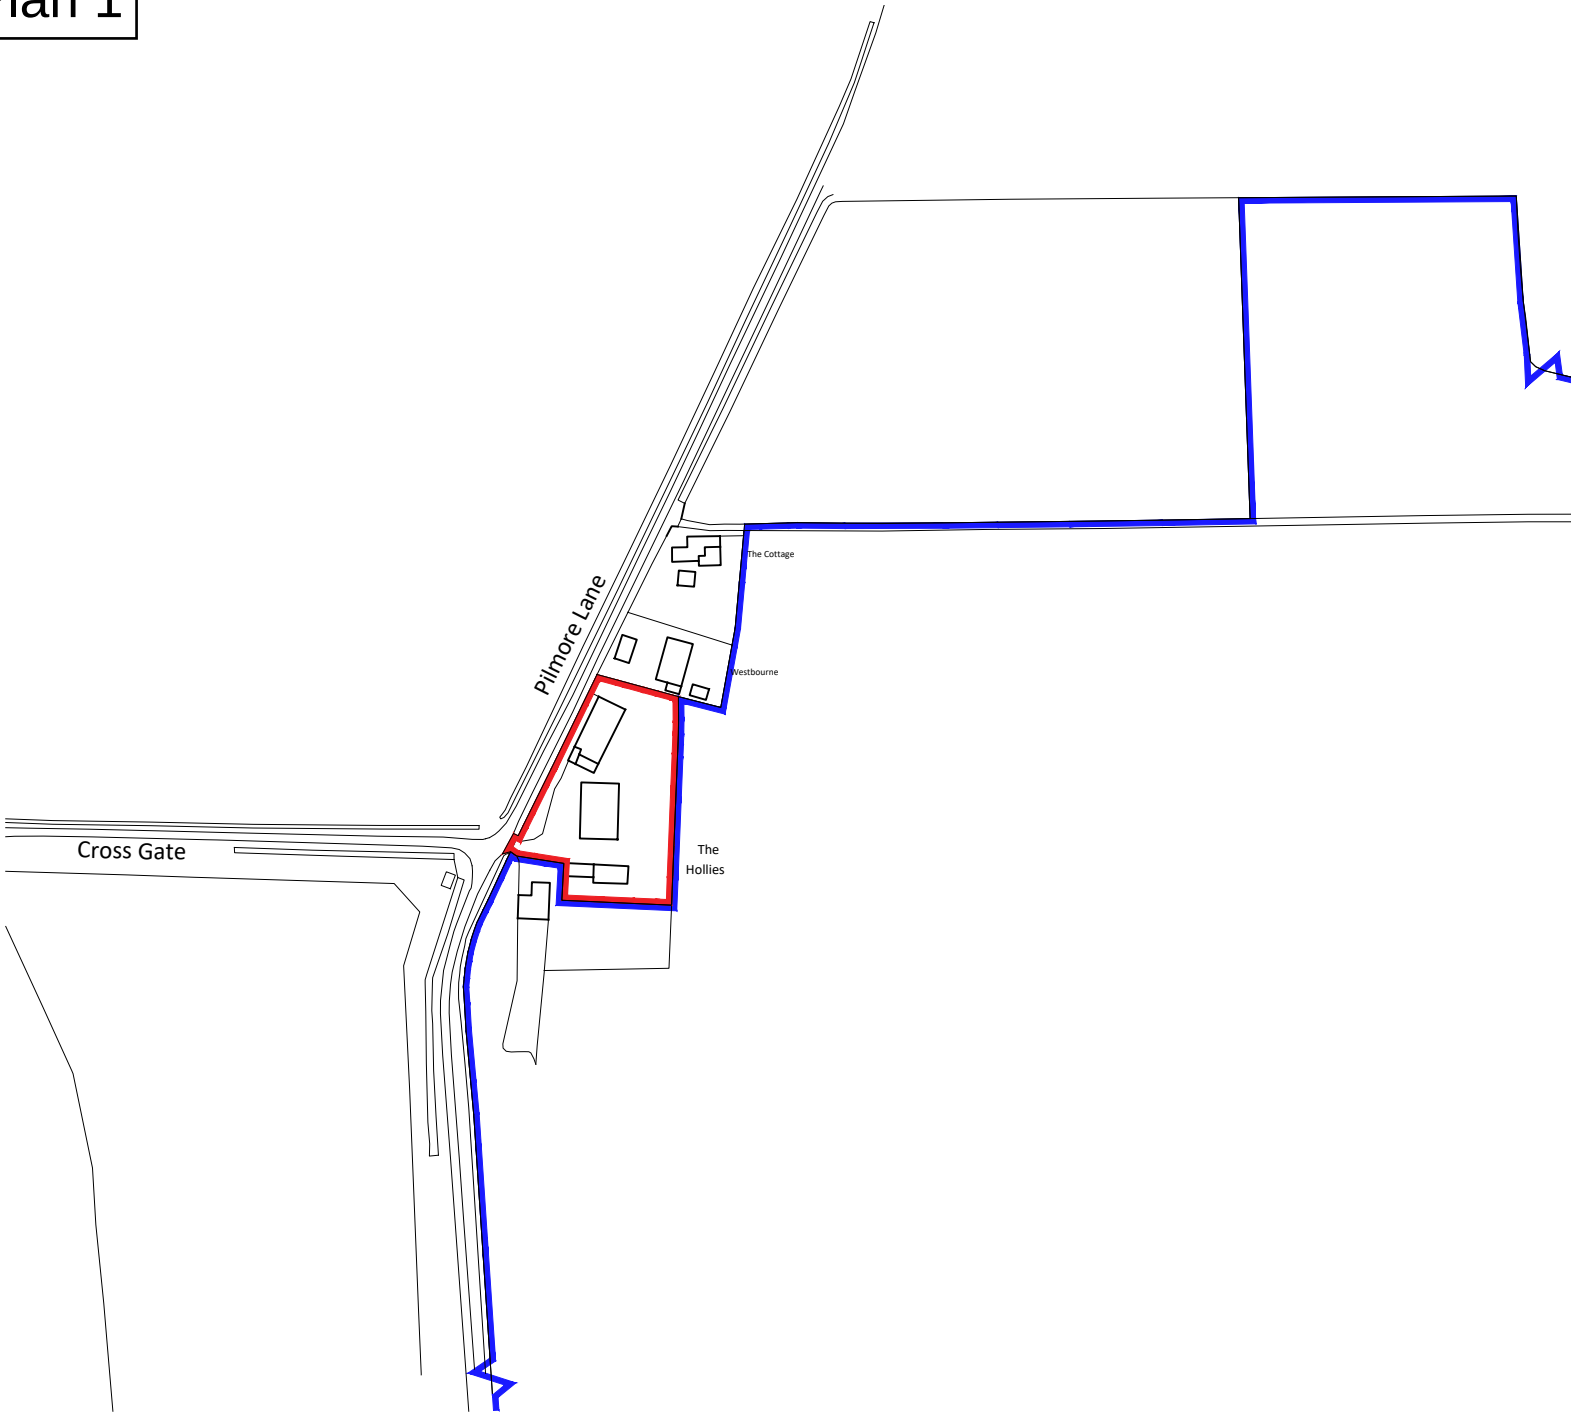

Notes

Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.

Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.


Rev	Description	Date
 Robert Doughty Consultancy 32 High Street, Helpringham Sleaford, Lincolnshire, NG34 0RA Tel: 01529 421646 Email: admin@rdc-landplan.co.uk Web: www.rdc-landplan.co.uk		
Client Miss Veronica Frohock		
Project The Hollies Farmyard Pilmore Lane, Fulney, Spalding, PE12 6EG		
Drawing Location Plan		
Scale @ A4 1: 2500		Date 11/09/24
Drawn By WW		Checked By -
Job Number 1623-1	Status FP	Purpose of Issue Planning
Drawing No. 1623-1_FP_LP01		Rev -



Notes

Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.

Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.

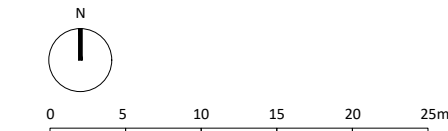

-	-	-	-
---	---	---	---

Rev	By	Description	Date
-----	----	-------------	------

Current revision checked by: -



32 High Street, Helpingham
Sleaford, Lincolnshire, NG34 0RA

Tel: 01529 421646
Email: admin@rdc-landplan.co.uk
Web: www.rdc-landplan.co.uk

Client
Miss Veronica Frohock

Project
The Hollies Farmyard
Pilmore Lane, Fulney, Spalding, PE12 6EG

Drawing
Existing Site Plan

Scale @ A3	Date
1: 500	05/09/24

Drawn By	Checked By
WW	-

Job Number	Status	Purpose of Issue
1623-1	FP	Planning

Drawing No.	Rev
1623-1_FP_SP01	-




Notes

Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.

Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.

Dimensions
All dimensions shown are for the purposes of obtaining the relevant planning permission only.

CDM 2015
This drawing is for illustrative purposes and/or obtaining the relevant planning permission only. It should not be used for construction and accordingly, risk identification under the Construction (Design & Management) Regulations 2015 has not been undertaken.

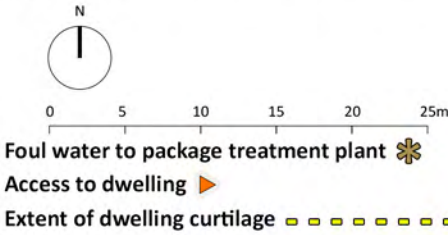

-	-	-	-
Rev	By	Description	Date
Current revision checked by: -			

rdc
Robert Doughty Consultancy

32 High Street, Helpringham
Sleaford, Lincolnshire, NG34 0RA

Tel: 01529 421646
Email: admin@rdc-landplan.co.uk
Web: www.rdc-landplan.co.uk


Client
Miss Veronica Frohock

Project
The Hollies Farmyard
Pilmore Lane, Fulney, Spalding, PE12 6EG


Drawing
Proposed Site Plan

Scale @ A3 1: 500		Date 05/09/24
Drawn By WW		Checked By -
Job Number 1623-1	Status FP	Purpose of Issue Planning



Drawing No. 1623-1_FP_SP02	Rev -
--------------------------------------	-----------------

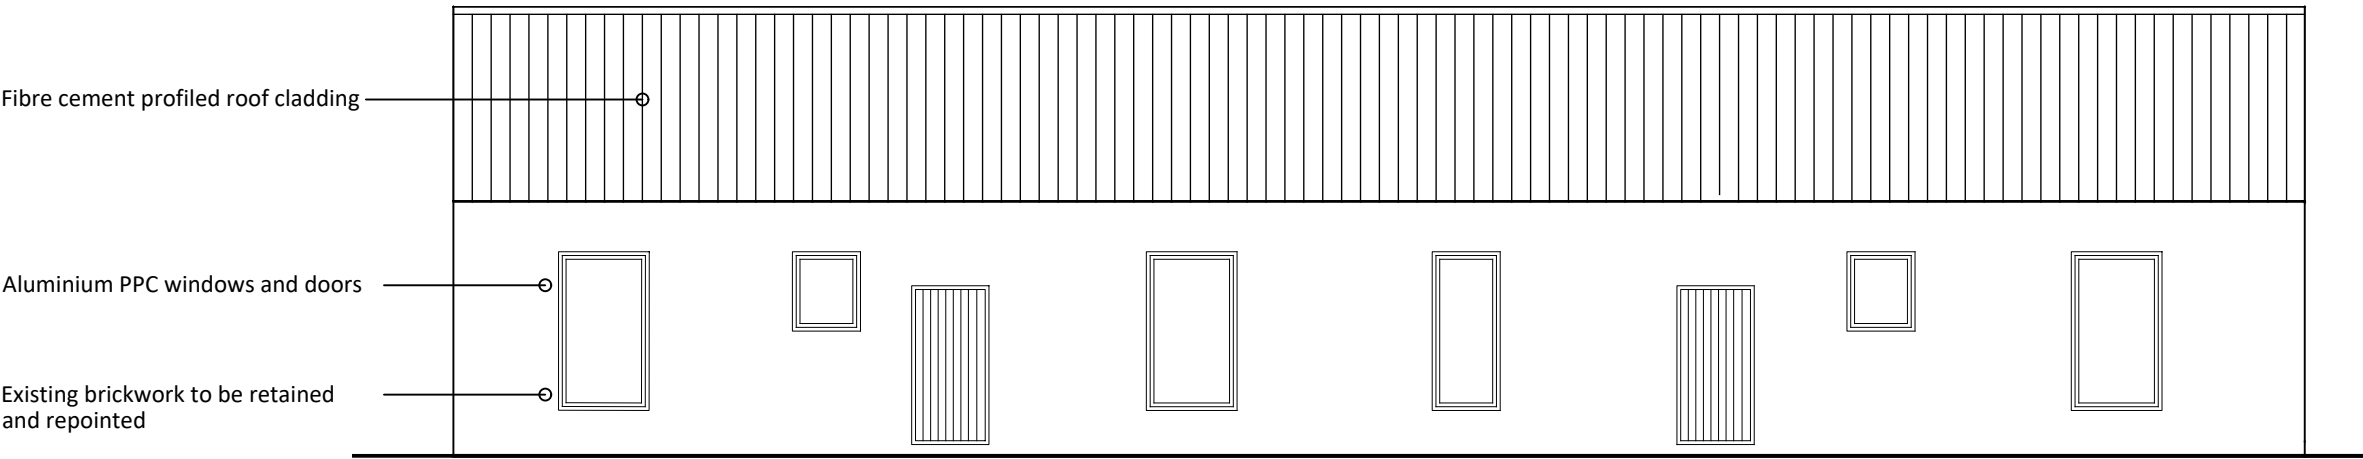


Proposed North Elevation

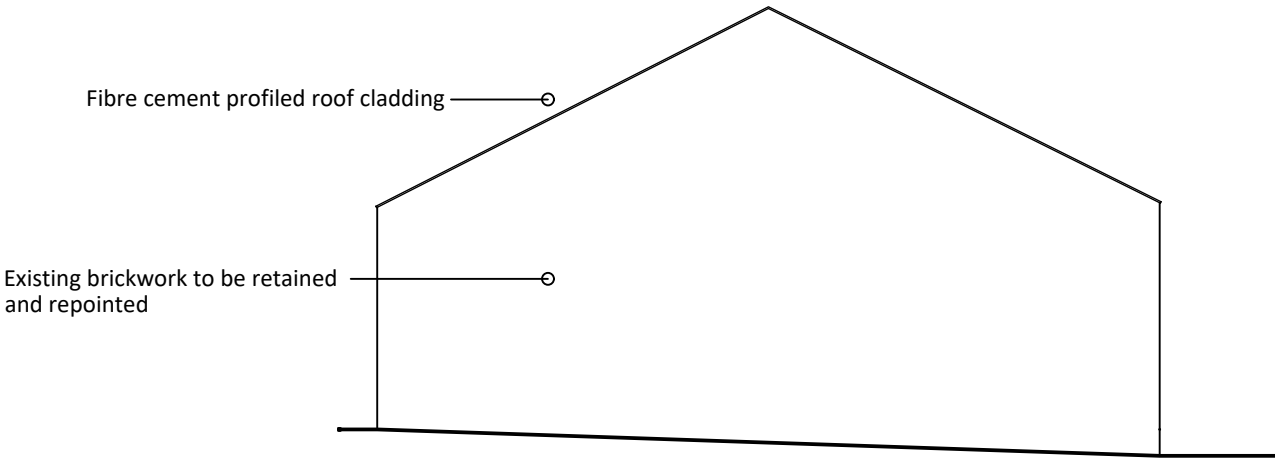

Proposed South Elevation

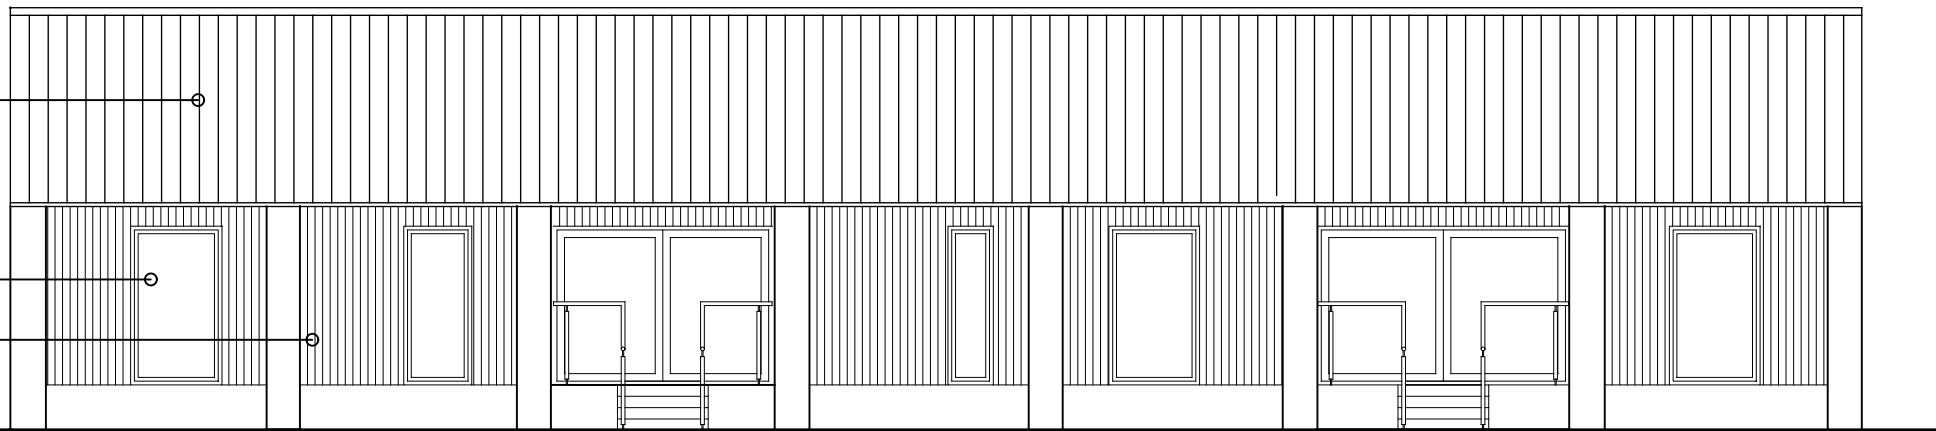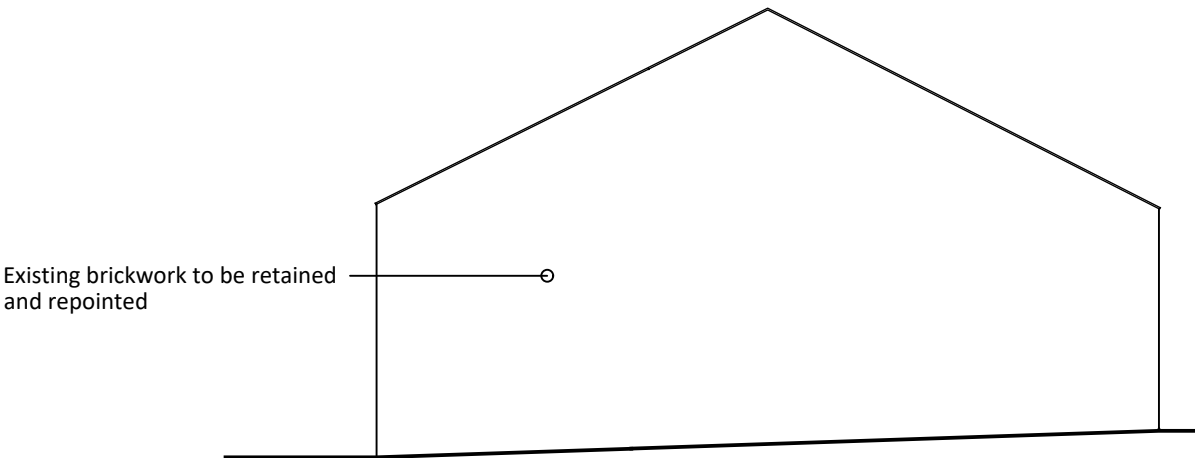

Proposed East Elevation

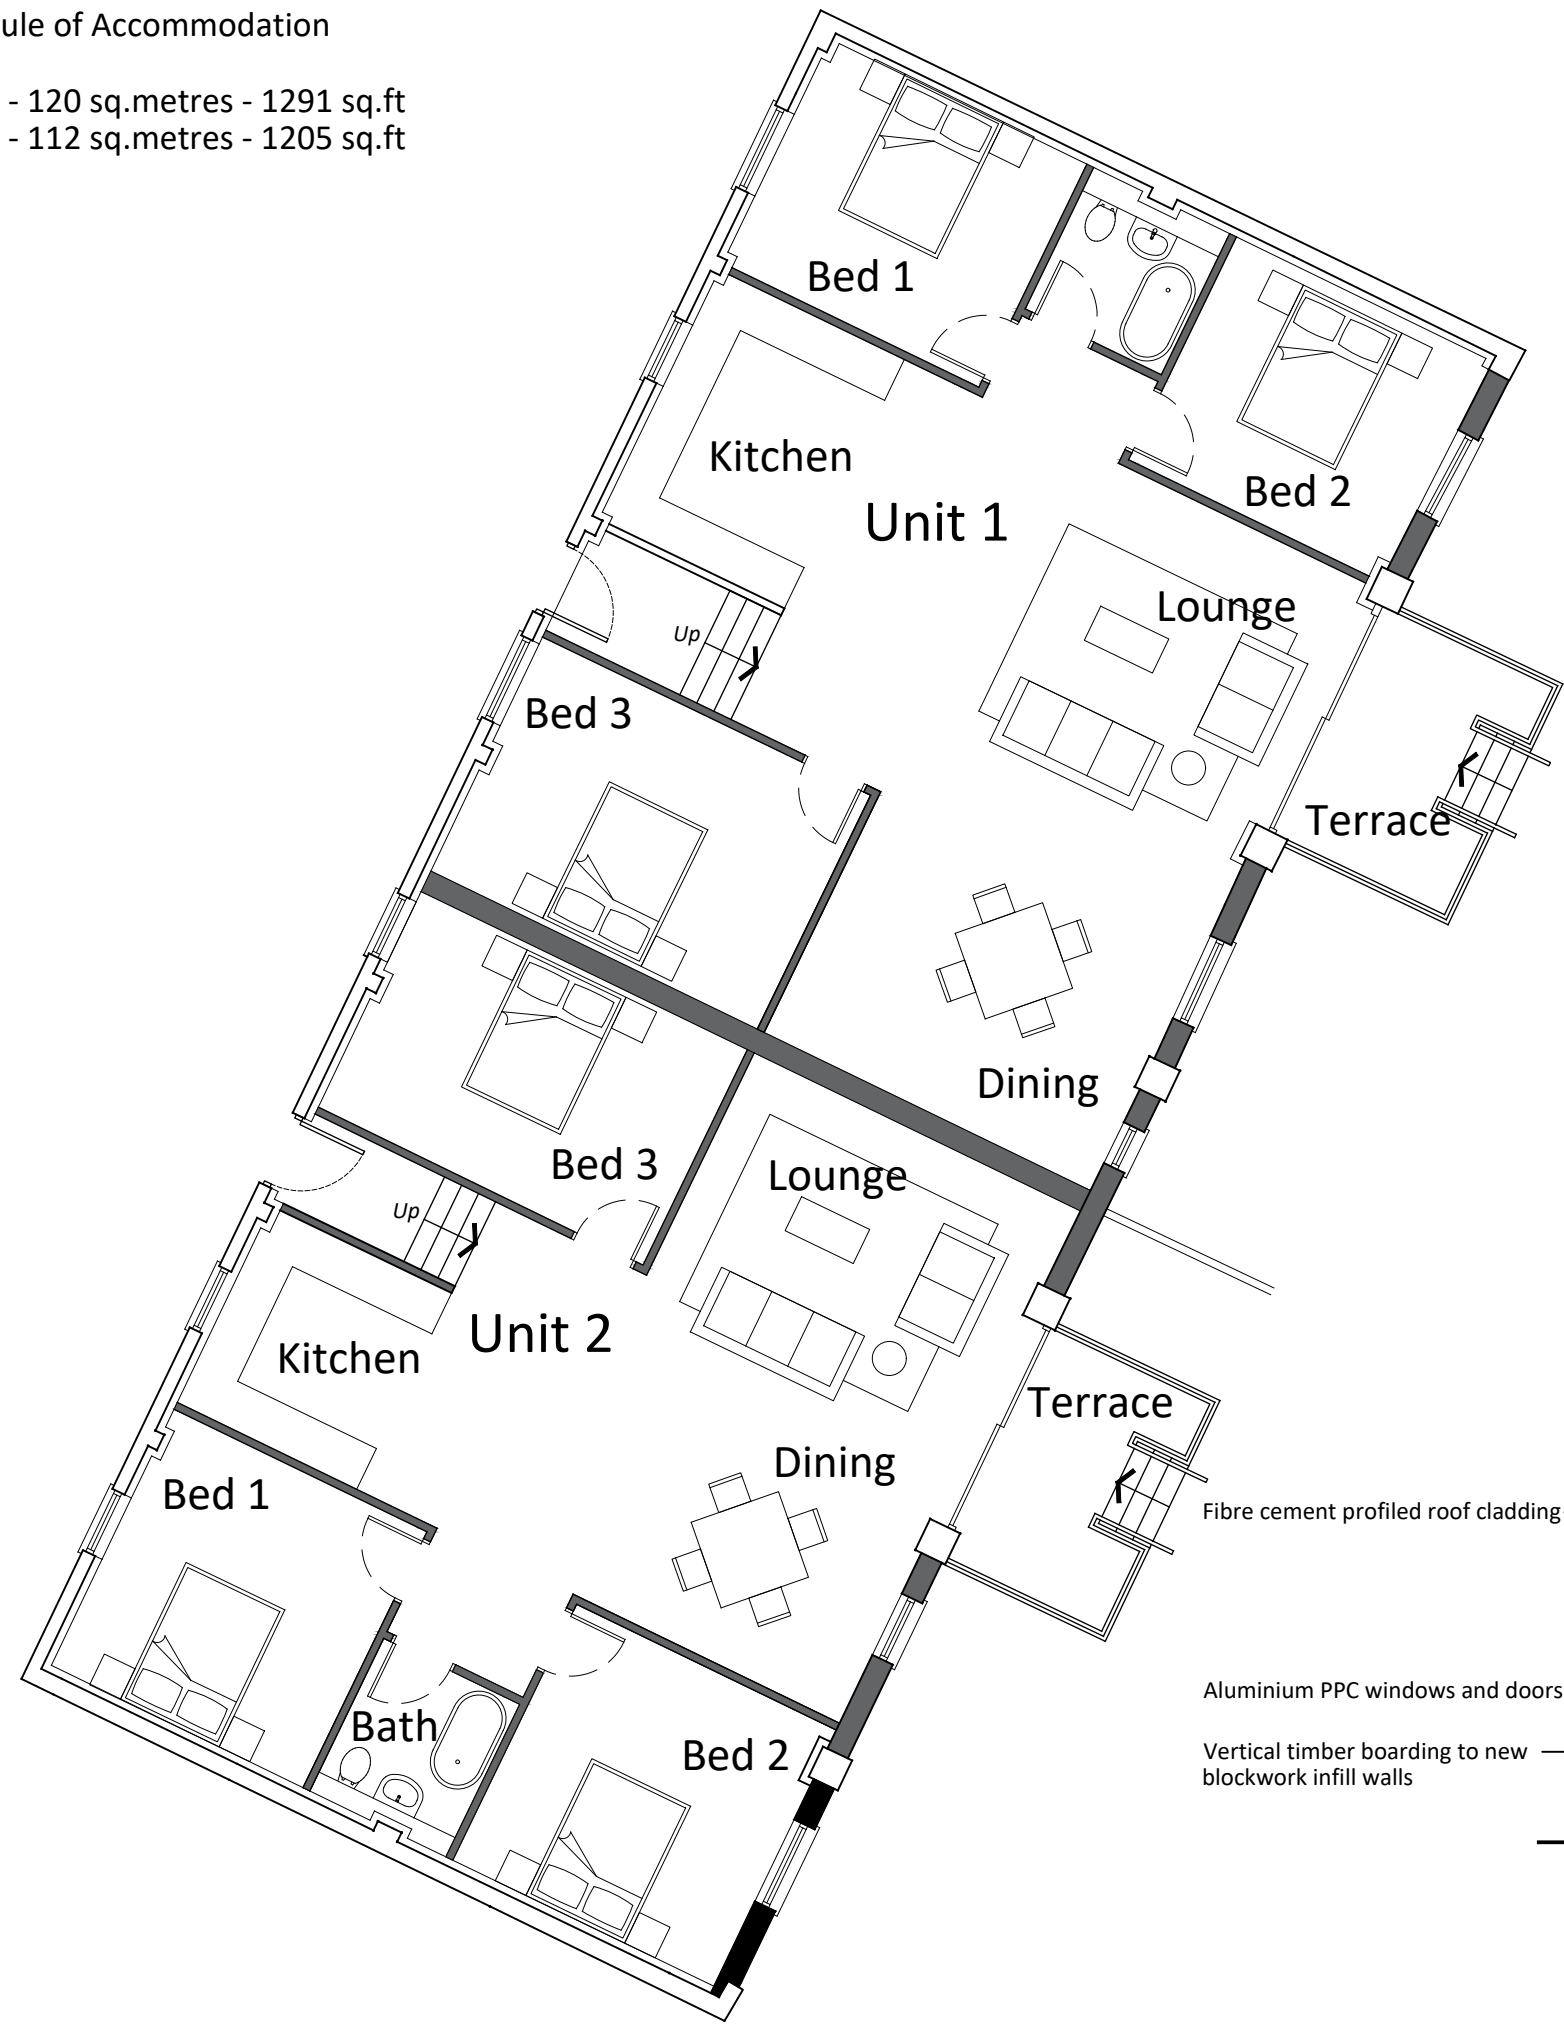

Proposed Ground Floor Plan

Schedule of Accommodation

Unit 1 - 120 sq.metres - 1291 sq.ft
Unit 2 - 112 sq.metres - 1205 sq.ft

Notes

Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.

Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.

Dimensions
All dimensions shown are for the purposes of obtaining the relevant planning permission only.

CDM 2015
This drawing is for illustrative purposes and/or obtaining the relevant planning permission only. It should not be used for construction and accordingly, risk identification under the Construction (Design & Management) Regulations 2015 has not been undertaken.


Rev	By	Description	Date
-	-	-	-
Current revision checked by: -			

rdc
Robert Doughty
Consultancy


32 High Street, Helpringham
Sleaford, Lincolnshire, NG34 0RA

Tel: 01529 421646
Email: admin@rdc-landplan.co.uk
Web: www.rdc-landplan.co.uk

Client Miss Veronica Frohock		
Project The Hollies Farmyard Pilmore Lane, Fulney, Spalding, PE12 6EG		
Drawing Proposed Floor Plan Unit 1 and 2		
Scale @ A2 1: 100	Date 05/09/24	
Drawn By PSS	Checked By -	
Job Number 1623-1	Status FP	Purpose of Issue Planning
Drawing No. 1623-1_FP_GA04	Rev -	

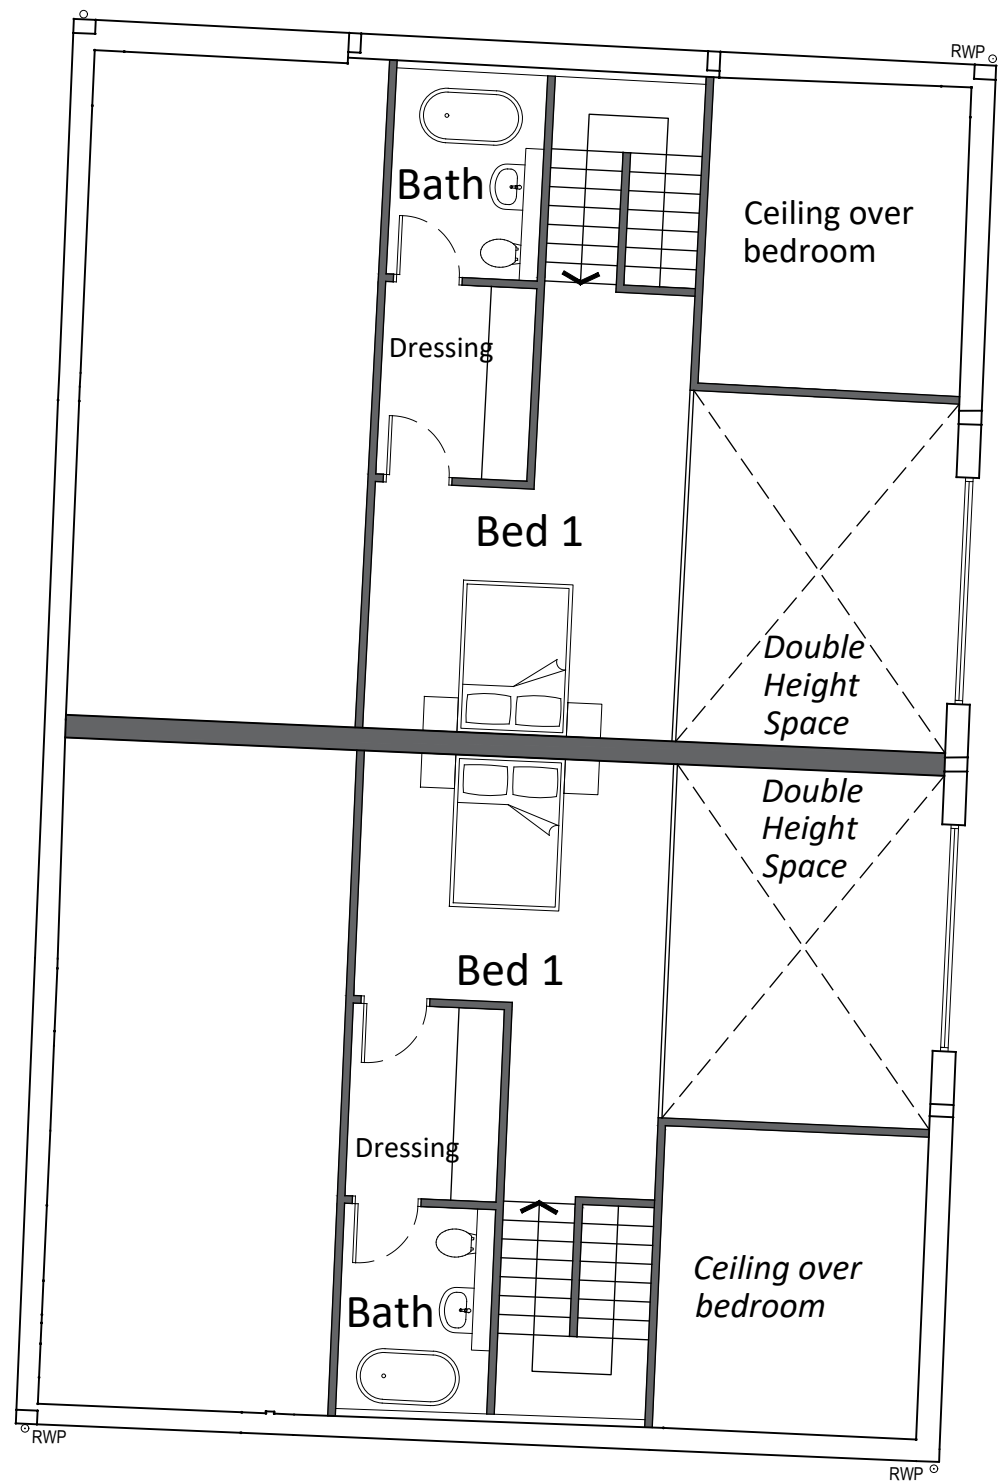


Proposed First Floor Plan

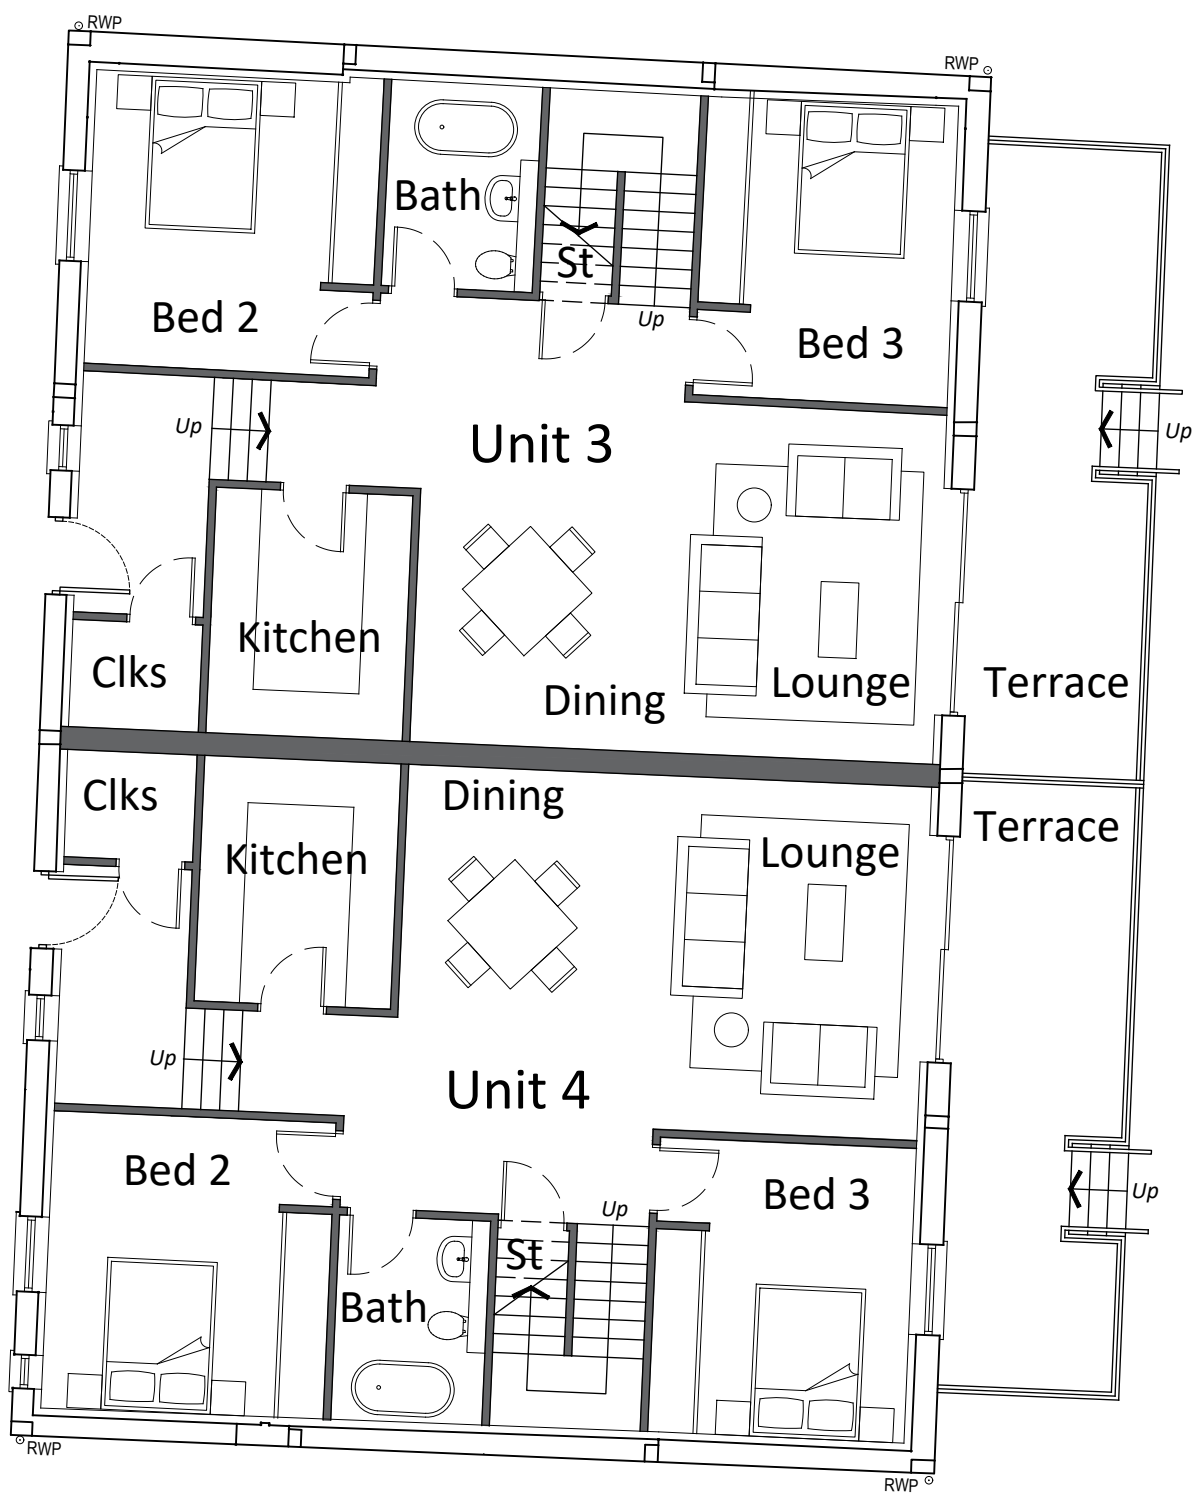


Proposed Ground Floor Plan

Schedule of Accommodation


Unit 3 - 136 sq.metres - 1463 sq.ft
Unit 4 - 136 sq.metres - 1463 sq.ft

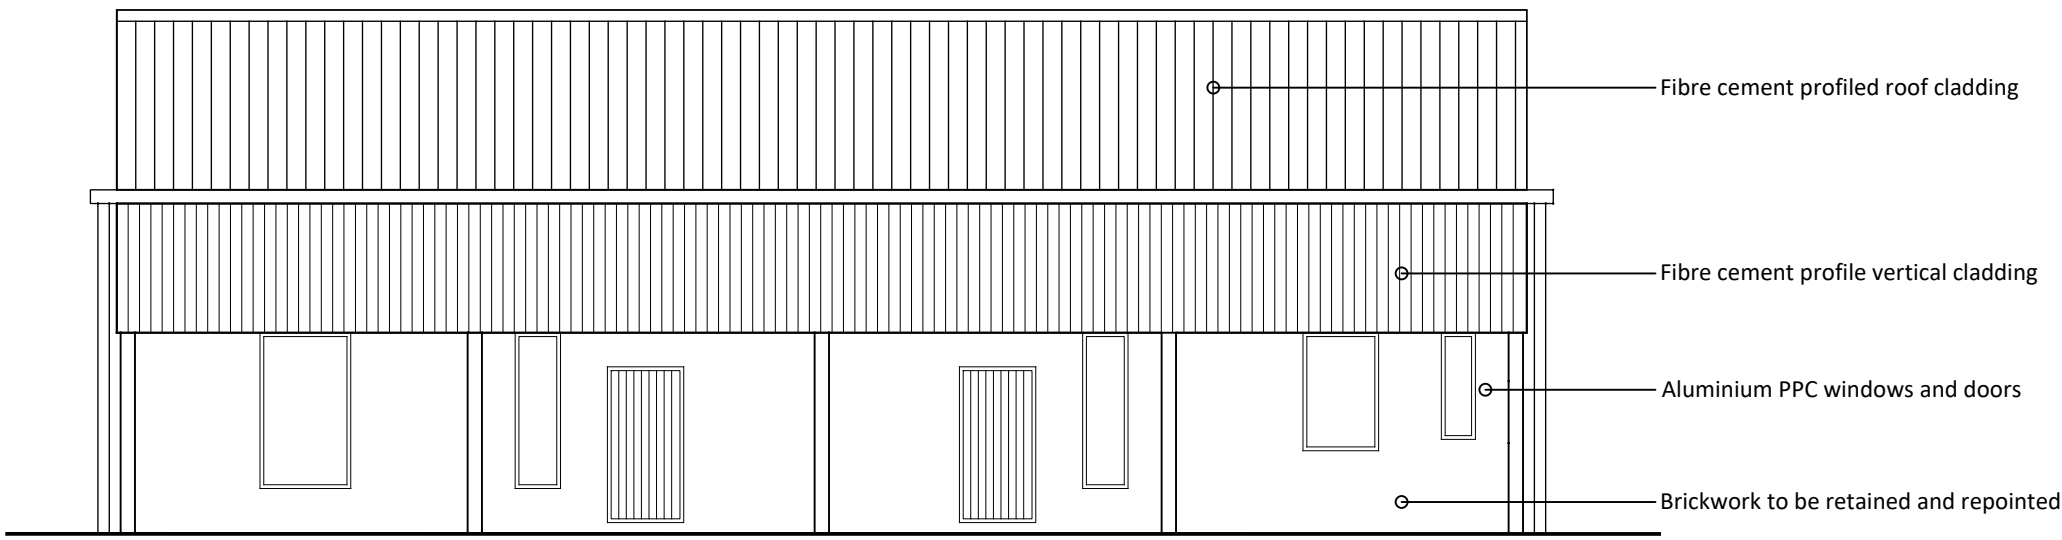


Proposed West Elevation

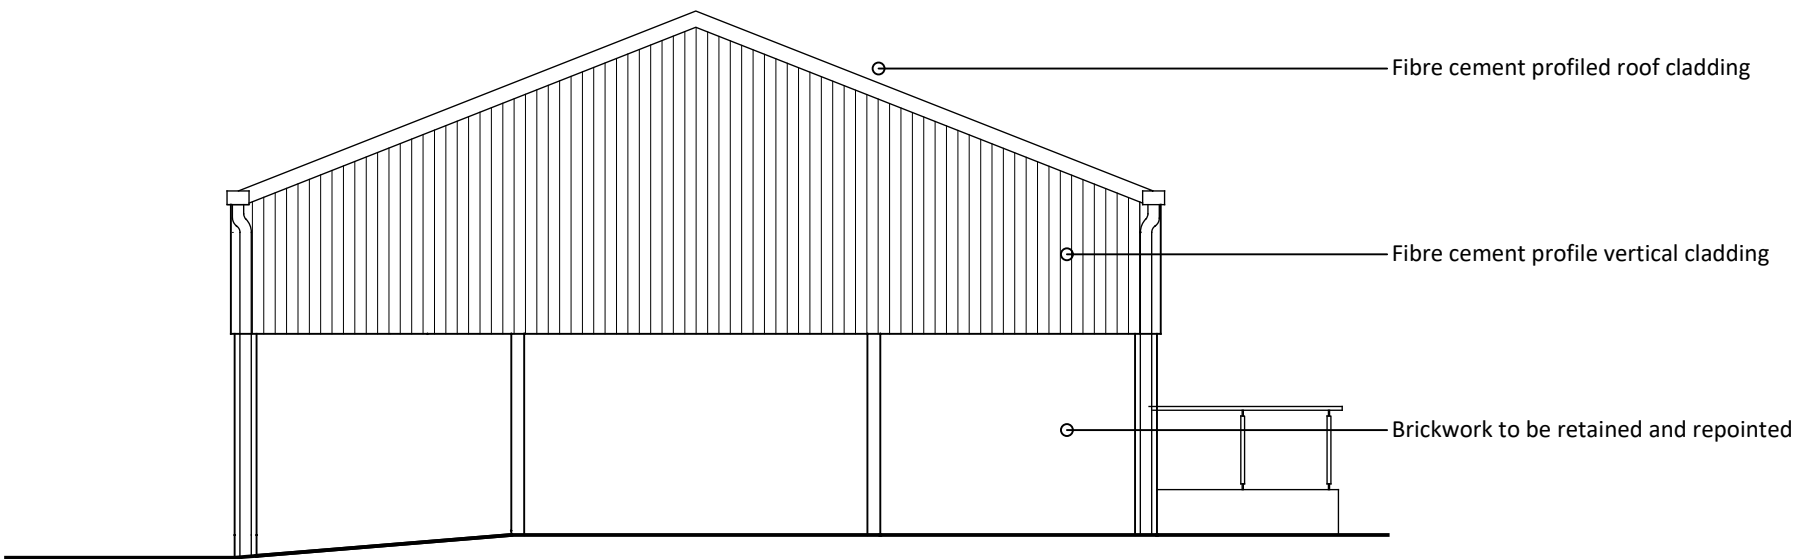

Proposed South Elevation

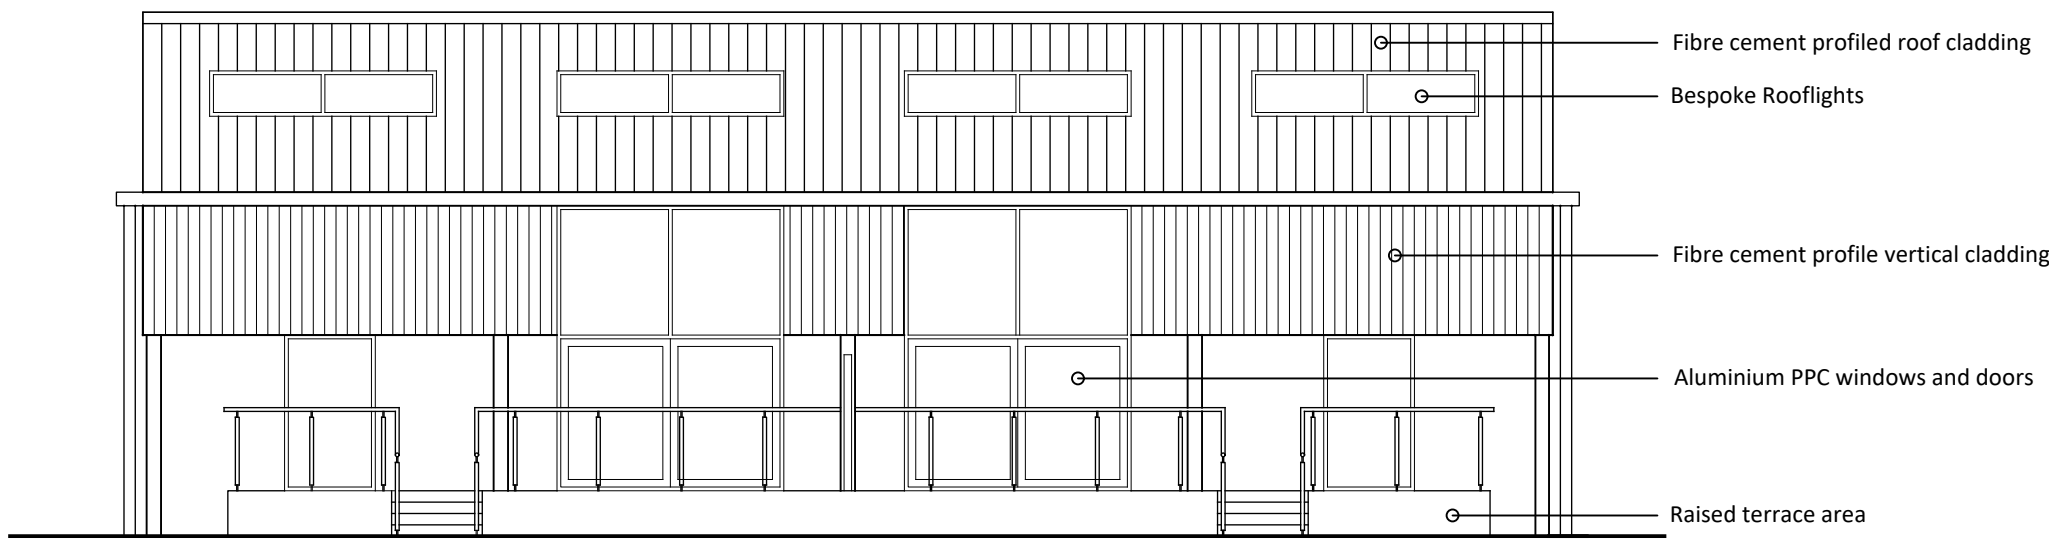

Proposed East Elevation

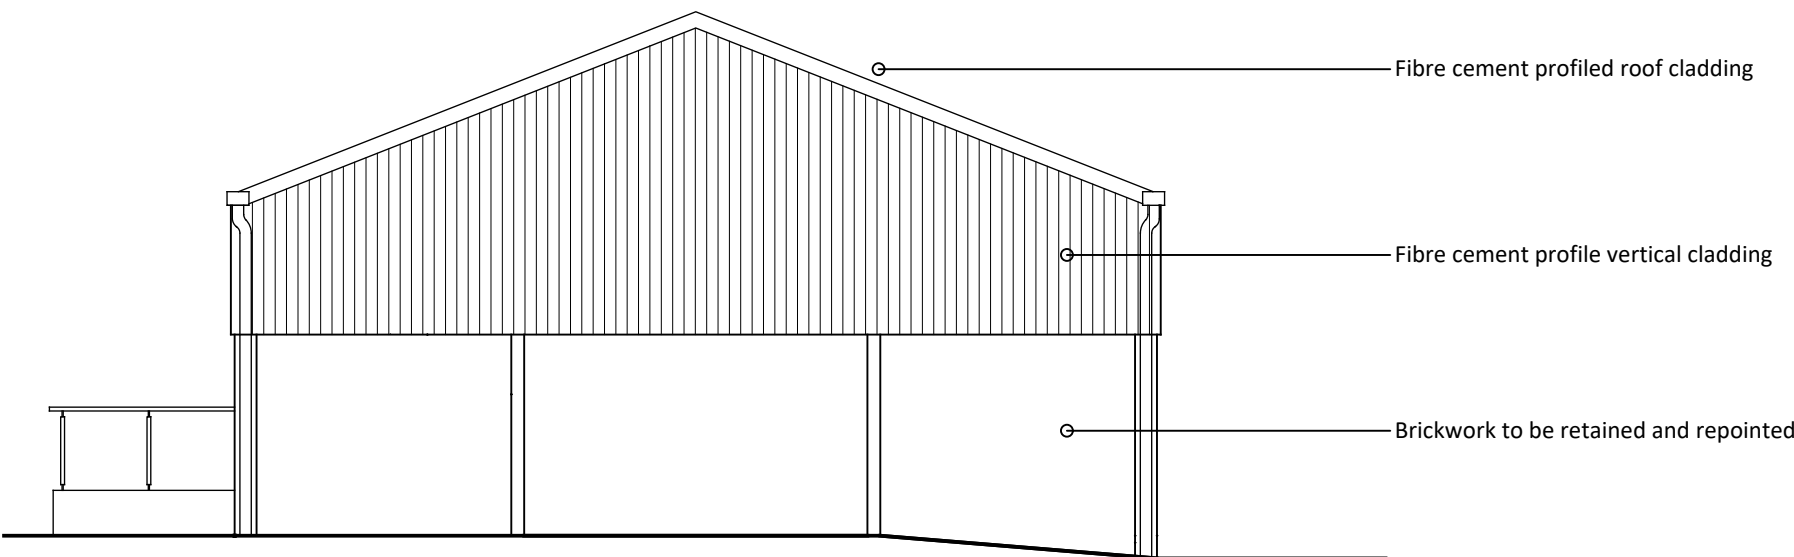

Proposed North Elevation

0 1 2 3 4 5m

Notes
Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.
Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.
Dimensions
All dimensions shown are for the purposes of obtaining the relevant planning permission only.
CDM 2015
This drawing is for illustrative purposes and/or obtaining the relevant planning permission only. It should not be used for construction and accordingly, risk identification under the Construction (Design & Management) Regulations 2015 has not been undertaken.

Rev	By	Description	Date
Current revision checked by: -			

rdc

Robert Doughty
Consultancy

32 High Street, Helpingsham
Sleaford, Lincolnshire, NG34 0RA

Tel: 01529 421646
Email: admin@rdc-landplan.co.uk
Web: www.rdc-landplan.co.uk

Client

Miss Veronica Frohock


Project

The Hollies Farmyard
Pilmore Lane, Fulney, Spalding, PE12 6EG

Drawing


Unit 3 & 4 Proposed Plans and Elevations

Scale @ A1	Date		
1: 100	05/09/24		
Drawn By	Checked By		
PSS	-		
Job Number	Status	Purpose of Issue	
1623-1	FP	Planning	
Drawing No.		Rev	
1623-1_FP_GA05		-	

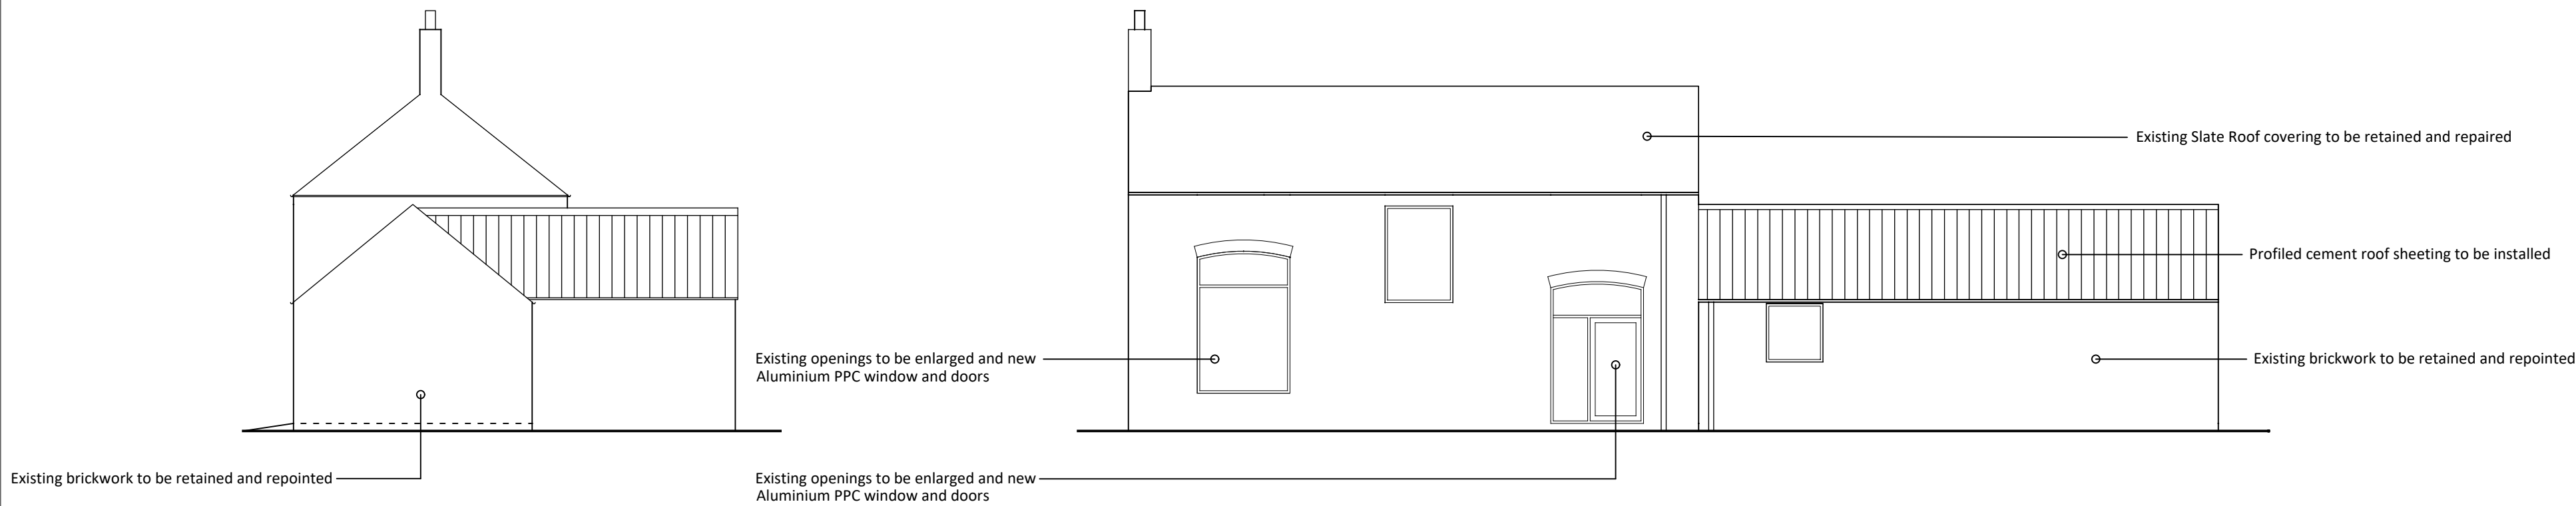


Proposed West Elevation

Proposed North Elevation

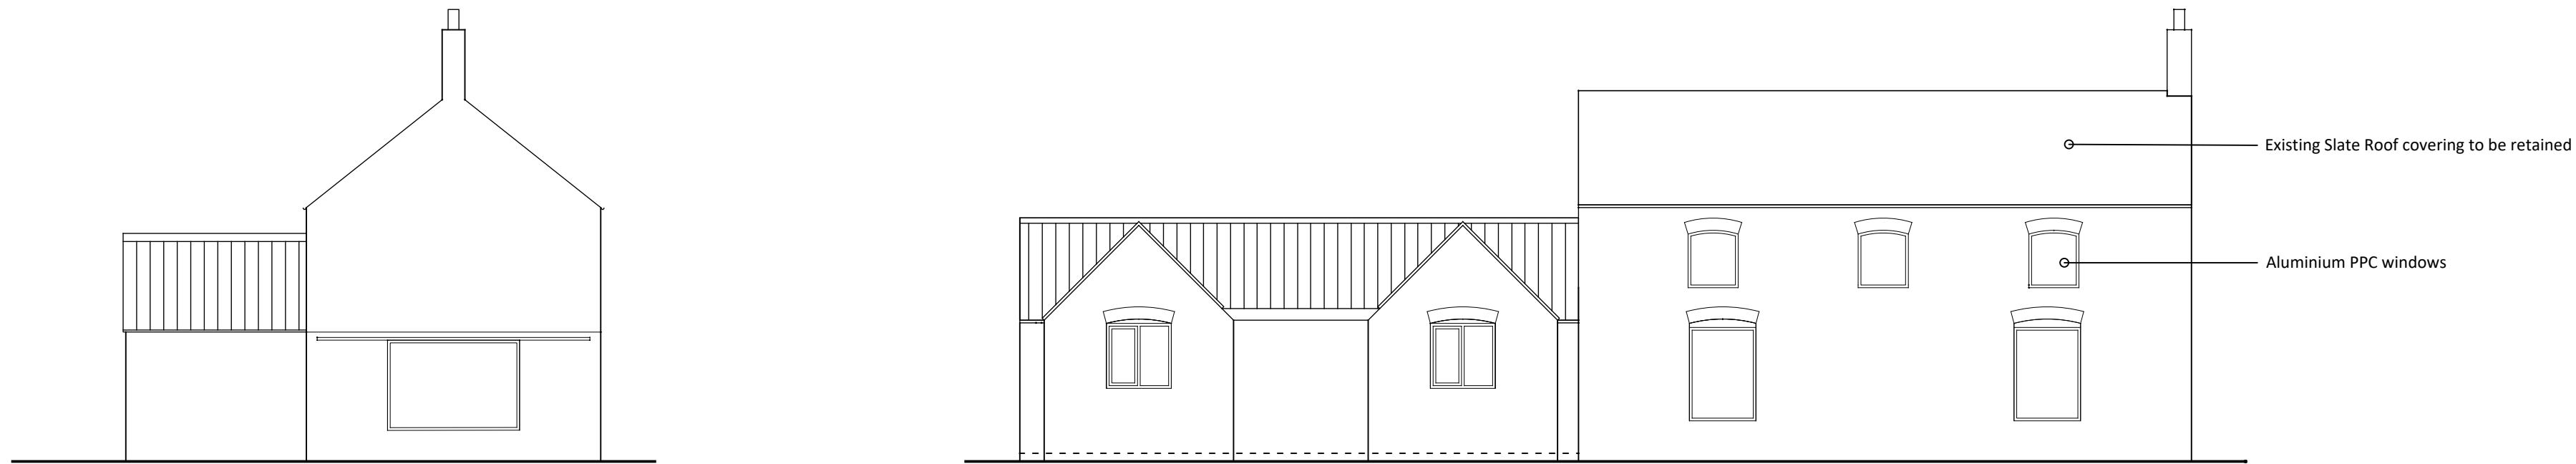

Proposed East Elevation

Proposed South Elevation

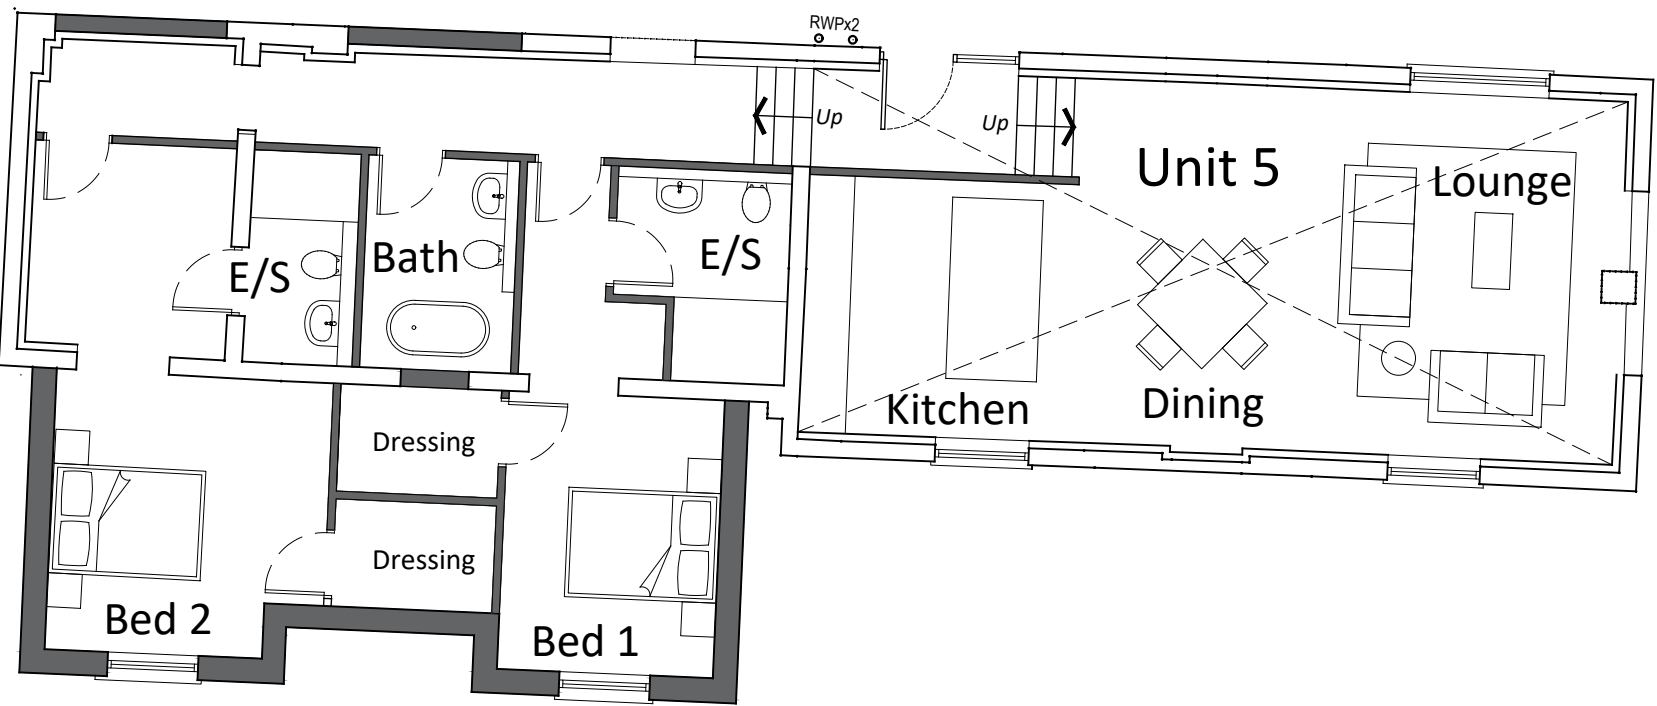

Proposed Ground Floor Plan

Schedule of Accommodation
Unit 5 - 126 sq.metres - 1356 sq.ft



Notes

Copyright
© Robert Doughty Consultancy Limited.
All rights described in the Copyright, Designs and Patents Act 1988 have been asserted.

Ordnance Survey Map
© Crown Copyright. OS Licence No: AR 100010613.

Dimensions
All dimensions shown are for the purposes of obtaining the relevant planning permission only.

CDM 2015
This drawing is for illustrative purposes and/or obtaining the relevant planning permission only. It should not be used for construction and accordingly, risk identification under the Construction (Design & Management) Regulations 2015 has not been undertaken.

Rev	By	Description	Date
-	-	-	-

Current revision checked by: -

rdc
Robert Doughty
Consultancy

32 High Street, Helpringham
Sleaford, Lincolnshire, NG34 0RA

Tel: 01529 421646
Email: admin@rdc-landplan.co.uk
Web: www.rdc-landplan.co.uk


Client
Miss Veronica Frohock

Project
The Hollies Farmyard
Pilmore Lane, Fulney, Spalding, PE12 6EG

Drawing
Proposed Floor Plans Unit 5

Scale @ A2 1: 100	Date 05/09/24	
Drawn By PSS	Checked By -	
Job Number 1623-1	Status FP	Purpose of Issue Planning

Drawing No. 1623-1_FP_GA06	Rev -
--------------------------------------	-----------------

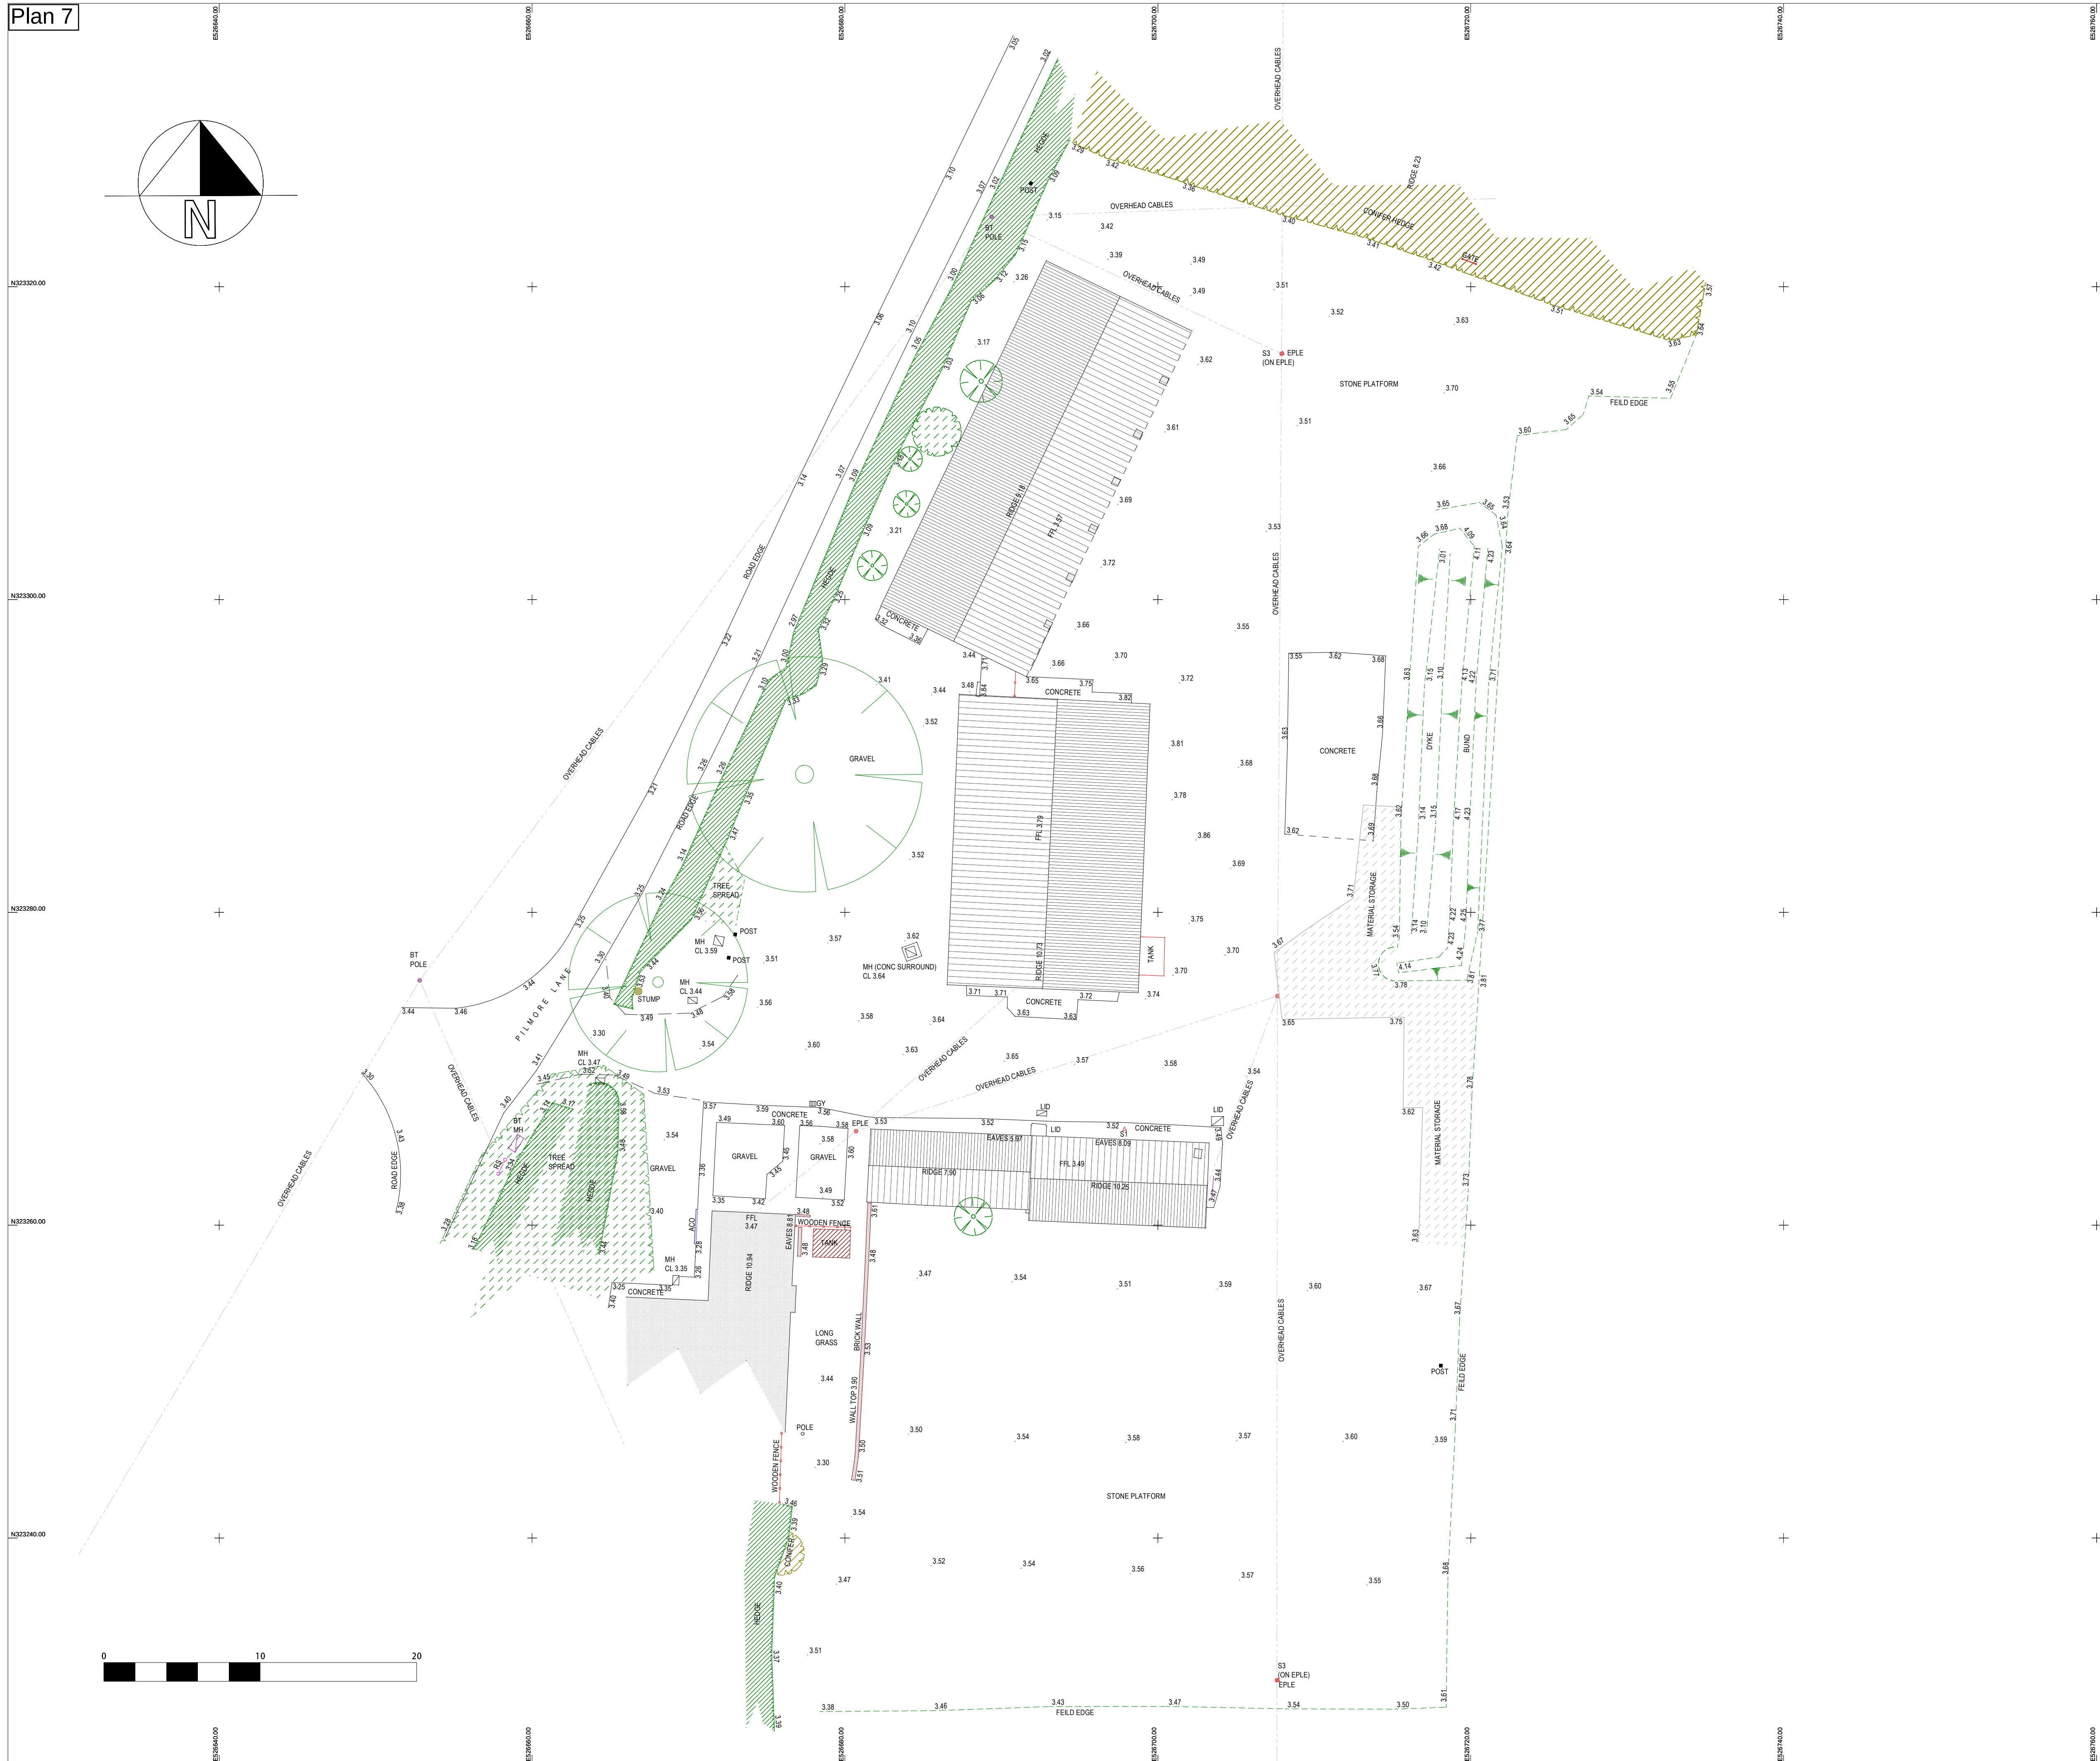

ABBREVIATIONS & SYMBOLS

AV	AR VALVE	PHC	OVERHEAD CABLE
BA	BAR	PHD	PHASE BOX
BO	BOLLARD	PIN	PIN INVERT LEVEL
BU	BURST	PI	PUMPING METER
CV	CTV SECURITY CAM	PO	POST
CL	COVER LEVEL	PP	POST TOWER LEVEL
CH	CHAMBER	PR	PROVE & FAIL FEED
COL	COLUM	PW	PROVE & WIRE FEED
CO	CORNER L/D	RD	ROD END OF ROADING
DO	DOWN PIPE	RE	RODDING STOP POINT
EL	ELEV	RF	REFLECTIVE POST
EL	ELEV LEVEL	RS	ROD STOP LEVEL
ER	EARH ROD	SL	SLANT SLOPE LEVEL
ER	EARH ROD	ST	STAKE
EH	EH HYDRANT	SV	VALVE
EN	ENGINEER LEVEL	SW	SWITCH WATER
FP	FLAG POLE	TA	TACTILE PAVING
FI	FINISH LEVEL	TR	TRAFFIC LIGHT
GV	GV GAS VALVE	TL	TRAFFIC LIGHTS
IN	INLET	TW	TOW TOW WALL LEVEL
IC	INSPECTION COVER	U	UTILITY
KB	KEB BOTTOM	TRK	TRUCK
KE	KEB	UT	UTILITY TO LIFT
KE	KEB TOP	VP	VENT PIPE
LC	LC LIGHT	W	WALL
LC	LC LIGHT COLUMN	WV	WALL WATER LEVEL
MA	MARKER	WV	WALL WATER
MP	MARKER POST	WU	WASH OUT POINT

- THE POSITION OF THIS SURVEY IS BASED ON GPS STATION GRID
ALL LEVELS RELATE TO HGTS TO WHICH USING TRIMBLE VRS NOW
THREE SPREADS ARE DRAWN TO SCALE AND SHOW THE
GENERAL/AVERAGE CANOPY SURFACE.
ALL BELOW GROUND LEVEL INFORMATION INCLUDING VIOLES,
DRAINAGE, UTILITIES AND DRAINAGE ARE OBTAINED FROM THE
SURFACE LEVEL ONLY. THEREFORE PIPE SIZES ETC ARE
NOT KNOWN. THEREFORE THE SURVEYOR HAS NOT BEEN
CHECKED PRIOR TO THE COMMENCEMENT OF ANY SITE WORKS
EVERY EFFORT HAS BEEN MADE TO LOCATE AND SURVEY ALL
VISIBLE FEATURES. IT SHOULD BE NOTED THAT SOME ITEMS
MAY NOT BE VISIBLE OR KNOWN TO THE SURVEYOR AND
THEREFORE NOT SHOWN ON THIS DRAWING.
PHYSICAL BOUNDARY FEATURES SHOWN ON THIS DRAWING DO
NOT REPRESENT THE ACTUAL BOUNDARY OF THE SITE.
BOTH HEREIN. THIS INFORMATION SHOULD BE CONFIRMED WITH
THE NECESSARY DOCUMENTATION.
THE CONTRACTOR MUST CHECK AND VERIFY ALL SITE LEVELS,
DIMENSIONS, UTILITIES AND DRAINAGE PRIOR TO THE
COMMENCEMENT OF ANY SITE WORKS. ANY DISCREPANCIES
MAY BE THE RESPONSIBILITY OF THE CONTRACTOR.
ALL SURVEY STATION CONTROL POINTS MUST BE CHECKED BY
THE CONTRACTOR PRIOR TO STARTING ANY SITE WORKS.

Point	Easting	Northing	Elevation
S2	526707.957	323315.746	5.747
S3	526707.688	323230.888	5.786
S1	526697.868	323266.127	3.549

SURVEY DATE	28 / 05 / 2024	INITIALS	JT/SRW
-------------	----------------	----------	--------

REV	AMENDMENTS	DRN	DATE
-----	------------	-----	------

Client: ROBERT DOUGHTY CONSULTANCY

Project Title:
MISS VERONICA FROHOCK
THE HOLLIES FARMYARD
FULNEY DROVE, LINCS
PE12 6BW

Drawing Title:

TOPOGRAPHICAL SURVEY

Scale @ A1: 1 : 200	Date: 29 / 05 / 2024
------------------------	-------------------------

Drawing No: **CHS 24 - 112 - 01**

C.A.D. Title: rdc fulney drove\topo (chs 24-112-01).mjo

Drawn By: JT	Checked By: SRW
-----------------	--------------------



CASTLE HILL
SURVEYS LTD

Land Surveying & Site Setting Out Services
Commerce House, Carlton Boulevard,
Lincoln, LN2 4WJ Tel : 07710649549
E-mail : castlehillsurveys@outlook.com
Website : www.castlehillsurveys.co.uk