

S EAST

N EAST

FOUNDATIONS

Foundations to be ST4 grade concrete

For 265mm walls foundations to be 700 x 230mm
For 215mm " " " 600 x 230mm
For 100mm " " " 450 x 230mm

Foundations to be taken down to a firm loadbearing strata, a min. 1.0m if in shrinkable sub soil, in accordance with the requirements of the Local Authority Building Control Dept. and in accord with the NHBC guidelines for building near trees.
Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.
Any investigation work relating to extg foundations should be carried out prior to the commencement of any works.

FLOOR CONSTRUCTION

Ground
65mm sand/cement screed reinforced with chicken wire mesh
100mm ST4 grade oversite concrete
1200g polythene damp proof membrane
25mm sand blinding
100mm compacted hard-core - if in excess of 100mm fill, to a max. 600mm, the hard-core is to be laid and compacted in layers not exceeding 150mm.
Where 100mm internal walls are constructed off the floor slab the slab is to be thickened to 230mm for a min. width of 450mm
Strip off all vegetable soil beneath proposal.

garage floor to be as above excl. screed finish

WALL CONSTRUCTION

Below Ground
To be 100mm Class A concrete blocks
Cavity to be filled to 225mm below lowest dpc level with lean mix concrete

Above Ground
To be 265mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
65 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Hemelite (k = 0.44)

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

Internal finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.414W/mK

Internal Walls
To be 100mm blockwork constructed off a dpc off the floor slab/foundation as indicated on plan.

DPC in Walls
To be a min. 150mm above finished ground level
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.
A dpc cavity tray, stepped as applicable, is to be constructed within the wall immediately above an abutment.

LINTELS

Lintels to be Catnic, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels over internal openings to be Catnic CN102 lintels unless specified otherwise.

Lintels to be protected with min. 15mm gypsum plaster skim finish to give a min. half hour fire protection.

WINDOW

Window to be purpose made UPVC double glazed with 20mm air gap to sealed units and weather stripped.

Windows to habitable rooms are to incorporate a controllable trickle vent of 8000mm², 4000mm². to non habitable rooms.

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

All internal rooms are to be mechanically ventilated direct to the external air. Extractors are to be capable of a min. 3No. air changes per hour and are to incorporate a 15 minute over-run period when installed in WC's, bath/ shower rooms.

HOT WATER SYSTEM

A room thermostat or radiator valves are to be installed.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.05W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

DRAINAGE

Surface
Excavate for and lay in where indicated 100mm diam. flexible jointed UPVC drains on 100mm pea gravel bed from 100mm diam. upturned bend at base of downpipe to surface water soakaway.

Form soakaway where indicated a min. 5.0m from the nearest building. Excavate 1200 x 1200 x 1200mm deep, backfill with brick rubble to 300mm below ground level, lay in sheet polythene and make up with vegetable soil.

Foul
Supply and install proprietary upvc inspection chambers on 100mm pea gravel bed in strict accordance with manufacturers instructions. Inspection chambers to conform to the following sizes : -

Depth	Internal diam	Cover diam
.6m or less	190mm	190mm
1.0m or less	450 mm	450mm
1.5m or less	1050mm	600mm
over 1.5m	1200mm	600mm

Excavate for and lay in where indicated 100mm diam. flexible jointed upvc drains on 100mm pea gravel bed at a gradient of 1 : 70.

Where 100mm diam. drains pass through walls they are to be protected by the use of a lintel over. Both sides the wall to be masked with rigid sheet material with 50mm clearance of the pipe.

Where flexible pipes are not under a road and have less than 600mm cover they are to have concrete paving slabs laid as bridging above the pipes for protection and are to have a min. 75mm granular material between the top of the pipe and the underside of he slab.

Install where indicated a 75mm diam. vent pipe jointed to upturned bend at base. Finish at top, a min. 900mm above window head height, with a durable cage.

Install where indicated trapped (roddable) gullies - waste pipes to discharge below grating level and above water level.

Install 40mm diam. pvc waste to sinks and showers, *(NOTE : shower trays to be constructed on a suitable plinth to maintain access to trap and waste)*, 32mm diam. pvc waste to hand basins all with 75mm deep traps. *Unless specified other wise on plan.*
All waste pipes to have rodding access at each change of direction and be readily accessible throughout their length.

Above ground drainage to comply with BS5272 : 1978
Below ground drainage to comply with BS8301 : 1985


All drainage items are to be installed in strict accordance with the manufacturers instructions.

FLAT ROOF CONSTRUCTION


12.5mm white spar chippings bitumen bedded on
3 layer built up roofing felt, bottom layer to be astos based, dressed up abutments a min 150mm
12/13mm fibreboard fully bonded to
70mm Jablite Thermodek insulation
vapour barrier
18mm exterior grade plywood decking
Firrin pieces to give a fall of 1 : 80
Joists as specified on section
12.7mm Gypsum Fireline board with 5mm gypsum plaster finish to garage and 12.7mm foil backed plasterboard and skim finish elsewhere.

Where joists run parallel to walls they are to be strapped at 1800mm cts with 30 x 6mm galv m.s. straps fixed to a min 3No. joists, having nogged between beforehand, and securely fixed to walls. Similar straps to be used at 1800mm cts to hold down the wall plate.


Supply and install 103mm pvc gutters and fit. to falls on fascia with all necessary brackets, stop ends, outlets etc. Supply and install 64mm downpipes securely clipped to walls at 1800mm cts together with all necessary offsets, swannecks, adaptors etc. and taken into 100mm diam. upturned bend at base

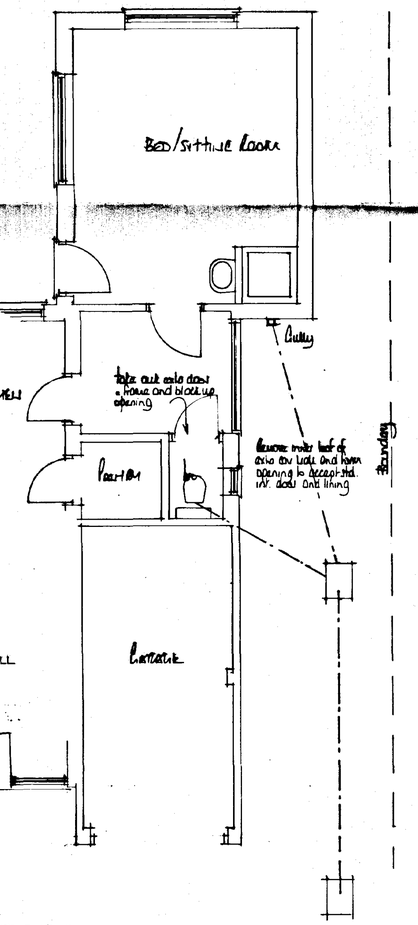


EXISTING

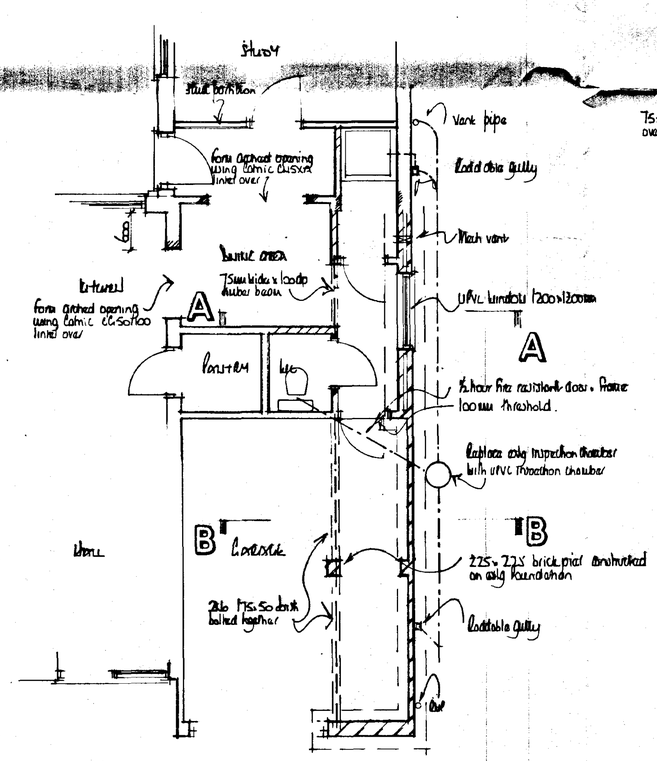


PROPOSED

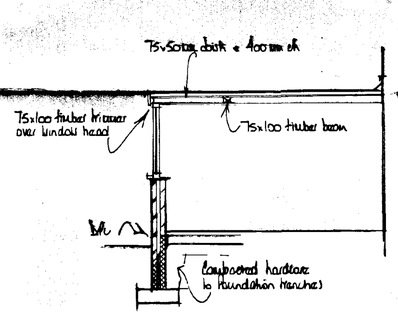

A - A

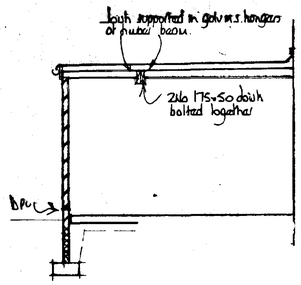

B - B

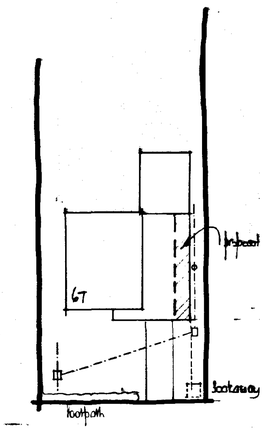

Cathedral Drive

DETERMINED

BLOCK PLAN

SOUTH HOLLAND DC
HOUSING & PLANNING
23 SEP 1999
Ref: 0945/99

A		
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767968

Client
Mr. Mrs Carter

Job Title
Extension to Dwelling at
67 Cathedral Drive
Spalding.

Drawing Title
Plans
Sections
&
Elevations.

Scale 1:50. 1:100. 1:250

Date June 99 | Drawn by AL

Drg No 99/35/01 | Rev