




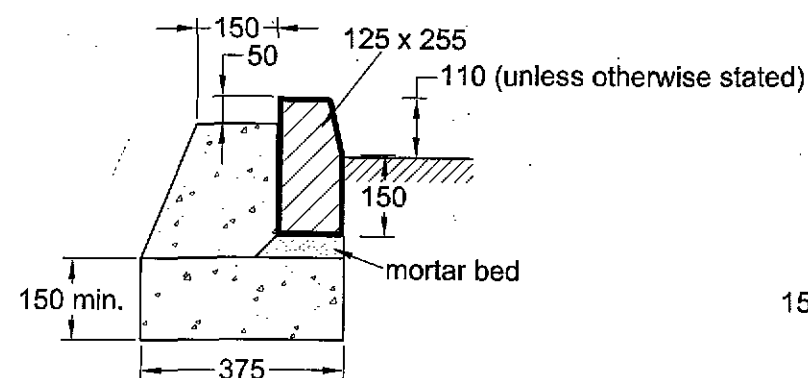


Type K1 (half battered 12.5 - 15°)
K1A (45° splay)

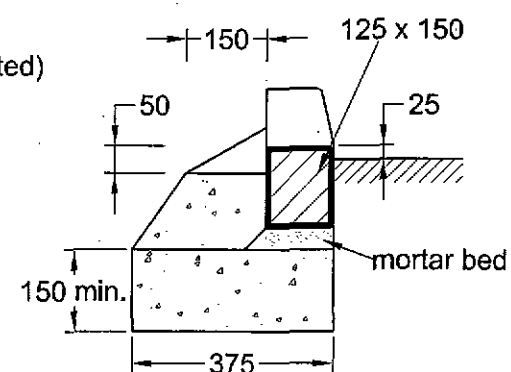

Type K2 Dropper - TYPE K3 Dropped
K2A (45° splay)

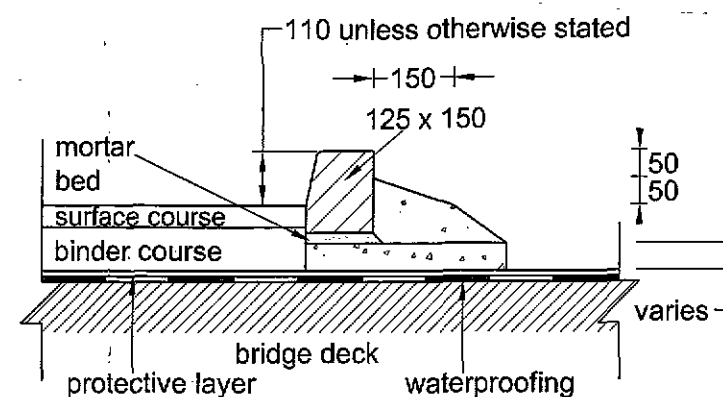


Type K4
(half battered 12.5 - 15°)
K4A (45° splay)

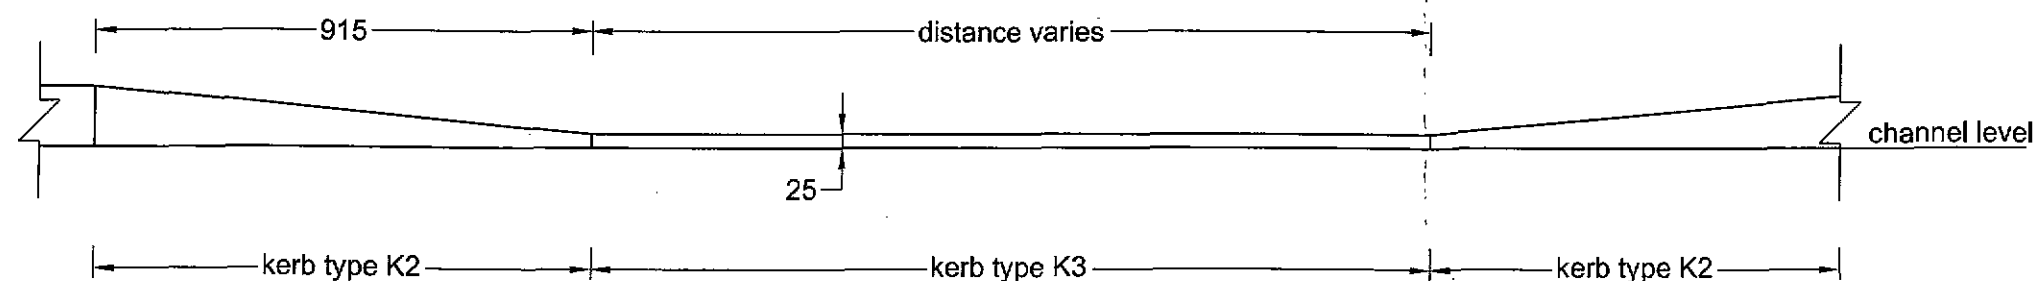

Notes

1. Concrete bed and backing to Grade ST3 concrete to Clause 2602.
2. Mortar bed to be Class 1 to Clause 2404 thickness 10-40mm to Clause 1101.
3. Precast concrete kerbs and edgings to BS 7263.
4. See SD7A/11/3 and SD7A/11/4 for back of kerb treatment when area to rear of kerb is surfaced.

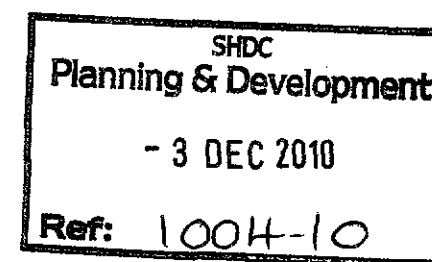

SD7A/11/2/A1

Precast Concrete Kerbs

Checked by: PAS

Approved by: DF

ISSUED

FEB 2008

Lincolnshire
COUNTY COUNCIL

A3 ORIGINAL
NOT TO SCALE
(all units in millimetres)

This Standard Drawing relates to typical detail and may require conversion to a full scheme specific drawing.

Rev:	Date:	Description:	Approved by:
A1	27/1/09	BRITISH STANDARD REFERENCES UPDATED	DF
		AMENDMENT DETAILS	

SD7A/11/2/A1

Kerbs, Footways and Paved Areas