



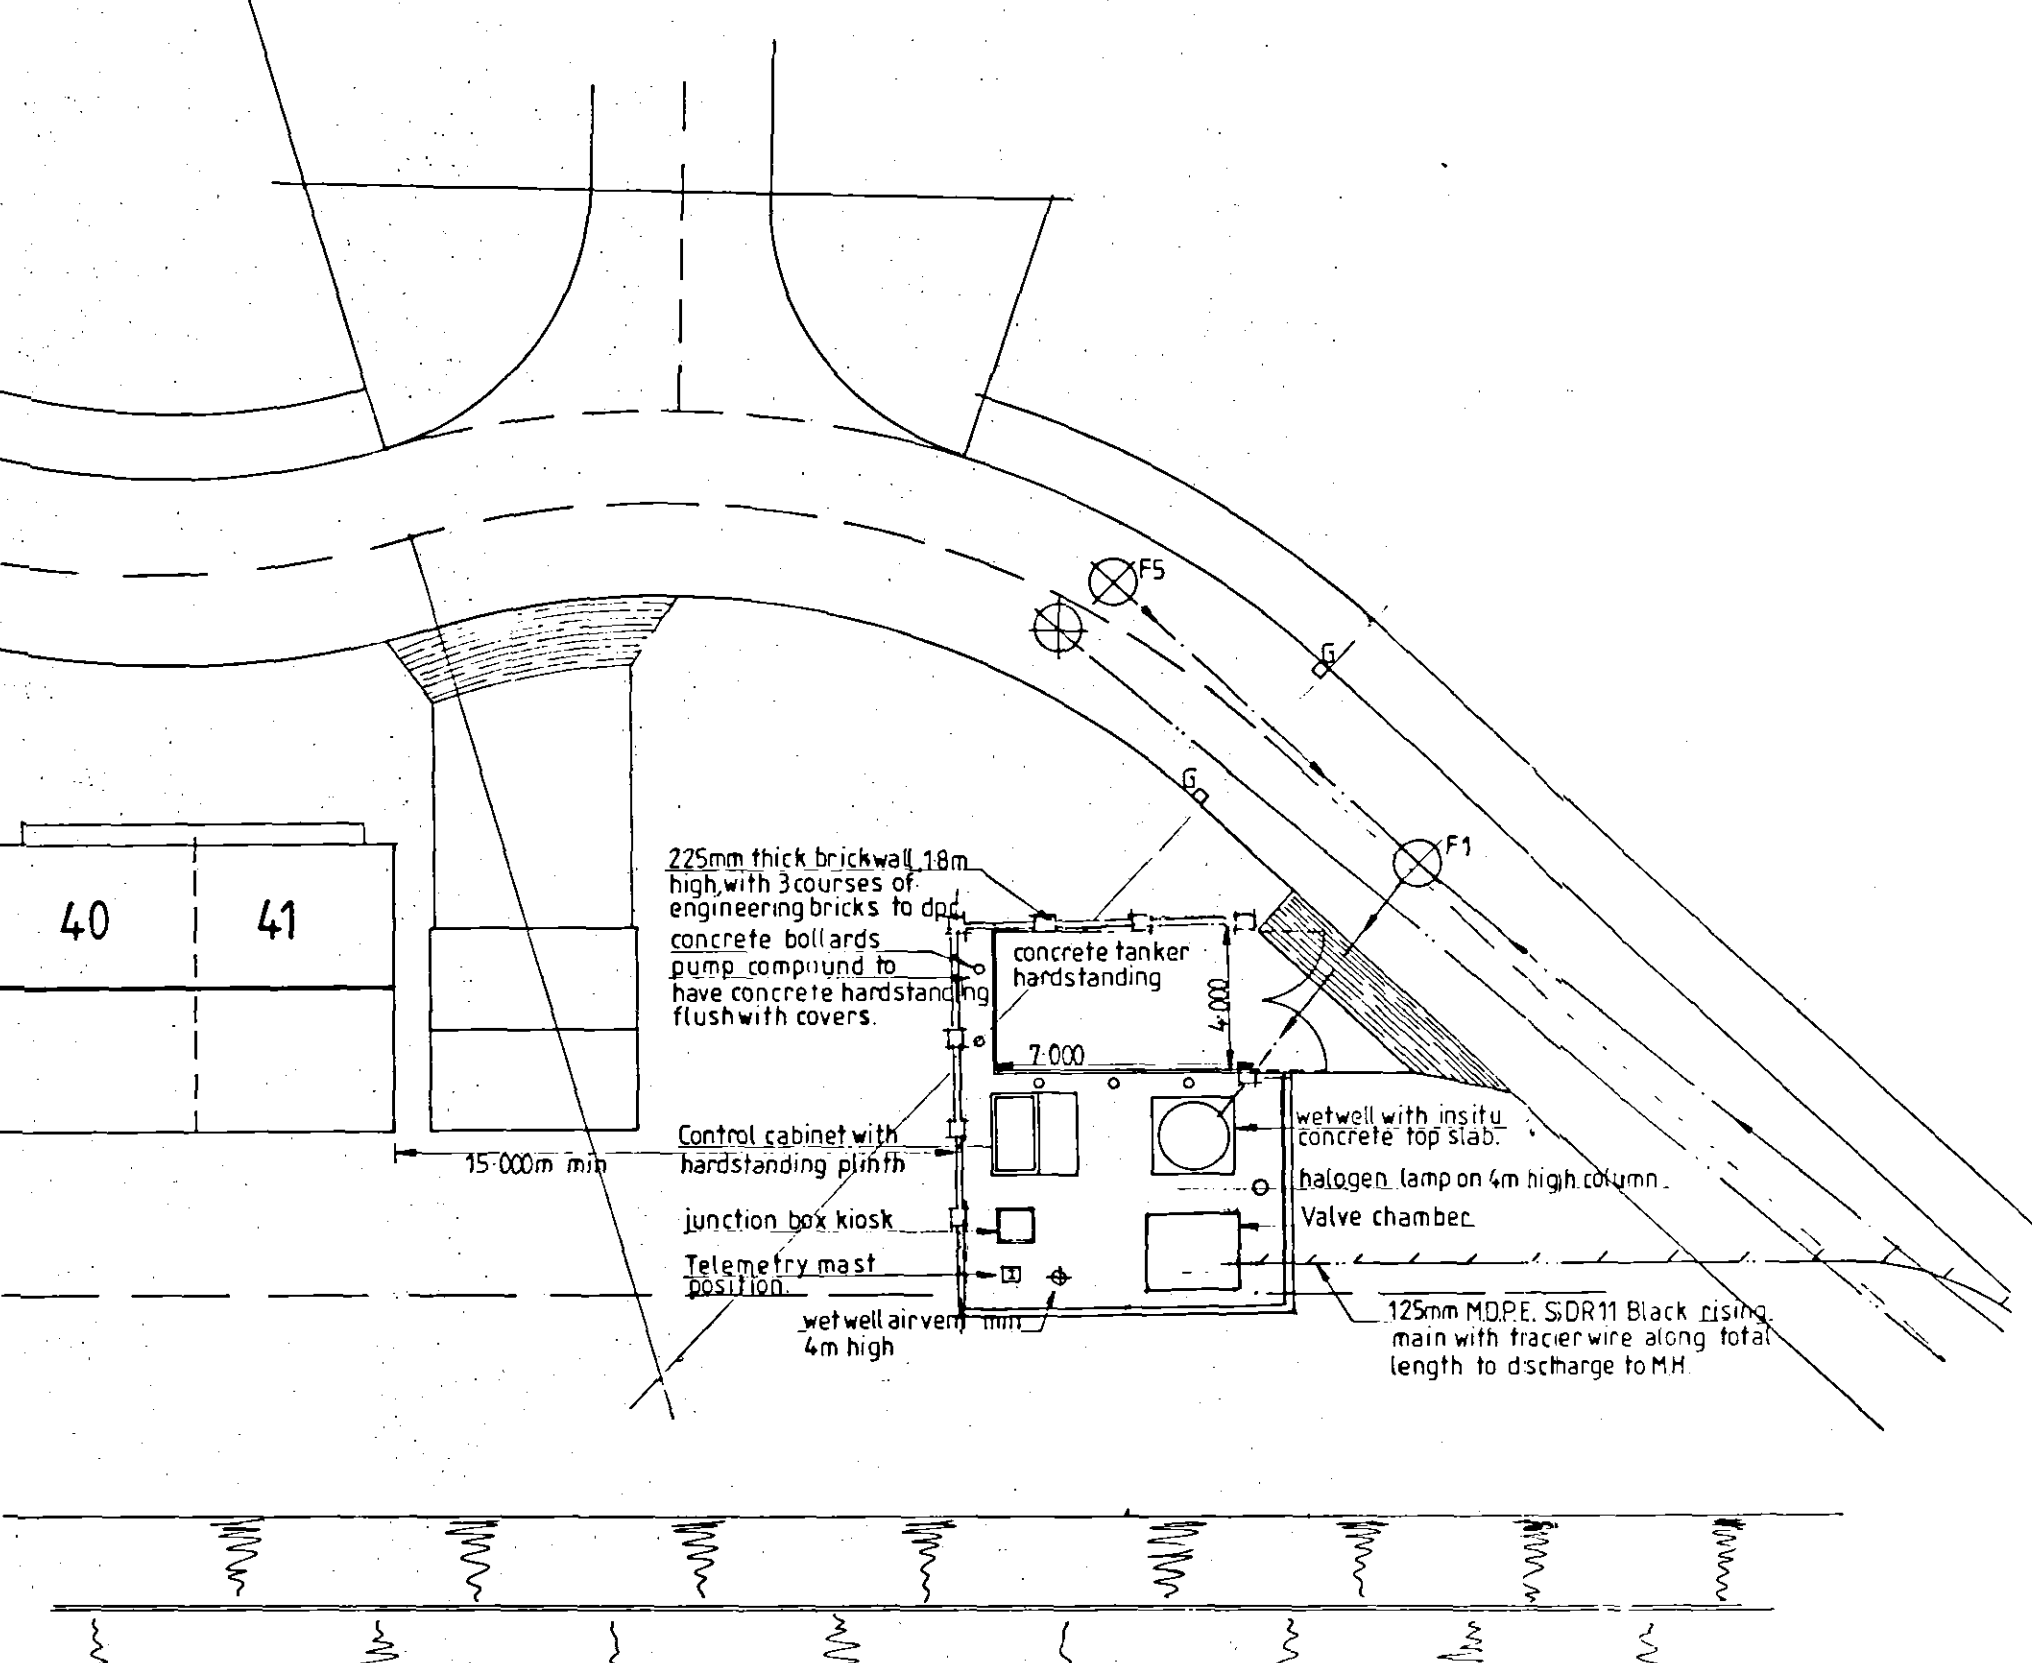


Pumping Station Compound layout

All works to comply with Sewers for Adoption 5 Edition

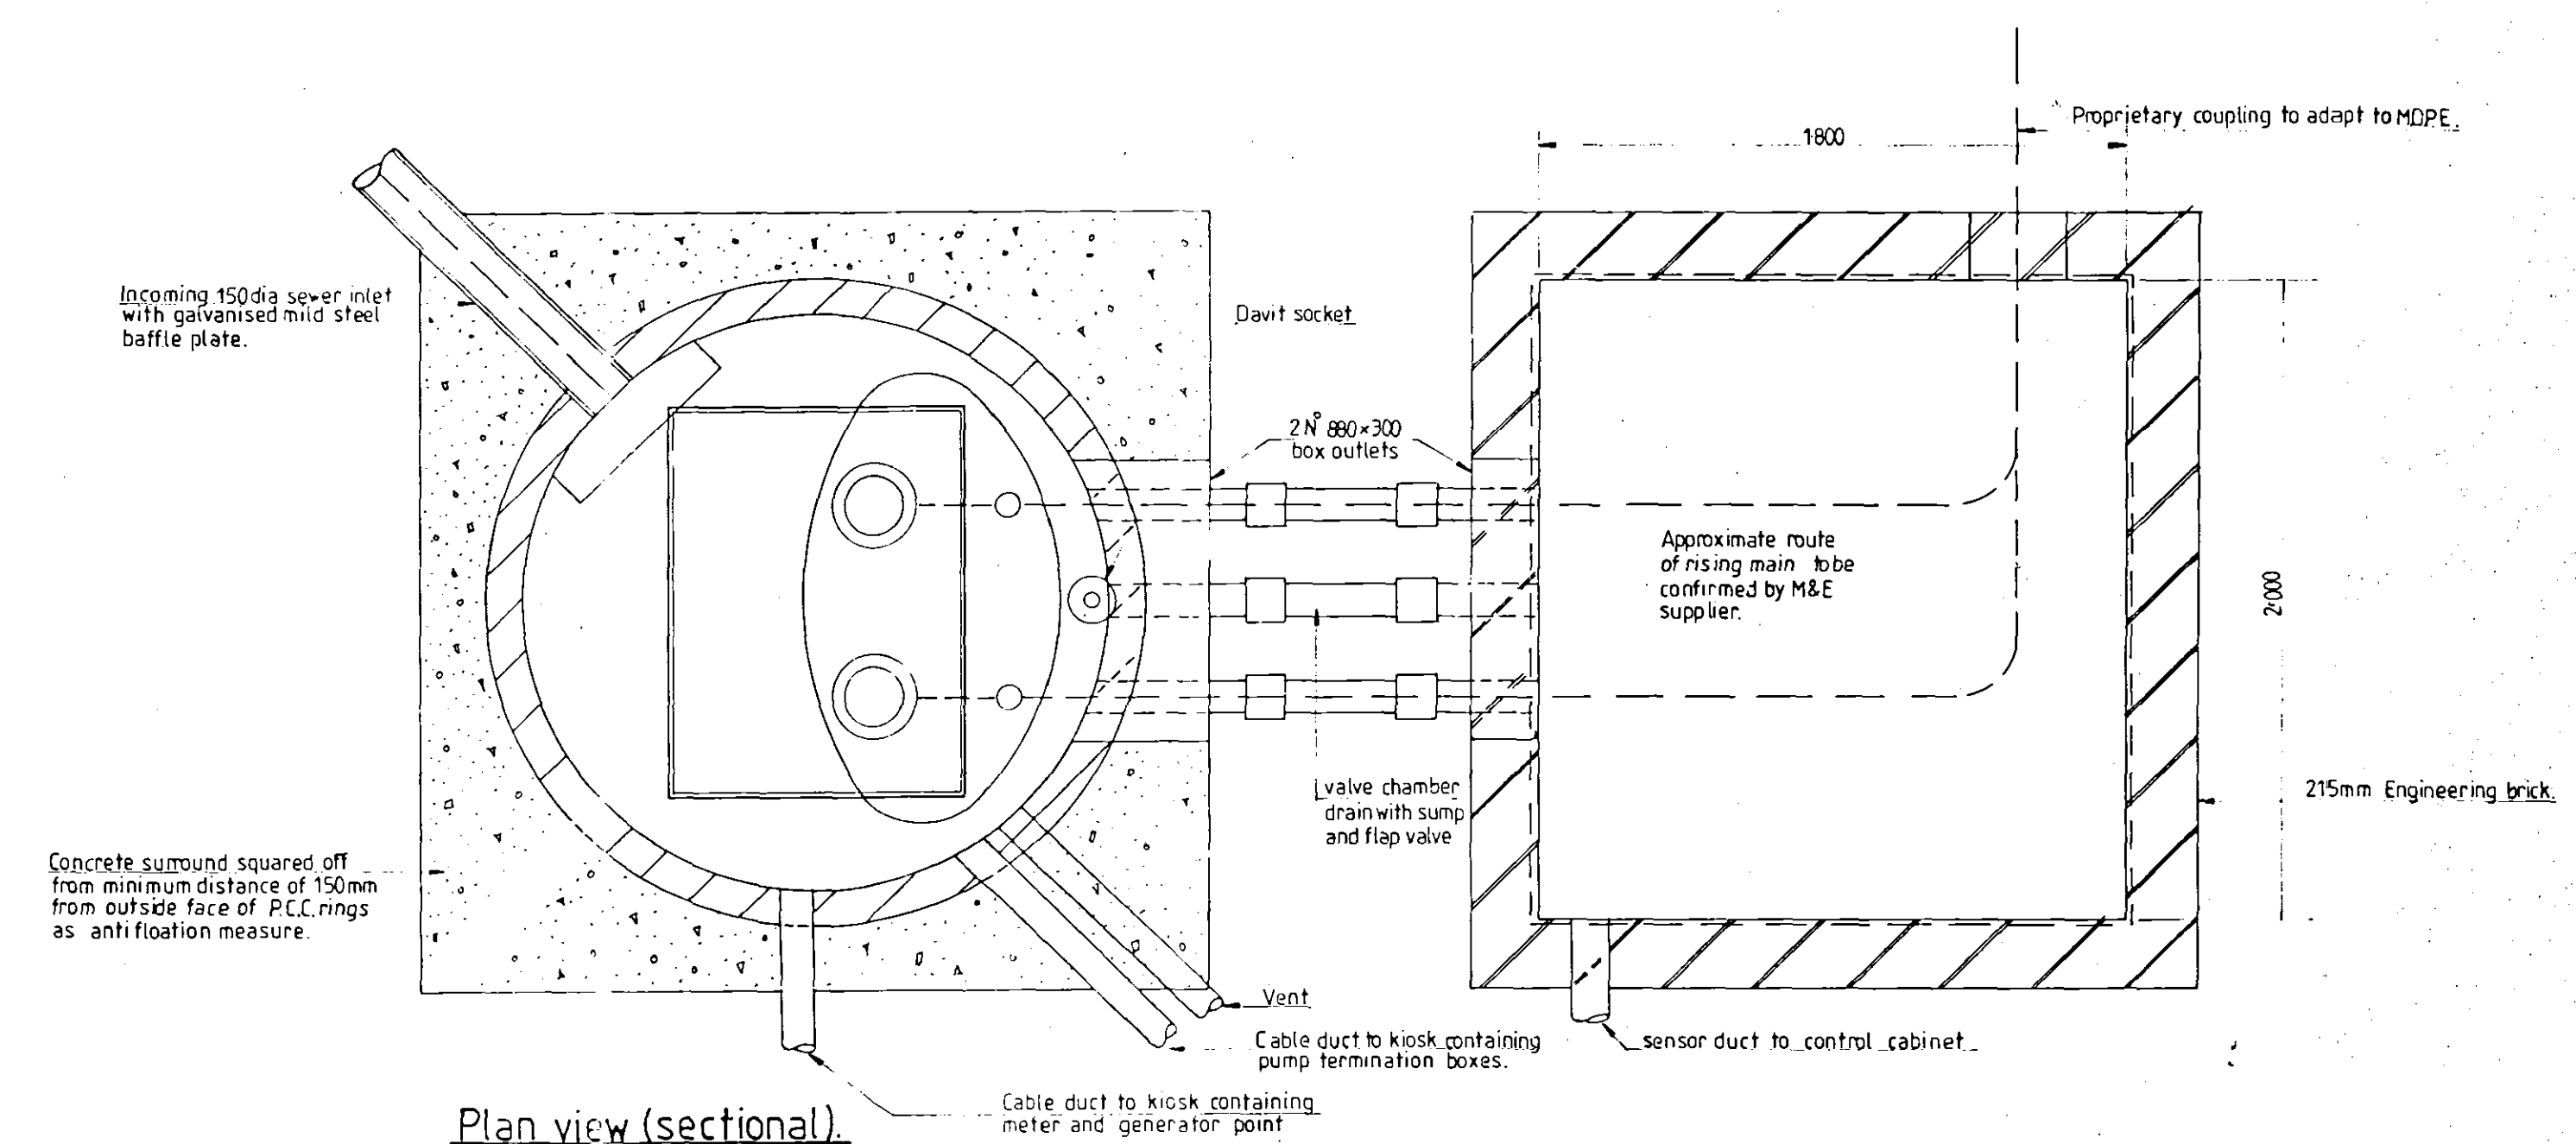

Testing of MDPE pipework shall be carried out in accordance with provisional pressure test Type 2 detailed in section 8 of the manual for MDPE pipe systems for water supply, published by WRc. The test pressure shall be 15 bar for MDPE pipework.

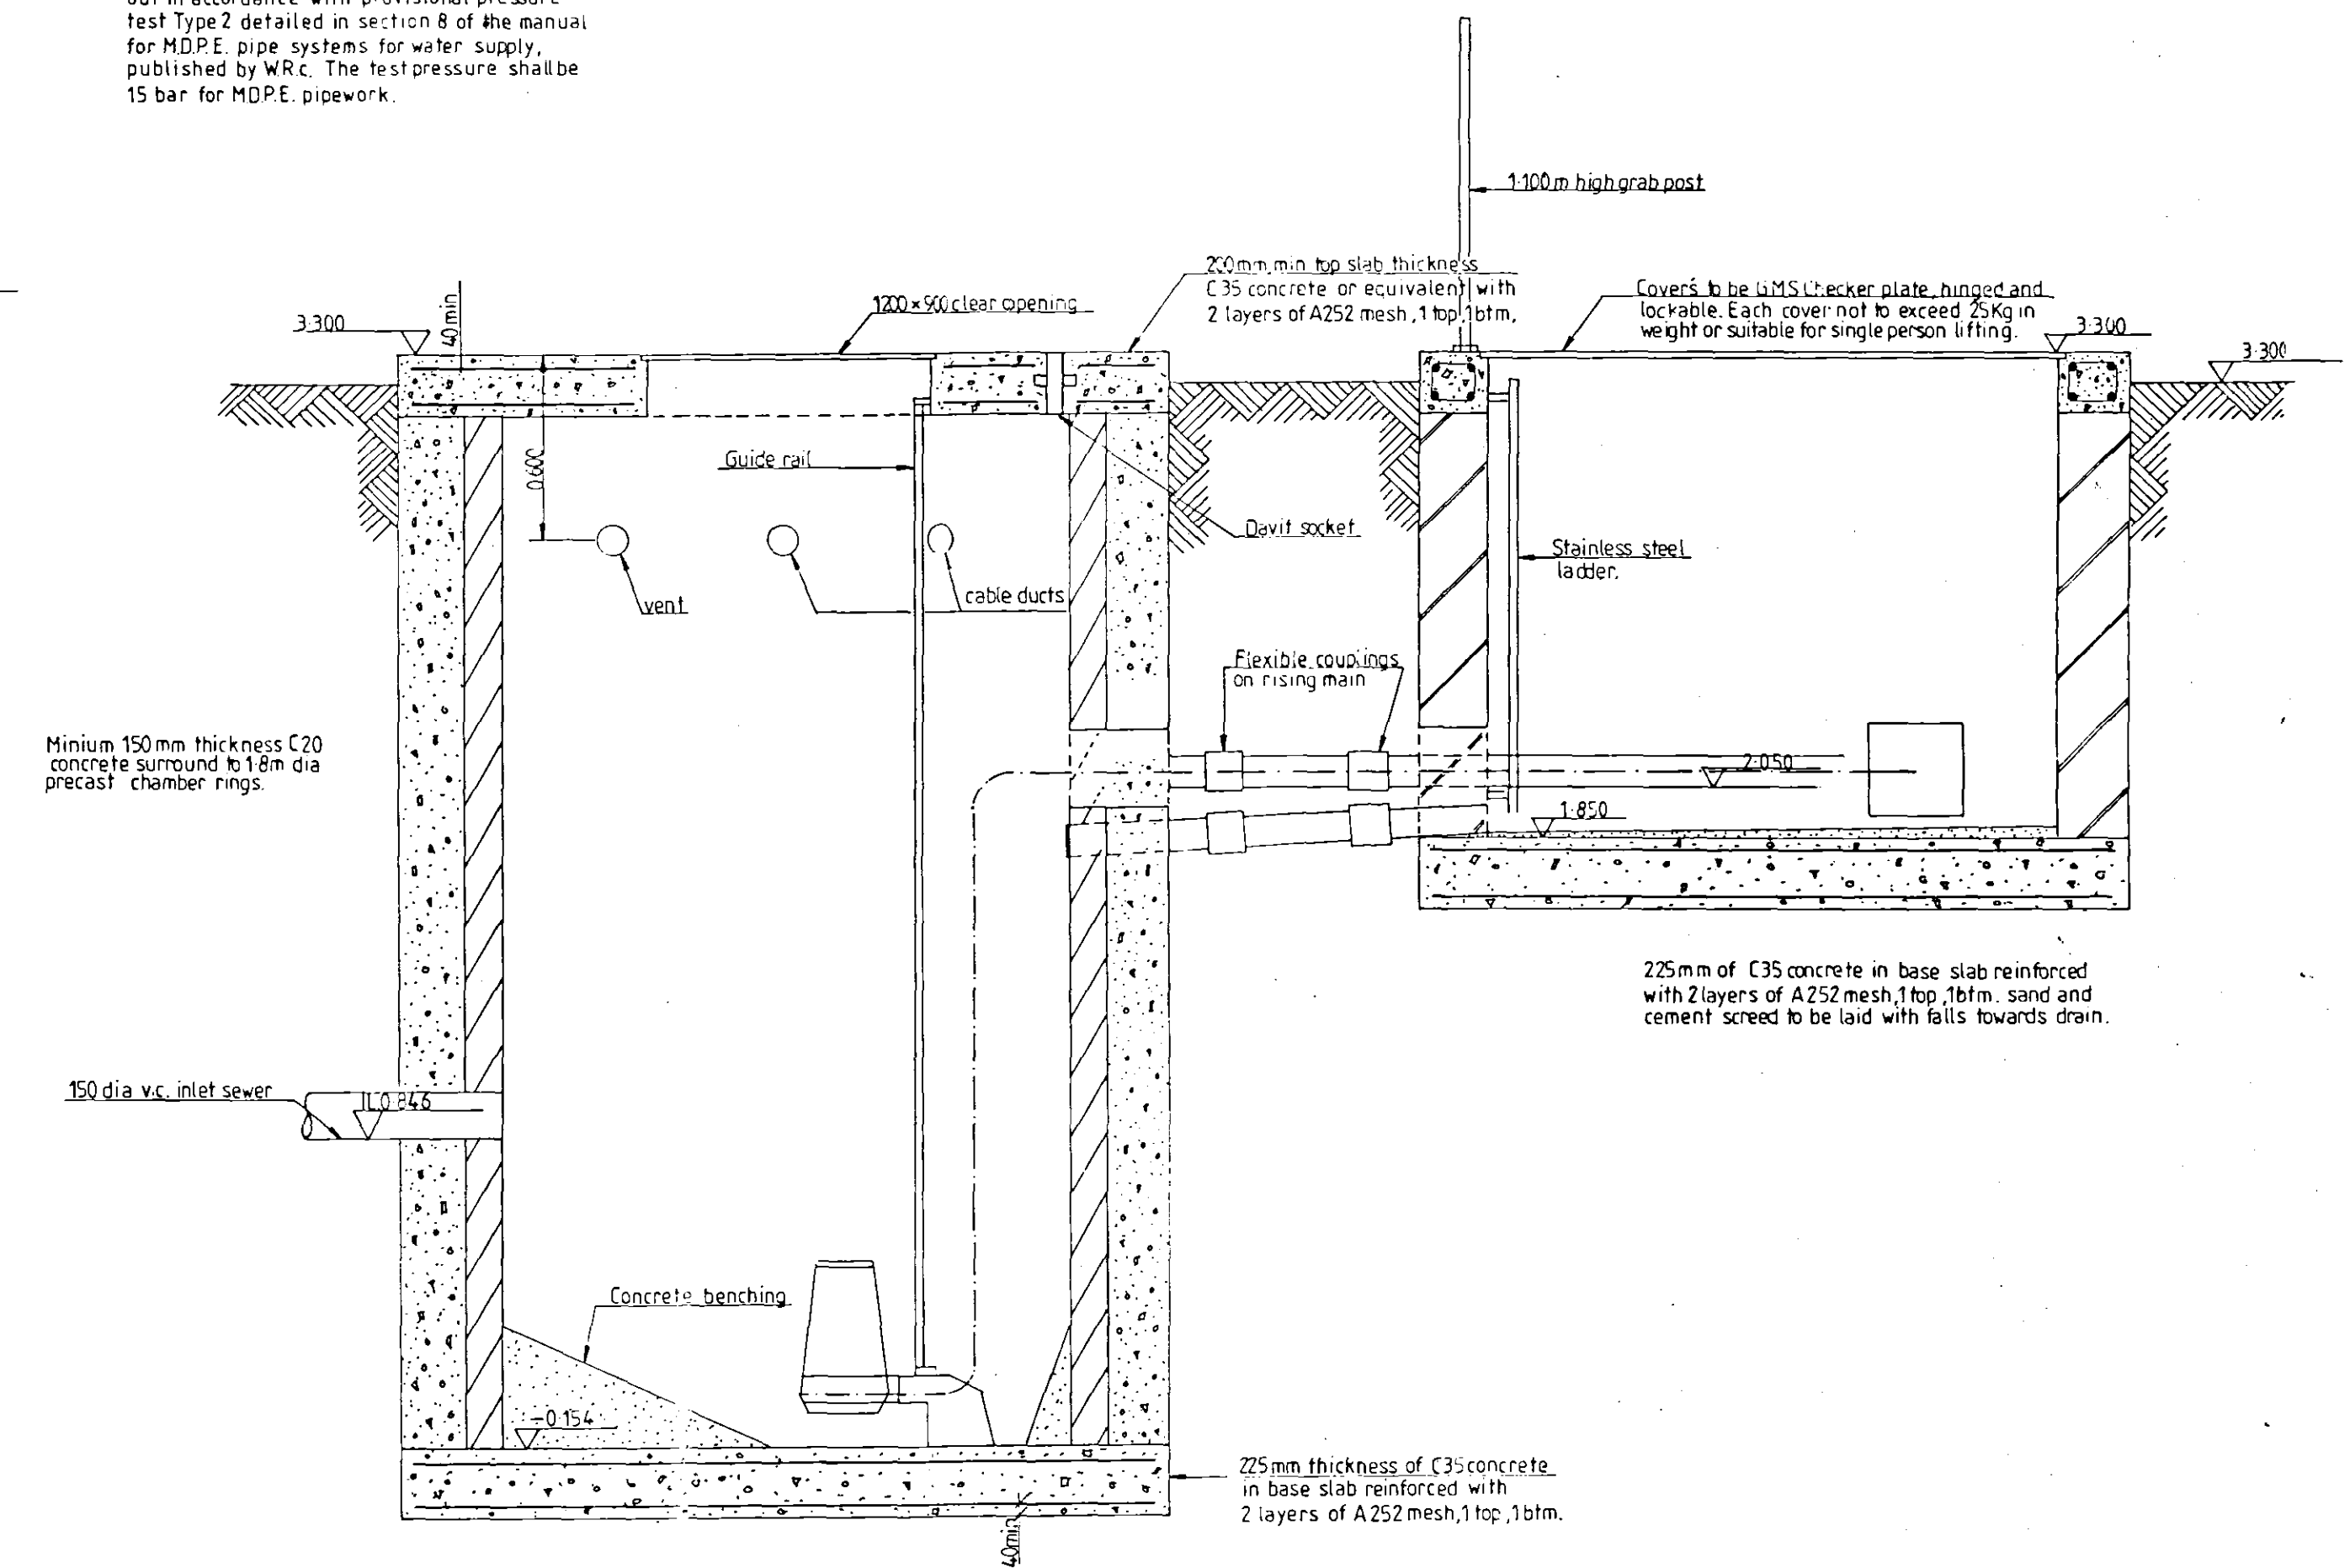

Section Through 1:20

19 AUG 2003

1022/03

Rev	Date	Remarks
8	14/5/03	WET WELL & VALVE CHAMBER COVER SLAB LEVELS ADJUSTED TO ALIGN WITH REVISED ROAD LEVELS ALSO PUMP COMPOUND ENTRANCE ADJUSTED TO 1.5M FROM 1.8M AT ARCHITECTS REQUEST
A	25.2.03	M.D.P.E. PIPE WORK TESTING NOTATION ADDED AT A.W. REQUEST.

REDBOURNE HOUSE,
CLOSSHILL LANE,
WYBERTON,
BOSTON, Lincs.
PE21 7AA
TEL: 01205 311021
FAX: 01205 359316

Project
Residential Development at Edward Road, Spalding, for Broadgate Homes Limited.

Drawing Type
Foul water Pumping Station. Typical Arrangement.

Client Broadgate Homes Ltd. Broadgate House. Weston Hills. Spalding. Lincolnshire. Pe126db.	Drawing No. E02/BHL/ERS/03
Scale 1/200 1/20	Drawn By P. Grimwood.