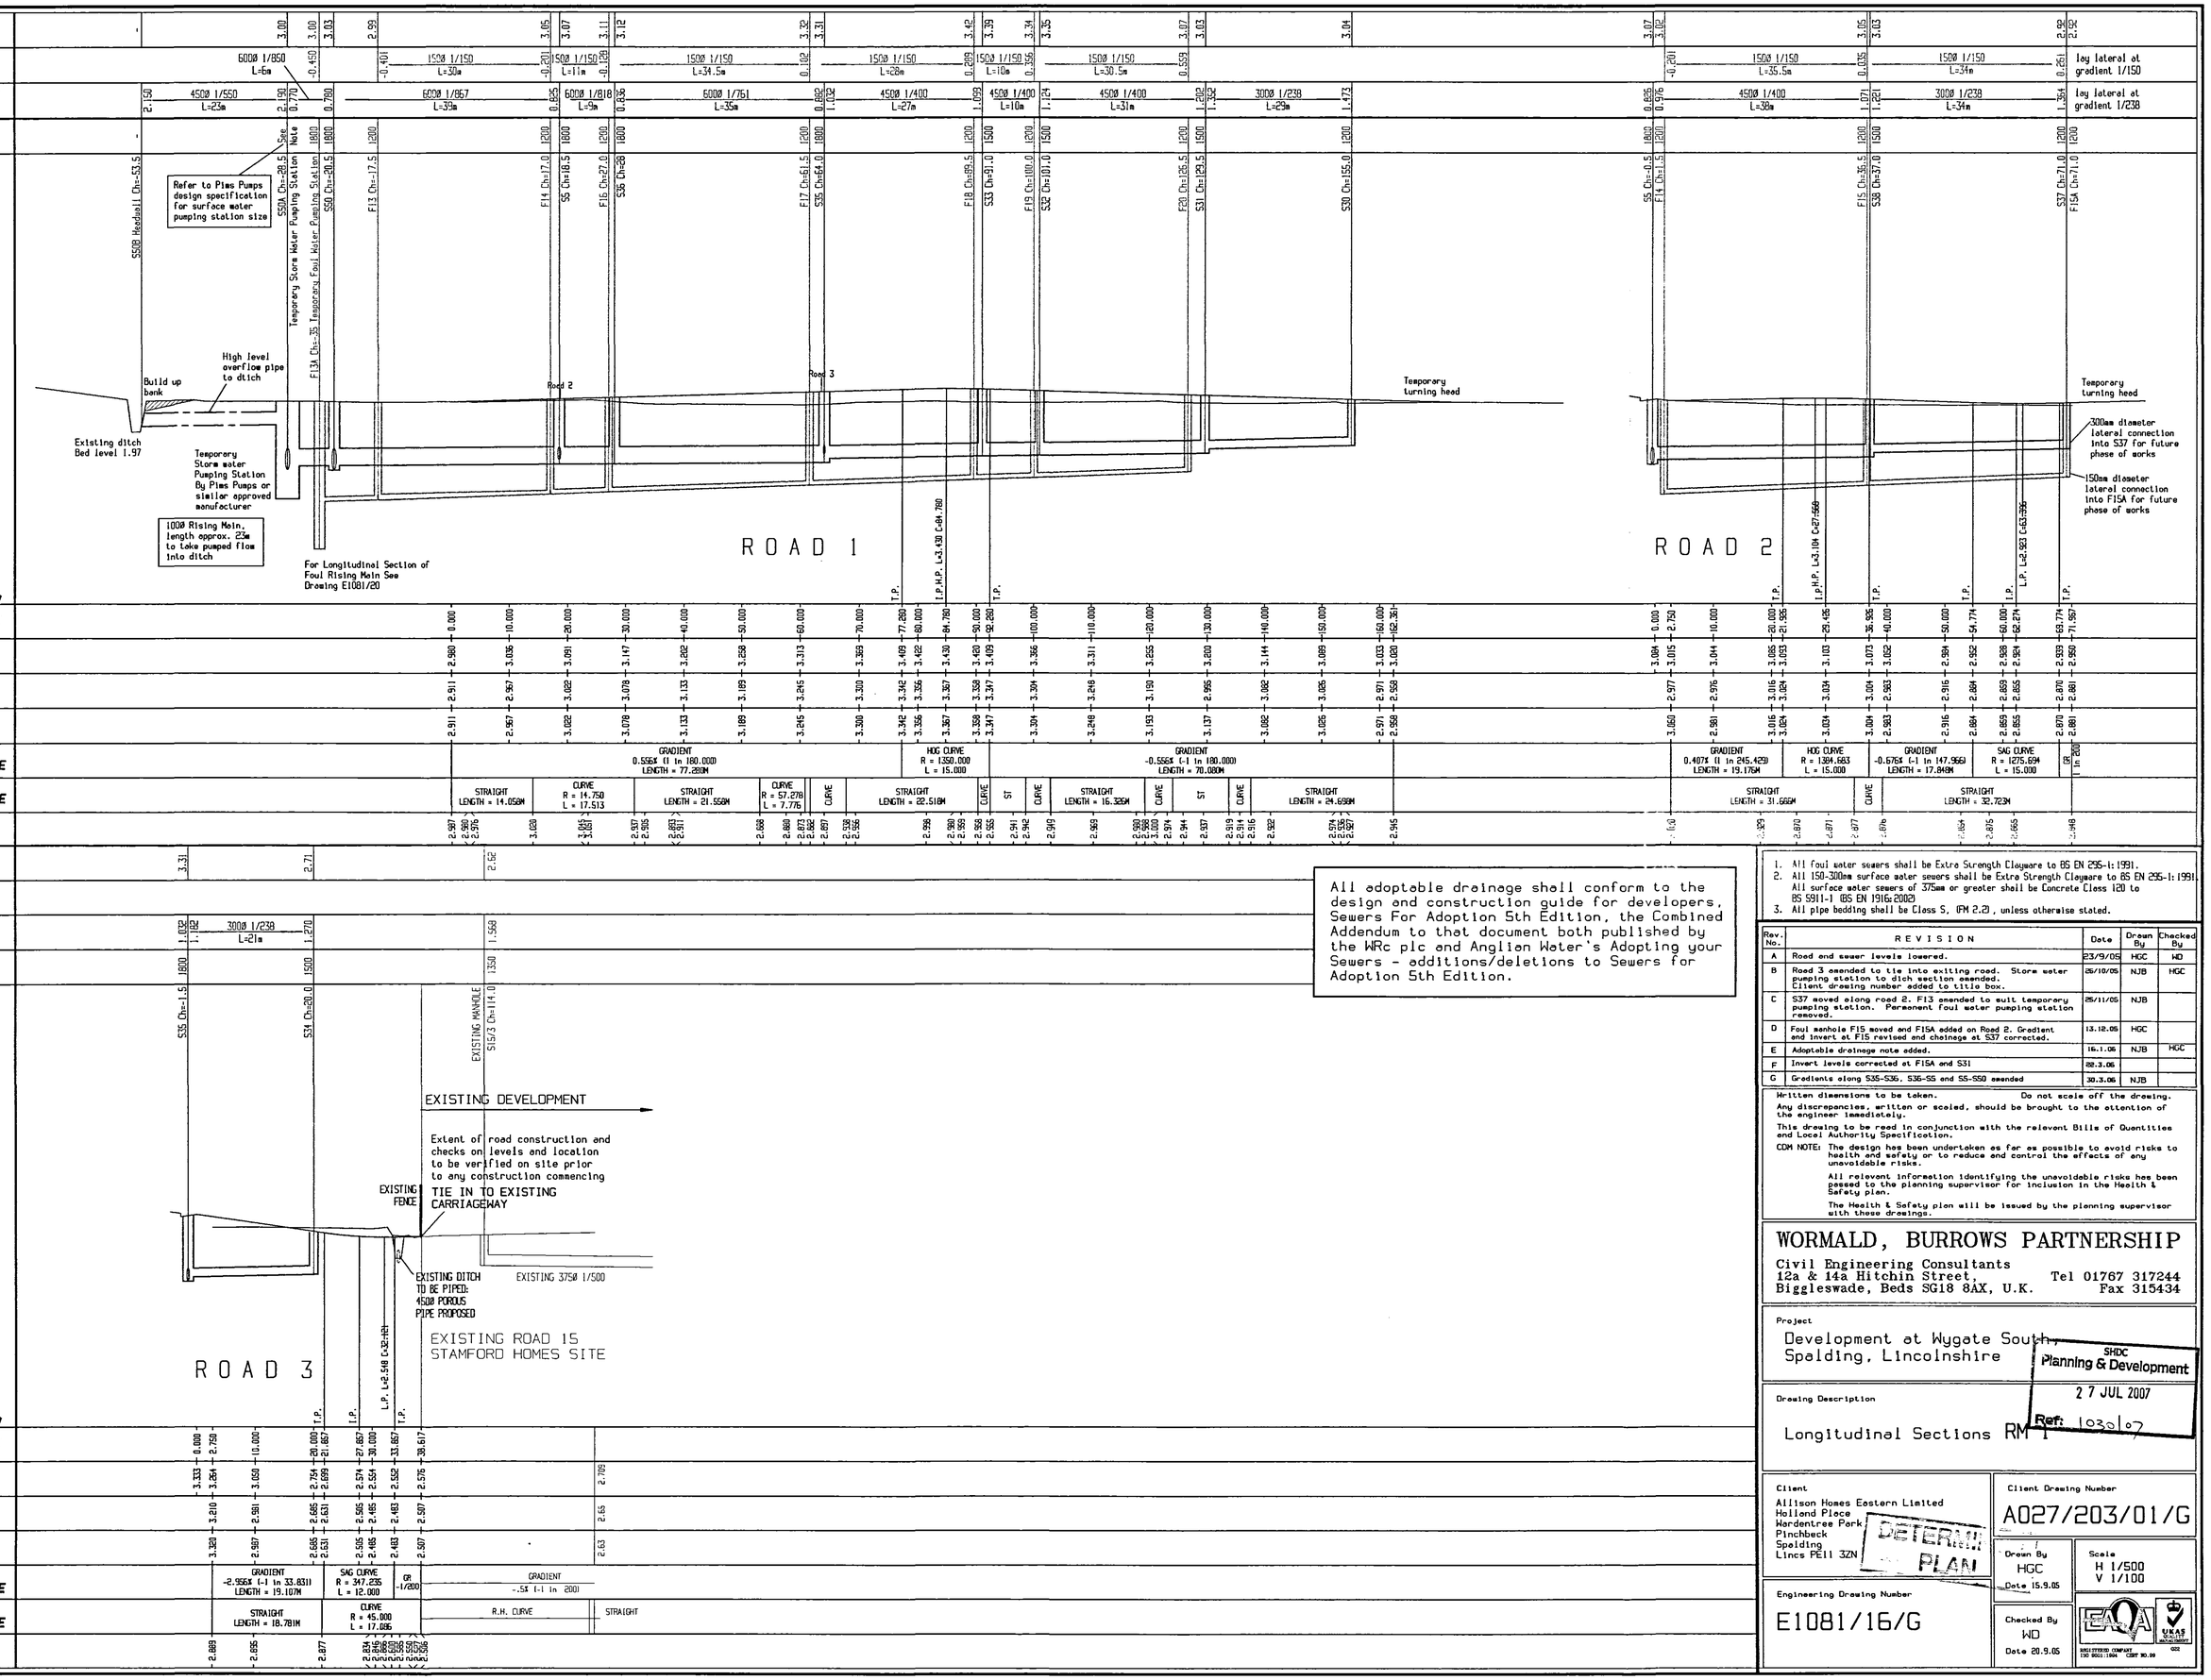

All adoptable drainage shall conform to the design and construction guide for developers, Sewers For Adoption 5th Edition, the Combined Addendum to that document both published by the WRc plc and Anglian Water's Adopting your Sewers - additions/deletions to Sewers for Adoption 5th Edition.

1. All foul water sewers shall be Extra Strength Clayware to BS EN 295-1: 1991.
2. All 150-300mm surface water sewers shall be Extra Strength Clayware to BS EN 295-1: 1991.
   All surface water sewers of 375mm or greater shall be Concrete Class 120 to BS 5911-1 (BS EN 1916:2002)
3. All pipe bedding shall be Class S, (FM 2.2), unless otherwise stated.

Rev. No.	REVISION	Date	Drawn By	Checked By
A	Road end sewer levels lowered.	23/9/05	HGC	WD
B	Road 3 amended to tie into exiting road. Storm water pumping station to dtch section amended. Client drawing number added to title box.	26/10/05	NJB	HGC
C	S37 moved along road 2. F13 amended to suit temporary pumping station. Permanent foul water pumping station removed.	25/11/05	NJB	
D	Foul manhole F15 moved and F15A added on Road 2. Gradient and invert at F15 revised and chainage at S37 corrected.	13.12.05	HGC	
E	Adoptable drainage note added.	16.1.06	NJB	HGC
F	Invert levels corrected at F15A and S31	22.3.06		
G	Gradients along S35-S36, S36-S5 and S5-S50 amended	30.3.06	NJB	

Written dimensions to be taken. Do not scale off the drawing.
Any discrepancies, written or scaled, should be brought to the attention of the engineer immediately.
This drawing to be read in conjunction with the relevent Bills of Quantities and Local Authority Specification.
CDM NOTE: The design has been undertaken as far as possible to avoid risks to health and safety or to reduce and control the effects of any unavoidable risks.
All relevant information identifying the unavoidable risks has been passed to the planning supervisor for inclusion in the Health & Safety plan.
The Health & Safety plan will be issued by the planning supervisor with these drawings.

WORMALD, BURROWS PARTNERSHIP
Civil Engineering Consultants
12a & 14a Hitchin Street, Biggleswade, Beds SG18 8AX, U.K.
Tel 01767 317244
Fax 315434

Project
Development at Wygate South, Spalding, Lincolnshire

SHDC Planning & Development
27 JUL 2007
Ref: 1030/07

Drawing Description
Longitudinal Sections RM 1

Client
Allison Homes Eastern Limited
Holland Place
Wardentree Park
Pinchbeck
Spalding
Lincs PE11 3ZN

DETERMINED PLAN

Client Drawing Number
A027/203/01/G

Drawn By HGC Date 15.9.05

Scale H 1/500 V 1/100

Engineering Drawing Number
E1081/16/G

Checked By WD Date 20.9.05

EAQA UKAS ACCREDITED
AN ISO 9001:1994 COMPANY CERT NO.99

Level 1081 Nick-Pc1 Mar 31 09.18.23 2006.