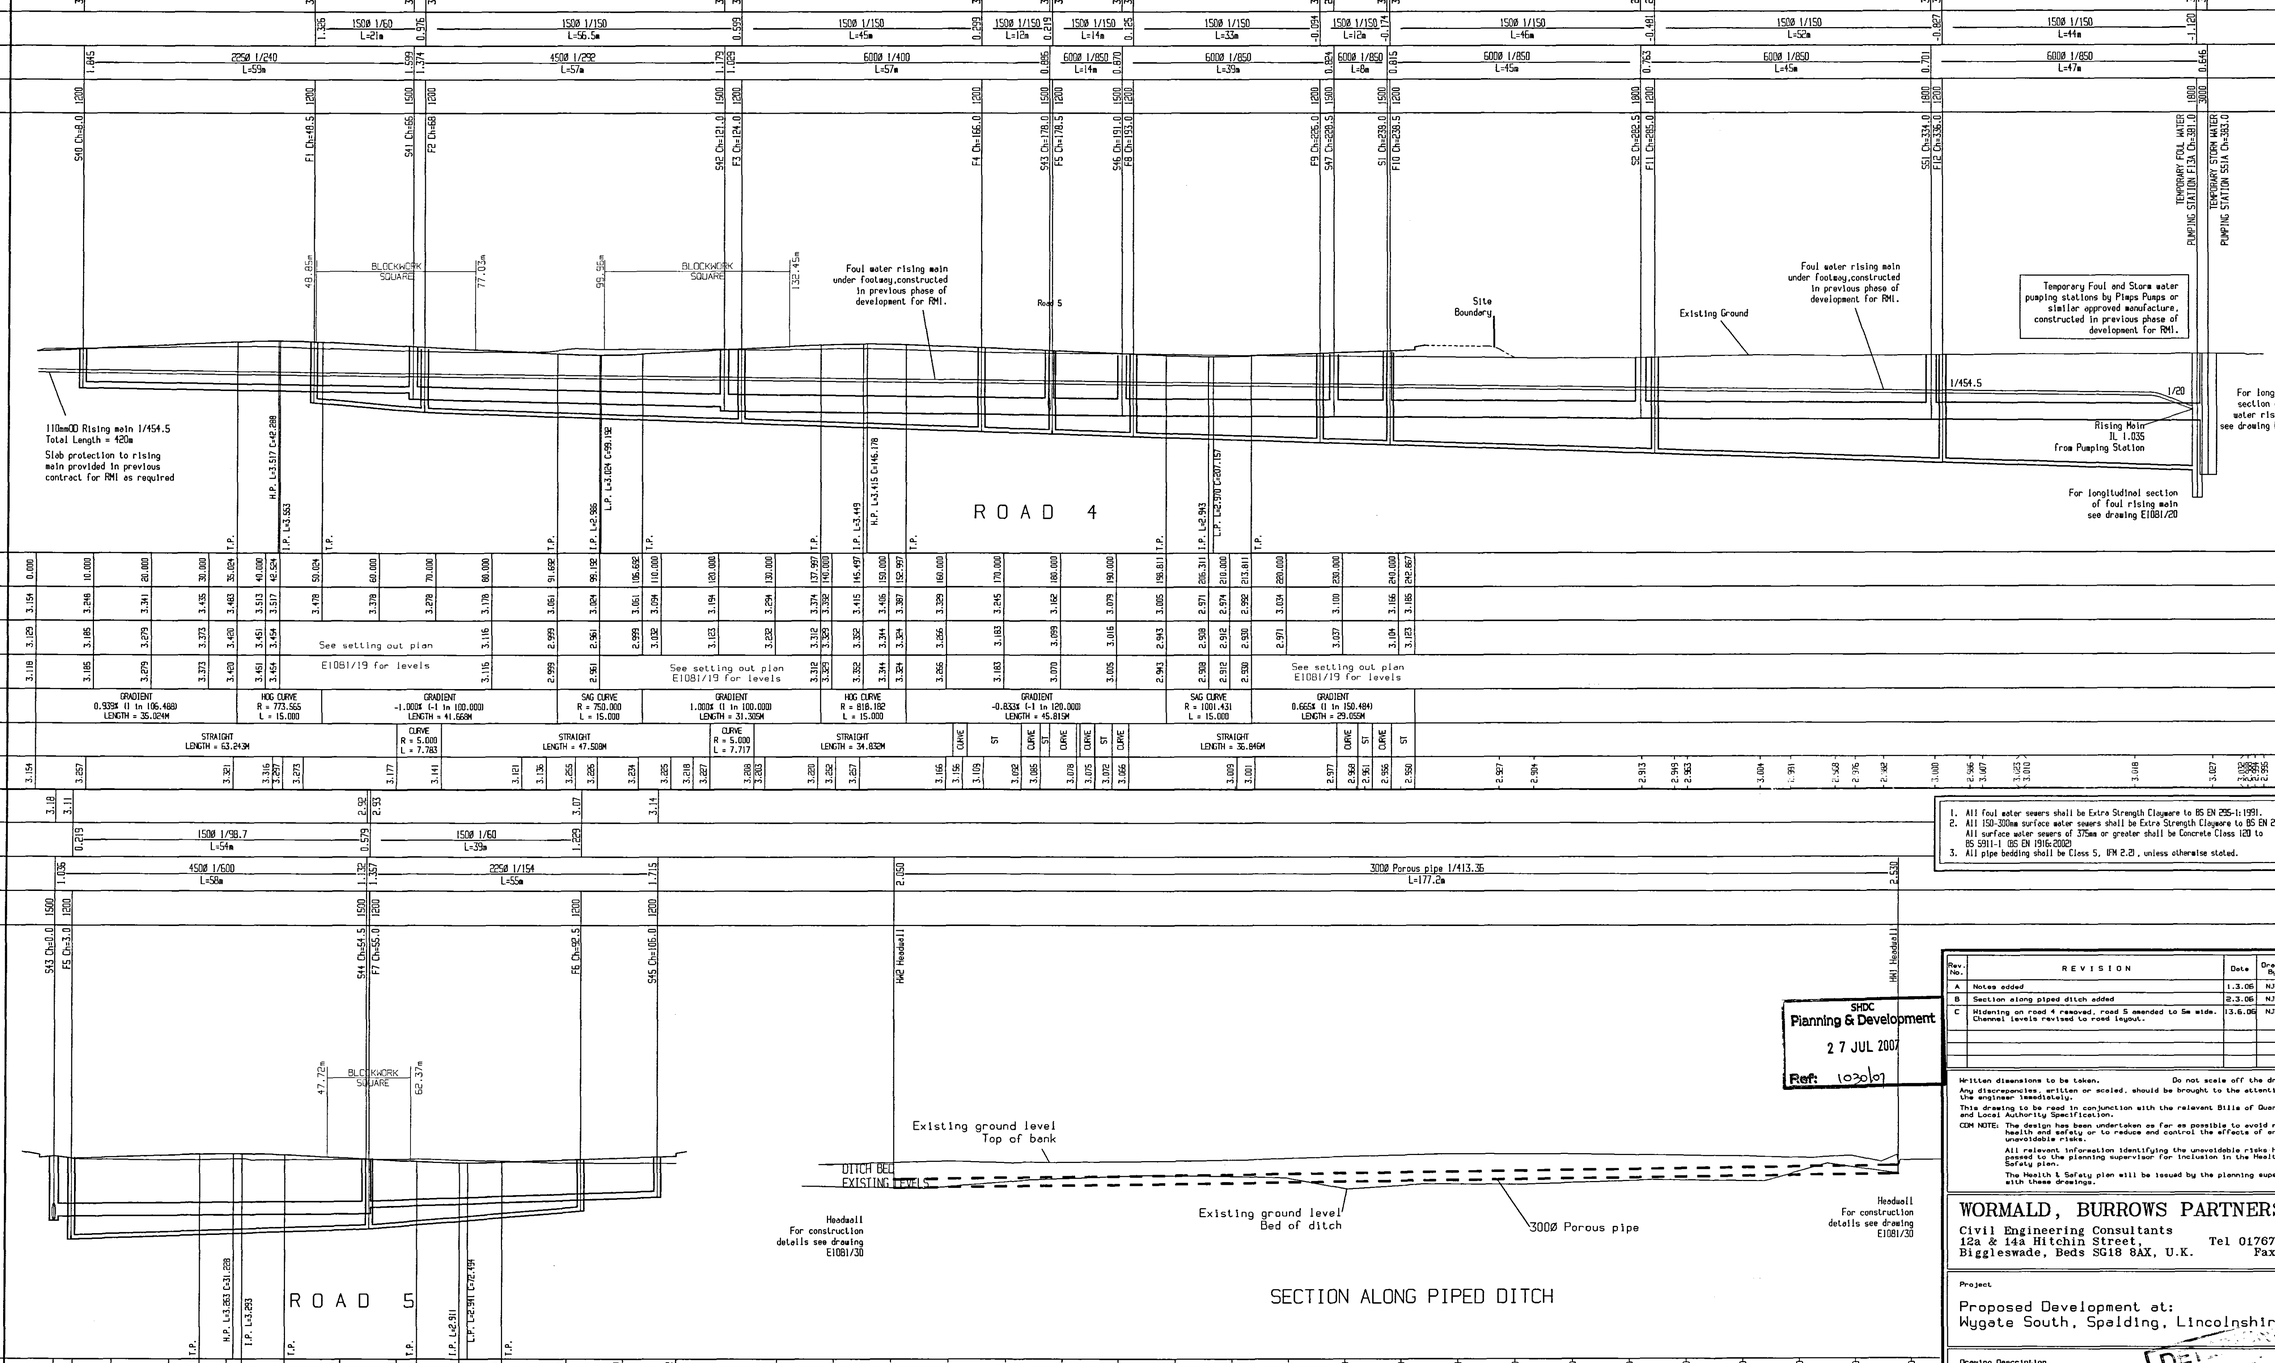

1. All foul water sewers shall be Extra Strength Clayware to BS EN 295-1:1991.
2. All 150-300mm surface water sewers shall be Extra Strength Clayware to BS EN 295-1:1991. All surface water sewers of 375mm or greater shall be Concrete Class 120 to BS 5911-1 (BS EN 1916:2002)
3. All pipe bedding shall be Class S, SFN 2.0, unless otherwise stated.

Rev. No.	REVISION	Date	Drawn By	Checked By
A	Notes added	1.3.06	NJB	HGC
B	Section along piped ditch added	21.3.06	NJB	HGC
C	Widening on road 4 removed, road 5 amended to 5m wide. Channel levels revised to road layout.	13.6.06	NJB	HGC

SHDC Planning & Development 27 JUL 2007 Ref: 1030/07

Written dimensions to be taken. Do not scale off the drawing.
Any discrepancies, written or scaled, should be brought to the attention of the engineer immediately.
This drawing to be read in conjunction with the relevant Bills of Quantities and Local Authority Specification.
CDM NOTE: The design has been undertaken as far as possible to avoid risks to health and safety or to reduce and control the effects of any unavoidable risks.
All relevant information identifying the unavoidable risks has been passed to the planning supervisor for inclusion in the Health & Safety plan.
The Health & Safety plan will be issued by the planning supervisor with these drawings.

WORMALD, BURROWS PARTNERSHIP
Civil Engineering Consultants
12a & 14a Hitchin Street, Biggleswade, Beds SG18 8AX, U.K.
Tel 01767 317244
Fax 315434

Project
Proposed Development at:
Wygate South, Spalding, Lincolnshire

Drawing Description
Longitudinal Section RM 2

DEPOSITED

Client
Allison Homes Eastern Limited
Holland Place
Wardentree Park
Pinchbeck
Spalding
Lincs PE11 3ZN

Client Drawing Number
A027/203/04/C

Drawn By NJB Date Jan 06

Scale H1: 500 V1: 100

Engineering Drawing Number
E1081/17/C

Checked By WD Date Jan 06

EQA UKAS REGISTERED COMPANY ISO 9001:2000 CERT No.00 66 002

I:\E1081\Drawings\ Thu Jun 15 14:57:25 2006