

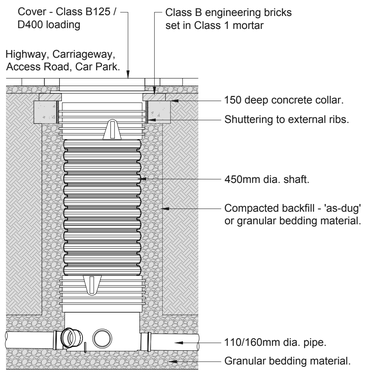



450 Diameter Inspection Chamber - B125 - D400 Loading
(Scale 1:20)

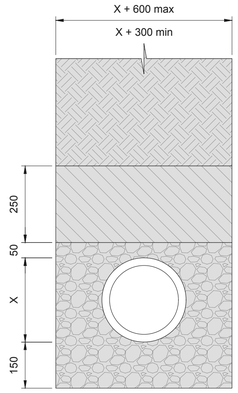


Type "S" Bed and Surround
(Scale 1:10)

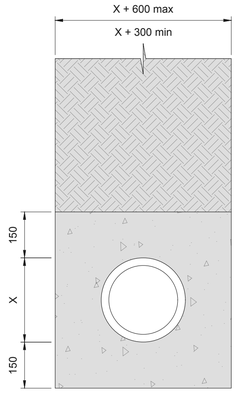


Type "Z" Bed and Surround
(Scale 1:10)

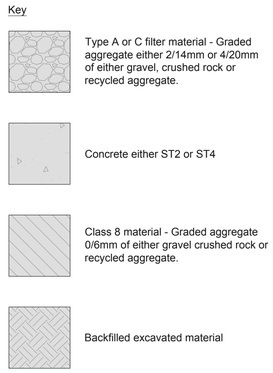


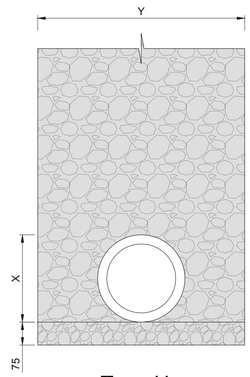

Type H
(Scale 1:10)

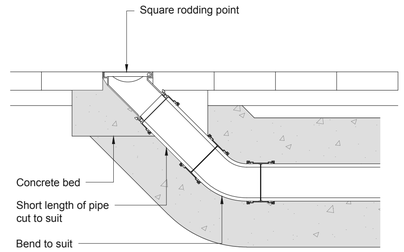

Rodding Point Installation Detail
(Scale 1:10)

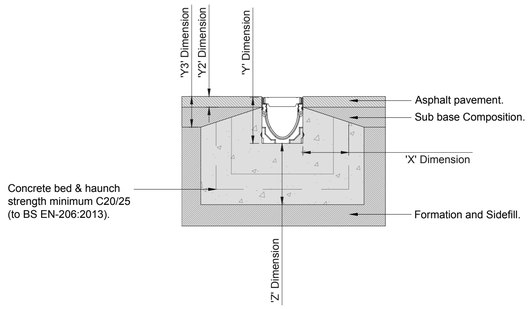

1 : 10 ACO MultiDrain Asphalt Pavement

1.0 Load Class
Installation recommendations shown are ACO minimum recommendations for BS EN 1433:2002 load class requirements.

2.0 Ground Conditions
The long term performance of a channel installation to sustain vertical and lateral loads depends upon A) ground conditions B) stability of the adjacent pavement and C) a durable concrete bed and surround. The recommended installation detail may require the minimum dimensions to be revised to achieve site specific load class requirements (referred to in 1.0 above).

3.0 Cutting and Jointing
Mitre joints are formed by cutting the channels to the required angle and butting them together with appropriate sealant (e.g. Sikaflex 11FC or similar) or ACO Repair Kit. Where possible 90° joints and T's should be formed so that gratings do not have to be cut. Angles can be formed by connecting them using proprietary PVCu pipework attached to ACO inlet/outlet endcaps. For further details please contact ACO Design Services Team.
Note: For Load Classes higher than C 250, mitred joints are not recommended in vehicular areas. Where requested ACO can custom manufacture angled junctions to order.

4.0 Isolation Joints
The channel must be isolated from the surrounding environment. An isolation joint must be positioned up to 1500mm from the channel wall. Any dowel bars must be located no nearer than 150mm from the channel wall. Other isolation joints in surrounding slab must be continued through the channel. Additional crack control may be required to comply with specifier requirements.

5.0 Installation into in-situ Slab
Where a channel is to be installed into an existing concrete slab it is necessary to cut a suitably sized pocket in the slab. The channel will then need to be bedded in polymer modified mortar of 25mm minimum thickness (this may vary depending on the type of mortar used). Engineering advice may be necessary.

6.0 Temporary Installation
A channel installation is not complete until the final surfacing is laid. In any temporary condition, i.e. with the channel walls projecting above adjacent ground, site traffic should not cross channels. Loose boards, stone fill or cover plates will not protect the channel walls or grating. A temporary channel crossing should be formed by raising the ground level locally, to 3 - 6mm above top of edge rail, either side of a channel for a distance of 750 to 1000mm, to form ramps. Note that the channel load class should be adequate to carry the site traffic.

7.0 Block Pavements
The channel must be supported laterally. Blocks laid directly against a channel must be laid as a soldier course and restrained from movement by bedding securely on the concrete haunch e.g. by using a polymer modified mortar for bed and perpendicular joints (e.g. RONAFIX mortar mix C or similar). Blocks or slabs bedded on sand remote from the channel should be set at a higher level to compensate for possible settlement of the paving in service.


8.0 Grate Locking System
Gratings should be securely fixed to the channel, where required, using an appropriate grate lock system (where available).

9.0 Channel Protection
Avoid contact between compaction equipment and top of ACO channel edge rail. The installer must ensure that the finished surface level lies above the top of the edge rail (by at least 3-6mm). Covering or protecting the grating, before concreting the haunch or laying blocks, removes the time and cost associated with cleaning the channel and grating of cement material and embedded stones. (Please note that ACO channels must be installed with the grating in place to prevent deformation of the channel).


10.0 Watertight Installation to BS EN 1433:2002
Where ACO channel joints/fittings and channel/pavement interfaces are to be sealed, an appropriate sealant should be used (e.g. Sikaflex 11FC or similar). Guidance on the necessary surface preparation and/or priming should be sought from the sealant manufacturer.

For Guidance a typical method of application follows:
- The end faces of the channels are to be sound and free from dust, oil, and grease, with any loose material or dirt removed, e.g. by mechanical wire brush. No water drops should be evident.
- Using a standard cartridge gun, apply the sealant evenly and with no flaws. The detail on the ends of a channel varies from one product to another:
- Products with a basically flat face - apply the sealant in a layer approximately 5mm thick to one face of the joint.
- Products with a sealing groove within the end face - apply the sealant in a bead of approximately 10mm diameter into the sealing groove.
- Products with a sealing groove following the inside shape of the channel - apply the sealant to the end face of the channel and to the sealant groove, such that when the joint is completed, the sealant will both cover the end face and fill the groove.
- The channel unit should be placed on the prepared concrete bedding and pressed against the previously placed channel unit. A sealed joint of approximately 1-2mm width should be formed between adjacent channel units.
- Excess sealant should be wiped from the inside face of the channel to leave a smooth finish.
- The sealant is to be left to cure for 24 hours, during which time the sealant should be kept as dry as possible.


Note: Galvanised steel and iron products have good corrosion resistance to concrete and mortar products but may experience corrosion if high chloride and/or sulphate content is present. Use only good quality concrete and consider using corrosion inhibitors where necessary. The use of protective coatings, such as paint, can minimise the risk of corrosion.

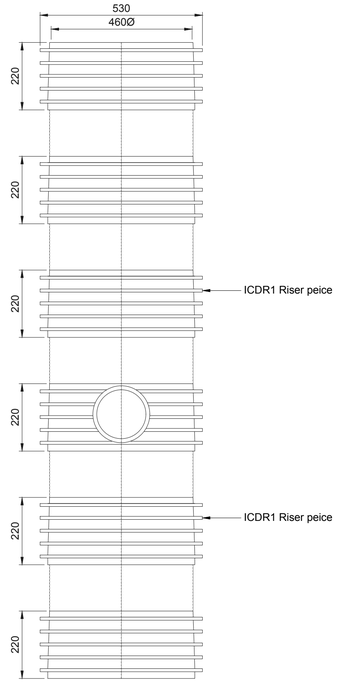


Basic Silt Trap - Exploded Elevation
(Scale 1:10)



Basic Silt Trap - Plan
(Scale 1:10)

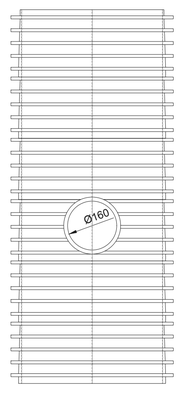

Basic Silt Trap - Elevation
(Scale 1:10)

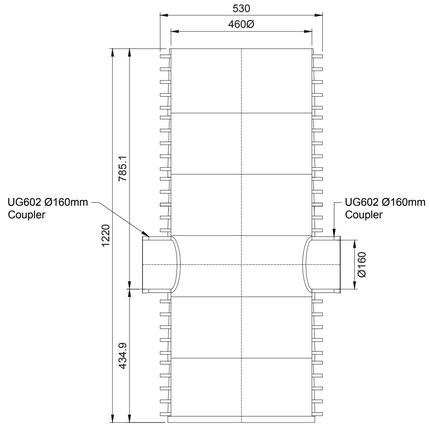

Basic Silt Trap - Section A-A
(Scale 1:10)

G30 Consulting Ltd

Copyright © 2016 G30 Consulting Ltd. All rights reserved.

Copying of these plans in full or in part is not permitted unless the written consent of G30 Consulting Ltd is obtained.

General Notes

1. Do not scale this drawing.
2. All dimensions are in millimeters unless stated otherwise.
3. This drawing is to be read in conjunction with all other relevant drawings & specifications.
4. All proprietary items to be installed in strict compliance with manufacturers instructions and recommendations.
5. No works shall commence on site until approval has been obtained from all relevant Agencies / Authorities.
6. All dimensions referred to in this drawing must be verified.

Revision	Description	Date
P1	First Issue	04.06.2018

PRELIMINARY

Unit 6, Neepsend Triangle Business Centre, 1 Burton Road, Sheffield, South Yorkshire, S3 8BW
W: www.g30consulting.com
E: enquiries@g30consulting.com
T: 0114 349 2720

Project
Proposed Residential Development, Banbury Close, Spalding, Lincolnshire

Title
Construction Details - Sheet 1

Drawn by	Checked by	Paper Size
CB	SG	A1

Drawing Number	Revision	Scale	Date
06-0083-005	P1	As Shown	04.06.2018