

Contractor to check all Dimensions on site prior to ordering materials / commencing work.Do Not Scale from this Drawing - If in doubt then please ask

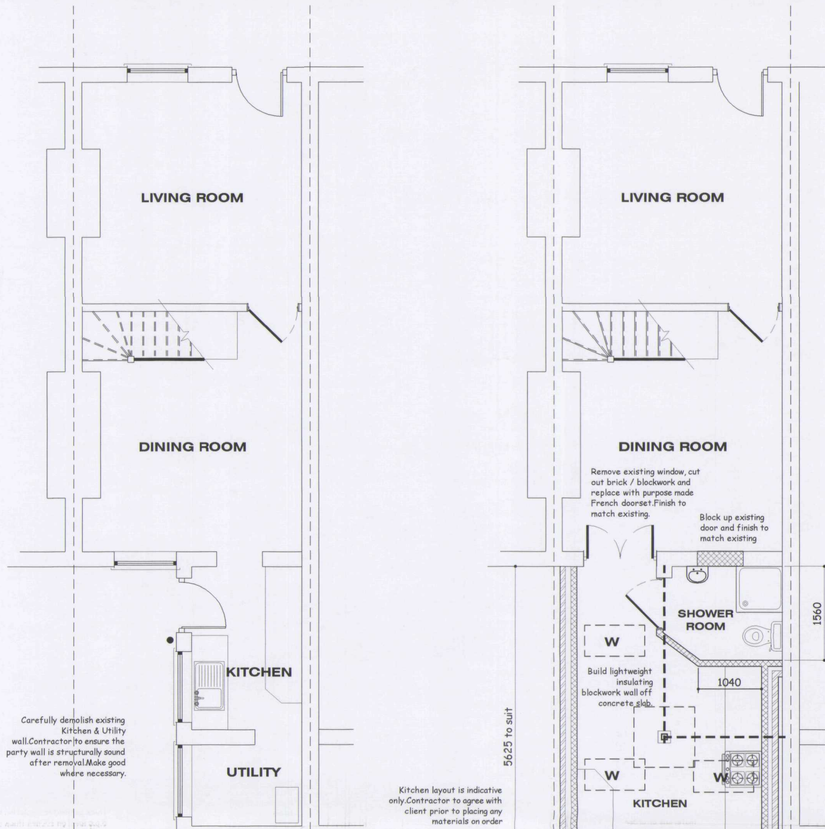


EXISTING GROUND FLOOR PLAN
Scale1:50

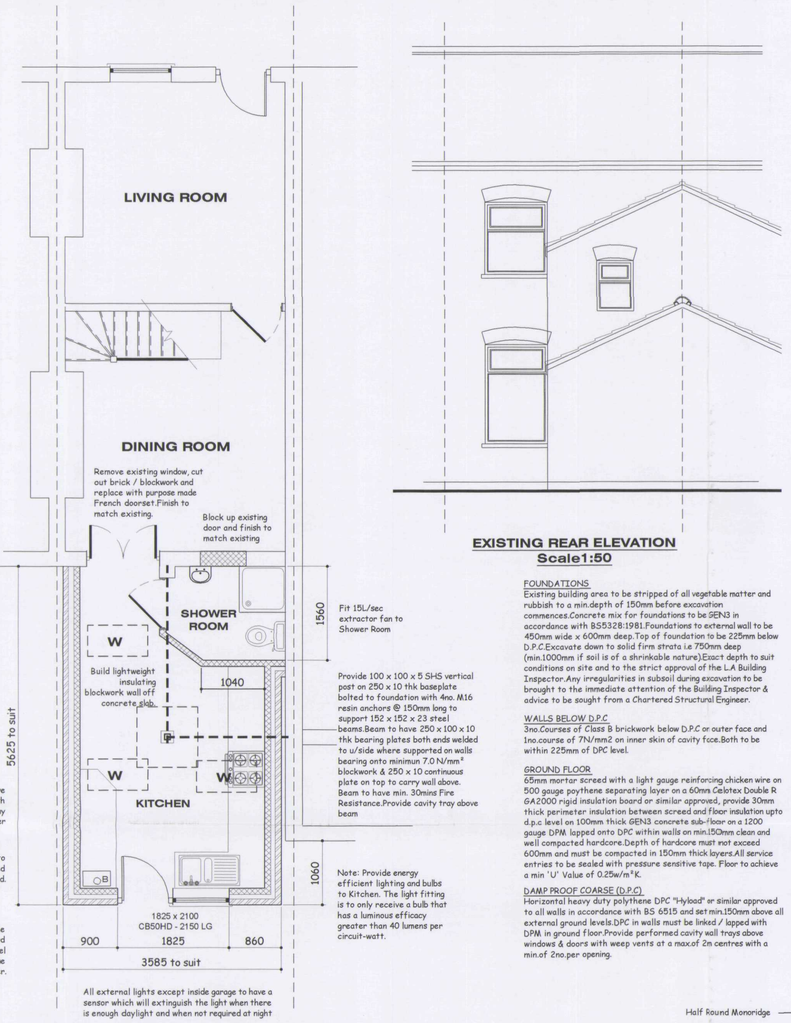


PROPOSED GROUND FLOOR PLAN
Scale1:50

PLEASE NOTE:
Due to areas of the structure being covered, unexposed or otherwise inaccessible the notes / specifications of existing materials are subject to confirmation of site when it is feasible to expose the relevant areas of construction.

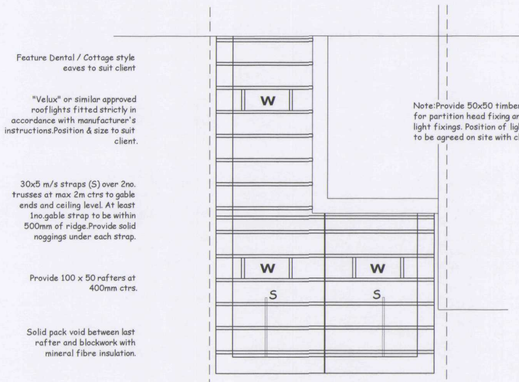

PROPOSED JOIST PLAN
Scale 1:50

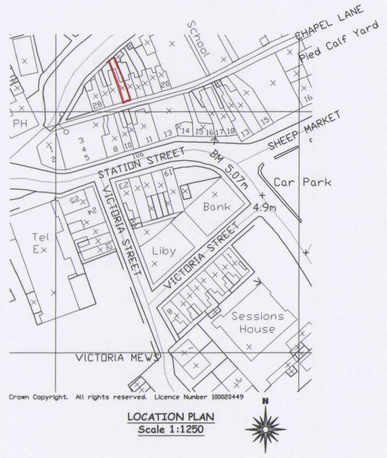

LOCATION PLAN
Scale 1:1250


EXISTING REAR ELEVATION
Scale1:50

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min.depth of 150mm before excavation commences.Concrete mix for foundations to be 9EN3 in accordance with BS5328:1981.Foundations to external wall to be 450mm wide x 600mm deep.Top of foundation to be 225mm below D.P.C.Excavate down to solid firm strata i.e 750mm deep (min.1000mm if soil is of a shrinkable nature).Exact depth to suit conditions on site and to the strict approval of the L.A Building Inspector.Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer.

WALLS BELOW D.P.C
3no.Courses of Class B brickwork below D.P.C on outer face and 1no.course of 7N/mm2 on inner skin of cavity face.Both to be within 225mm of DPC level.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge polythene separating layer on a 60mm Celotex Double R GA2000 rigid insulation board or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation upto d.p.c level on 100mm thick GEN3 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min.150mm clean and well compacted hardcore.Depth of hardcore must not exceed 600mm and must be compacted in 150mm thick layers.All service entries to be sealed with pressure sensitive tape. Floor to achieve a min 'U' Value of 0.25w/m²K.

DAMP PROOF COARSE (D.P.C)
Horizontal heavy duty polythene DPC "Hylead" or similar approved to all walls in accordance with BS 6515 and set min.150mm above all external ground levels.DPC in walls must be linked / lapped with DPM in ground floor.Provide performed cavity wall trays above windows & doors with weep vents at a max.of 2m centres with a min.of 2no.per opening.

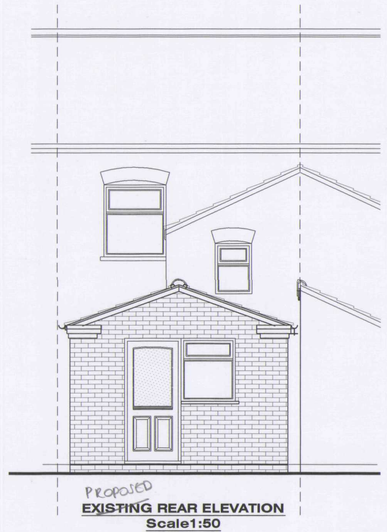


EXISTING REAR ELEVATION
Scale1:50

EXTERNAL WALLS
All external walls to be 265mm overall thickness comprising of:
-100mm Brickwork to match existing
-65mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses.Insulation batts should be kept clean and free from mortar droppings, all joints should be closely butted. Any cutting and fitting should be neatly done and not distort the layers of glass wool which comprise the material. All DPC's should be installed to ensure that penetrating water is directed only to the outer leaf.
-100mm Thermalite Shield insulating blockwork.
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min 'U' value of 0.35w/m²K.

CAVITIES
Close all cavity walls at jambs with Thermabate or similar approved Insulated cavity closers fitted strictly in accordance with manufacturers instructions. Roof insulation to be continuous with wall cavity insulation.Install Insulated Cavity Closers by Thermabate or equal approved, 25mm thick x 65mm wide (to equal cavity width) at jambs and cills of all openings in masonry cavity walls. Secure with the proprietary clips provided at maximum 500mm centres. Ensure that closers fit tightly to each other and to the lintel. The closer at the jamb must completely lap the closer at the cill.

MORTAR
All mortar to be 6:1:1 sand/cement/lime or equally approved and to be a consistent colour throughout duration of contract.Finish mortar joints as agreed with Client on site.

WALL TIES
Stainless steel cavity wall ties to BS1243:1978.To be built into cavity wall as works proceeds and spaced at 900mm centres horizontally,450mm centres vertically and 300mm staggered around all openings.Ensure wall ties are level or at least sloping to the outside leaf.Bed ties a minimum of 50mm into each leaf and ensure wall ties are completely free from mortar droppings.

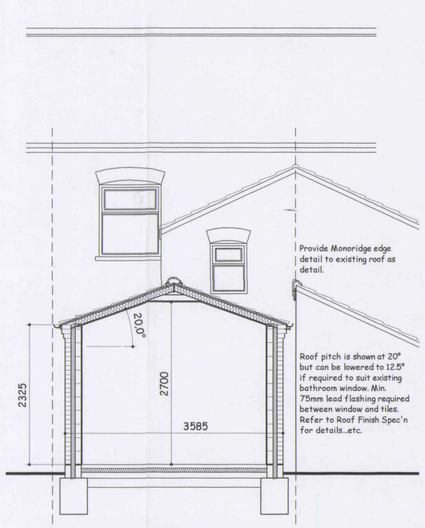

PROPOSED SECTION
Scale1:50

RAINWATER DRAINAGE
White uPVC guttering and downpipes to clients approval.Falls for guttering to be 1:600 and brackets fixed at max. 2m ctrs.Downpipes to be connected into underground drains via reducing adapter.Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surronds laid to 1:100 falls to new soakaway.Soakaway specification detailed elsewhere.

NOGGINGS
Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings.Position of light fittings to be advised by client on site.

INTERNAL JOINERY SKIRTING & ARCHITRAVES
All internal finished timber to be free from all defects and to clients approval prior to ordering any materials.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E Regulations and Engineer to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

HEATING SYSTEM
Provided from existing but all radiators are to be fitted with thermostatic radiator valves. All space heating pipework located outside the building fabric insulation layers to be wrapped with insulation material having a thermal conductivity at 40°C not exceeding 0.035 W/m°K and a thickness equal to the outside diameter of pipe upto max. of 40mm.It should be noted that central heating and hot water pipework in unheated areas may need increased insulation thicknesses for the purpose of protection against frost, refer to BRE Report No. 262 2002 Edition.

LINTELS
All lintels to cavity wall to be factory insulated Birtley Supergalv range unless noted otherwise or equalled approved.All lintels must have a min.150mm endbearing and installed in accordance with manufacturer's instructions.Do not allow masonry to overhang lintel by more than 25mm. Note: lintels are not to have a continuous baseplate.

WINDOWS & DOORS
All windows to be White uPVC to clients requirements based on styles shown on elevations.Fit with 4000mm² trickle ventilators to Kitchen, Utility,Bathroom & En-Suite windows and 8000mm² elsewhere all in accordance with manufacturer's recommendations.Patio doors to be fitted with 10000mm² ventilators.Opening vents to give 1/20 th of floor area rapid ventilation to all rooms.All glazing within 800mm of floor level and within 300mm of a door to a height of 1500mm of ground level to have toughened glass in accordance with Section N of the Building Regulations and BS6206 class B.All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a soft Low 'E' coating on glass inner pane to achieve a min 'U' value of 2.0 w/m²K.Note all windows to have a perimeter weatherseal both internally and externally and to be fully draught sealed.Provide frosted glass to all Bathroom, W.C's and En-suite windows.Ensure windows & doors are fitted within masonry reveal to overlap cavity closer by min.10mm to avoid cold bridging.

TIMBER WALLPLATES
All timber wallplates supporting roof trusses to be 100mm x 50mm bedded on top of wall.Timber to be SC3 grade and use a min. length of 3m and half-lap plates at joints and corners..Provide anchor straps as described in notes elsewhere.

LATERAL RESTRAINT STRAPS
Tie roof structure to blockwork wall with 30X5 galvanised mild steel straps at max 1.8m ctrs where rafters and ceiling joists run parallel to blockwork walls.Also fit at max 1.8m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap.

CEILINGS
All ceilings to be 15mm plasterboard to BS1230.
Ceilings to be have Coving and an Artex finish to clients requirements.Plasterboard sheets to be fixed with joints staggered and must be layed perpendicular to all joist runs.Fix boards at a min.150mm centres.

SMOKE ALARMS
To be self contained,interconnected and wired to a separately fused circuit with a battery back up.Smoke alarms to be fitted to u/side of plasterboard ceiling to the ground floor max 7m from the kitchen / lounge and to be max. 3m from any bedroom door. All alarms to be strictly in accordance with BS 5446 and to be wired that when one alarm is triggered all alarms are activated.

WASTE SIZES FOR NEW PLUMBING
All new plumbing to have the following waste sizes:
W.C=100mm ø Multikwik or similar approved
W.H.B=32mm ø uPVC with 75mm Deep sealed trap
SINK=40mm ø uPVC with 75mm Deep sealed trap
SHOWER=40mm ø uPVC with 75mm Deep sealed trap
Provide access points to all changes in direction.Provide anti-siphon traps where pipe runs exceed 3m and W.H.B pipe run exceeds 1.8m.

ROOF VENTILATION
Install Tyvek® or similar approved Breathable Membrane in accordance with manufacturers instructions which are briefly described below & BBA certificate 99/3635 (fourth issue) breather membranes in non-ventilated pitched roofs of any plan, any shape or any size under all types of roof coverings including tight jointed and fully interlocking tiles and synthetic slates. Installing Tyvek® underlay in accordance with the above certificate will enable a roof to meet all the requirements of the Building Regulations.
Installation Guidelines
Tyvek® SUPRO should be installed with min. 150mm overlaps as a standard bituminous felt underlay and secured with stainless steel staples or large headed galvanised clout nails.
Eaves:
There is no need to provide any vents into the loft at eaves, because a Tyvek® non-ventilated roof system does not rely upon air movement beneath the membrane to avoid damage by condensation.To avoid water ponding behind the fascia of closed eaves and to prevent prolonged exposure of the membrane to ultra-violet radiation, use a Tyvek® Eaves Carrier. Stop the membrane short of the fascia and lap it onto the Eaves Carrier.Pack closed eaves with fibrous insulation to reduce thermal bridging.
Verge detail:
Lap the Tyvek® underlay 50mm onto the gable or flying rafter.
Ridge/ hip detail:
Extend the Tyvek® underlay 150mm from each slope and overlap it at the ridge/ hip line. There is no need to provide vents at the ridge.
Valley detail:
Extend the Tyvek® underlay from each slope by 150mm beyond the valley centre line and seal the lap using Tyvek® Butyl Tape to form a watertight seal.
Abutments:
Turn up the Tyvek® underlay beneath flashings not less than 50mm.
Penetrations:
Seal around all penetrations using Tyvek® Butyl Tape.

ROOF FINISH
Redland Regent Concrete Interlocking tile which will allow a min. pitch of 12.5° with 100mm headlap & max. gauge below 17.5° of 318mm and 343mm over 17.5° with min. gauge of 293mm fixed in accordance with manufacturers instructions and in accordance with BS 5534:Parts 1 and 2.Set out to give true lines and regular appearance, fitting neatly at all edges, junctions and features.Fix roof covering to make the building sound and weathertight at the earliest opportunity.Repair any defects as quickly as practicable to minimise damage and nuisance & keep gutters and pipes free of debris and clean out at completion.Provide 50x25 preservative treated timber battens.Tiling battens should be not less than 1.2m long and continuous over at least 3 trusses.They should be fixed to every rafter member which they cross, or on which they are joined, with nails in accordance with BS5534: Part 1. The ends of the battens should be sawn square and butt jointed centrally on a rafter member so that adequate bearing and nailing can be provided for each end of each batten.Butt joints in battens should be arranged so that not more than one batten in four is joined on any one rafter.Generally all tiles at perimeter of roof to be clipped and nailed. Use Code 4 Lead flashing to any abutments with min.75mm upstand.

ROOF INSULATION
Roof to achieve a 'U' value of 0.16w/m²K by using 2no.layers of 75mm Celotex tuff-R GA3000Z rigid insulation board fixed between rafters on timber noggings fixed securely to sides of each rafter with 12.7mm Duplex plasterboard.Celotex boarding & noggings to be fixed, cut and installed strictly in accordance with manufacturer's instructions and the brief description with Building Control Specification.

CELOTEX INSTALLATION GUIDELINES: UNVENTILATED

Install the breather membrane over rafters by either fixing battens to the side of the rafters and allowing the membrane to sag between the rafters or by fixing counter battens over the membrane leaving the entire rafter depth to be filled with insulation. All in accordance with the membrane manufacturer's recommendations.

Measure the space to be filled between the inside face of the rafters prior to cutting board.

Cut tuff-R at a slight angle, making the board width slightly oversize on one surface, to achieve a 'friction fit'.

Push the boards into the void between the rafters until tight up to the underside of the stop batten or nails, ensuring that lateral joints are closely butted.

Push boards into the void between the rafters until tight up to the battens or breather membrane, ensuring that lateral joints are closely butted. Secure the second layer of Celotex tuff-R GA3000Z to the underside of the rafters with broad headed clout nails. Joints between boards must be tightly butted.


The length of fasteners required to secure the plasterboard lining should be considered.

It is good building practice to vapour seal all insulation board joints. This may be achieved by the use of a self-adhesive aluminium foil tape.

Clearly mark rafter-lines on the board face, using a spirit-based felt-tip marker.

Nail or screw plaster board or other lining through the insulation to the rafter.


Alternatively, secure the boards in place using softwood battens and fix the plasterboard direct to the batten. This also provides a void for lighting cables /conduit.

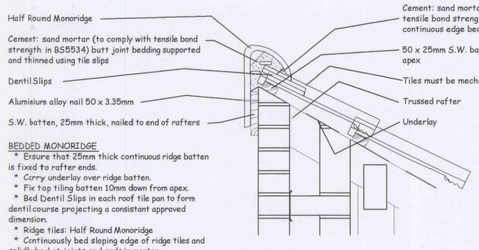


BEDDED MONORIDGE
* Ensure that 25mm thick continuous ridge batten is fixed to rafter ends.
* Carry underlay over ridge batten.
* Fix top tiling batten 10mm down from apex.
* Bed Dentil Slips in each roof tile pan to form dentil course projecting a consistant approved dimension.
* Ridge tiles: Half Round Monoridge
* Continuously bed sloping edge of ridge tiles and solidly bed at joints and ends in mortar.

TYPICAL MONORIDGE ROOF DETAIL
Not to Scale

Note: The detail shown is a typical constructional method to provide the roof space with 5000mm² at the top edge.This detail should be adapted to suit specific site conditions and always to the satisfaction of the Building Inspector.

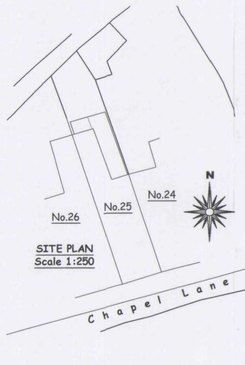


SITE PLAN
Scale 1:250

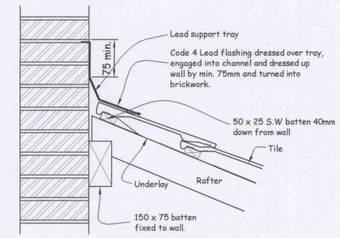

TYPICAL ROOF TOP ABUTMENT DETAIL
Not to Scale

Note: The detail shown is a typical constructional method to provide the roof space with 5000mm² at the top edge.This detail should be adapted to suit specific site conditions and always to the satisfaction of the Building Inspector.

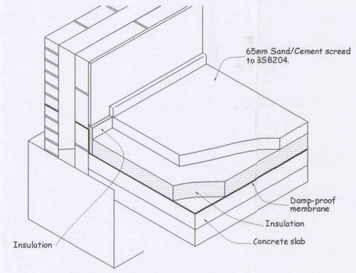

NOTE: Damp-proof membrane can also be positioned below the concrete slab.

TYPICAL ISOMETRIC SLAB DETAIL
Not to Scale

GENERAL CONDITIONS
Contractors are resonsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment.If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are all subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose.All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.

DETERMINED PLAN

SMDC
Planning & Development
2 0 AUG 2004
Ref:

Client :
Mr & Mrs J Hinchcliffe
25 Chapel Lane
Spalding
PE11 1BP

Site :
Proposed Rear Extension to form Kitchen & Shower Room.

remway design Ltd
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Date : aug04 | Scale : 1:50 / 1:100

Drawing No:
rem 937 - 01