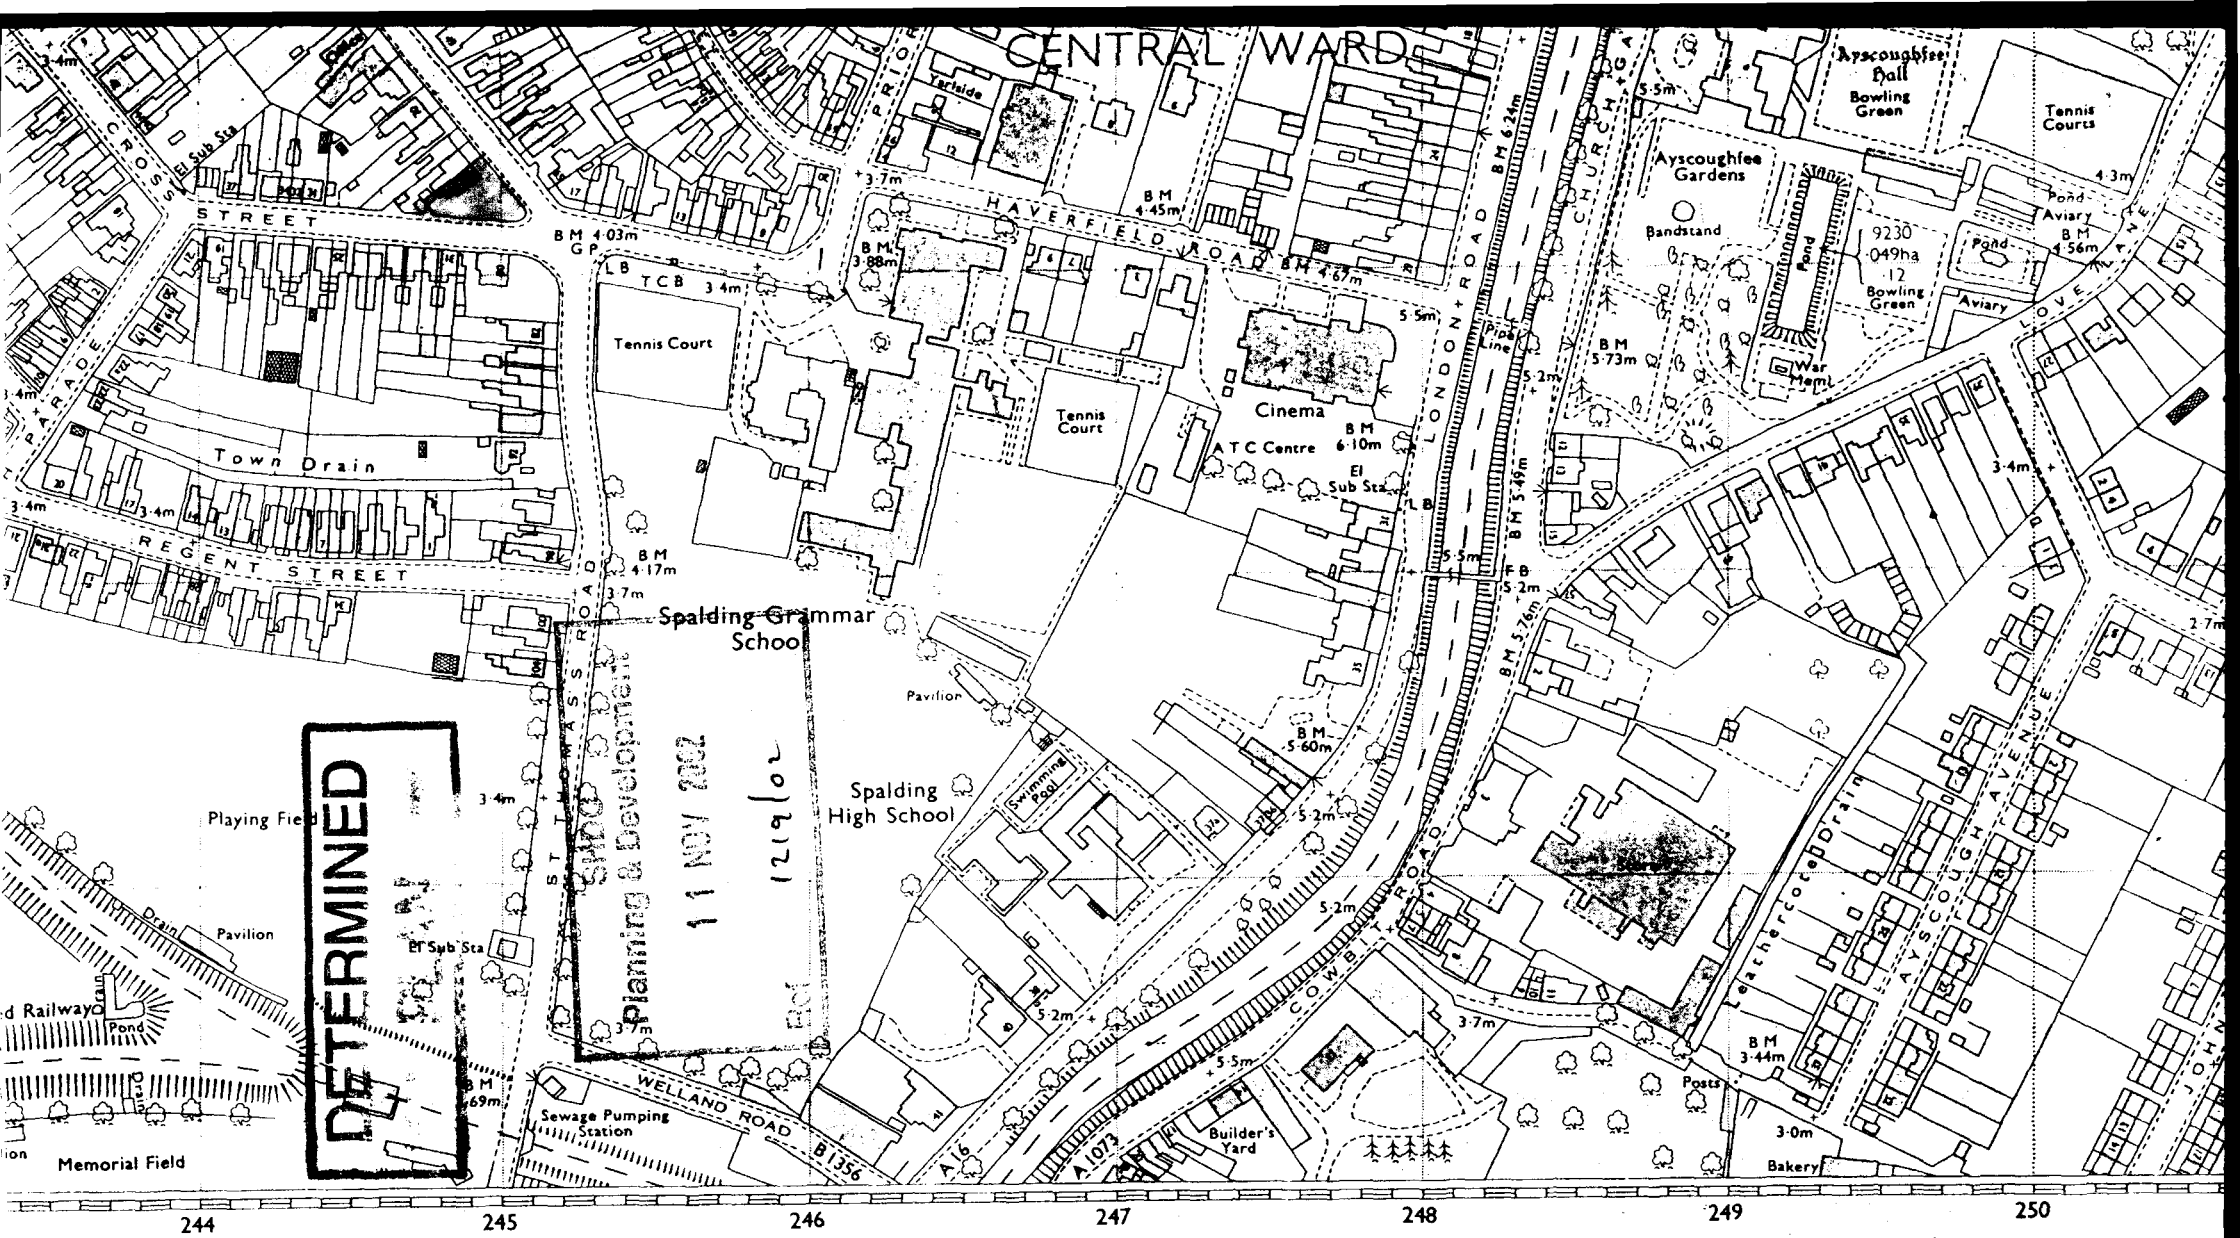


UTH WARD

HOLLAND WITH BOSTON CO CONST

TF2421-2521

CONVERSION SCALES

HECTARES-ACRES

Hectares 0 1 2 3 4 5 6

Acres 0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16

METRES-FEET

Metres 30 20 10 0 20 40 60 80 100 120 140 160 180 200 220 240 260 280 300 320 340 360 380 400 420 440 460 480 500 520 540 560 580

Feet 100 50 0 100 200 300 400 500 600 700 800 900 1000 1100 1200 1300 1400 1500 1600 1700 1800 1900

1 metre = 3·2808 feet

1 foot = 0

ABBREVIATIONS

B H ..... Beer House


L B Sta ..... Lifeboat Station

P T P. ..... Police Telephone Pillar


SYMBOLS




n east

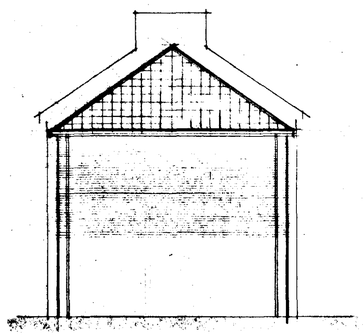

s east

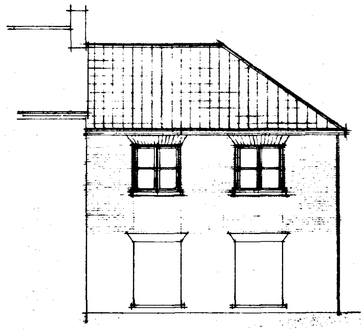

s west

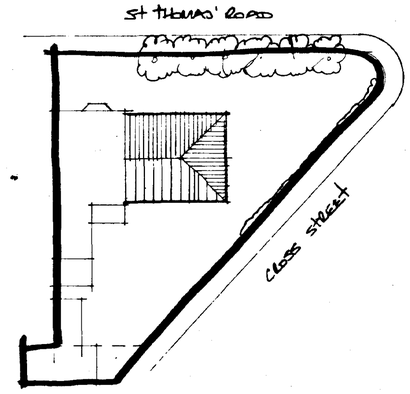

block plan

FLOOR CONSTRUCTION

First
18mm Wbyroc floor panels
220 x 50mm SC3 grade tanalised timber joists, unless specified otherwise on joist plan, at 400mm cts with min. 1 row herringbone strutting midspan
12.7mm plasterboard, fixed in accord with manufacturers instructions, with all necessary noggins etc. and finished with either artex or skim in accord. with clients instructions.

Note : All floor joists are to be supported in joist hangers secured to external cavity walls. Joists are NOT to be built into external walls.

WALL CONSTRUCTION

Above Ground
To be 275mm o/a constructed as follows :-

100mm facing brick (to be FL quality below dpc level)
75 mineral wall insulation i.e. Dritherm (k = 0.036)
100mm loadbearing insulation blocks i.e. Tarmac Toplite standard, k = 0.15

All to be tied together using stainless steel wall ties positioned at distance not exceeding 900mm horizontally, 450mm vertically and staggered. To be at every block course vertically at all returns and reveals.

External finish to be 12mm render with gypsum plaster skim finish to give a 'U' value of 0.303W/mK

Stud Partitions
to be constructed as follows :-

75 x 50mm head and sole plate
75 x 50mm studs at 400mm cts with min. 2 rows
75 x 50mm noggins equally spaced
75mm glassfibre insulation within framework
face both sides with 12.7mm plasterboard, tape joint and skim finish

stud partitions to be constructed off doubled up floor joists (bolted together at 1.0m cts) at first floor level when running parallel to joists, and off 75 x 50mm sole plate, with solid blocking between joists, when running perpendicular to joists.

DPC in Walls
An insulating vertical cavity closer and dpc, i.e. Thermabate, is to be provided to all cavity closures.

LINTELS

Lintels to be Catnic, or similar and equivalent, to have a min. 150mm end bearing and be installed in strict accordance with manufacturers instructions with a dpc cavity tray over where applicable.

Lintels to be protected with min. 15mm gypsum plaster skim finish to give a min. half hour fire protection.

VENTILATION

All habitable rooms are to have windows containing opening vents, the combined total of which is equal to not less than 1/20th of the floor area of the room.

WINDOWS & DOORS

Windows and doors to be purpose made UPVC, or similar and approved, double glazed using glass having a soft low E coating with an emissivity value of 0.05 with 12mm air gap to sealed units and weather stripped.
'U' value of double glazing to be 2.0W/m²K
Double glazing manufacturers certificate to be provided to prove compliance of the glazing to that specified.

Windows to habitable rooms are to incorporate a controllable trickle vent of 8000mm².

Windows to first floor habitable rooms are to contain openings that have min. dimensions of 450mm and a min. area of 0.33m², and have a cill level no more than 1100mm above finished floor level. *Key operated locking devices are not permitted to first floor windows.*

Glazing to windows less than 800mm and doors (include sidelights to doors) less than 1500mm above floor level is to be laminated or toughened glass in accord with BS6206 : 1981.

WINDOW/DOOR & LINTEL SCHEDULE

Location	window/door ref. Width	x	height	lintel ref. &	length
1	1030	x	1650	CG70/100	1350
2	1030	x	1650	"	1350
3	1500	x	1650	"	1800
4	1500	x	1650	"	1800

HOT WATER/CENTRAL HEATING SYSTEM

Thermostatic radiator valves are to be installed with a room thermostat provided to switch off the boiler when there is no demand for heating or hot water.

All pipes not contributing to useful heat requirements are to be insulated using an insulation material with a thermal conductivity not exceeding 0.45W/mk and a thickness equal to the external diameter of the pipe up to a max. of 40mm.

ROOF CONSTRUCTION

Tiles
The roof is to be covered with interlocking concrete roof tiles fixed in strict accordance with manufacturers instructions.

Battens
Approved quality tanalised s/w battens, 38 x 25mm, are to be laid at a gauge suitable for the tiles and fixed with 90 x 3.35mm wire nails. Battens should be at least 1.2m in length and should be of sufficient length to be supported at each end and intermediately by at least three rafters, trusses or walls. Butt joints over intermediate supports should be staggered and the ends must be sawn.

Underlay
Approved reinforced roofing felt, type 1F to BS 747, is to be laid over the rafters lapped 150mm at the joins and secured with clout nails. The underlay should extend over the fascia board and into the eaves gutter. In order to prevent water traps behind the fascia it is recommended that a strip of 6mm marine plywood is provided to support the underlay. The ply is to be laid over the rafters and under the roofing felt positioned as close as possible to the last tiling batten and secured to the fascia.

Eaves
Eaves are to be formed with standard size tiles and purpose made eave fillers must be nailed to the fascia board. Eave tiles must be laid at the same pitch as the main body of tiling and should overhang the fascia by an amount sufficient to ensure that the water discharges into the centre of the gutter.

Verges
Verges are to be formed with 150mm wide asbestos cement strip onto which is bedded the tiles which form the verge projecting approx. 50mm over bargeboards or gable brickwork.

Ridge
The ridge is to be covered with segmental ridge tiles of the same colour as the main body of tiling, unless specified otherwise, and secured using a proprietary ventilated dry ridge system having ventilation equivalent to a continuous 6mm gap.

Hips
Hips should be covered with Marley segmental ridge tiles of similar colour and texture to that of the main roof tiles. The tiling should be cut closely to the rake of the hip and the ridge tiles bedded, with solid bedding at butt joints, onto the adjacent roof tile.

A galv. hip iron, 6mm thick, should be fixed at the base of the hip tree with 2No 2.65mm diam. screws.

The first hip tile should be shaped at the foot to the line of tiling at the eaves and the fair end filled with mortar inset with pieces of tile and neatly pointed.

The junction of the hip and ridge should be mitred using a standard three way mitre and solid bedding.

Abutments
The tiling is/to be cut closely at abutments and weathered by Code 4 lead flashing dressed down over the tiles and up the abutment a min. 150mm.

Mortar
All bedding mortar is to consist of 3 parts sharp sand to 1 part Portland cement and should be struck off to give a smooth face and pointed in one operation.

Trusses
Gangnail trusses, extg re-used, at 600mm centres to be designed, fixed and braced in accordance with BS5268 : pt3 : 1985 and secured to wall plate with proprietary stainless steel clips.

Manufacturers details and calculations in respect of prefabricated trusses, include compound roof trusses, are to be submitted to the Local Authority Building Control Dept. for approval at least 28 days prior to fixing on site.

Truss positions and bracing shown is indicative only and is to be confirmed/superseded by truss manufacturer.

Insulation
To be Rockwool Rollbatts (k = 0.037 W/mK), 150mm thick between joists with a further layer of 150mm laid at right angles over the top.

Ceilings
15mm foil backed plasterboard, fixed in accordance with manuf. instructions with all necessary noggins etc., and finish with artex/skim finish in accord with clients instructions.

Ventilation
Provide over fascia ventilation (equal to a 10mm continuous gap) to provide cross ventilation to the roof space.

Rainwater Goods
Supply and fix 115mm PVC gutters to fascia with all necessary brackets, stop ends, outlets etc.

Supply and fix 64mm PVC downpipes securely clipped to walls at 1800mm cts with all necessary offsets, swannecks, adaptors etc. and taken into existing 100mm diam. upturned bend at base.


STRAPPING

Where rafters, floor joist and ceiling ties run parallel to walls they are to be strapped at 1800mm cts. Straps to be fixed to a min. 3No. rafters etc., having nogged between beforehand, and hooked into the cavity a min. 150mm.
Similar straps to be used at 1800mm cts to hold down the wall plate.

Straps to be 30 x 6mm galv. m.s.

STRUCTURAL STEEL BEAMS

Structural steel beam to have min 100mm end bearing on 2 course Eng. brick padstone. Beam to be encased with 12.7mm plasterboard secured with 1.6mm wire binding at 100mm pitch and finish with 5mm gypsum plaster to give a min. ½ hour fire resistance

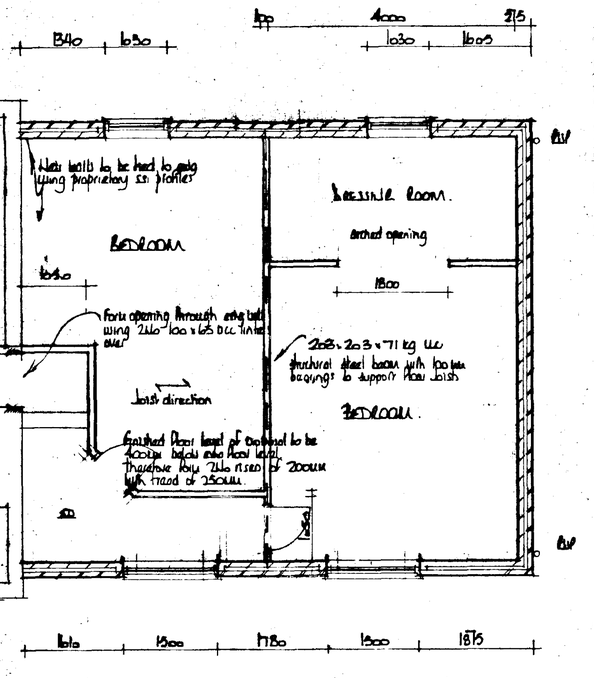

ground floor plan


SMOKE DETECTION


Self contained smoke alarms complying with BS5446 : Pt 1 : 1990 are to be installed where indicated SD on the drawing. An alarm must be positioned within 3.0m of bedroom doors.

The alarms are to be permanently wired to a seperately fused circuit at the distribution board operating at a low voltage via a mains transformer.

Where more than one smoke alarm is required the units are to be interconnected so that the detection of smoke by one unit operates the alarm signal in all units.

The wiring installation is to comply with the I.E.E. Regulations.

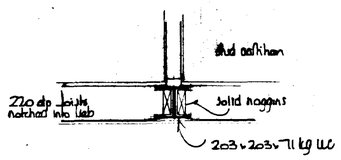

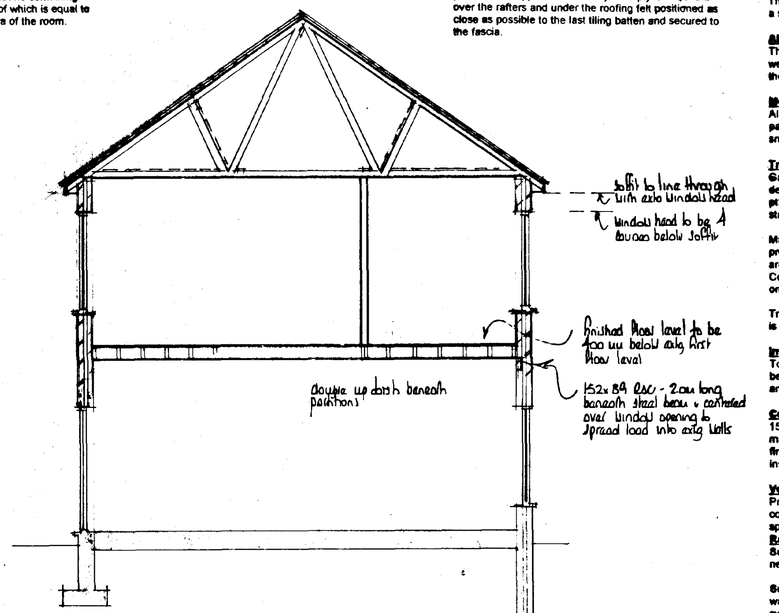

section

SHDC
Planning & Development
11 NOV 2002
1219/02

DETERMINED
PLAN

A		
	Date	Revisions

© copyright

East Midlands Design Associates
"Willow Lodge",
Horseshoe Road,
Spalding,
Lincs. PE11 3JA
Tel: Spalding (0775) 767988

Client
Mr. & Mrs B Bothwell

Job Title
First floor Bathroom over Extd Lounge Room at 78 St THOMAS' ROAD SPALDING.

Drawing Title
Plans. Section & Elevations

Scale 1:50. 1:100. 1:250

Date NOV 02 | Drawn by DA

Drg. No. | Rev