Dwelling
To be to drawing no. SD05-082/5

External Materials
Red facing bricks.
Grey concrete interlocking roof tiles.


Accesses
Provide single access to No. 92, as shown, minimum width to be 2.5m.
Provide joint access to proposed site and No. 90, as shown, minimum width to be 5.0m.
All accesses to be constructed to Lincolnshire County Council requirements.

Drives
Washed gravel on 150mm well-compacted hardcore with suitable edging kerbs.

Turning Area
To No 92 provide turning area, as shown, all to Lincolnshire County Council requirements.

Demolition
Existing single-storey elements of No. 90 and 92 to be demolished, as shown dotted, to make way for proposal.

Foul Drainage
Connect to foul sewer in Holbeach Road, all to Anglian Water requirements.

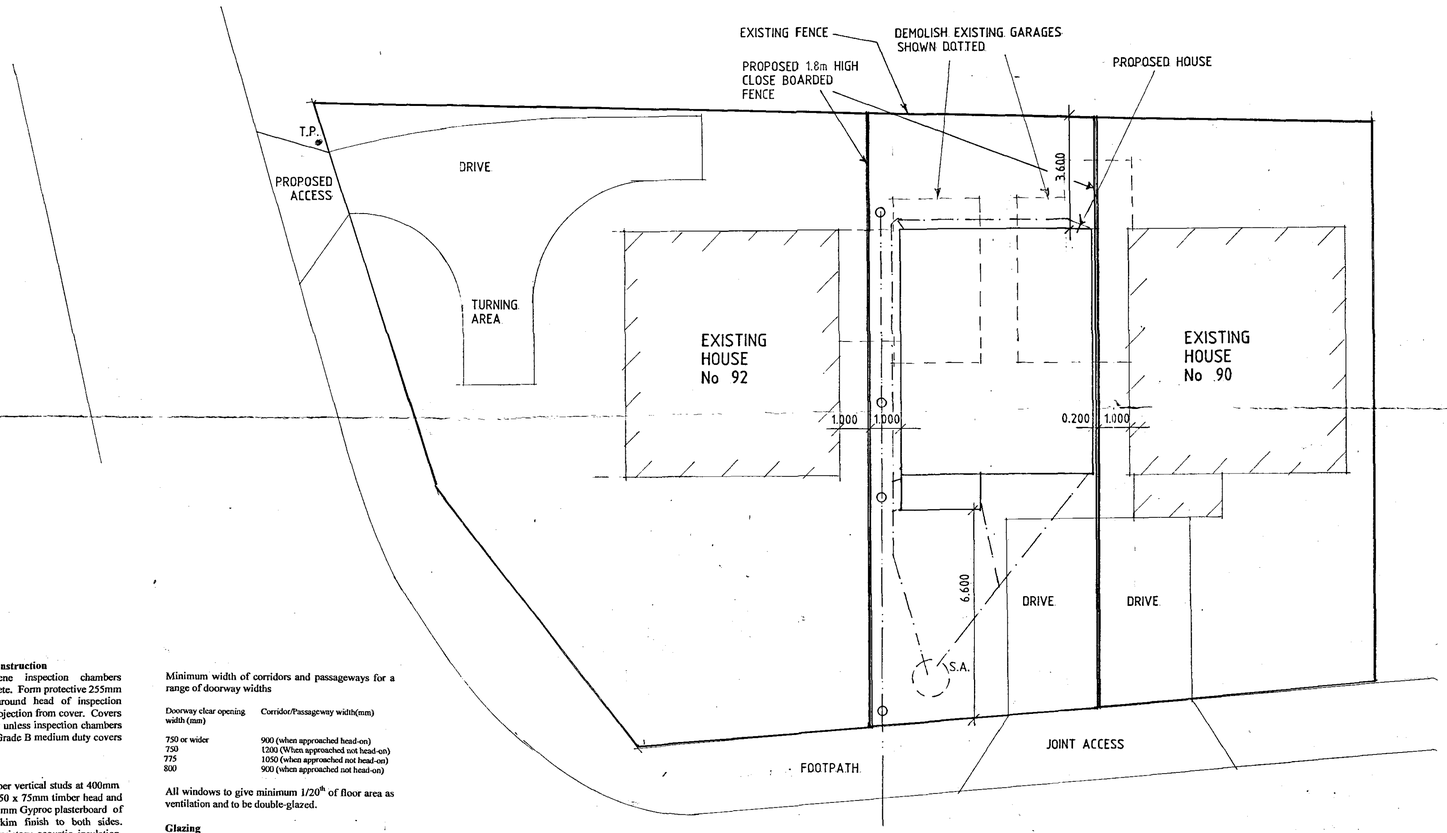

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH SD05-082/5

Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

First Floor Walling
Provide 50 x 75mm timber vertical studs at 400mm c/c to be constructed of 50 x 75mm timber head and sole plates. Provide 12.5mm Gyproc plasterboard of 10kg/m³ density and skim finish to both sides. Provide to airspace proprietary acoustic insulation. Timber stud partitions running parallel to joist direction to be built off 2 no. floor joists fixed together. Provide 1 no. joist either end of stud partition joist beam to fix flooring.

First Floor Construction
19mm flooring grade moisture resistant decking on timber joists as stated on plan. To external walls joists to be supported on joist hangers (not built into wall). Provide 30mm x 5mm mild steel restraint straps to joists running parallel with wall securely fixed to walls and to span minimum 3 no. joists at maximum 1200mm c/c. At strap positions provide pack and noggin to joists. Solid strutting to be installed mid-span where span of joists between 2.5m and 4.5m. For spans in excess of 4.5m position of struts at 1/3 rd span. Double up floor joists locally under bath feet and hot water cylinder where applicable. All doubled up joists to be bolted together at 600mm centres. Provide 75mm fibreglass insulation between floor joists.

Boiler
Provide balanced flue condensing type gas boiler of required rating in position indicated on drawing to be either a wall hung type or free standing on 125mm high concrete hearth above oversite. Boiler outlet to have protective guard cover and to be a minimum 300mm from any opening into the building which is wholly or partially above the terminal. Read in conjunction with Approved Document J1/2/3. At completion of works commissioning of heating system to be provided to the local authority Building Control by a competent Corgi registered person. Boiler to have a Sedbuk rating of 86%.

Minimum width of corridors and passageways for a range of doorway widths

Doorway clear opening width (mm)	Corridor/Passageway width(mm)
750 or wider	900 (when approached head-on)
750	1200 (When approached not head-on)
775	1050 (when approached not head-on)
800	900 (when approached not head-on)

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Commissioning of Heating and HWS Systems
A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

Internal Lighting
Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Fascia and Bargeboards
To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Header Tank Support
Water tank in roof space to be supported on bearers to spread the load to BS5268 Part 3 1985.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Ground Floor Construction
65mm sand/cement screed on 100mm Celotex insulation with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor.

Opening at eaves level to be LI/E lintels by I.G. or similar approved.

Foundations
As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

Oversailing Gabled and Corbelled Eaves
Provide the above to the design as shown on elevations plus any other details that are shown on the plans.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Valleys
Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Kitchen Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 60 lt/sec. Alternatively provide proprietary cooker hood capable of extracting 30 lt/sec.

Bathroom/En-suite Ventilation
Provide proprietary mechanical extract ventilation unit capable of extracting 15 lt/sec. System to offer intermittent operation.

Hot Water Storage
Provide system approved by BBA and installed by BBA approved installer. System to be vented and insulated in accordance with BS5615 1985. Provide thermostatic control.

Heating System
Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Insulated Pipes and Ducts
All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Provide a firm level approach to front entrance of minimum width 900mm. Gradient of approach to be no steeper than 1:20. At entrance to building threshold to be maximum 15mm high.

External access door that serves as access to ground floor WC to have a minimum clear opening width of 775mm.

Ensure minimum 900mm corridor width, access to ground floor WC with no obstructions (radiators, etc.) to corridor area adjacent doors

Sockets, light switches, TV points, doorbells to habitable rooms to be positioned between 450mm and 1200mm above floor level.

Provide area within main driveway of hard surfacing (block paving, tarmac or similar) of adequate size to enable wheelchair access from parked vehicle direct to main access of dwelling. Footpath minimum 900mm wide to be directly linked to hard surfacing driveway.

Habitable Room Trickle Ventilation
Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm²

Kitchen/Utility/Bathroom/WC Trickle Ventilation
Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Foul Water Drainage
Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes
Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Private Stairs
Stairwell formed by timber trimmers and load bearing walls (see plan). Provide timber balustrading to open side of stairs 900mm above pitch line and 1000mm high to stairwell opening to act as guarding and to be capable of resisting a horizontal force of 0.36 KN/m. Balustrading to be vertical type, not horizontal or ranch style. No parts of stairs to have any gaps greater than 99mm. Provide timber handrail to top of balustrading or independently 900mm above pitch line. Ensure minimum headroom above pitch line is 2000mm. Total rise: See plan. Maximum rise: 220mm. Minimum going: 220mm. Maximum pitch: 42°. Read in conjunction with Approved Document K.

Soldier Coursing
Provide soldier course brickwork to all areas where shown on elevations.

SHDC
Planning & Development
17 SEP 2007
Ref: 1252/07

C - ALTS - 13.9.07
B - IMF. ADDED - 13.6.07
A - ALTS - 16.5.07

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agents responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components, materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

DETERMINED PLAN

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED HOUSE BETWEEN 90 & 92 HOLBEACH ROAD, SPALDING FOR

MR. T.S. KHELA.

1:100	SD05-082/1
MARCH-06	B.GILHAM.

7 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702