
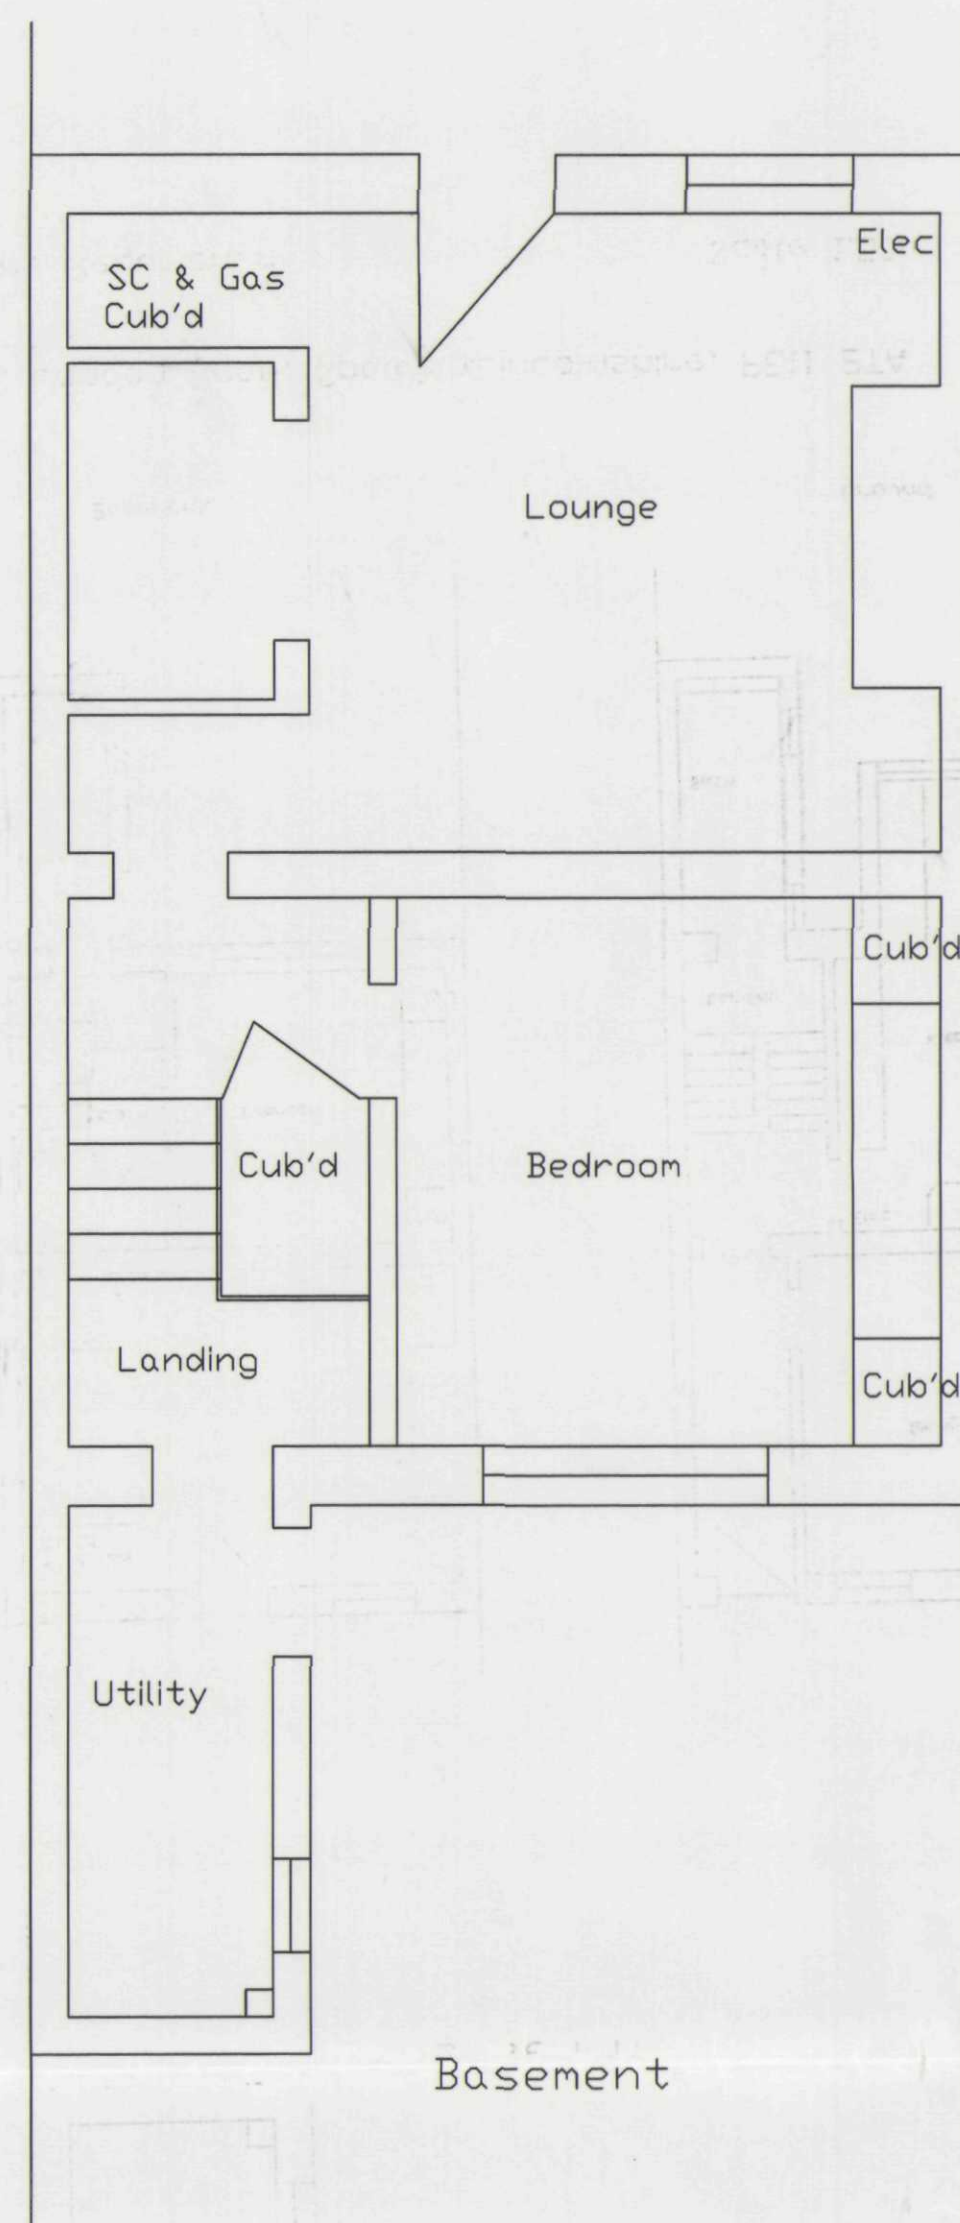
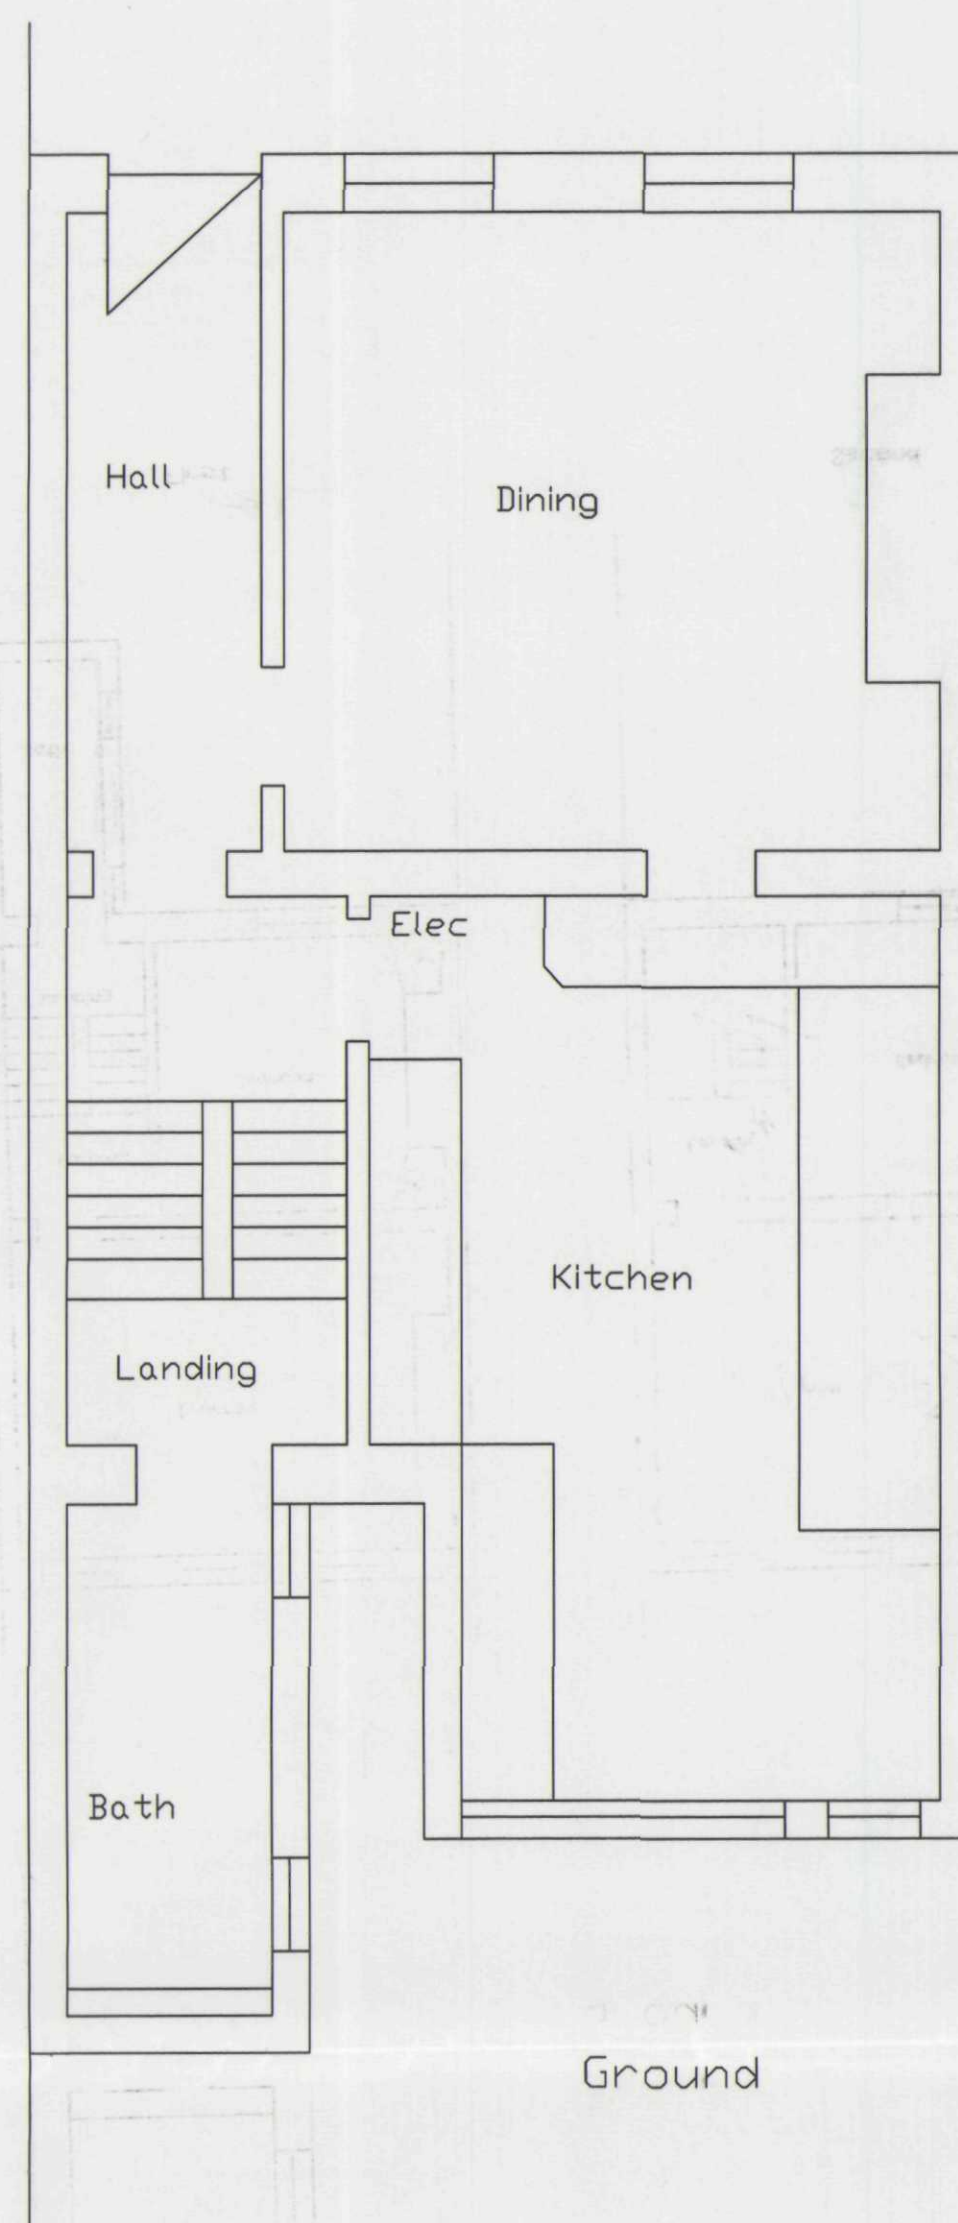
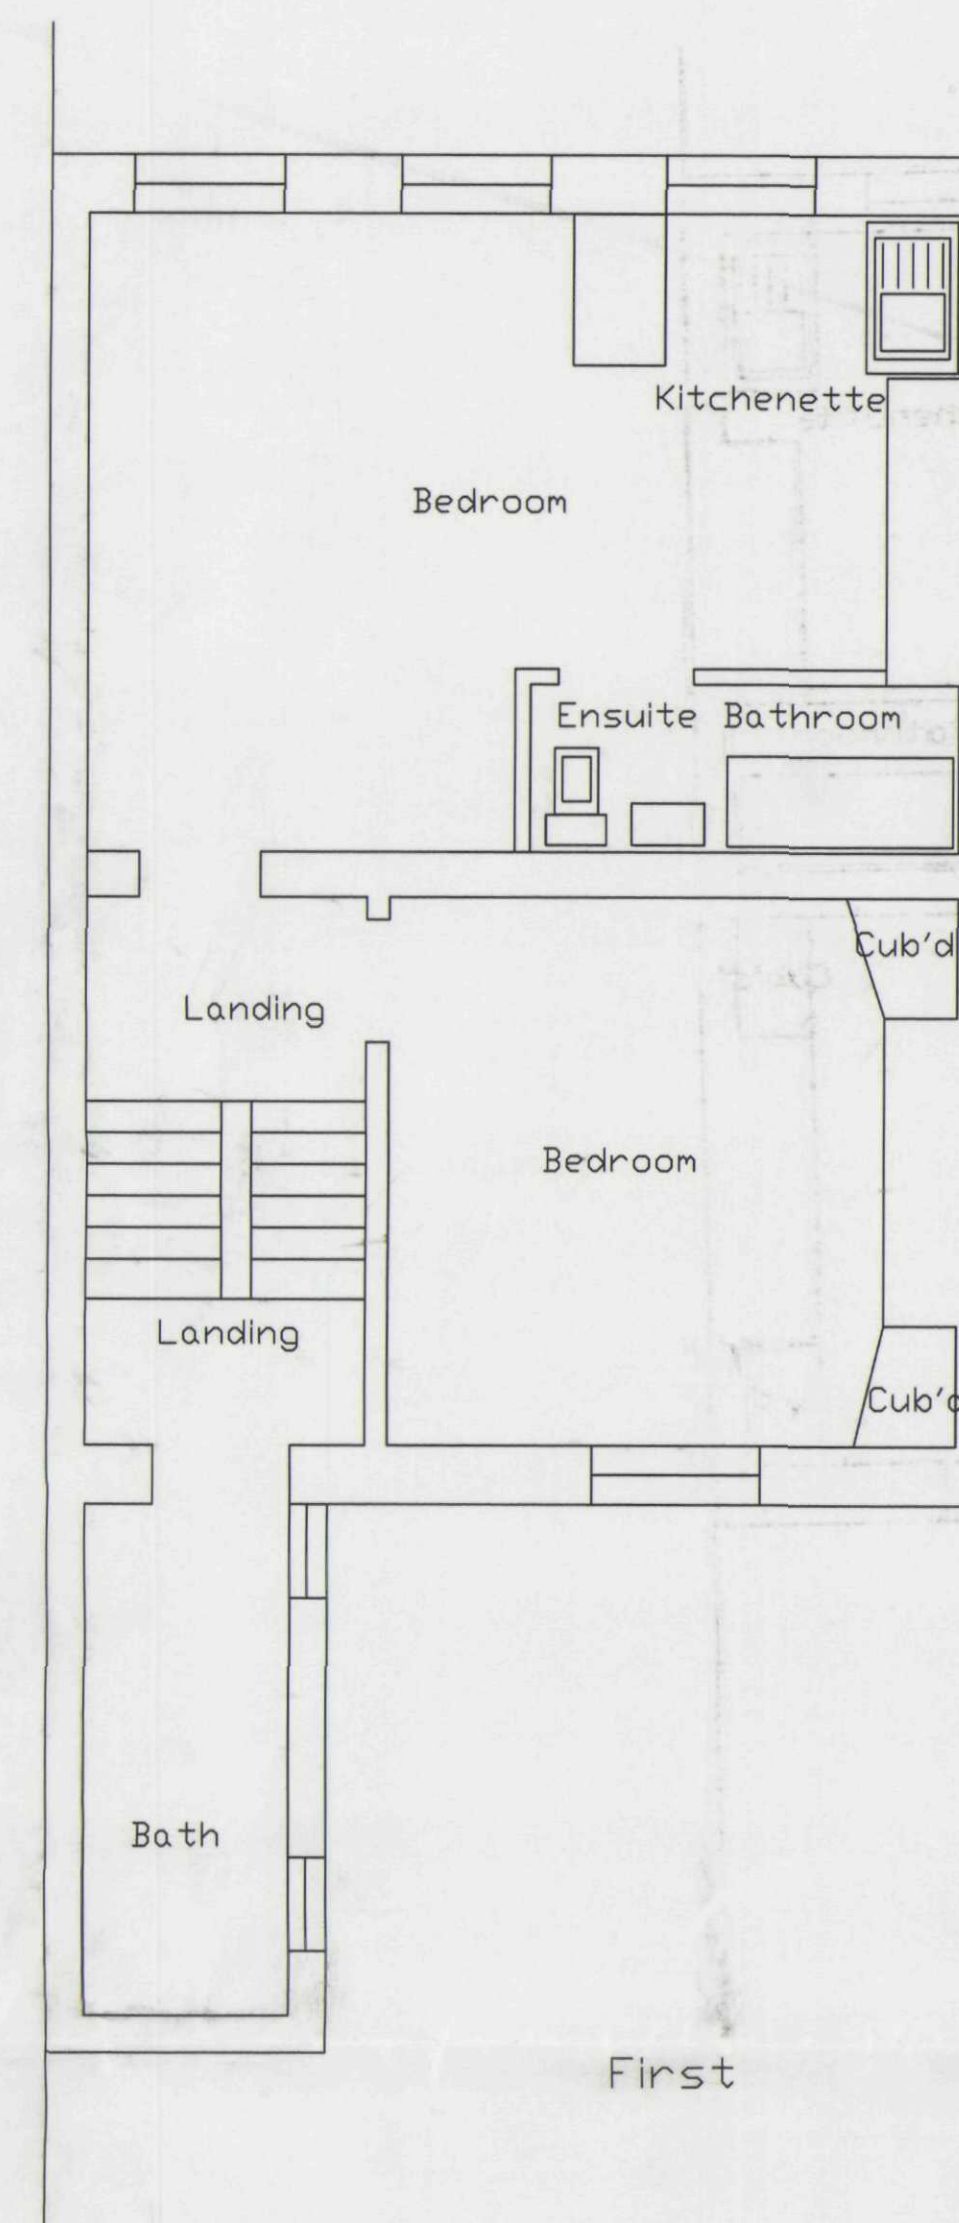
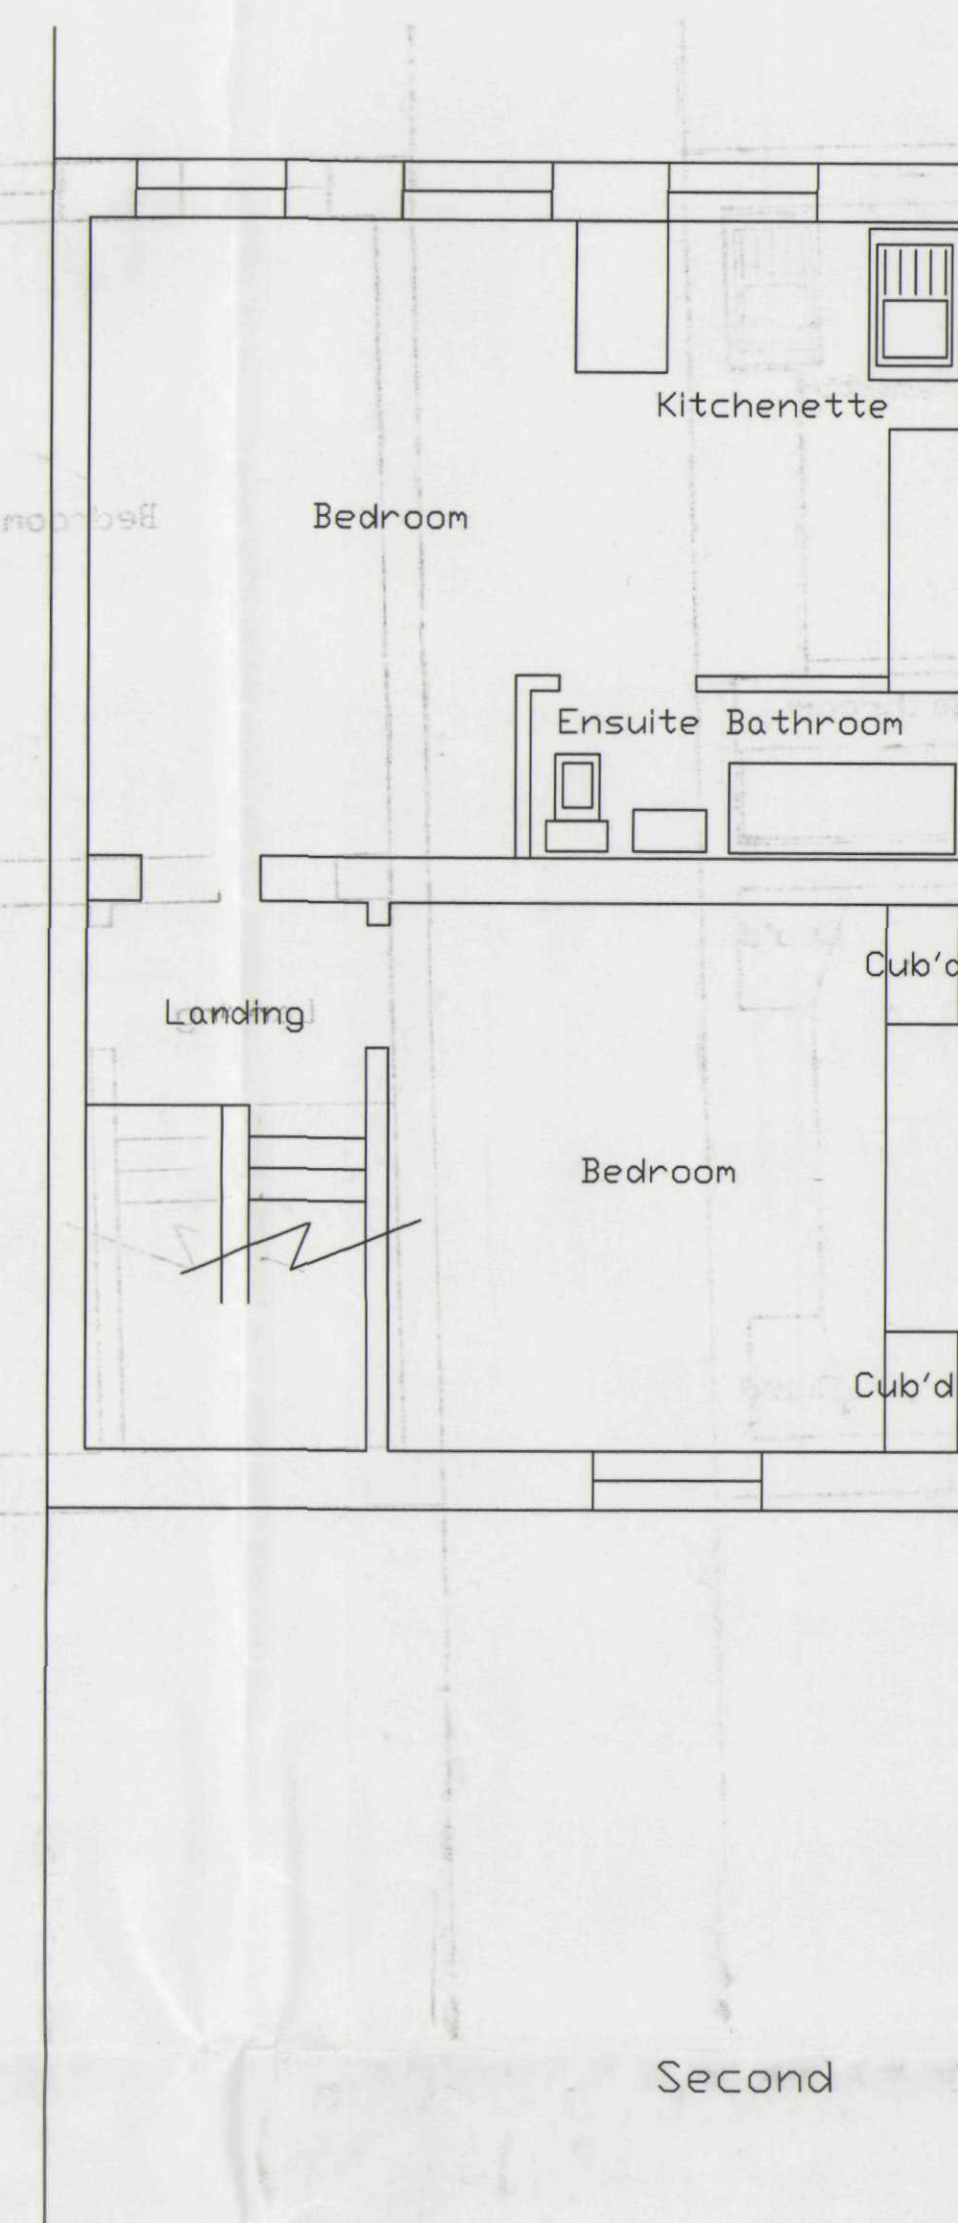
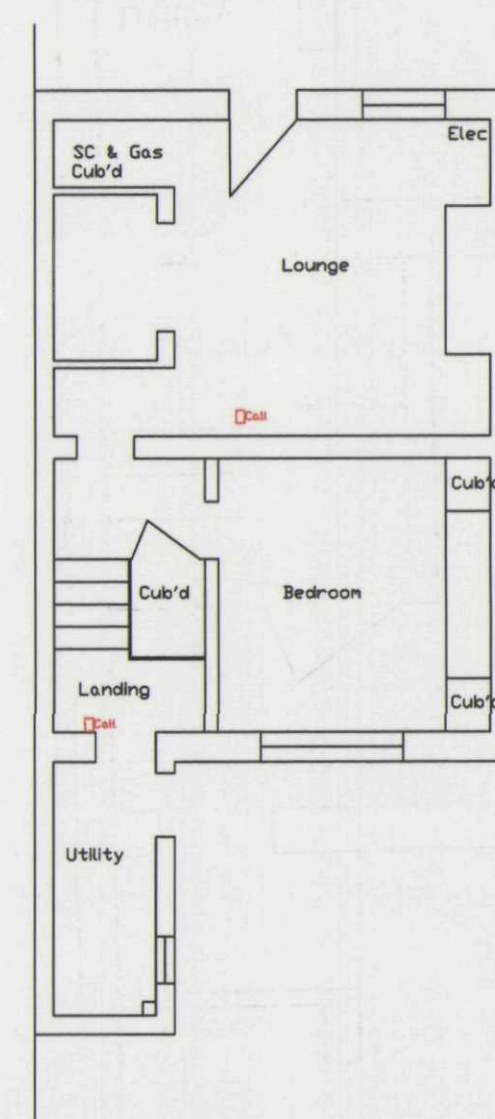
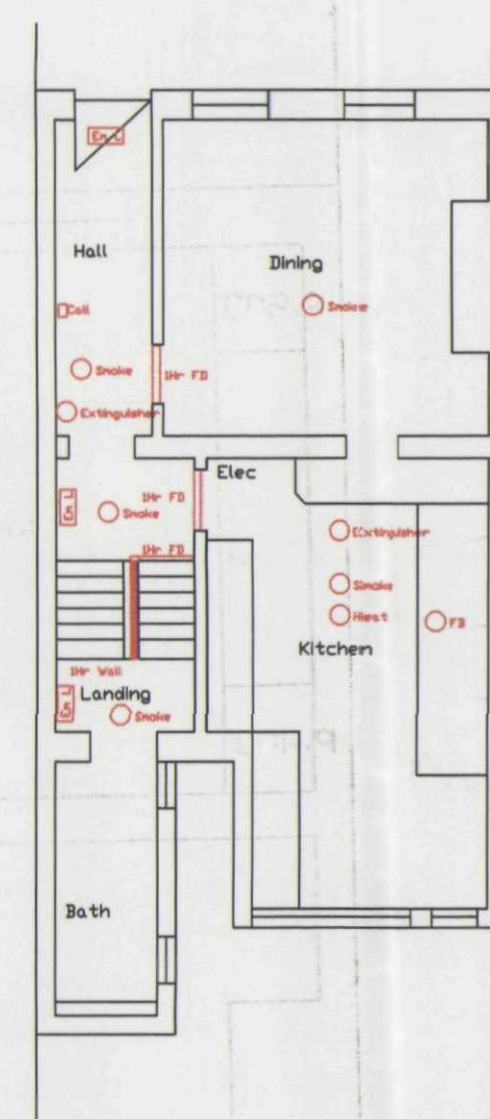
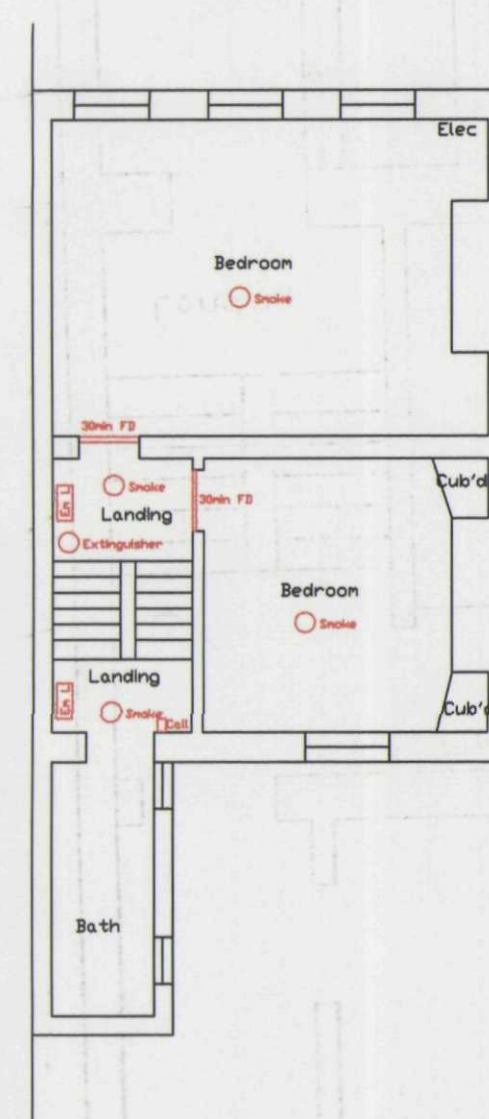


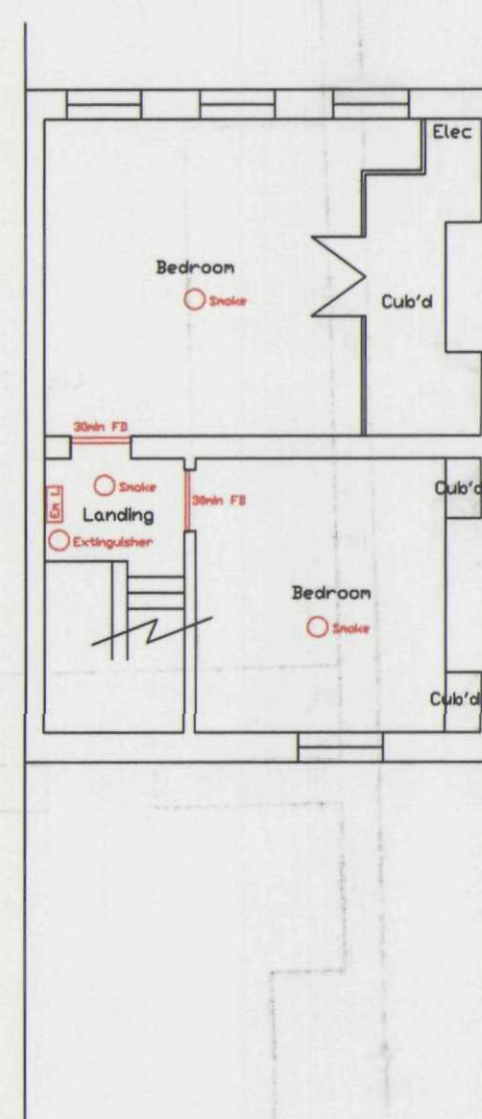

- Index
- Call point
 - Smoke detector
 - Fire extinguisher
 - Fire alarm
 - Heat detector
 - Emergency lighting
 - Fire door

12 London Road, Spalding, Lincolnshire, PE11 2TA

Fire Requirements

Scale 1:50

Fire Requirements

Mrs A M Currie
5 Harts Close, Bushey
Herts., WD 23 2BL

Tel: 01923 234351

DETERMINED
PLAN

Form 1277/04
04 OCT 2004

12 London Road, Spalding, Lincolnshire, PE11 2TA

1st & 2nd Floor Revised room layout. Scale 1:50 main