

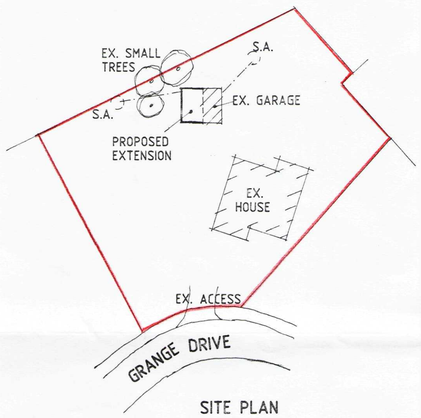



SITE PLAN



FRONT



SIDE



REAR

Build on extension to the side of existing detached garage in the manner shown.

Form opening from existing garage into new extension between existing piers as shown. Support over with IG L11 lintel.

Walls to be in 100mm brickwork with piers as shown,

External facing bricks to match those of existing garage.

Provide d.p.c. 150mm above ground level.

New floor to be laid level with existing.

Lintels over new openings to be IG L11.

Flat roof joists to be 175mm x 50mm SC3 grade at 400mm centres.

Make good to all disturbed and affected areas.

Flat Roof Construction (Cold Roof)
12.7mm white spar chippings bedded on bitumen on 3no. layers built up felt (first layer asbestos based) on 12mm external grade plywood decking on 50mm to 0mm timber firrings securely spiked to treated timber joists (size stated on drawings). Provide 30 x 5mm mild steel anchor and lateral restraint straps to joists fixed to walls at maximum 1200mm c/c. Extend joists past wall and provide suitably sized fascia board, complete with soffit board. Provide proprietary ventilation to soffit to offer equal to a 25mm continuous gap along eaves. Lay between joists proprietary 150mm thick insulation maintaining a 50mm air gap between insulation and plywood. Form all necessary felt drips including tilting fillets and keep felt drips clear of fascia boarding. If flat roof intersects with pitched roof ensure flat roof felt laps under felt of pitched roof by a minimum of 600mm.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Rain.water Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Inspection Chamber Construction
Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

Garage Floor Construction
100mm concrete oversite on 1200 gauge polythene d.p.m. on minimum 150mm, maximum 600mm well blinded and compacted hardcore. If garage is integral to house finished floor level to be 100mm below that of house. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.


Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.


Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Foundations
450mm x 225mm widened at piers to an approved firm base subject to local authority specifications. Concrete to be SC3 grade.

Proximity of existing trees to be taken into account in accordance with NHBC, Chapter 4, when determining foundation depth.

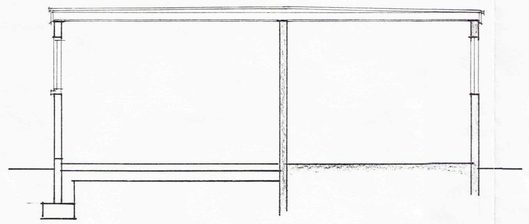

SECTION

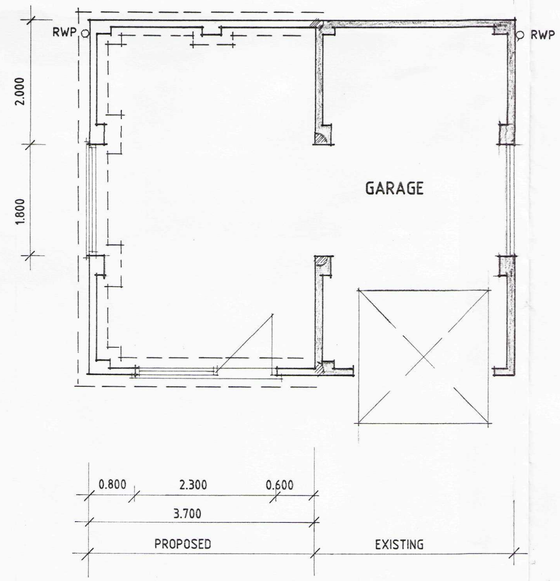

PLAN

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practise. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

SHDC
Planning & Development
1 6 DEC 2004
Ref: 1652/04

DETERMINED
PLAN

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSION TO GARAGE AT 33 GRANGE DRIVE, SPALDING FOR

MR. N. B. MANN.

1:50 1:100 1:500	SD04-113/1
DEC-04	B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702