




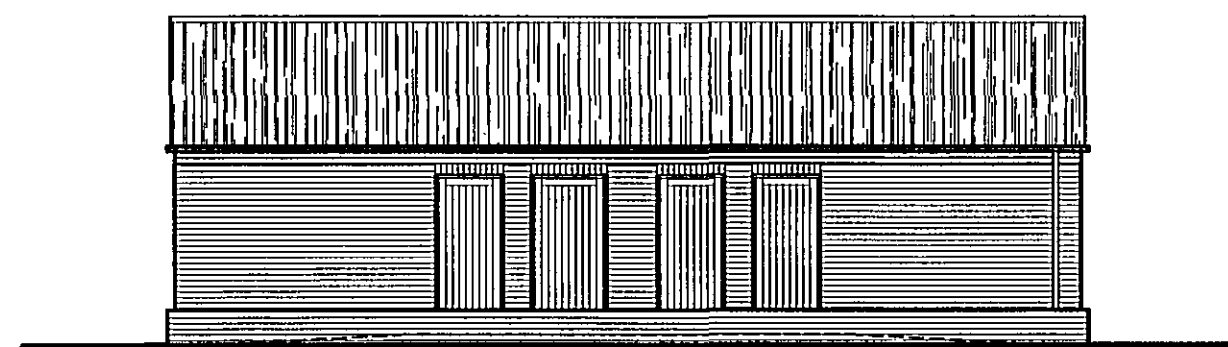


SOUTH ELEVATION 1:100

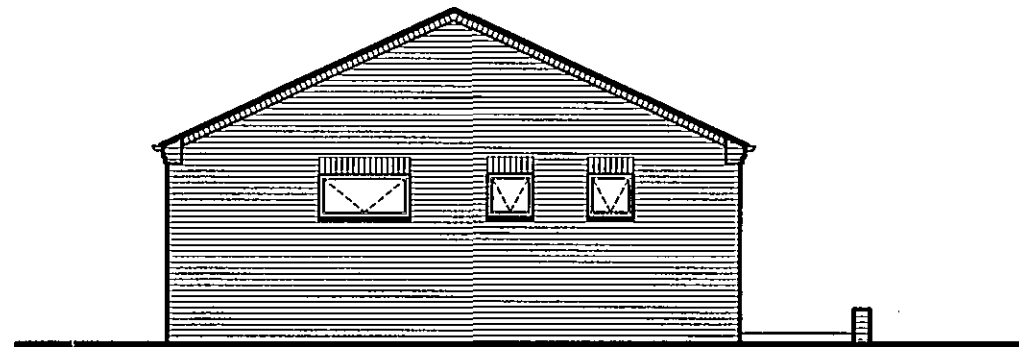


WEST ELEVATION 1:100

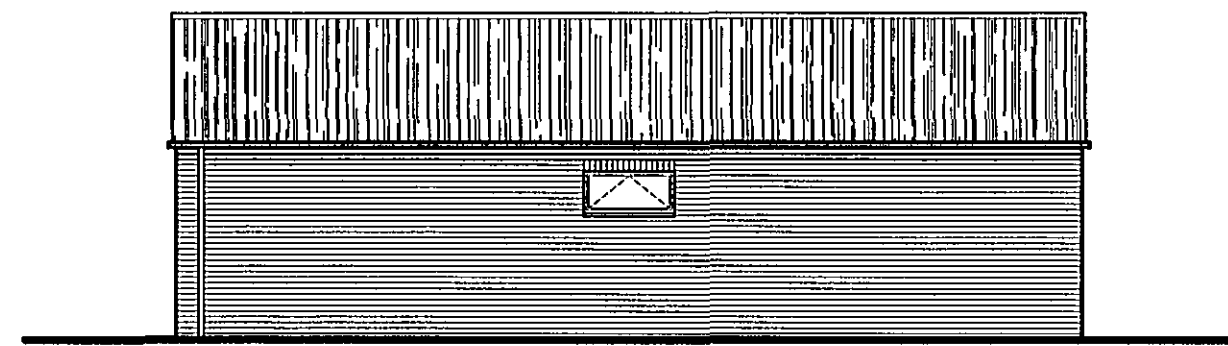


NORTH ELEVATION 1:100

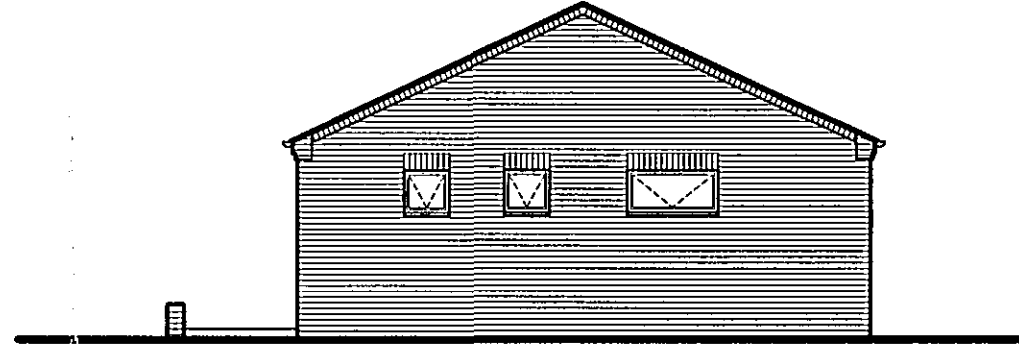

EAST ELEVATION 1:100

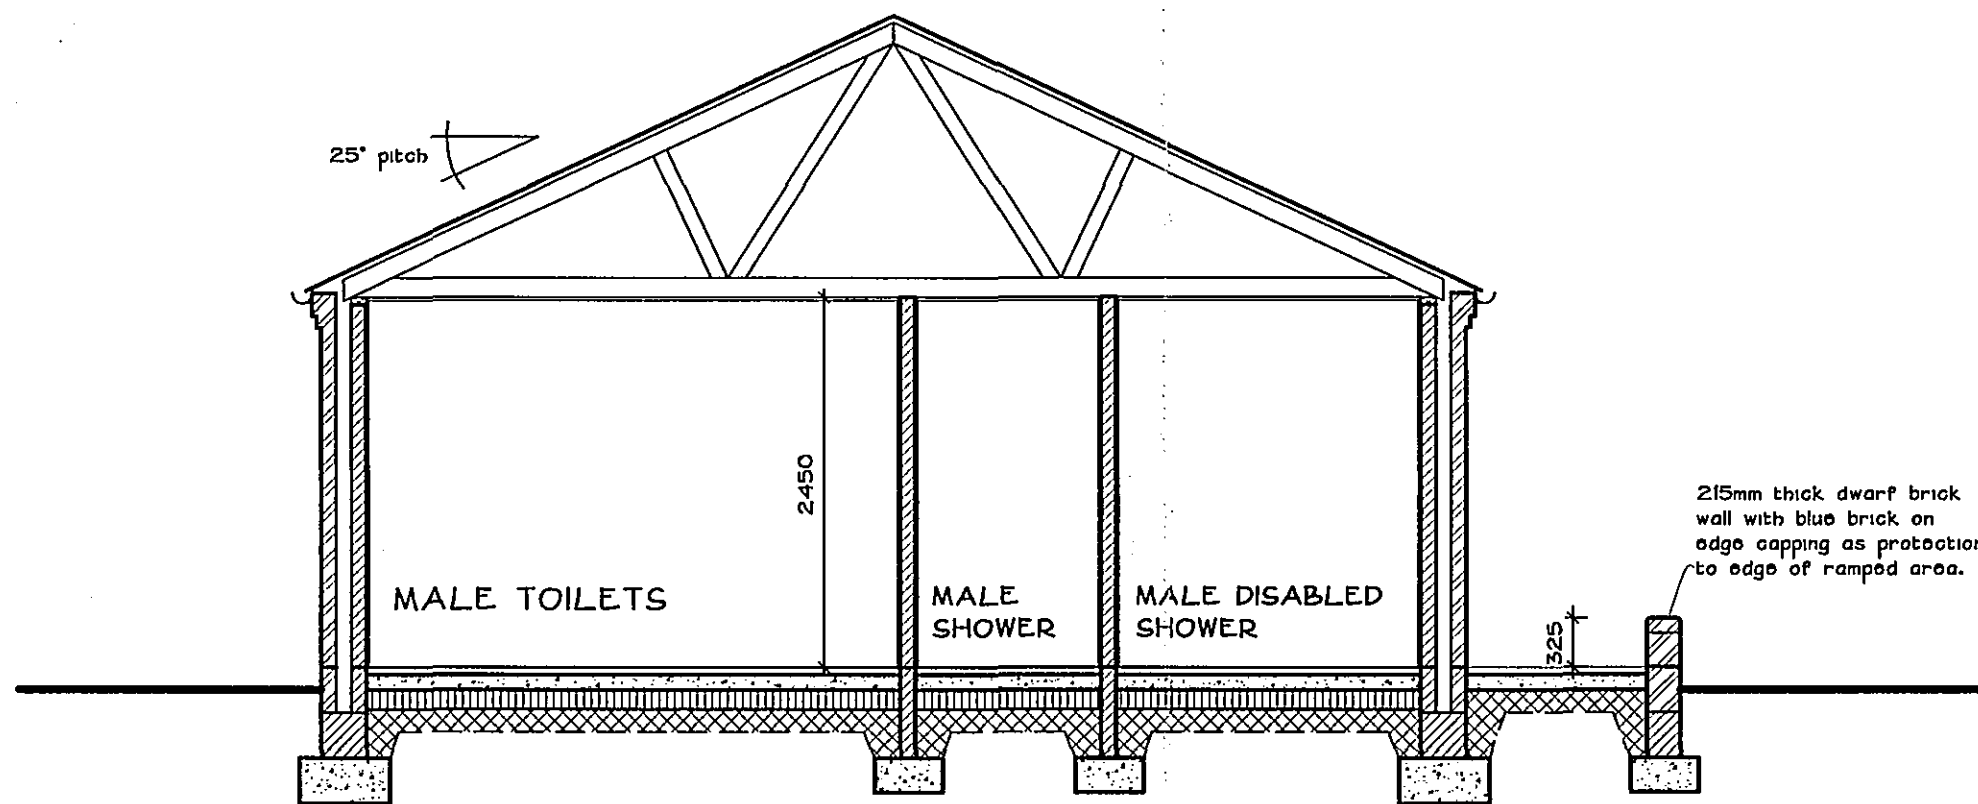

SECTION AA 1:50

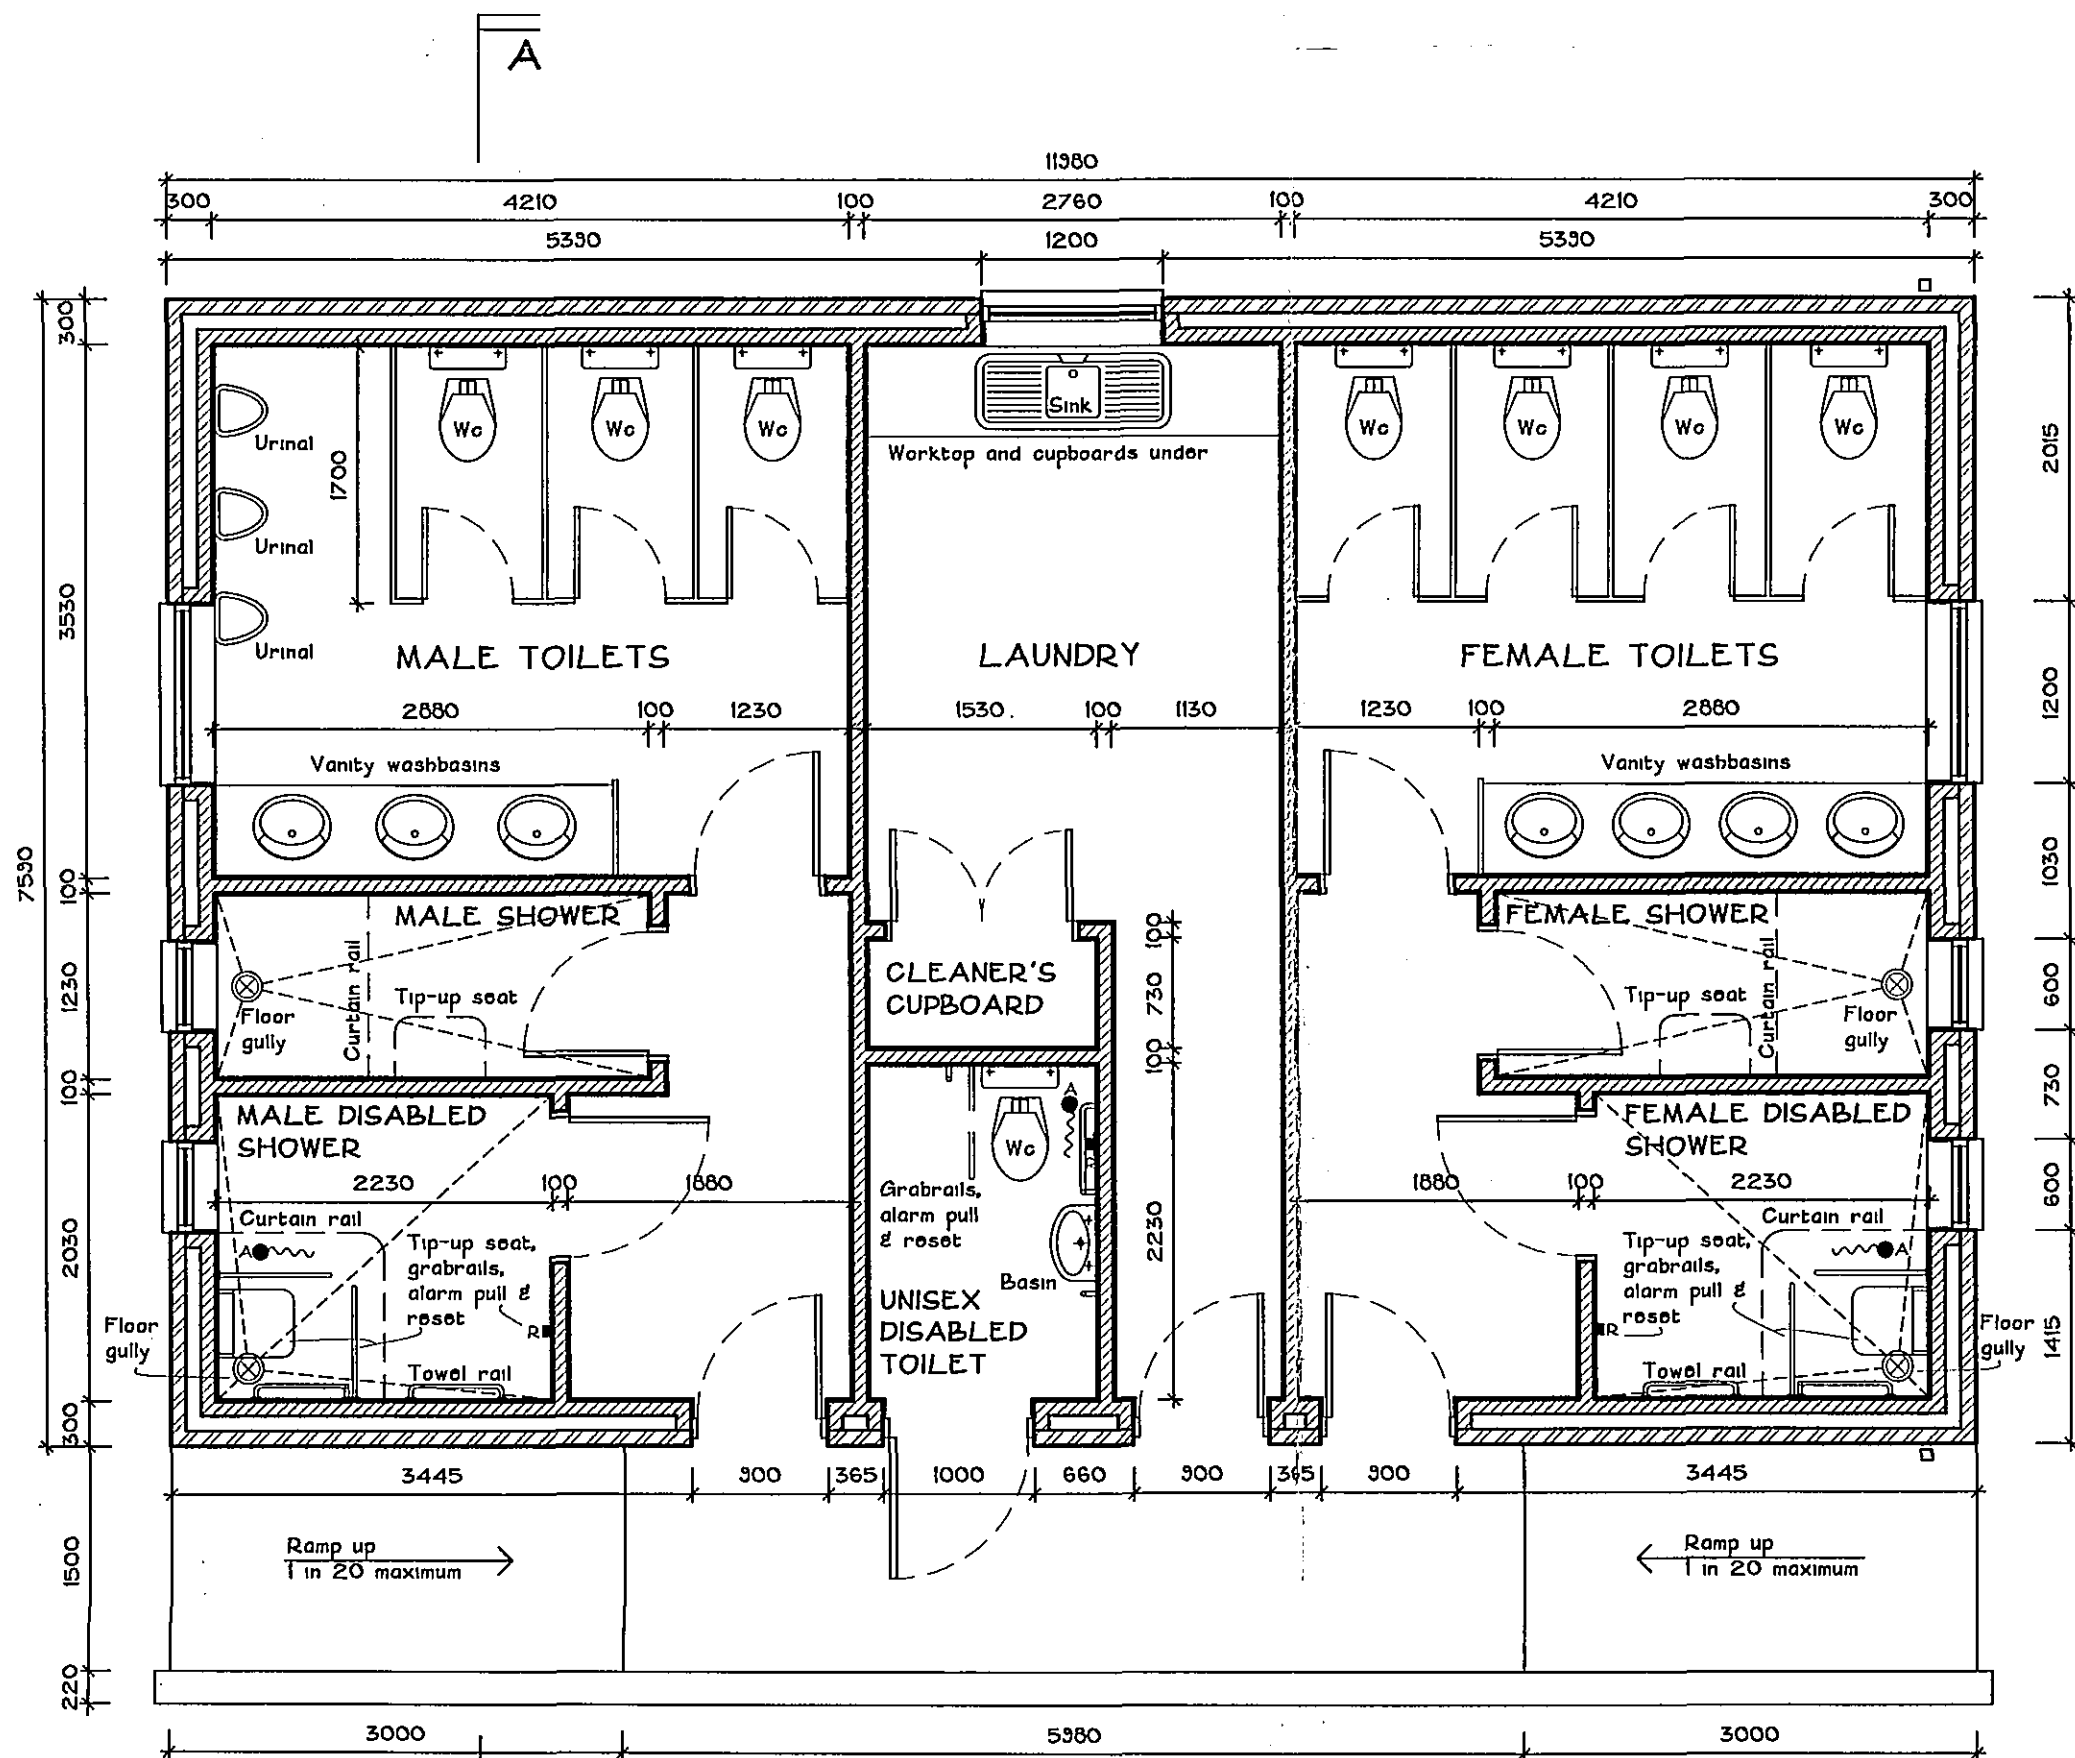

FLOOR PLAN 1:50

MAIN SHOWER BLOCK

GENERAL SPECIFICATION NOTES

FOUNDATIONS

Foundations to be mass concrete strip footings reinforced with one layer of A252 mesh incorporated into the bottom of the footings to span over any soft spots. Sizes as follows:
600 x 300mm deep to external walls.
450 x 225mm deep to internal block partitions.
Underside to be founded at minimum 750mm below external ground level for minimum 1000mm if no suitable subsoil is encountered. Final depth and detail to be agreed on site with Local Authority Building Control Officer.

Concrete to be general grade of foundation mix - GEN 3 to BS5328.

GROUND FLOOR CONSTRUCTION

To comprise 50mm sand/cement screed on 100mm thick (G20) gradal mass concrete floor slab on vapour barrier on 1200mm thick 'Jabite' 'Jabifloor' flooring grade insulation on 1200 gauge polythene membrane with 150mm lags and turned up at all edges and lapped with wall dips all on 25mm minimum thickness sand bedding on 150mm minimum thickness well rolled and consolidated hardcore base. Overall construction to achieve a 'U' value of 0.22w/m2k.

Foundation trenches to be backfilled with hardcore internally and consolidated in layers not exceeding 150mm thick.

NOTE: Vertical upstands of insulation to be provided to all edges of concrete slab in strict accordance with manufacturer's instructions.

EXTERNAL CAVITY WALL CONSTRUCTION

300mm external cavity wall construction to comprise: 102mm external skin in facing brickwork, 100mm cavity filled as work proceeds with 'Dritherm' or similar insulation cavity bats, 100mm internal skin in 'Celcon' or similar insulating blocks with 15mm thick dense plaster finish internally. Overall wall construction to achieve combined 'U' value of 0.3w/m2k.

Walls below dpc level to be constructed in 230 thick foundation blocks.

Leaves of cavity wall to be tied together with stainless steel wall ties at 750mm horizontal centres and 450mm vertical centres (500mm vertical centres where next to an opening).

Jambes and sills to be closed by inserting proprietary insulated cavity closers.

Cavities to be left open at top and wall insulation to be continuous with roof insulation (no gap between).

Bituminous based damp proof course to be built in 150mm minimum above outside ground level to external walls.

LINTELS

To openings in cavity walls, to be 'Keystone' type 'HD/K-70' or similar heavy duty insulated galvanised steel lintels with cavity tray over and 150mm minimum end bearing.

To internal openings in block partitions, to be 'Keystone' type 'Box/K-100' or similar with 150mm minimum end bearing.

WINDOWS

All new windows to be constructed from white UPVC frames with a 'U-value' of 1.8W/m2K. Style as shown.

Glazing to be double glazed sealed units using ' Pilkington-K' glass with a minimum gap of 16mm between glass layers and having a 'K' value of 0.05.

To incorporate controllable trickle ventilators providing 8000mm2 background ventilation.

All new windows to have top or bottom hung hinged casements as shown.

All window frames to be recessed 30mm to ensure that they lap over the cavity closure.

Internal window cills to be to client's requirements.

DRAUGHT PROOFING

Draught stripping to be fitted to all operable elements of windows and external doors.

GLAZING IN CRITICAL LOCATIONS

Any glazing to windows and doors below 800mm above floor level and to doors and sideglights below 1500mm above floor level (ie in critical locations) to be laminated or toughened safety glass in accordance with BS6206.

DOORS

All internal and external doors to be to client's selected design.

INTERNAL GROUND FLOOR WALLS

To be constructed from 100mm thick blockwork with 15mm thick dense plaster finish each side.

ROOF CONSTRUCTION

To comprise: concrete interlocking roof tiles of a style to suit roof pitch all on 35 x 25mm treated softwood battens gauged to suit tiling on untearable sarking felt to BS747 : Part 2 : Type IF on pre-made trussed rafters at 600mm maximum centres.

Roof pitch to be approx 25°.

All to be designed, braced and fixed in accordance with BS5268 : Part 3 : 1995.

Specialist manufacturer's design calculations to be submitted to Local Authority for approval prior to fixing on site.

Trusses to be fixed at eaves level with galvanised truss clips to 100 x 50mm softwood wallplate bedded in mortar.

Diagonal bracing to be provided to full length of roof in plan of rafters and ceiling ties to BS 5368 : Part 3 : 1995.

Timber runners to be provided at all truss node points for full length of roof.

PITCHED ROOFS GENERALLY

Proprietary roof ventilation system to be installed in strict accordance with manufacturer's instructions and comprising continuous eaves ventilator below roof tiles (minimum 25mm continuous gap) and ridge ventilators to match slates (minimum 5mm continuous gap).

External walls to be strapped to roof with 30 x 5mm cross-section galvanised mild steel anchor straps fixed to wallplates and blockwork in cavities at eaves level all at 2000mm maximum centres. Timber noggins to be provided under straps where necessary.

270mm thick quilt insulation to be laid in roof space in two layers - first layer between ceiling ties/joists and second layer at right angles over ceiling ties/joists. Roof insulation to be extended into top of wall cavity to ensure continuity of insulation but still maintaining 50mm minimum air gap above insulation. Overall construction to achieve a 'U' value of 0.16w/m2k.

Roof access hatch to be insulated type.

CEILINGS

Ceilings to be 12.5mm plasterboard fixed to underside of joists and ceiling ties.

Joint treatment and skim coat plaster or Artek finish to be in strict accordance with British Gypsum instructions.

Timber noggins to be provided to all unsupported joints in plasterboard.

MECHANICAL VENTILATION

To be provided to all areas capable of extracting 30 litres per second litres per second.

ELECTRICAL INSTALLATION

To be carried out in strict accordance with the latest edition of the IEE Regulations. Socket outlet and lighting positions all to client's requirements.

All electrical work is to meet the requirements of Part P (Electrical Safety) of the Building Regulations and should therefore be designed, installed, inspected and tested by a person competent to do so.

Prior to completion, the Building Control Officer should be satisfied that Part P has been complied with. This may require an appropriate BS7671 electrical certificate to be issued for the work by a person competent to do so.

ENERGY EFFICIENT LIGHTING

Internal lighting installation to be provided with energy efficient lighting so that every one in four lighting points or one per 25m2 can only take lamps having a luminous efficacy greater than 40 lumens per circuit-watt.

HEATING

Existing water fed radiator system to be extended to all new areas. Radiators to be fitted with thermostatic valves and appropriate pipework to be insulated as necessary to promote energy conservation.

DRAINAGE SPECIFICATION NOTES

WASTE PIPEWORK

Sinks, showers and basins to be fitted with 40mmF wastes with accessible 75mm deep solid traps.

Rodding access to be provided at all changes of direction.

RAINWATER GOODS

Gutters and downpipes to be square section white UPVC securely fixed at eaves and laid to falls complete with all required outlet positions, sloped, swan necks etc. To be installed in strict accordance with manufacturer's instructions.

Pre-stressed concrete lintels to be inserted in walls where pipes pass through.

SOIL & VENTILATING PIPE

To be 100mmF UPVC terminating at minimum 300mm above head of nearest windows and fitted at top with ballon guard mesh.

MANHOLES


To be pre-formed polypropylene inspection chambers installed and surrounded in concrete in strict accordance with manufacturer's instructions.

GULLIES


External gullies to be pre-formed polypropylene roddable back inlet gullies set in concrete in strict accordance with instructions.

SOAKAWAYS


Storm water pipes to drain into now soakaways constructed to CP501 minimum 5000mm from any building (6000mm in clay soil). To be 1250 x 1250 x 1250mm deep filled with rubble to within 450mm of ground level and overlaid with polythene sheet and backfilled to ground level with vegetable soil.

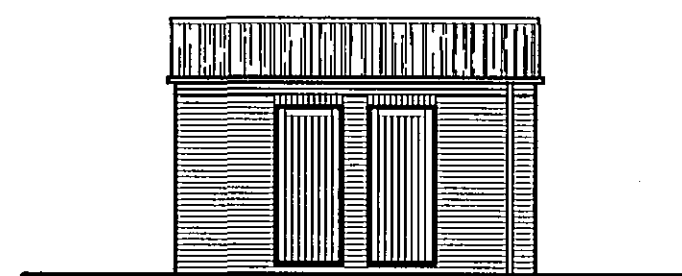


NORTH ELEVATION 1:100

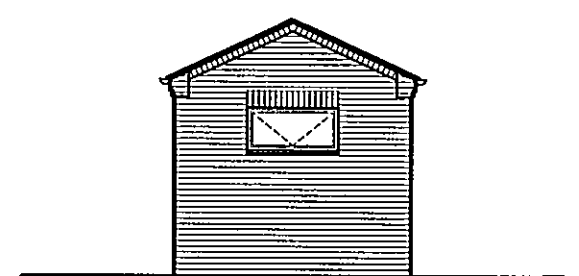


WEST ELEVATION 1:100

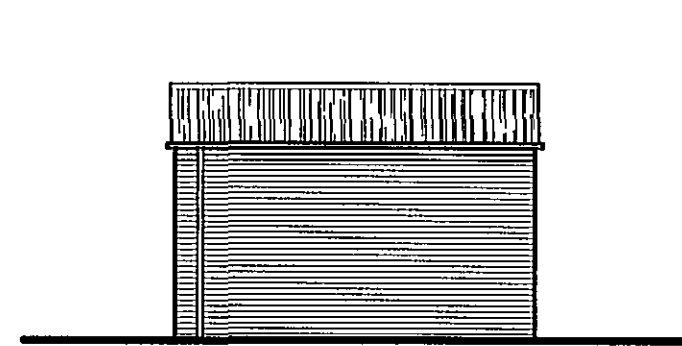


SOUTH ELEVATION 1:100

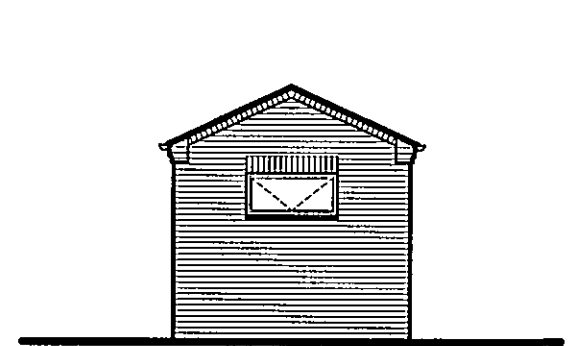

EAST ELEVATION 1:100

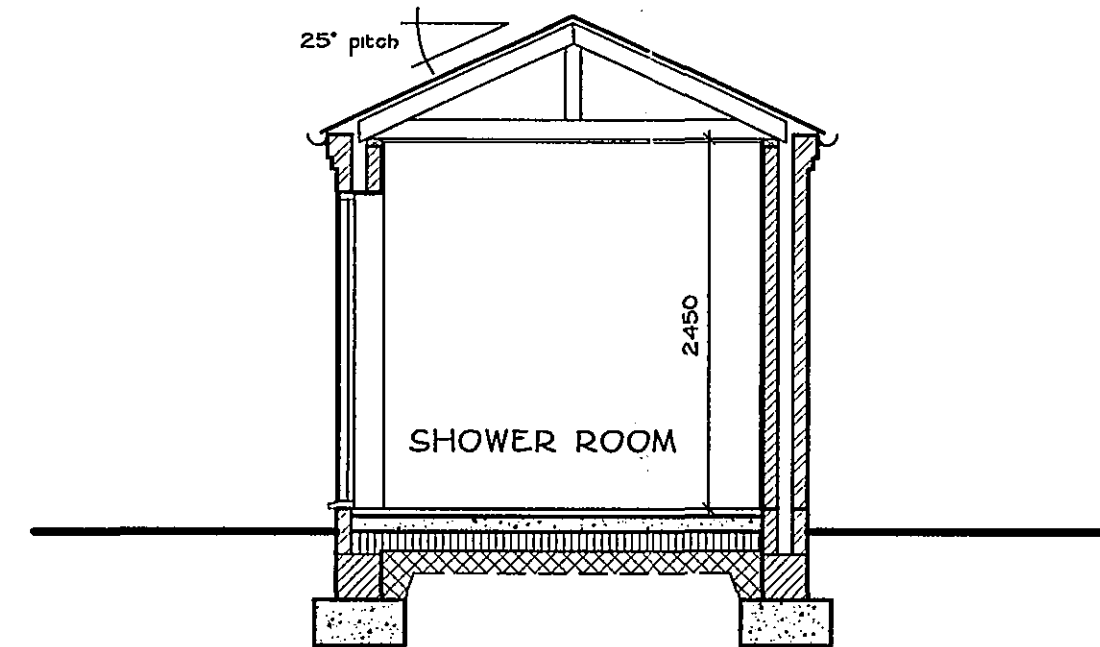

SECTION AA 1:50

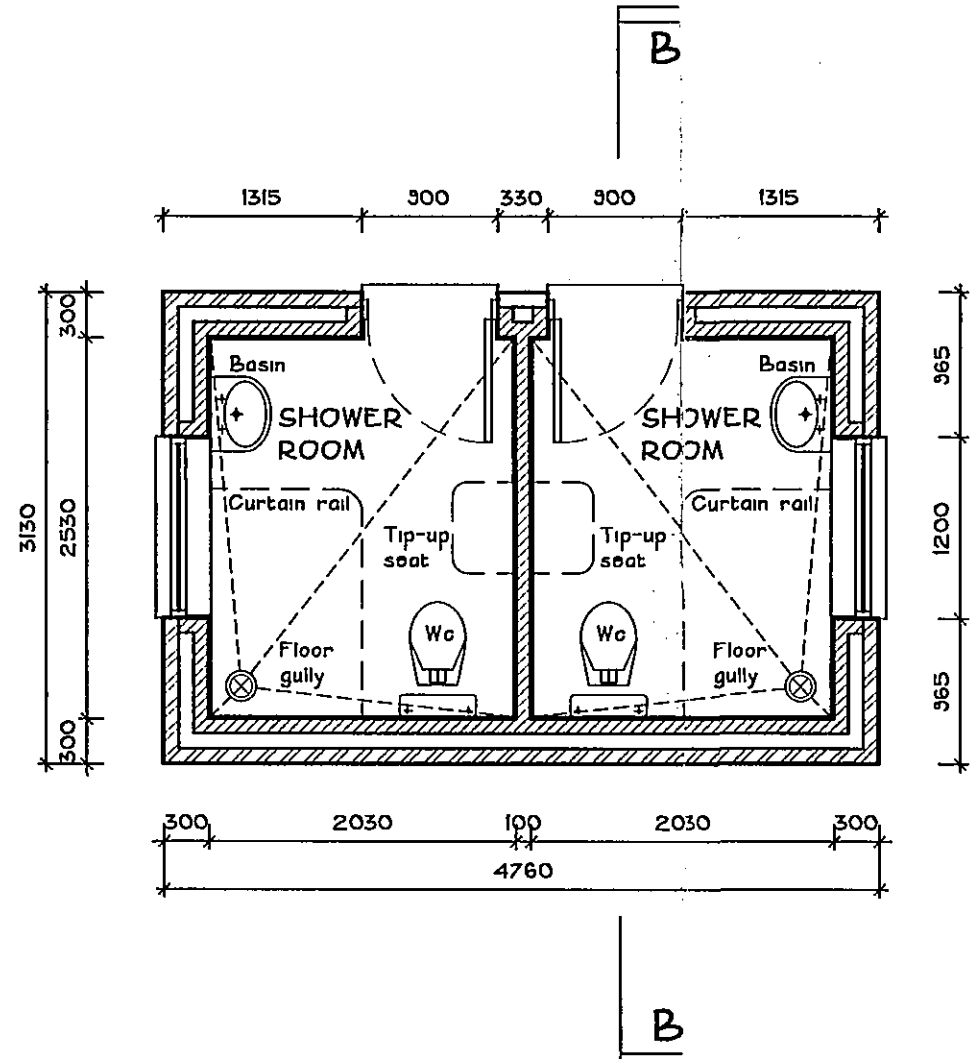

FLOOR PLAN 1:50

SMALL SHOWER BLOCKS

NOTES

LIMITATIONS

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Building Regulation approval. The drawing must not be used as a contract document alone.

DIMENSIONS

All dimensions are to be checked on site by the builder who shall take responsibility for measurements for construction and ordering purposes from commencement of site work.

Whilst every effort is made to ensure accuracy in dimensioning, measurements should be carefully checked to ensure compatibility with existing structures and features.

SUPERVISION

The works will not be supervised by Richard J Diggle or any representative thereof. It is the clients or their appointed agents responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract etc.

STANDARDS

All materials to be new unless otherwise stated and all components and materials etc. to be used, fitted and installed in strict accordance with manufacturers instructions and relevant Code of Practice.

Materials shall conform to the appropriate British Standard Specification or BBA Certificate or European Code equivalent.

Preservative treatment to BS 5268 : Part A is to be carried out to all timber prior to delivery to site.

DETAILS / FOUNDATIONS

All details shown on this drawing including foundations, are based upon typical site conditions including soil of good bearing capacity.

Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

If adverse ground conditions are encountered, then the advice of a qualified structural engineer should be sought.

HEALTH AND SAFETY

The Employer / Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety legislation for Building Sites and Work Places.

The Employer / Client is advised that should the works need to comply with the Construction Design and Management Regulations, and independent Planning Supervisor will be required.

SCOPE OF THE WORKS

The works comprise all that is shown on the drawings and details. Any work that may not be specifically shown, but may reasonably be inferred as necessary to carry out the works will be deemed to be included.

SHDC
PLANNING & DEVELOPMENT
21 DEC 2006
Ref. 1753106

Revisions

Richard J Diggle Ltd
Building Design : Project Management

194 Broad Gate
Weston Hills
Spalding
Lincs
PE12 6DQ
Tel/fax: 01406 380852
Mob: 07771 621902
E-mail: richard@diggle.biz

Client:
MR J W & MRS C J M WELCH

Project:
CARAVAN & MOBILE HOME SITE

SPALDING DROVE
SPALDING

Drawing:
SHOWER BLOCKS

FLOOR PLANS
SECTIONS
ELEVATIONS

Scale: As shown Date: December 2006
Drawing Number:

1009-02