
Contractor to check all Dimensions on site prior to ordering materials / commencing work.Do Not Scale from this Drawing - If in doubt then please ask




PROPOSED GARAGE FRONT ELEVATION
Scale 1:100


PROPOSED GARAGE SIDE ELEVATIONS
Scale 1:100

PROPOSED GARAGE REAR ELEVATION
Scale 1:100


PROPOSED GARAGE SIDE ELEVATION
Scale 1:100

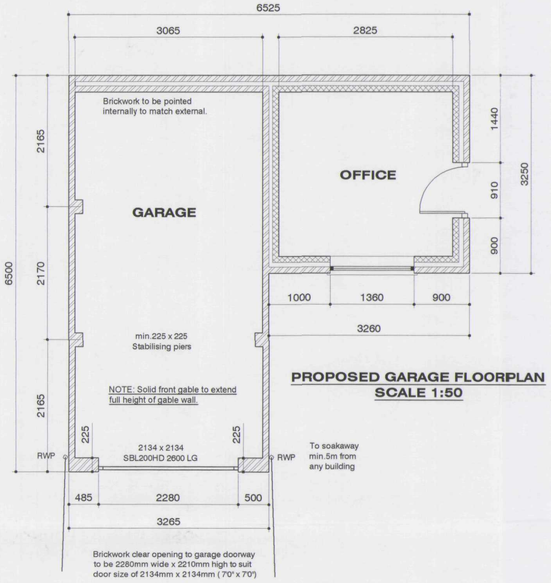

PROPOSED GARAGE FLOORPLAN
SCALE 1:50

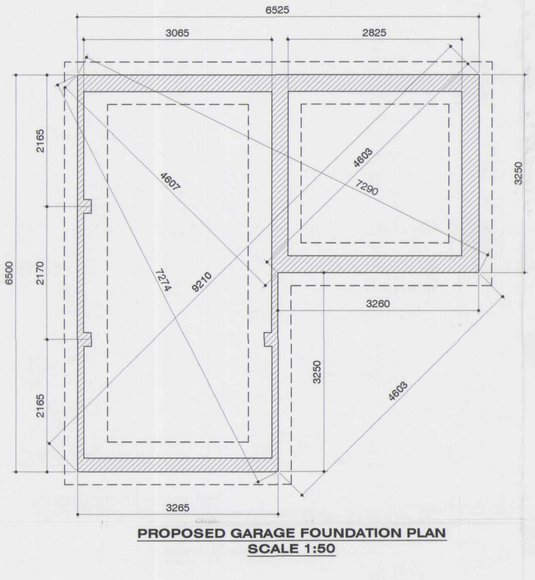

PROPOSED GARAGE FOUNDATION PLAN
SCALE 1:50

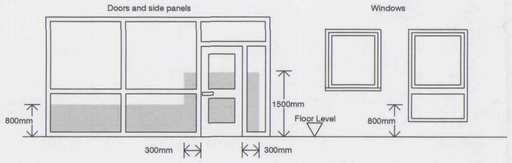

Shaded areas show critical locations to which requirement N1 applies.

FOUNDATIONS
Existing building area to be stripped of all vegetable matter and rubbish to a min.depth of 150mm before excavation commences.Concrete mix for foundations to be GEN3 in accordance with BS5328:1981.Foundations to external wall to be min.700mm wide x 225mm deep.Excavate down to solid firm strata i.e 750mm deep (min.1000mm if soil is of a shrinkable nature).Exact depth to suit conditions on site and to the strict approval of the L.A Building Inspector.Any irregularities in subsoil during excavation to be brought to the immediate attention of the Building Inspector & advice to be sought from a Chartered Structural Engineer.

WALLS BELOW D.P.C
3no.Courses of Class B brickwork below D.P.C on outer face and 1no.coarse of 7N/mm2 on inner skin of cavity face.Elsewhere to be either 7N/mm2 concrete blockwork or full width trench blocks.Both to be within 225mm of DPC level.Cavity to be filled to within 225mm min. of below DPC with lean concrete mix.

GROUND FLOOR
65mm mortar screed with a light gauge reinforcing chicken wire on 500 gauge poythene separating layer on a 60mm Celotex Double R GA2000 rigid insulation board or similar approved, provide 30mm thick perimeter insulation between screed and floor insulation upto d.p.c level on 100mm thick GEN3 concrete sub-floor on a 1200 gauge DPM lapped onto DPC within walls on min.150mm clean and well compacted hardcore.Depth of hardcore must not exceed 600mm and must be compacted in 150mm thick layers.All service entries to be sealed with pressure sensitive tape. Floor to achieve a min 'U' Value of 0.25w/m²K.

DAMP PROOF COURSE (D.P.C)
Horizontal heavy duty polythene DPC "Hyload" or similar approved to all walls in accordance with BS 6515 and set min.150mm above all external ground levels.DPC in walls must be linked / lapped with DPM in ground floor.Provide performed cavity wall trays above windows & doors with weep vents at a max.of 2m centres with a min.of 2no.per opening.

EXTERNAL WALLS
All external walls to be 275mm overall thickness comprising of:
-100mm Brickwork to match existing
-75mm cavity filled with Crown Dritherm (or equal approved) built in as work progresses.Insulation batts should be kept clean and free from mortar droppings, all joints should be closely butted. Any cutting and fitting should be neatly done and not distort the layers of glass wool which comprise the material. All DPC's should be installed to ensure that penetrating water is directed only to the outer leaf.
-100mm Thermalite Shield insulating blockwork.
Continue wall insulation at least 150mm below top of perimeter floor insulation and support off wall ties.
External wall to achieve a min 'U' value of 0.35w/m²K.

CAVITIES
Close all cavity walls at jambs with Thermabate or similar approved insulated cavity closers fitted strictly in accordance with manufacturers instructions. Roof insulation to be continuous with wall cavity insulation.Install Insulated Cavity Closers by Thermabate or equal approved, 25mm thick x 75mm wide (to equal cavity width) at jambs and cills of all openings in masonry cavity walls. Secure with the proprietary clips provided at maximum 500mm centres. Ensure that closers fit tightly to each other and to the lintel. The closer at the jamb must completely lap the closer at the cill.

MORTAR
All mortar to be 6:1:1 sand:cement/lime or equally approved and to be a consistent colour throughout duration of contract.Finish mortar joints as agreed with Client on site.

WALL TIES
Stainless steel cavity wall ties to BS1243:1978.To be built into cavity wall as works proceeds and spaced at 750mm centres horizontally,450mm centres vertically and 300mm staggered around all openings.Ensure wall ties are level or at least sloping to the outside leaf.Bed ties a minimum of 50mm into each leaf and ensure wall ties are completely free from mortar droppings.

LINTELS
All lintels to cavity wall to be factory insulated Birtley Supergalv range unless noted otherwise or equalled approved.All lintels must have a min.150mm endbearing and installed in accordance with manufacturer's instructions.Do not allow masonry to overhang lintel by more than 25mm. Note: lintels are not to have a continuous baseplate.

WINDOWS & DOORS
All windows to be White uPVC to clients requirements based on styles shown on elevations.Fit with 4000mm² trickle ventilators to Kitchen, Utility,Bathroom & En-Suite windows and 8000mm² elsewhere all in accordance with manufacturer's recommendations.Patio doors to be fitted with 10000mm² ventilators.Opening vents to give 1/20 th of floor area rapid ventilation to all rooms.All glazing within 800mm of floor level and within 300mm of a door to a height of 1500mm of ground level to have toughened glass in accordance with Section N of the Building Regulations and BS6206 class B.All double glazed units to be installed in accordance with BS 6262 and to have a 16mm Air gap with a soft Low 'E' coating on glass inner pane to achieve a min 'U' value of 2.0 w/m²K.Note all windows to have a perimeter weatherseal both internally and externally and to be fully draught sealed.Provide frosted glass to all Bathroom, W.C's and En-suite windows.Ensure windows & doors are fitted within masonry reveal to overlap cavity closer by min.10mm to avoid cold bridging.

TIMBER WALLPLATES
All timber wallplates supporting roof trusses to be 100mm x 50mm bedded on top of wall.Timber to be SC3 grade and use a min. length of 3m and half-lap plates at joints and corners..Provide anchor straps as described in notes elsewhere.

LATERAL RESTRAINT STRAPS
Tie roof structure to blockwork wall with 30X5 galvanised mild steel straps at max 1.8m ctrs where rafters and ceiling joists run parallel to blockwork walls.Also fit at max 1.8m ctrs to anchor wallplate to blockwork wall with min 3no. fixings per strap.

CEILINGS
All ceilings to be 15mm plasterboard to BS1230.
Ceilings to be have Coving and an Artex finish to clients requirements.Plasterboard sheets to be fixed with joints staggered and must be layed perpendicular to all joist runs.Fix boards at a min.150mm centres.

SMOKE ALARMS
To be self contained,interconnected and wired to a separately fused circuit with a battery back up.Smoke alarms to be fitted to u/side of plasterboard ceiling to the ground floor max 7m from the kitchen / lounge and to be max. 3m from any bedroom door. All alarms to be strictly in accordance with BS 5446 and to be wired that when one alarm is triggered all alarms are activated.

NOGGINGS
Fix 38x38mm timber noggings to all potential loose plasterboard ceiling edges and light fittings.Position of light fittings to be advised by client on site.

INTERNAL JOINERY ,SKIRTING & ARCHITRAVES
All internal finished timber to be free from all defects and to clients approval prior to ordering any materials.

ELECTRICAL INSTALLATION
To be in strict accordance with the latest I.E.E Regulations and Engineer to advise if any appliance or position of appliance does not conform to regulations. Contractor to seek advice from Client with regard to lighting requirements.

ROOF / LOFT ACCESS
Provide insulated roof access trap door with a fully weathered sealed frame and a 38mm brass bolt or to clients requirements.

SOAKAWAYS
All rainwater to discharge into soakaways and to be min.of 5m from any building & a min.of 1m³ filled with rubble to within 450mm of external ground level.Overlay rubble with polythene sheet and backfill with clean topsoil.Note the soakaway inlet pipe must discharge to the centre of the soakaway in all directions.

RAINWATER DRAINAGE
White uPVC guttering and downpipes to clients approval.Falls for guttering to be 1:600 and brackets fixed at max. 2m ctrs.Downpipes to be connected into underground drains via reducing adapter.Underground drains to be 110mm Ø Osma uPVC or similar approved with flexible joints laid on 100mm peagravel and min 150mm surronds laid to 1:100 falls to new soakaway.Soakaway specification detailed elsewhere.



Crown Copyright. All rights reserved. Licence Number 100020449

LOCATION PLAN
Scale 1:1250

ROOF FINISH
Concrete Interlocking Roof tiles to match existing& fixed in accordance with manufacturers instructions and in accordance with BS 5534:Parts 1 and 2.Set out to give true lines and regular appearance, fitting neatly at all edges, junctions and features.Fix tile roofing to make the building sound and weathertight at the earliest opportunity.Repair any defects as quickly as practicable to minimise damage and nuisance & keep gutters and pipes free of debris and clean out at completion.Provide 50x25 preservative treated timber battens.Tiling battens should be not less than 1.2m long and continuous over at least 3 trusses.They should be fixed to every rafter member which they cross, or on which they are joined, with nails in accordance with BS5534: Part 1. The ends of the battens should be sawn square and butt jointed centrally on a rafter member so that adequate bearing and nailing can be provided for each end of each batten.Butt joints in battens should be arranged so that not more than one batten in four is joined on any one rafter.Generally all tiles at perimeter of roof to be clipped and nailed. Use Code 4 Lead flashing to all abutments with min.75mm upstand.

ROOF INSULATION
The whole area of the ceiling to be insulated with two layers of Crown Wool Mineral Fibre Insulation or equal approved of a total thickness 300mm to achieve a 'U' value of 0.16w/m²K. Width of first layer of insulation to be appropriate to the joist spacings and of a thickness equal to joist depth (100mm) . The insulation to be laid between the joists to finish over the wall plate on external walls and pushed up tight to roofing membrane. The second layer (200mm) of Crown Wool to be laid at right angles to the first layer.All joints between the rolls of insulation to be close butted.

MASONRY WALL CONNECTORS
Provide Simpson Strong - Tie or similar approved wall connectors to connect new & existing brick / blockwork.Use all specified fasteners.Fasteners must be spaced evenly, unless otherwise specified, and installed into the existing bricks or block and not into mortar joints.Insert wall ties provided at maximum 300 mm centres, bedding the ties into the mortar joints.Detailed site work instructions are provided with each wall connector system and must be adhered to at all times.In exposed locations it may be necessary to incorporate additional protection, for example the insertion of a vertical dpc.

ROOF VENTILATION
Install Tyvek® or similar approved Breathable Membrane in accordance with manufacturers instructions which are briefly described below & BBA certificate 99/3635 (fourth issue) breather membranes in non-ventilated pitched roofs of any plan, any shape or any size under all types of roof coverings including tight jointed and fully interlocking tiles and synthetic slates. Installing Tyvek® underlay in accordance with the above certificate will enable a roof to meet all the requirements of the Building Regulations.
Installation Guidelines.
Tyvek® SUPRO should be installed with min. 150mm overlaps as a standard bituminous felt underlay and secured with stainless steel staples or large headed galvanised clout nails.
Eaves:
There is no need to provide any vents into the loft at eaves, because a Tyvek® non-ventilated roof system does not rely upon air movement beneath the membrane to avoid damage by condensation.To avoid water ponding behind the fascia of closed eaves and to prevent prolonged exposure of the membrane to ultra-violet radiation, use a Tyvek® Eaves Carrier. Stop the membrane short of the fascia and lap it onto the Eaves Carrier.Pack closed eaves with fibrous insulation to reduce thermal bridging.
Verge detail:
Lap the Tyvek® underlay 50mm onto the gable or flying rafter.
Ridge/ hip detail:
Extend the Tyvek® underlay 150mm from each slope and overlap it at the ridge/ hip line. There is no need to provide vents at the ridge.
Valley detail:
Extend the Tyvek® underlay from each slope by 150mm beyond the valley centre line and seal the lap using Tyvek® Butyl Tape to form a watertight seal.
Abutments:
Turn up the Tyvek® underlay beneath flashings not less than 50mm.
Penetrations:
Seal around all penetrations using Tyvek® Butyl Tape.

PLEASE NOTE:
Due to areas of the structure being covered, unexposed or otherwise inaccessible the notes / specifications of existing materials are subject to confirmation of site when it is feasible to expose the relevant areas of construction.

GENERAL CONDITIONS
Contractors are resonsible for checking all dimensions on site when work commences and before ordering any materials.Any discrepancies should be brought to the attention of the Client for remedial action before commencing further.

All details shown are based on typical site conditions for that area, any abnormal conditions should be brought to the attention of the Client and Local Authority.

The notes shown are mainly to cover the requirements of Building Regulations and should not be treated as full specification.

No allowance has been made for any Structural Calculations,a "SAP" calculation, Soil Investigation or Flood Risk Assessment.If deemed necessary then these will be a chargeable extra.All steel beam sizes shown on drawing are all subject to confirmation from Structural Engineer.

All materials not specified to be of a standard suitable for the work proposed and be fit for purpose.All work to be in accordance with good building practise and all necessary BS codes for Workmanship on Building Sites.

REV DESCRIPTION:

remway design Ltd
Plans drawn for: Local Authority - Planning permission & Building Control.
3, Rembrandt Way
Spalding
Lincs
PE11 3HX
Tel: 07815 112 058
Fax: 01775 768 921
e-mail: jason@remwaydesign.co.uk

Project: Proposed Two Storey Side Extension, Conservatory & Detached Garage with Office


Client: Mr M Gensiorskyj
10 Coalbeach Lane
Surfleet
PE11 4DE

Date: jun04 | DRG No.: rem917-02 | REV:

Provide solid blocking at the ends of herringbone strutting and under straps between last joist and wall.

30x5 m/s anchor straps (S) @ 2m ctrs with solid strutting beneath.Notch straps into minimum 3no. joists and fix with two nails.

Double up joists (D) undernearth bath & studwork wall and solid strutting (SS) reqd where studwork wal runs at right angles to joist span.

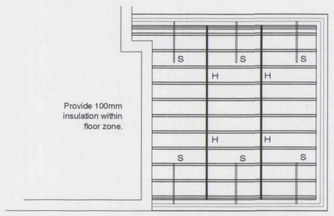

Provide 100mm insulation within floor zone.

Lay 22mm Weyroc Tongue and Grooved flooring grade wood particle boarding or equal approved on top of first floor joists with staggered joints

150 x 50 joists @ max.400mm ctrs. Solid herringbone stutting @ mid point to spans over 2m. Strutting at third points to span over 4m. Joists to be supported at all junctions with approved Joist Hangers with 75mm min. bearing on masonry and joist.Joist to be cut accurately for a tight fit in hanger with max.6mm gap. Joist bottom to be notched to keep ceiling line level.

All cut ends of joists to be sealed with suitable preservative

First and last joist to be clear of wall by 25-50mm to aid floor and services installation.


ALL TIMBER TO BE SC3 GRADE,DRY GRADED TO BS:4978 AND MARKED "DRY" or "KD"

PROPOSED JOIST PLAN
Scale 1:75

NOTE:MANUFACTURERS DETAILS & CALCULATIONS TO BE FORWARDED TO SHDCS BUILDING CONTROL OFFICER FOR APPROVAL AT LEAST 21 DAYS PRIOR TO FIXING ON SITE

Flat top trusses to be supplied with extended rafters for site cutting by others to suit Hip Rafter.Note:The horizontal top chords to the flat top trusses are to be well braced together to resist lateral buckling.

Compound Girder of flat top trusses permanently fixed together

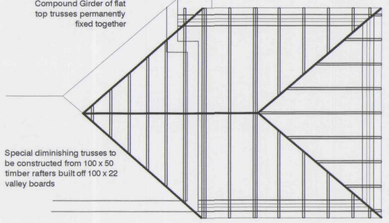

Special diminishing trusses to be constructed from 100 x 50 timber rafters built off 100 x 22 valley boards

Note:Provide 50x50 timber noggings for partition head fixing and pendant light fixings. Position of light fixings to be agreed on site with client.

ROOF PLAN
Not to Scale

All 25X100 diagonal and longitudinal wind bracing, and ceiling tie bracing to be free from all major defects and any weak points and fixed all in accordance with manufacturers details.Lap joints (if required) to be taken over 2no.trusses all in accordance with BS5268 Part 3 - 1985.Bracing to be fixed with 2no. 3.35 x 65mm galvanised round wire nails at each cross over and to firmly butt against walls.

Hip Rafters to be birdsmouthed over Pre Fabricated Compound Girder of Flat Top trusses and wallplate

30x5 m/s straps (S) over 2no. trusses at max 2m ctrs to gable ends and ceiling level. At least 1no.gable strap to be within 500mm of ridge.Provide solid noggings under each strap


Soffit and fascia profile to clients requirements fitted strictly in accordance with manufacturer's recommendations

Trussed Rafters to main roof to be at max.600mm ctrs.Roof construction to be designed strictly in accordance with BS5268 Part 3 1985 and to specialist manufacturers design drawings.Calculations to be submitted to the L.A building inspectors approval prior to any materials being placed on order.

Infill Jack Rafters to be min.25mm deeper than Trussed Rafters to allow for birdsmouthing at wallplate

Pre - Fabricated Mono pitch trusses by specialist to be fitted to girder truss with approved Girder Truss Shoe with min. bearing length of 90mm.

In order to minimise movement of the wallplate caused by the hip rafter, fix a 1200mm long galvanised steel angle restraint strap around the outside of the wallplate.

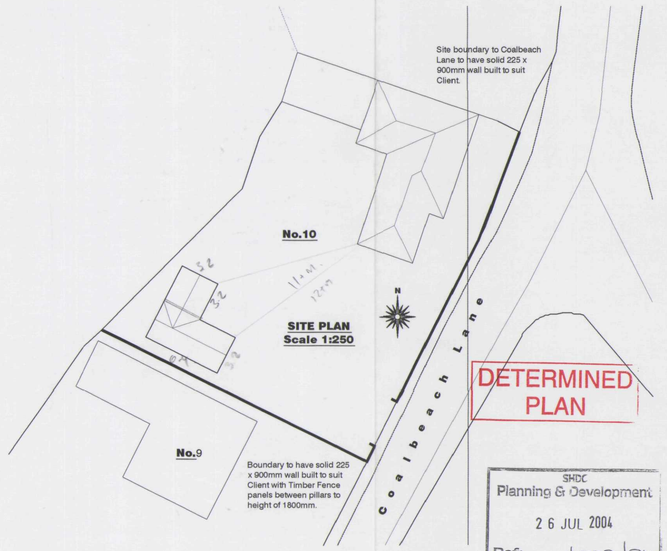

DETERMINED PLAN

SHDC
Planning & Development
26 JUL 2004
Ref: 1009/04