

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be steel, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

Build on new 2-storey extension in the manner shown.

Roof pitch to be similar to main roof - approximately 52½°, but ensure ridge is no higher than the existing house ridge.

Ground and first floors to be level with existing.

Roof trusses to be raised tie type as shown.

Provide and install Velux roof light where shown all in accordance with manufacturer's instructions.

First floor joists to be 50mm x 225mm SC3 grade at 400mm centres.

Roof tiles to match those of existing house roof.

External walls to be rendered and painted white and black to match those of existing house.

External walls at first floor level where they join existing first floor walls and do not have support from below to be of timber construction of 3mm skim finish on Gyproc Duplex plasterboard on 50mm x 125mm vertical studs at 400mm centres, built off existing roof, black breather paper, 6mm plywood face, 1 no. layer of DPC underlay, 38mm x 19mm battens, vertical hung tiles (colour to match main house roof). Provide 125mm Celotex 'Double R' insulation between studs. All timber to be SC3 grade. Provide 4lb lead flashings at junction with main roof.

Remove existing ground floor window and adjust opening to suit internal door into Study as shown.

Existing front door and side screen to be removed and opening adjusted to suit new window to stairs area as shown.

Make good to all disturbed and affected areas.

New/Old Walling
Where new walling meets old provide proprietary flexible wall starters.

Roof Ventilation to Sloping Ceiling
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

Valleys

Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Safety Glazing

Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection

Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods

PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Wall Construction

275mm cavity walls to consist of: 100mm face brickwork (see site plan for details), 75mm cavity to be filled with Crown Drithern full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved, 100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U-value. Cavity walls tied together using galvanised iron or plastic twist ties spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Habitable Room Trickle Ventilation

Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm².

Roof Insulation

To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.25 U-value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Roof Insulation to Sloping Ceiling

To sloping ceiling provide 96mm Celotex insulation. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Surface Water Drainage

To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

First Floor Construction

19mm flooring grade moisture resistant decking on timber joists as stated on plan. To external walls joists to be supported on joist hangers (not built into wall). Provide 30mm x 5mm mild steel restraint straps to joists running parallel with wall securely fixed to walls and to span minimum 3 no. joists at maximum 1200mm c/c. At strap positions provide pack and noggin to joists. Solid strutting to be installed mid-span where span of joists between 2.5m and 4.5m. For spans in excess of 4.5m position of struts at 1/3rd span. Double up floor joists locally under bath feet and hot water cylinder where applicable. All doubled up joists to be bolted together at 600mm centres. Provide 75mm fibreglass insulation between floor joists.

Roof Construction

Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Fascia and Bargeboards

To be 25 x 75mm PSE with 6mm groove to accept 6mm thick exterior grade plywood soffit.

Ceilings

To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Sub-structure Walling

100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

Ground Floor Construction

65mm sand/cement screed on proprietary 100 mm thick Jablite floor insulation or 60mm Celotex with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Lintels

All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor.

Opening at eaves level to be L1 E lintels by I.G. or similar approved.

Foundations

As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing

All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

First Floor Insulation

Provide 75mm fibreglass insulation between floor joists.

Brickwork below d.p.c. to be F.L. quality

All soakaways to be minimum 1m deep.

All external lintels to be insulated type.

All external joinery to be fully draught proofed.

Loft hatch to be draught sealed and latched shut.

Insulation in roof space to meet with insulation in external cavity walls to prevent cold bridging.


To all domestic floors to external perimeter walls provide 25mm thick insulation dressed up walls to prevent cold bridging.

Seal all openings and joints to perimeter walls.

All doors, windows and any loft hatches to be effectively sealed and draught proofed.


Provide a fibrous separating member between floor screed and insulation and provide chicken wire between insulation and screed.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m².

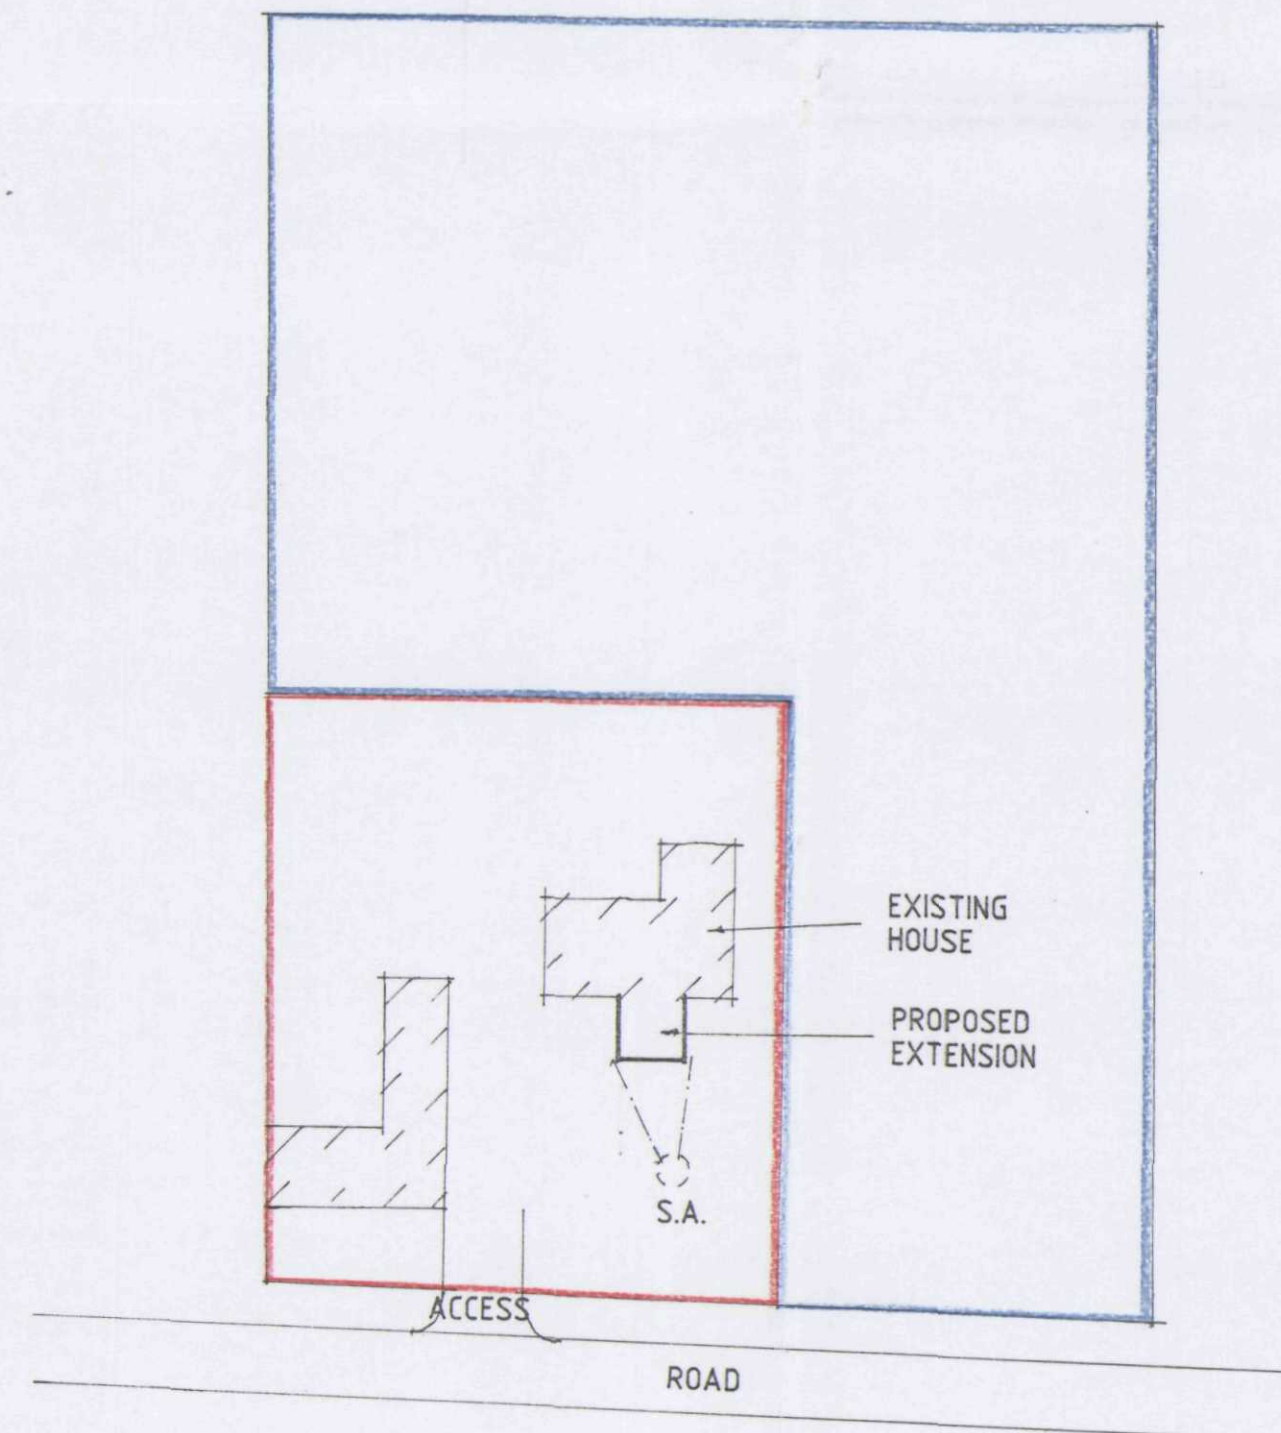

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH
SD03-095/1

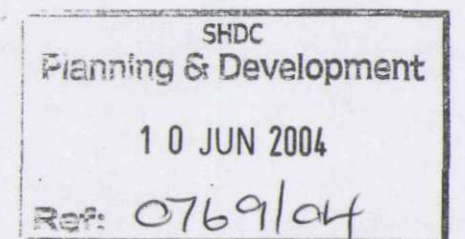

PROPOSED EXTENSION AT
GIBB FARM, PETERS POINT
SUTTON BRIDGE FOR

MRS. M. R. CONSTABLE.

1:500

MAY-04

SD03-095/2

B.GILHAM.

