on a scale of 250 to one

Demolition of existing washroom, to be rebuilt of similar appearance but larger.

At Guy's Head Lighthouse

tower

SO... HOUSING ...
30 AUG 1995
Ref: 0881/95

existing washroom

solid 10 inch wall to be demolished

Tower window

minimum 1.90 internal height in existing to be minimum in new.

wall angled to move similarly match radial nature of tower.

4 inch minimum concrete on hardcore with DPM.

new 250 mm cavity wall to be built on minimum 600 mm foundations minimum 600 mm deep.

foul water to existing septic tank

drainage to existing soakaway


existing window replaced ~~or~~ as "histaic buildings" might suggest

existing 30° roof pitch to be reduced to 27°
existing slates to be replaced with addition of similar

roof timbers 125 x 50 mm at 250 centres
4" minimum insulation

DETERMINED PLAN

cottage.

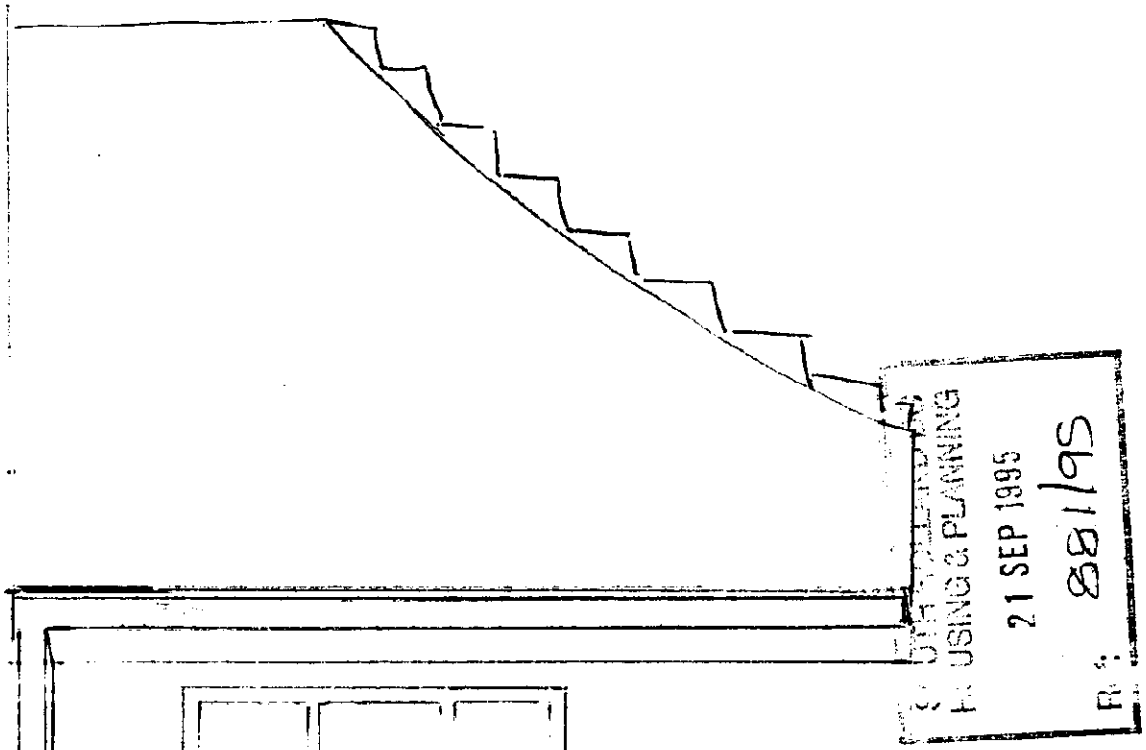

Gt 7's Head lighthouse
washroom alteration

Existing elevation

Scale at 20:1

ref application no
0881/95


existing 1980's window which replaced a 1950's metal framed window

see photographs supplied

21 SEP 1995
0881/95
PLANNING
DETERMINED
PLAN

Gurnard's Head Lighthouse

BLANK COTTAGE WITCC.

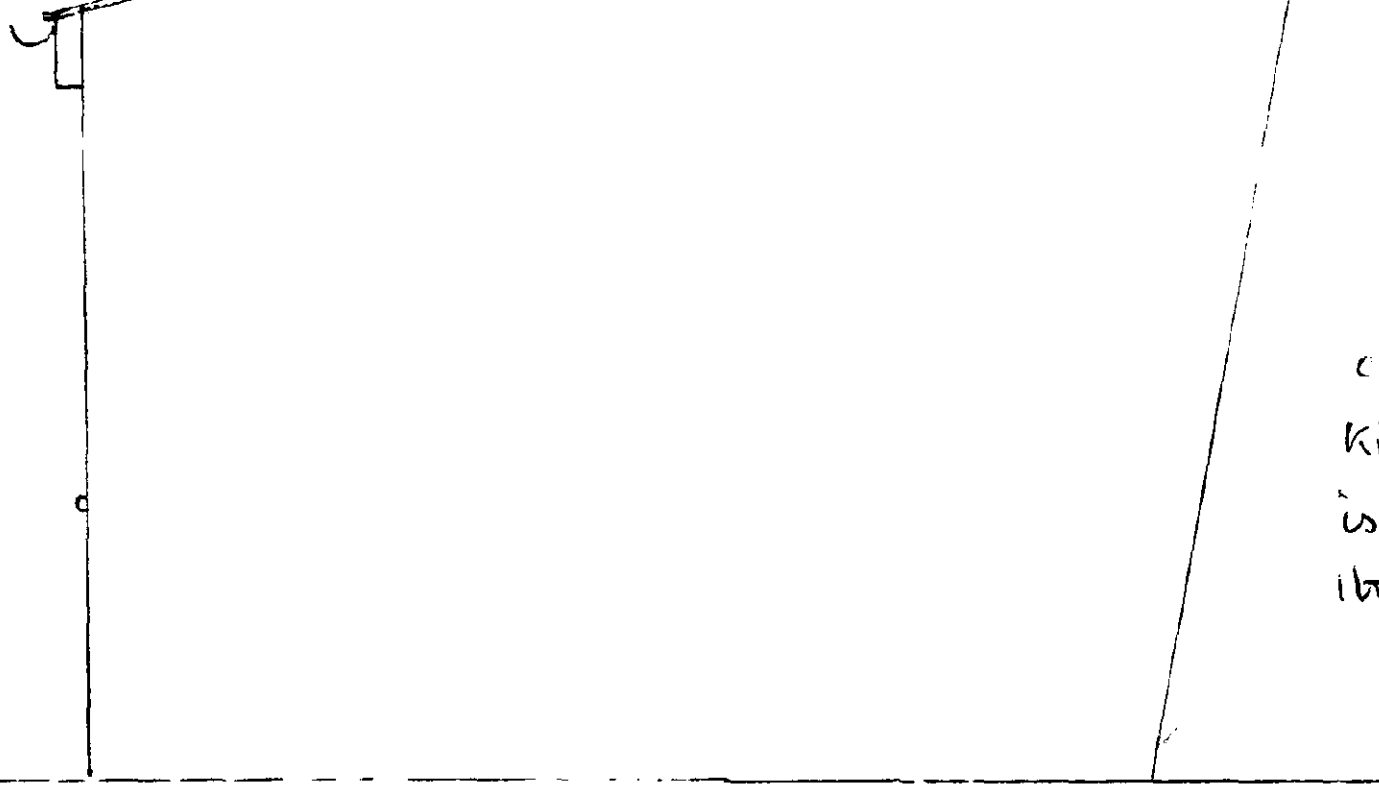

Proposed elevation
(no visible windows)


Scale of 20:1

TOWER

This elevation is concealed by a kitchen extension and is only visible from that kitchen

SOUTH HOLLAND HOUSING & PLANN
21 SEP 199
Ref: 881/95

DETERMINED
PLAN

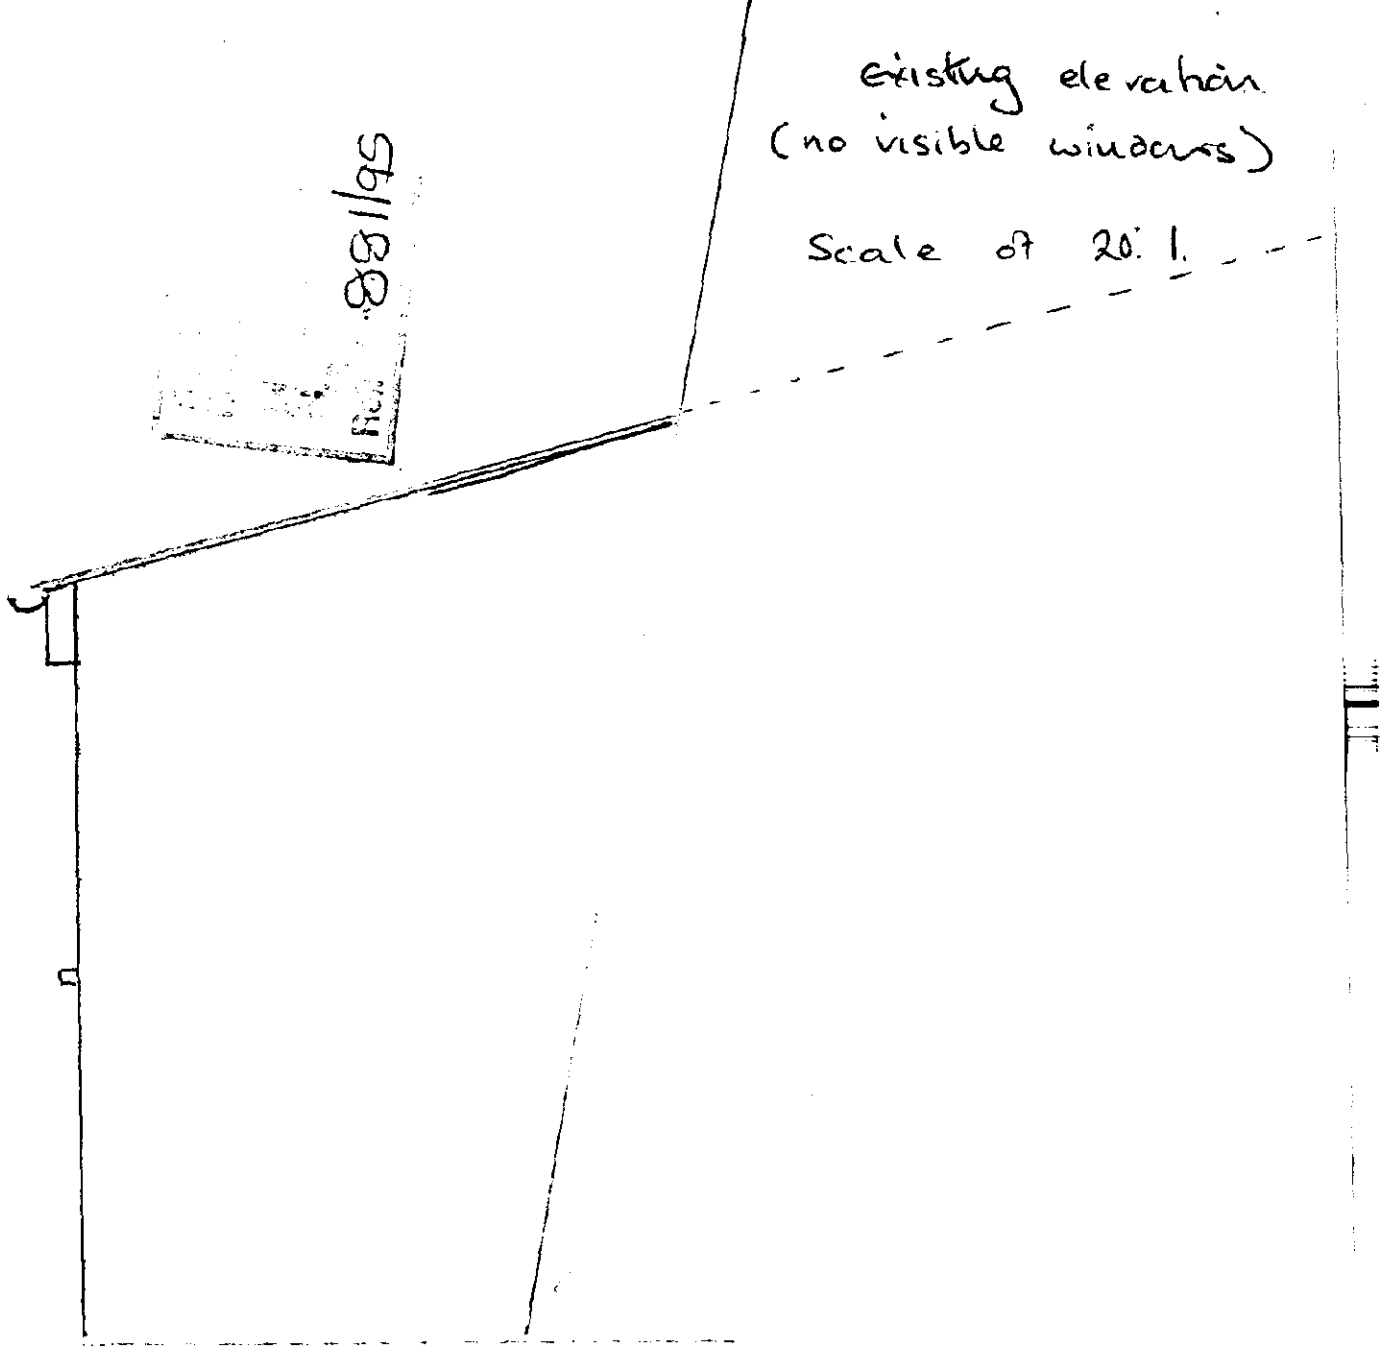


DETERMINED
PLAN

Guys Head Aquinas

proposed elevation

scale of 20:1

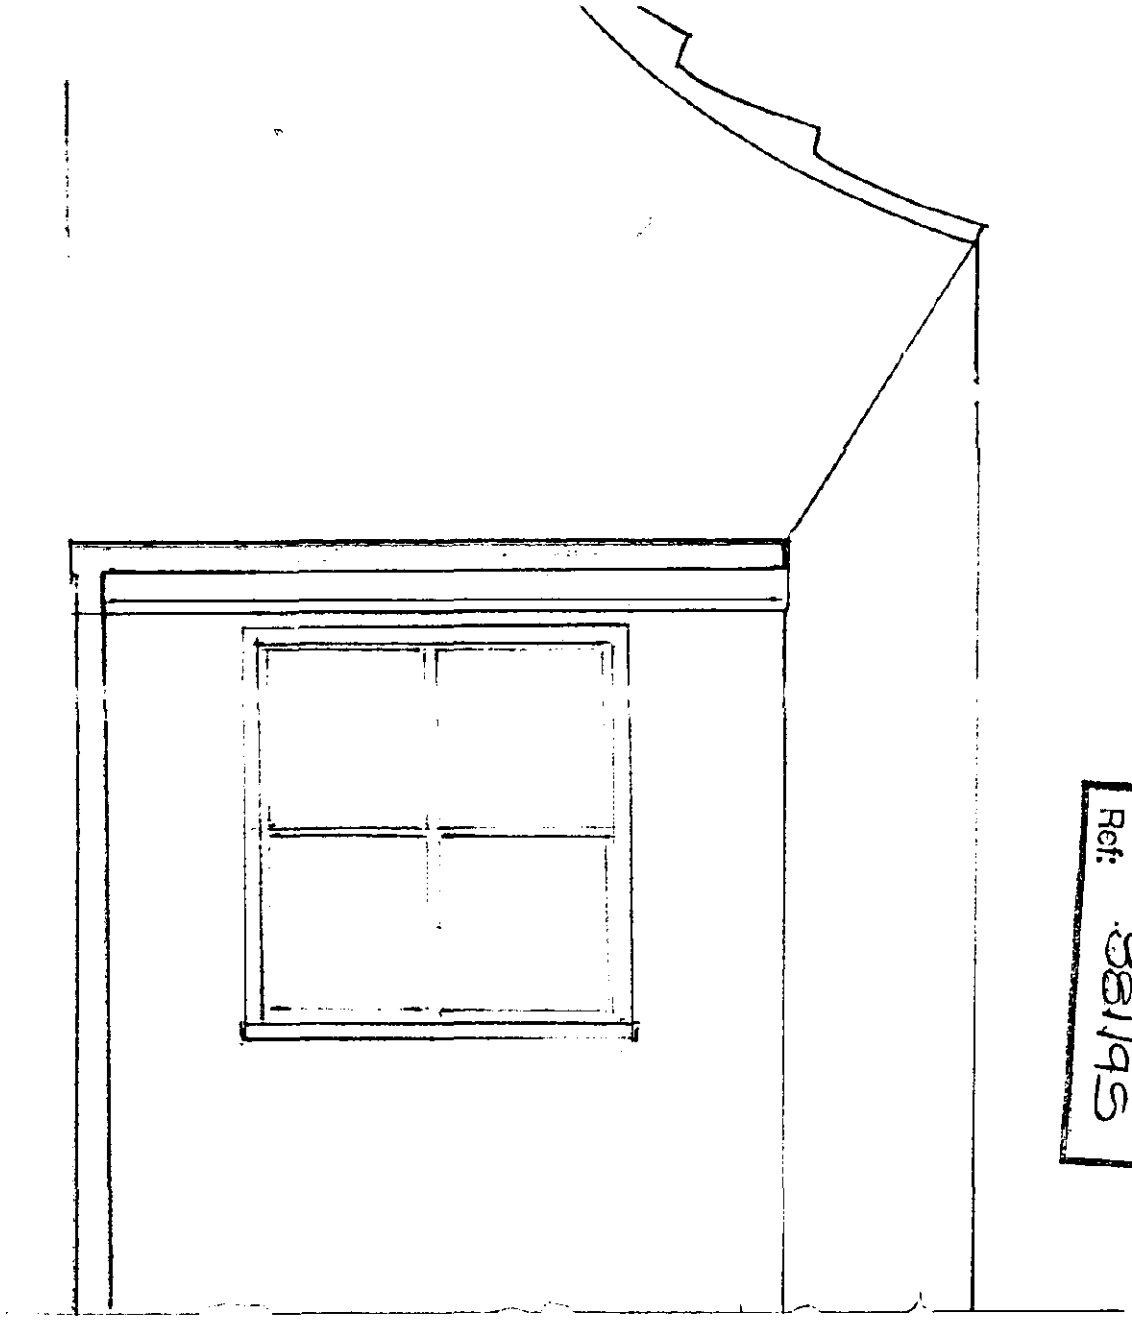

SOUTH HOLLAND DISTRICT COUNCIL
HOUSING & PLANNING
21 SEP 1995
Ref: 881/95

Victorian window, sash to replace non-descript existing window itself a replacement of a 1950's iron window.

DETERMINED
PLAN