
Drg. No. 20398

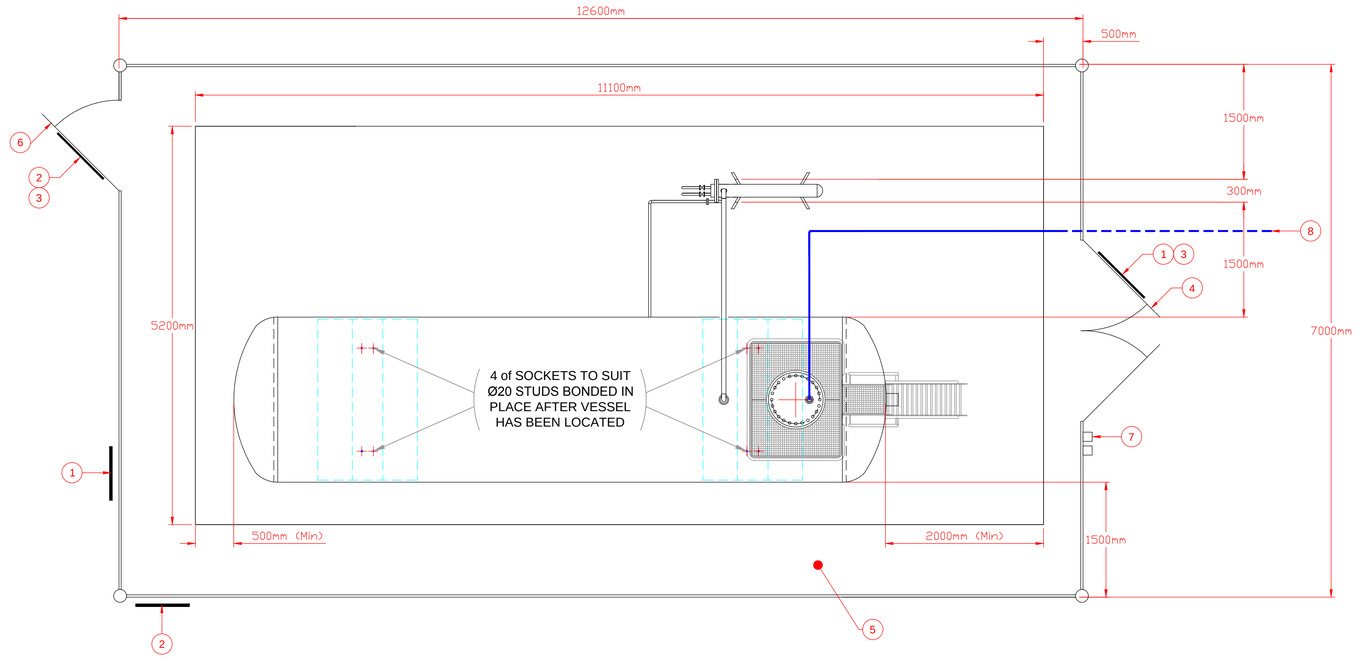

KEY:

1) WARNING NOTICE 1.
" COMPOUND SIGN" (NO SMOKING,
NO NAKED LIGHTS) 510mm x 340mm

2) WARNING NOTICE 2.
" EMERGENCY SERVICE SIGN"
300mm x 200mm

3) WARNING NOTICE 3.
" TRIP HAZARD SIGN"
300mm x 200mm

4) ACCESS GATE, (SEE SPEC ON THE RIGHT).

5) CONCRETE OR GRAVEL AREA LAID ON
A IMPERVIOUS MEMBRANE.

6) EMERGENCY GATE, (SEE SPEC ON THE RIGHT).

7) TANK SIZES ABOVE 2000L, REQUIRE
WATER SUPPLY FOR FIRE SERVICE USE,
(NO FURTHER THAN 100m FROM VESSELS)
- 19MM HOSE REEL
- 2 x 9KG DRY POWDER EXTINGUISHERS
IN BOXES.

8) VAPOUR SUPPLY UNDERGROUND
FROM INSIDE COMPOUND.
(POSITION TO SUIT)

NOTES:

1. REFER TO DRG No:
20005 FOR TYPE 662 VESSEL DETAILS
14586 FOR ACCESS LADDER & PLATFORM

2. DESIGN CONCRETE PLINTH TO SUIT SOIL CONDITIONS.
THE DESIGN LOAD SHALL BE 40 TONNES - PER TANK -
20 TONNES PER PLINTH.

3. SLOPE OF BASE IS TO BE 1:100 TO BACK

4. MINIMUM SAFETY DISTANCES:
15 M FROM BUILDING/PROPERTY LINE OR FIXED POINT OF IGNITION.
1.5 M FROM TANK TO COMPOUND FENCE.
1.5 M BETWEEN TANKS

MINIMUM SEPARATION DISTANCE OF 15 METRES MUST BE MAINTAINED AROUND THE VESSELS. THIS DEMARCATION AREA SHOULD BE CLEAR FROM BUILDINGS, BOUNDARIES, PROPERTY LINES OR ANY FIXED SOURCES OF IGNITION, INCLUDING ROADWAYS AND VEHICULAR PARKING AREAS (OTHER THAN FILLING VEHICLE ACCESS).

SEPARATION DISTANCE TO BE FREE FROM PITS, DEPRESSIONS OR ANY UN-TRAPPED DRAINS.

5. COMPOUND AREA SURROUNDING CONCRETE BASE TO BE FREE FROM COMBUSTIBLE MATERIALS AND FINISHED WITH IMPERFORATE SURFACING TO PREVENT GROWTH OF WEEDS.

6. COMPOUND SECURITY FENCE SHOULD BE CHAIN LINK OR OPEN MESH CONSTRUCTION WHICH ENSURES ADEQUATE VENTILATION WITH A MINIMUM HEIGHT OF 1.8M, TO COMPLY WITH UKLPGA COP 1.

ENTRANCE GATES TO BE NON SELFLOCKING AND SHOULD NOT BE ADJACENT TO EACH OTHER, GATES TO OPEN OUTWARDS.

7. IF VESSELS REQUIRE VEHICLE PROTECTION
FIT ARMCO BARRIERS 1 METRE MINIMUM
OFFSET FROM CONCRETE BASE


8. EARTH KIT TO BE ATTACHED TO VESSEL ADJACENT TO THE MAIN VESSEL FILL CONNECTION.


9. POSITION OF CONTROL HOUSING FOR VAPORISER CONTROL PANEL AND LPG ELECTRICAL SUPPIES TO BE CONFIRMED WITH CLIENT.

REVISIONS

B 18/05/15
Various compound alterations.
DRN: S. Phull
CHKD: C. Crane

C 03/06/15
1x12T Install added.
DRN: S. Phull
CHKD: C. Crane

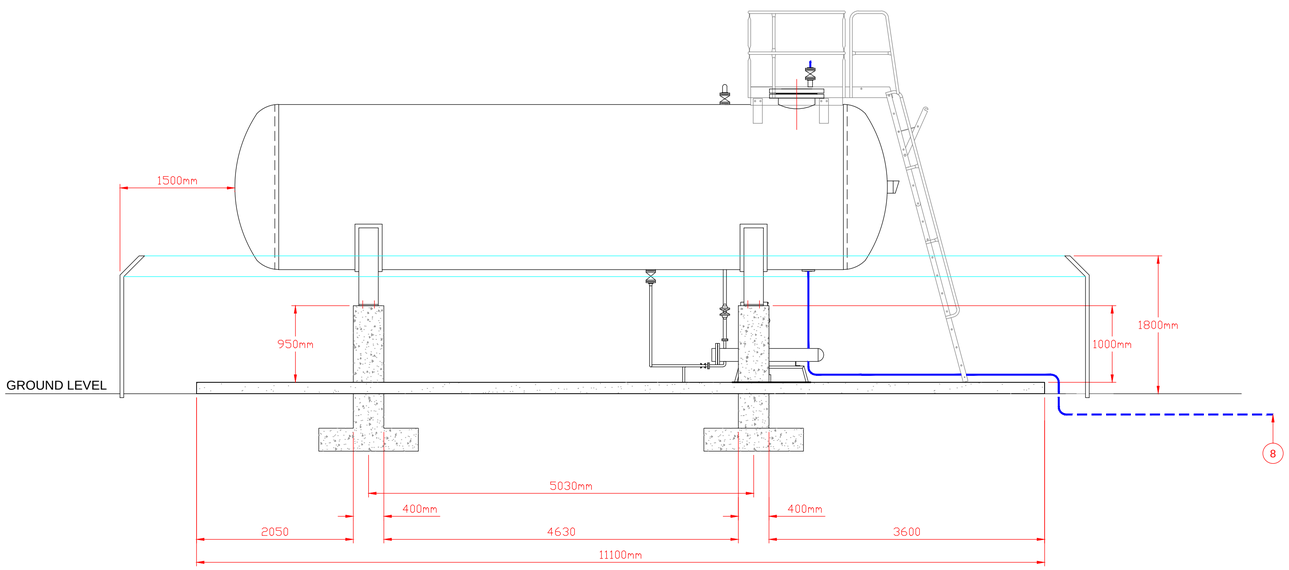

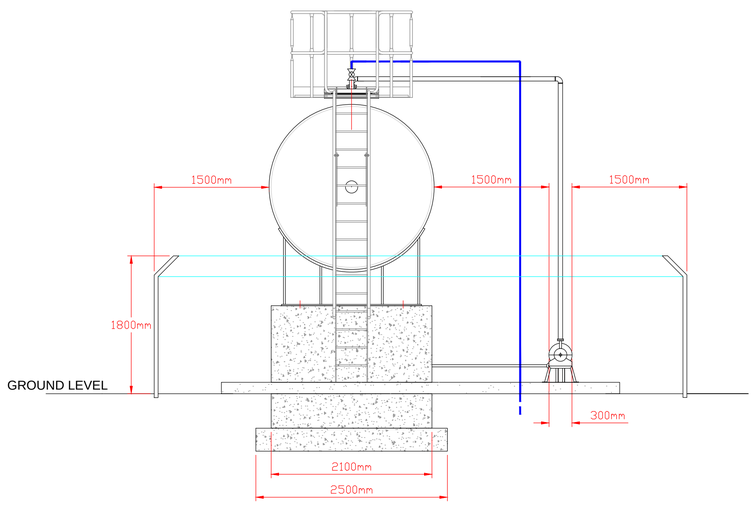

Sheet 1 : 1 x 12T Install
Sheet 2 : 2 x 12T Install
Sheet 2 : 3 x 12T Install

PRIVATE & CONFIDENTIAL
THIS DRAWING IS THE PROPERTY OF CALOR GAS LIMITED AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE PERMISSION OF THE COMPANY.


CALOR
Calor Gas Limited, Athena House, Athena Drive,
Tachbrook Park, Warwick, CV34 6RL
Tel: 01926 330088 www.calor.co.uk

Standard installation for
1 x 12T Vessels & Vapeg Vaporiser
Sheet 1 off 3

References

Date	27/04/14
Drawn By	S.Phull
Checked By	M.Baker
Scale	1:40
Paper Size	A1
Issue	C
Drg. No.	20398

Drg. No. 20398

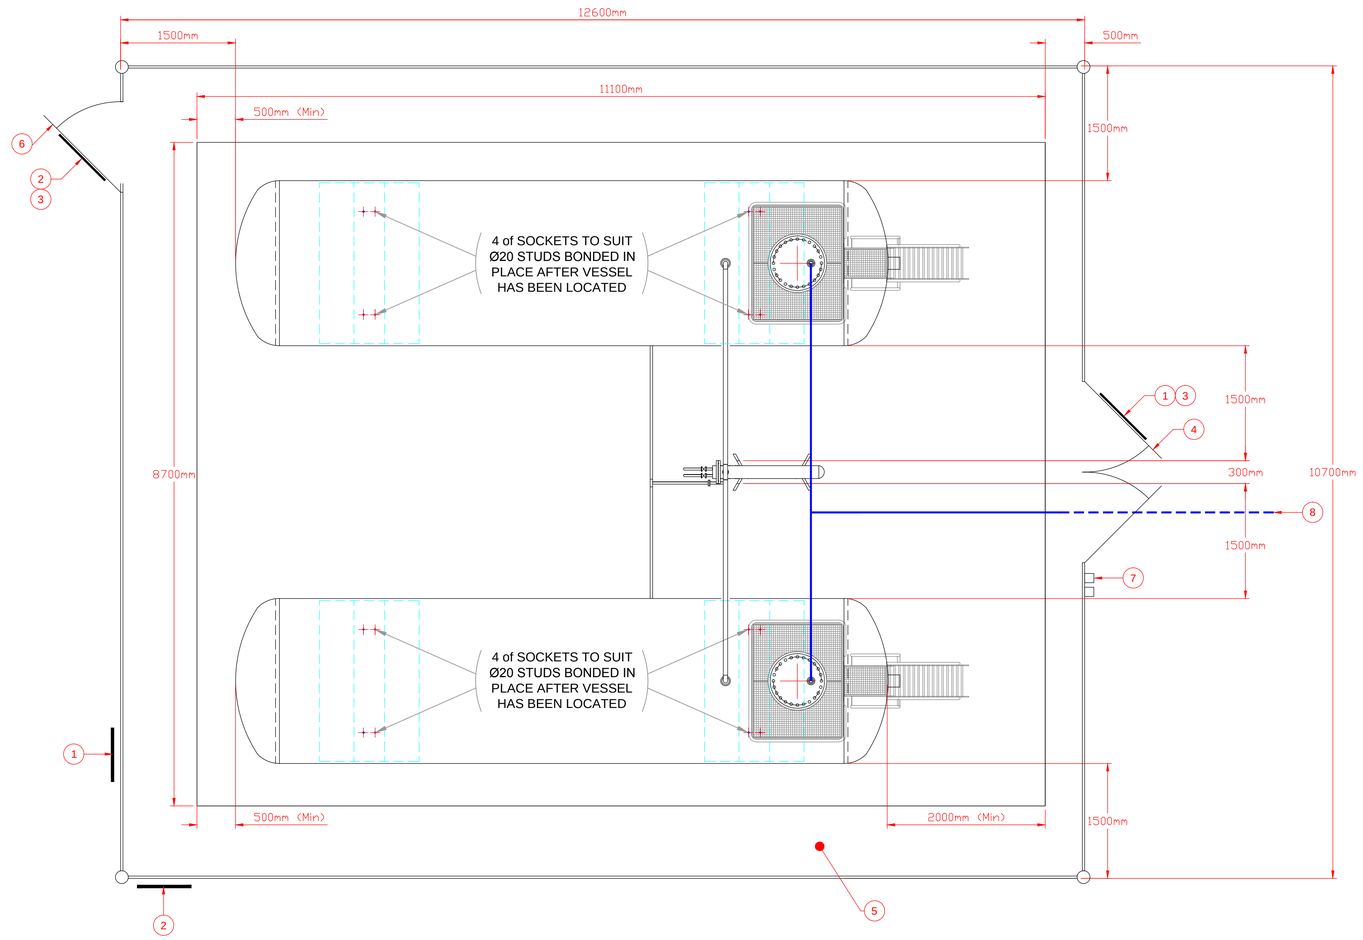

KEY:

1) WARNING NOTICE 1.
" COMPOUND SIGN" (NO SMOKING, NO NAKED LIGHTS) 510mm x 340mm

2) WARNING NOTICE 2.
" EMERGENCY SERVICE SIGN"
300mm x 200mm

3) WARNING NOTICE 3.
" TRIP HAZARD SIGN"
300mm x 200mm

4) ACCESS GATE, (SEE SPEC ON THE RIGHT).

5) CONCRETE OR GRAVEL AREA LAID ON A IMPERVIOUS MEMBRANE.

6) EMERGENCY GATE, (SEE SPEC ON THE RIGHT).

7) TANK SIZES ABOVE 2000L, REQUIRE WATER SUPPLY FOR FIRE SERVICE USE, (NO FURTHER THAN 100m FROM VESSELS)
- 19MM HOSE REEL
- 2 x 9KG DRY POWDER EXTINGUISHERS IN BOXES.

8) VAPOUR SUPPLY UNDERGROUND FROM INSIDE COMPOUND. (POSITION TO SUIT)

NOTES:

1. REFER TO DRG No:
20005 FOR TYPE 662 VESSEL DETAILS
14586 FOR ACCESS LADDER & PLATFORM

2. DESIGN CONCRETE PLINTH TO SUIT SOIL CONDITIONS.
THE DESIGN LOAD SHALL BE 40 TONNES - PER TANK -
20 TONNES PER PLINTH.

3. SLOPE OF BASE IS TO BE 1:100 TO BACK

4. MINIMUM SAFETY DISTANCES:
15 M FROM BUILDING/PROPERTY LINE OR FIXED POINT OF IGNITION.
1.5 M FROM TANK TO COMPOUND FENCE.
1.5 M BETWEEN TANKS

MINIMUM SEPARATION DISTANCE OF 15 METRES MUST BE MAINTAINED AROUND THE VESSELS. THIS DEMARCATION AREA SHOULD BE CLEAR FROM BUILDINGS, BOUNDARIES, PROPERTY LINES OR ANY FIXED SOURCES OF IGNITION, INCLUDING ROADWAYS AND VEHICULAR PARKING AREAS (OTHER THAN FILLING VEHICLE ACCESS).

SEPARATION DISTANCE TO BE FREE FROM PITS, DEPRESSIONS OR ANY UN-TRAPPED DRAINS.

5. COMPOUND AREA SURROUNDING CONCRETE BASE TO BE FREE FROM COMBUSTIBLE MATERIALS AND FINISHED WITH IMPERFORATE SURFACING TO PREVENT GROWTH OF WEEDS.

6. COMPOUND SECURITY FENCE SHOULD BE CHAIN LINK OR OPEN MESH CONSTRUCTION WHICH ENSURES ADEQUATE VENTILATION WITH A MINIMUM HEIGHT OF 1.8M, TO COMPLY WITH UKLPGA COP 1.

ENTRANCE GATES TO BE NON SELFLOCKING AND SHOULD NOT BE ADJACENT TO EACH OTHER, GATES TO OPEN OUTWARDS.


7. IF VESSELS REQUIRE VEHICLE PROTECTION FIT ARMCO BARRIERS 1 METRE MINIMUM OFFSET FROM CONCRETE BASE


8. EARTH KIT TO BE ATTACHED TO VESSEL ADJACENT TO THE MAIN VESSEL FILL CONNECTION.

9. POSITION OF CONTROL HOUSING FOR VAPORISER CONTROL PANEL AND LPG ELECTRICAL SUPPIES TO BE CONFIRMED WITH CLIENT.

REVISIONS

B	18/05/15
Various compound alterations.	
DRN: S. Phull	
CHKD: C. Crane	
C	03/06/15
1x12T Install added.	
DRN: S. Phull	
CHKD: C. Crane	

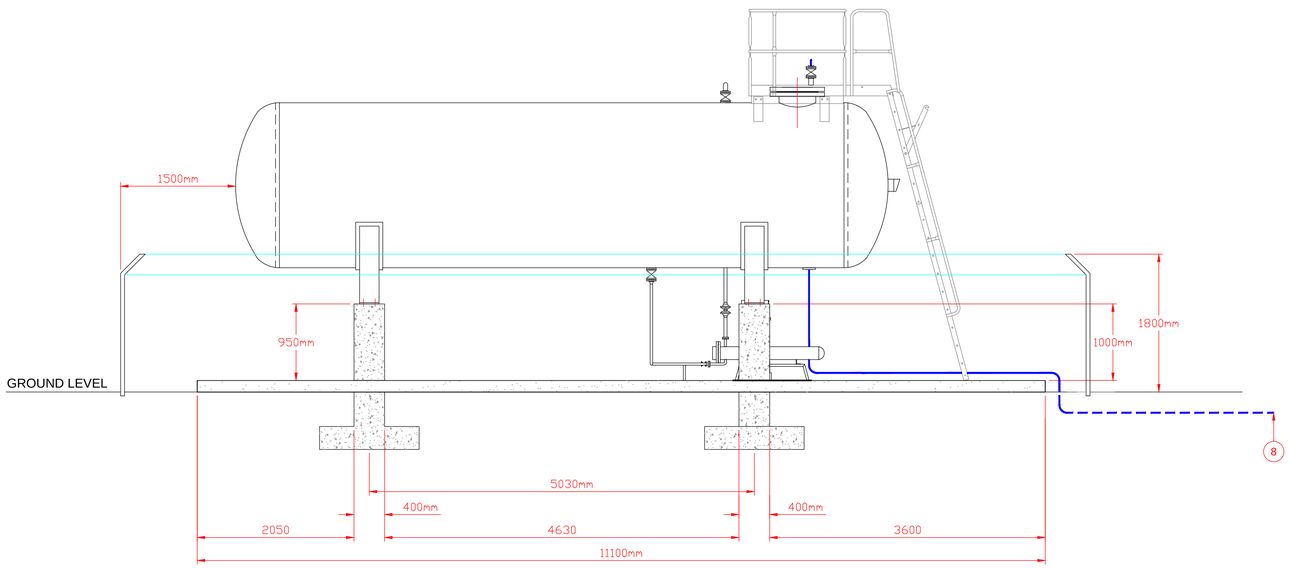

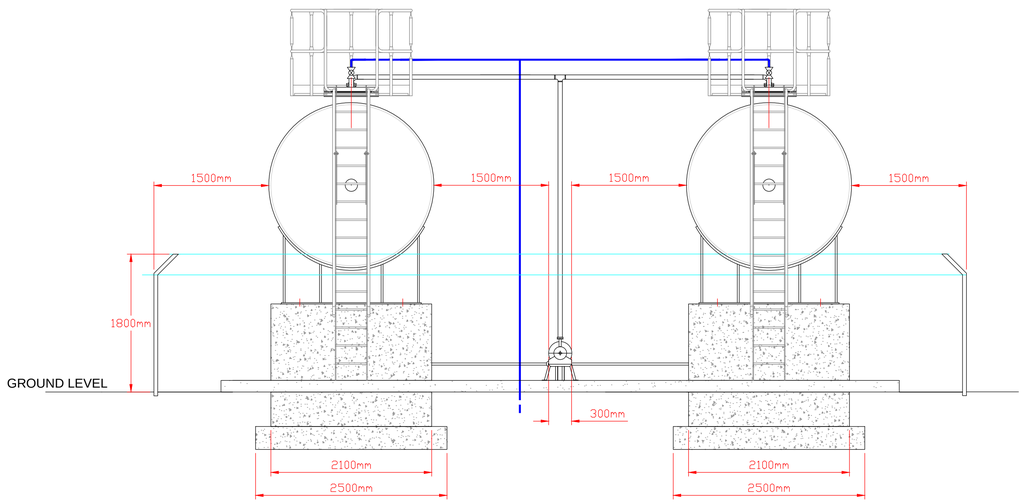

Sheet 1 : 1 x 12T Install
Sheet 2 : 2 x 12T Install
Sheet 2 : 3 x 12T Install

PRIVATE & CONFIDENTIAL

THIS DRAWING IS THE PROPERTY OF CALOR GAS LIMITED AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE PERMISSION OF THE COMPANY.

CALOR


Calor Gas Limited, Athena House, Athena Drive, Tachbrook Park, Warwick, CV34 6RL
Tel: 01926 330088 www.calor.co.uk


Standard installation for
2 x 12T Vessels & Vapeg Vaporiser
Sheet 2 off 3


References

Date	27/04/14
Drawn By	S.Phull
Checked By	M.Baker
Scale	1:40
Paper Size	A1
Issue	C
Drg. No.	20398

Drg. No. 20398

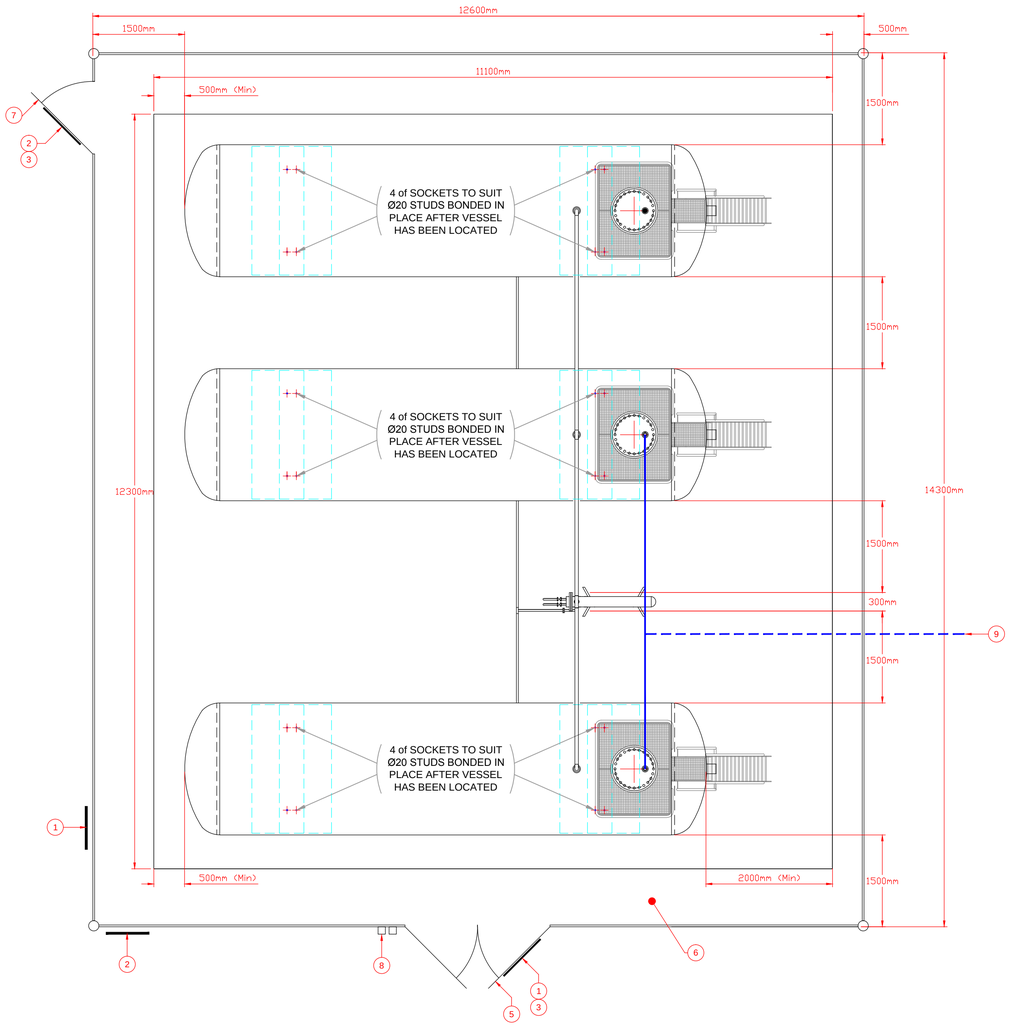

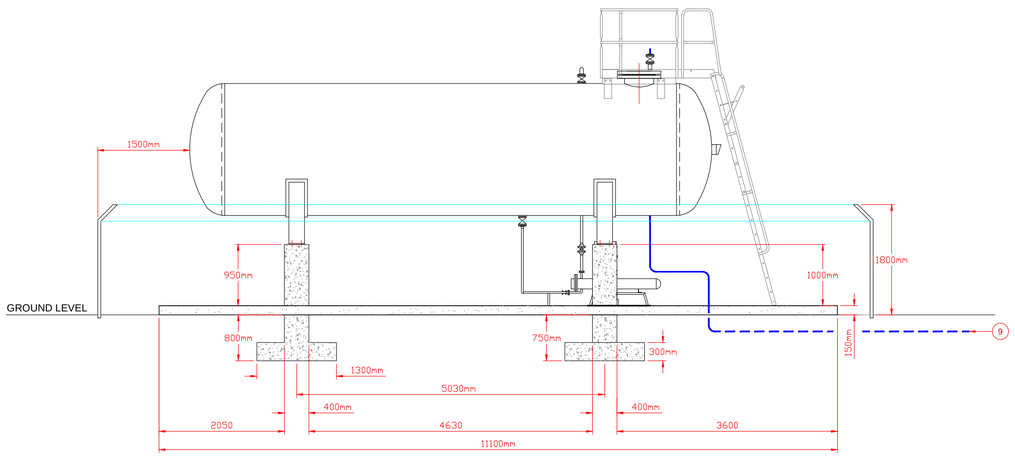

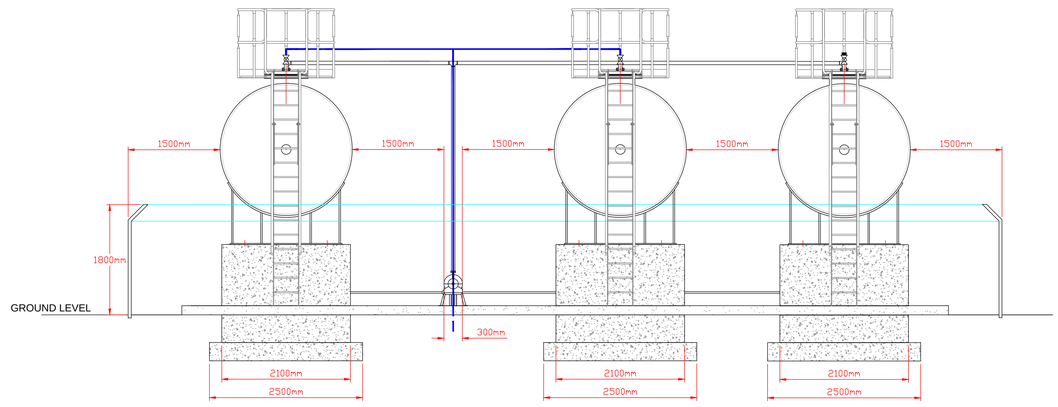

KEY:

1) WARNING NOTICE 1.
" COMPOUND SIGN" (NO SMOKING, NO NAKED LIGHTS) 510mm x 340mm

2) WARNING NOTICE 2.
" EMERGENCY SERVICE SIGN"
300mm x 200mm

3) WARNING NOTICE 3.
" TRIP HAZARD SIGN"
300mm x 200mm

4) ACCESS GATE, (SEE SPEC ON THE RIGHT).

5) CONCRETE OR GRAVEL AREA LAID ON A IMPERVIOUS MEMBRANE.

6) EMERGENCY GATE, (SEE SPEC ON THE RIGHT).

7) TANK SIZES ABOVE 2000L, REQUIRE WATER SUPPLY FOR FIRE SERVICE USE, (NO FURTHER THAN 100m FROM VESSELS)
- 19MM HOSE REEL
- 2 x 9KG DRY POWDER EXTINGUISHERS IN BOXES.

8) VAPOUR SUPPLY UNDERGROUND FROM INSIDE COMPOUND. (POSITION TO SUIT)

NOTES:

1. REFER TO DRG No:
20005 FOR TYPE 662 VESSEL DETAILS
14586 FOR ACCESS LADDER & PLATFORM

2. DESIGN CONCRETE PLINTH TO SUIT SOIL CONDITIONS.
THE DESIGN LOAD SHALL BE 40 TONNES - PER TANK -
20 TONNES PER PLINTH.

3. SLOPE OF BASE IS TO BE 1:100 TO BACK

4. MINIMUM SAFETY DISTANCES:
15 M FROM BUILDING/PROPERTY LINE OR FIXED POINT OF IGNITION.
1.5 M FROM TANK TO COMPOUND FENCE.
1.5 M BETWEEN TANKS

MINIMUM SEPARATION DISTANCE OF 15 METRES MUST BE MAINTAINED AROUND THE VESSELS. THIS DEMARCATION AREA SHOULD BE CLEAR FROM BUILDINGS, BOUNDARIES, PROPERTY LINES OR ANY FIXED SOURCES OF IGNITION, INCLUDING ROADWAYS AND VEHICULAR PARKING AREAS (OTHER THAN FILLING VEHICLE ACCESS).

SEPARATION DISTANCE TO BE FREE FROM PITS, DEPRESSIONS OR ANY UN-TRAPPED DRAINS.

5. COMPOUND AREA SURROUNDING CONCRETE BASE TO BE FREE FROM COMBUSTIBLE MATERIALS AND FINISHED WITH IMPERFORATE SURFACING TO PREVENT GROWTH OF WEEDS.

6. COMPOUND SECURITY FENCE SHOULD BE CHAIN LINK OR OPEN MESH CONSTRUCTION WHICH ENSURES ADEQUATE VENTILATION WITH A MINIMUM HEIGHT OF 1.8M, TO COMPLY WITH UKLPGA COP 1.

ENTRANCE GATES TO BE NON SELFLOCKING AND SHOULD NOT BE ADJACENT TO EACH OTHER, GATES TO OPEN OUTWARDS.

7. IF VESSELS REQUIRE VEHICLE PROTECTION FIT ARMCO BARRIERS 1 METRE MINIMUM OFFSET FROM CONCRETE BASE

8. EARTH KIT TO BE ATTACHED TO VESSEL ADJACENT TO THE MAIN VESSEL FILL CONNECTION.

9. POSITION OF CONTROL HOUSING FOR VAPORISER CONTROL PANEL AND LPG ELECTRICAL SUPPIES TO BE CONFIRMED WITH CLIENT.

REVISIONS

B	18/05/15
Various compound alterations.	
DRN: S. Phull	
CHKD: C. Crane	
C	03/06/15
1x12T Install added.	
DRN: S. Phull	
CHKD: C. Crane	

Sheet 1 : 1 x 12T Install
Sheet 2 : 2 x 12T Install
Sheet 2 : 3 x 12T Install

PRIVATE & CONFIDENTIAL

THIS DRAWING IS THE PROPERTY OF CALOR GAS LIMITED AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE PERMISSION OF THE COMPANY.

CALOR

Calor Gas Limited, Athena House, Athena Drive, Tachbrook Park, Warwick, CV34 6RL
Tel: 01926 330088 www.calor.co.uk

Standard installation for
3 x 12T Vessels & Vapeg Vaporiser
Sheet 3 off 3

References

Date	27/04/14
Drawn By	S.Phull
Checked By	M.Baker
Scale	1:50
Paper Size	A1
Issue	C
Drg. No.	20398