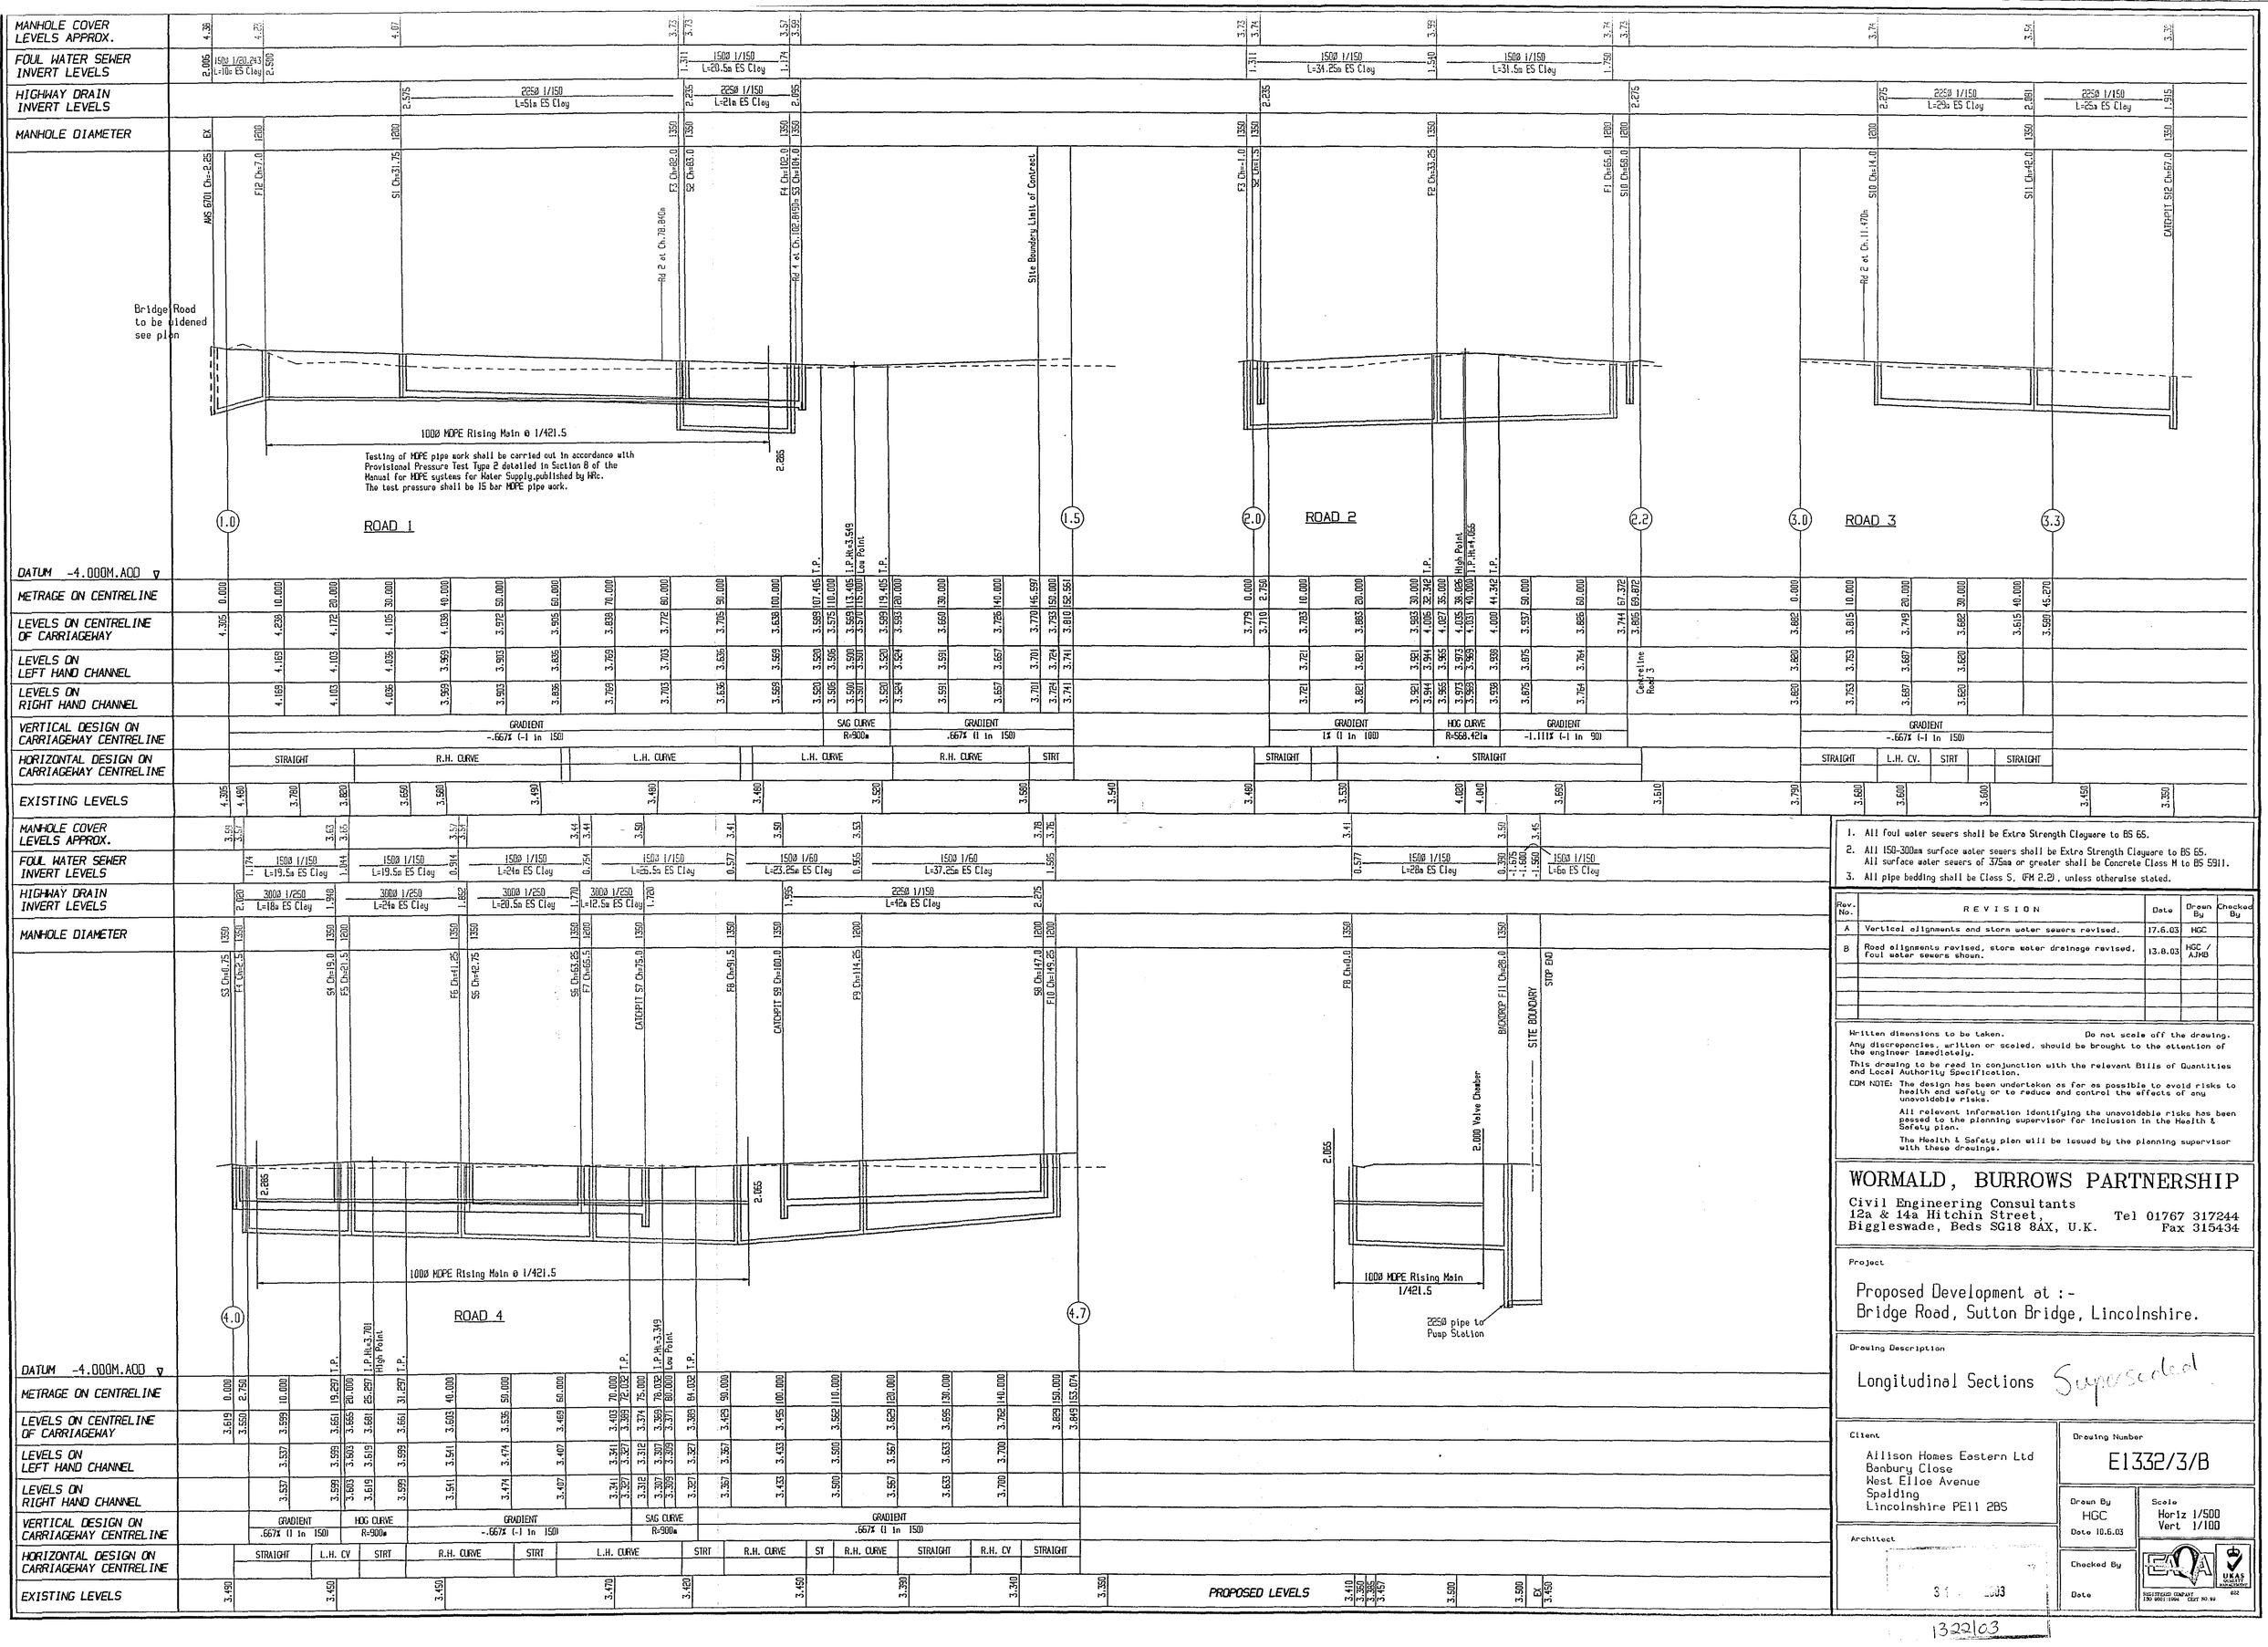


1. All foul water sewers shall be Extra Strength Clayware to BS 65.
2. All 150-300mm surface water sewers shall be Extra Strength Clayware to BS 65. All surface water sewers of 375mm or greater shall be Concrete Class M to BS 5911.
3. All pipe bedding shall be Class S, (FM 2.2), unless otherwise stated.

Rev. No.	REVISION	Date	Drawn By	Checked By
A	Vertical alignments and storm water sewers revised.	17.6.03	HGC	
B	Road alignments revised, storm water drainage revised, foul water sewers shown.	13.8.03	HGC / AJMB	

Written dimensions to be taken. Do not scale off the drawing.

Any discrepencies, written or scaled, should be brought to the attention of the engineer immediately.

This drawing to be read in conjunction with the relevant Bills of Quantities and Local Authority Specification.

CDM NOTE: The design has been undertaken as far as possible to avoid risks to health and safety or to reduce and control the effects of any unavoidable risks.

All relevant information identifying the unavoidable risks has been passed to the planning supervisor for inclusion in the Health & Safety plan.

The Health & Safety plan will be issued by the planning supervisor with these drawings.

WORMALD, BURROWS PARTNERSHIP
Civil Engineering Consultants
12a & 14a Hitchin Street, Tel 01767 317244
Biggleswade, Beds SG18 8AX, U.K. Fax 315434

Project

Proposed Development at :-
Bridge Road, Sutton Bridge, Lincolnshire.

Drawing Description

Longitudinal Sections Superseded

Client

Allison Homes Eastern Ltd
Banbury Close
West Elloe Avenue
Spalding
Lincolnshire PE11 2BS

Drawing Number

E1332/3/B

Drawn By HGC
Date 10.6.03

Scale
Horiz 1/500
Vert 1/100

Architect

Checked By

Date 31 [illegible]03

1322103