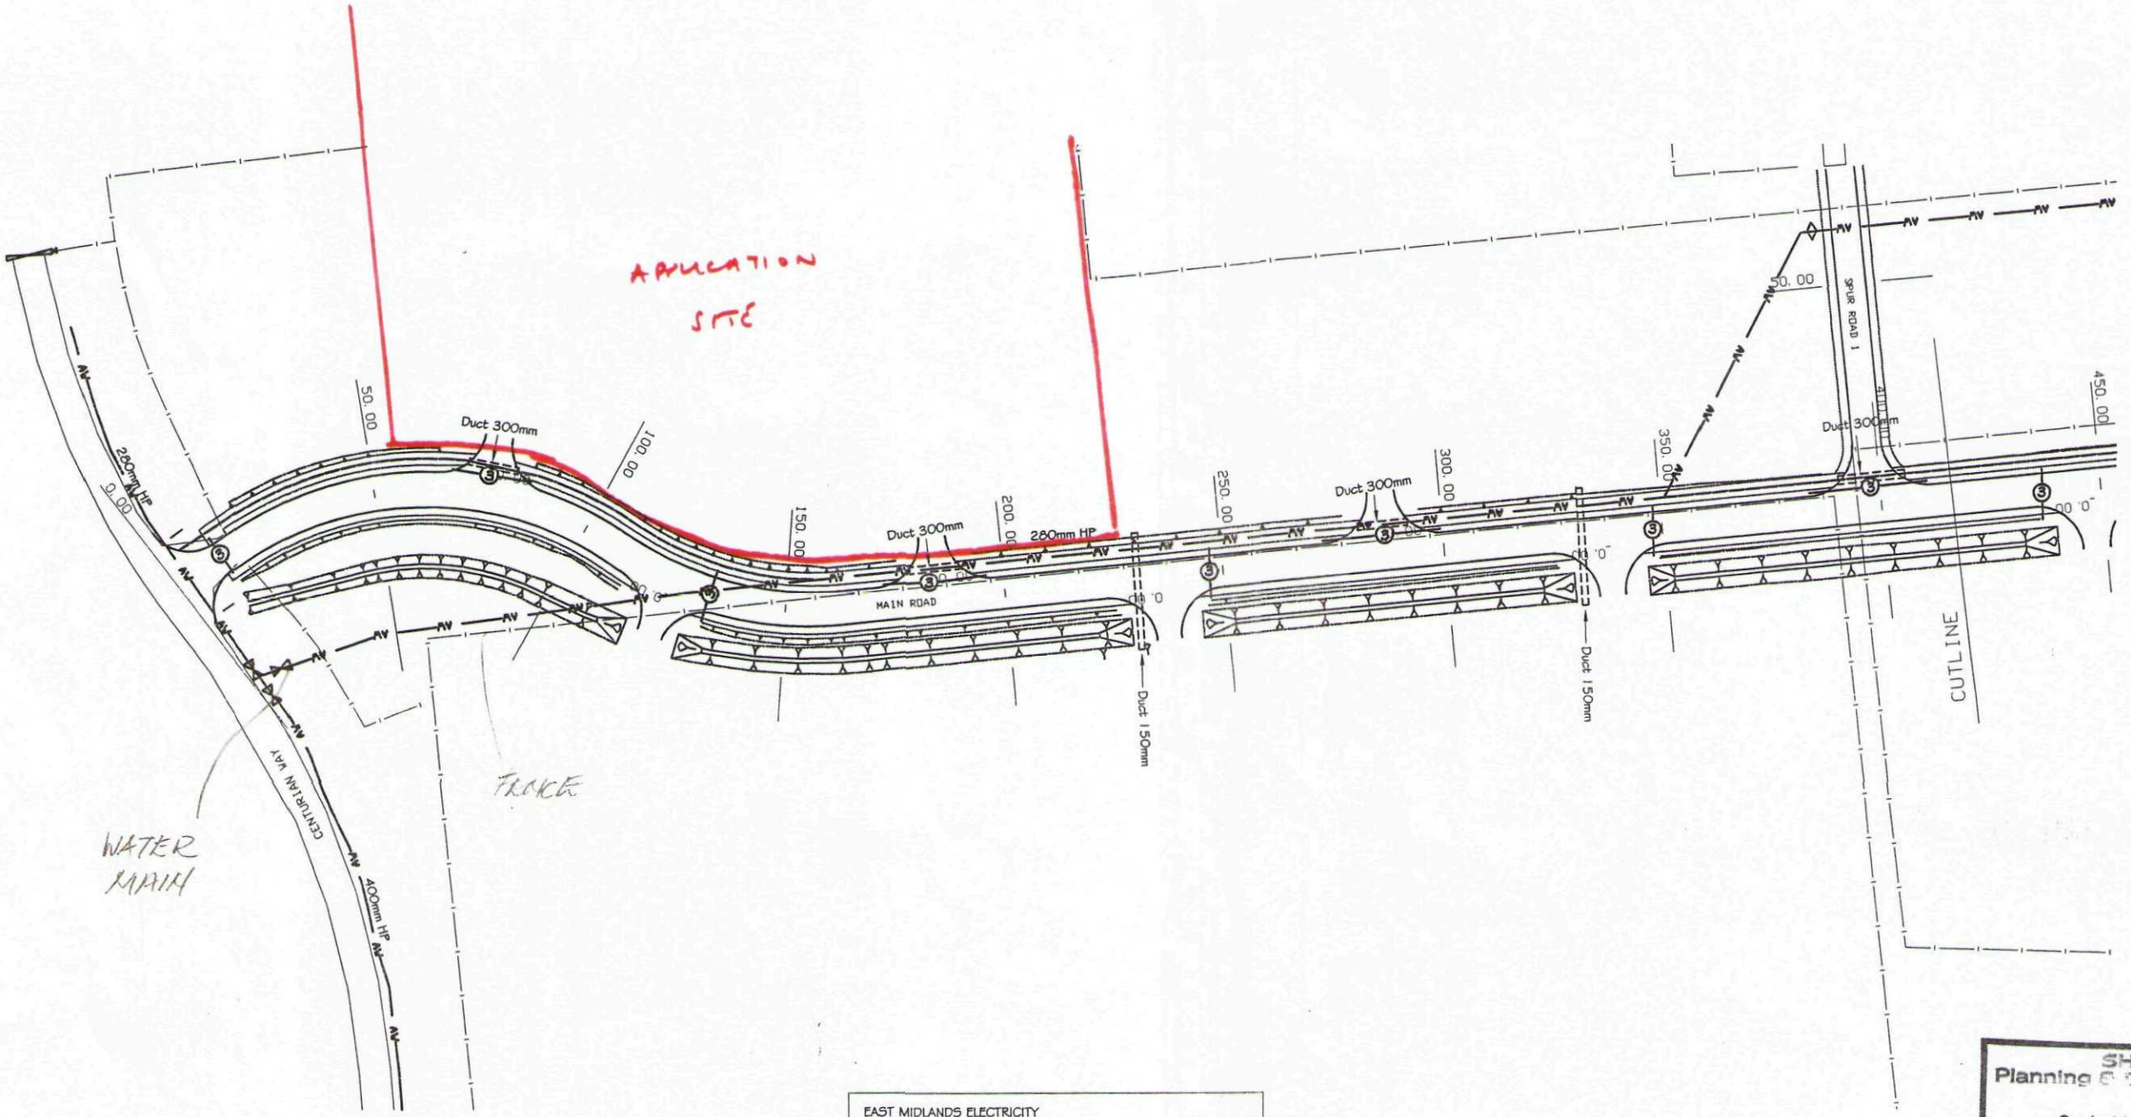


EAST MIDLANDS ELECTRICITY

—— LV —— EXISTING UG/OH LOW VOLTAGE

—⊗— X No. 100mm DIA. DUCTS TO BE LAID BY CONTRACTOR. GROUP Z 400mm BENEATH CARRIAGEWAY, GROUP 5 750mm BENEATH FOOTWAY AND VERGE.

ANGLIAN WATER SERVICES Ltd

—— AW —— EXISTING OPERATIONAL POTABLE WATER MAIN

———— PROPOSED WATER MAIN (to be laid by AW Contractor)

DUCT TO BE LAID BY CONTRACTOR. GROUP Z BENEATH CARRIAGEWAY, TYPE 5 BENEATH FOOTWAY AND VERGE. DUCT TO BE LAID UP TO WATER MAIN WITH 900mm COVER AND TERMINATED 1m BEHIND HIGHWAY BOUNDARY

SLUICE VALVE

WASHOUT VALVE

WASHOUT

AIR VALVE

SHDC Planning & Development
04 MAR 2005
Ref: 1374/04

DETERMINED PLAN

Amendment details

LINCOLNSHIRE - Part of the East Midlands Region

LINCOLNSHIRE COUNTY COUNCIL
HIGHWAYS & PLANNING DIRECTORATE
P.D. JAMESON, B.Sc.,C.Eng.,F.I.C.E., Head of Technical Services
Witham Park House, Witham Park, Waterside South, Lincoln LN5 7JN

DRG.No. A/S05033/31

Archive No.

SUTTON BRIDGE
WINGLAND ENTERPRISE PARK
NRSWA - EAST MIDLANDS ELECTRICITY & ANGLIAN WATER SHEET 1 of 2

SCALE 1:500 DATE 10.99

Drawn D.B. Draughted C.W. Approved D.B.

SHEET No.16