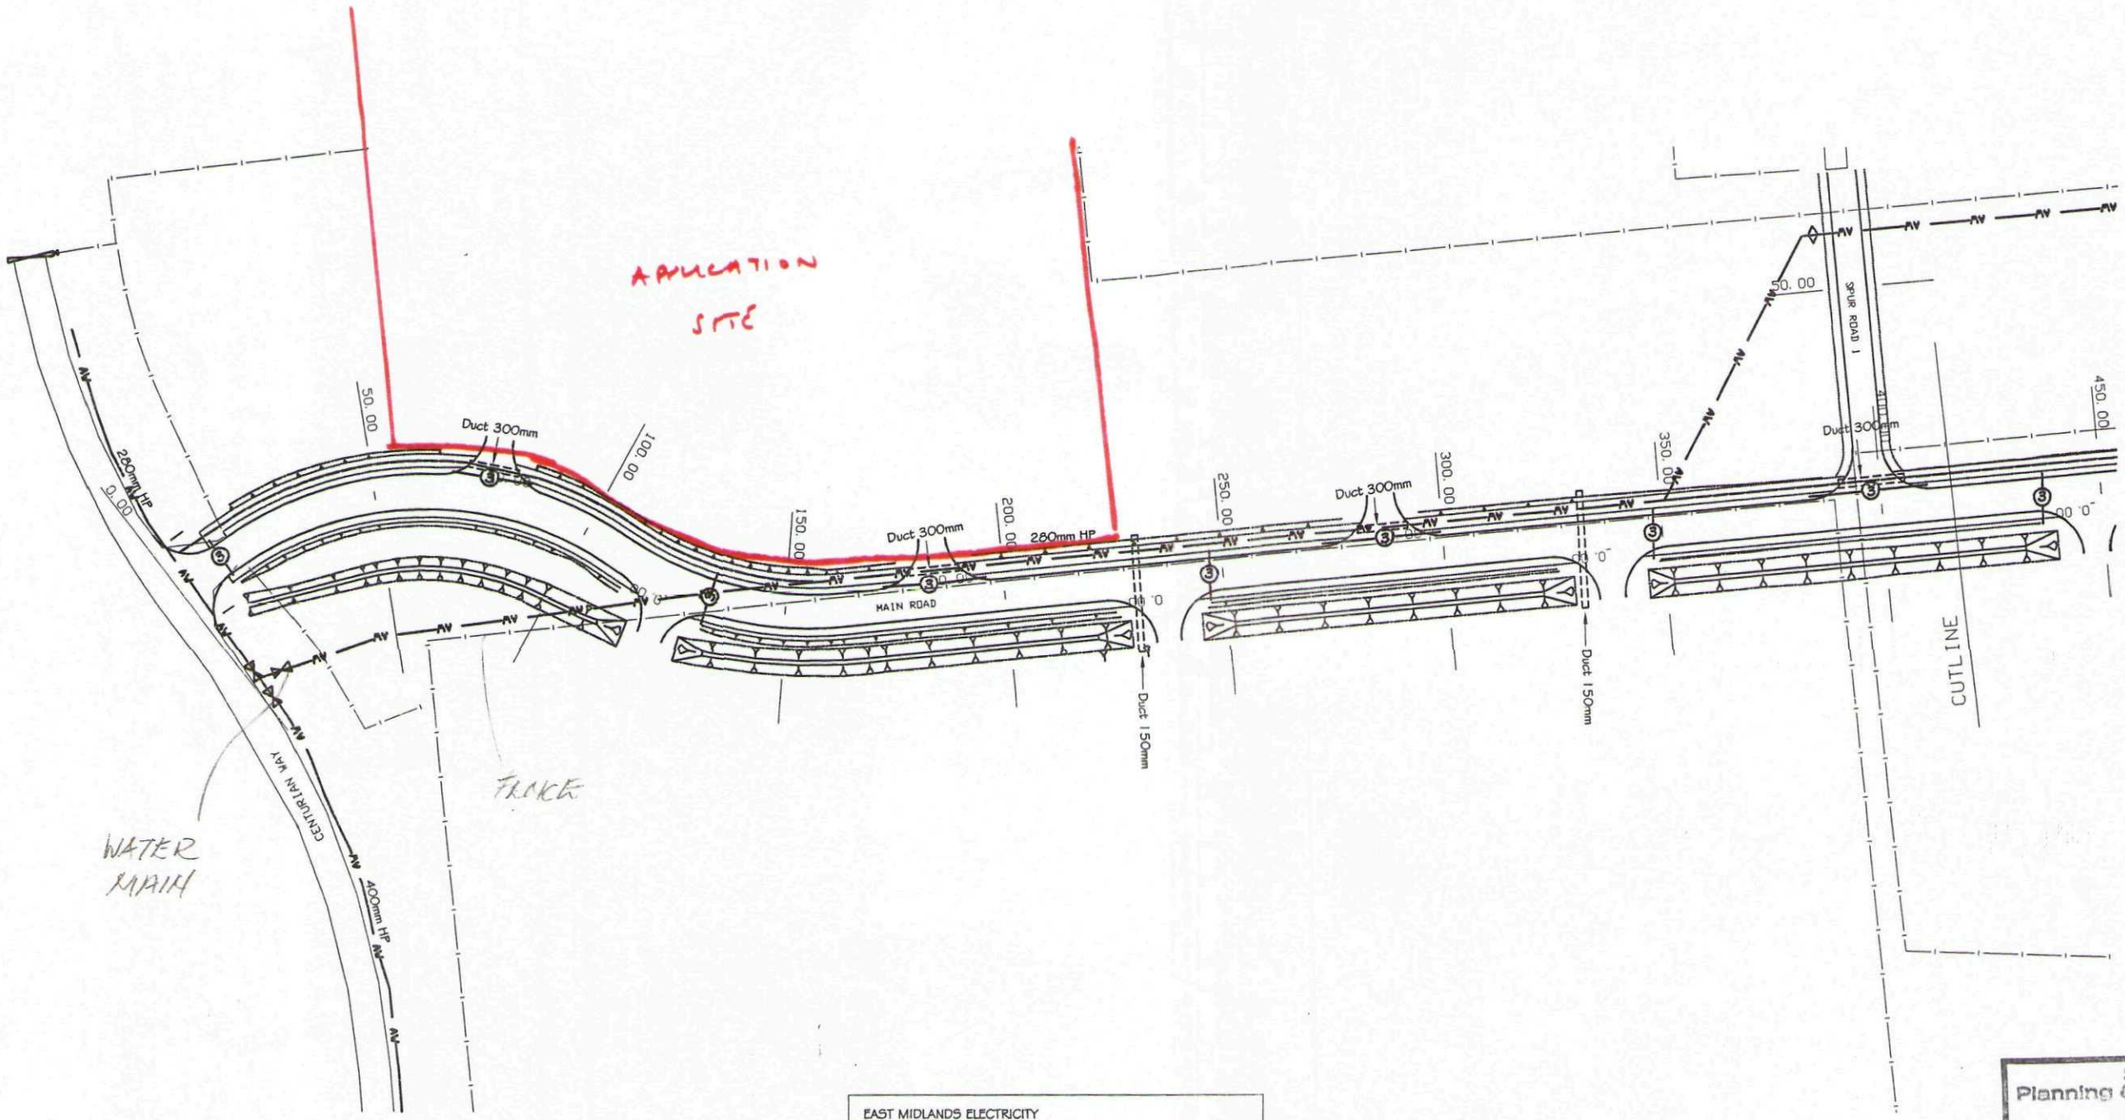


EAST MIDLANDS ELECTRICITY

LV — EXISTING UG/OH LOW VOLTAGE

X No. 100mm DIA. DUCTS TO BE LAID BY CONTRACTOR. GROUP Z 400mm BENEATH CARRIAGEWAY, GROUP S 750mm BENEATH FOOTWAY AND VERGE.

ANGLIAN WATER SERVICES Ltd

AW — EXISTING OPERATIONAL POTABLE WATER MAIN

PROPOSED WATER MAIN (to be laid by AW Contractor)

DUCT TO BE LAID BY CONTRACTOR. GROUP Z BENEATH CARRIAGEWAY, TYPE S BENEATH FOOTWAY AND VERGE. DUCT TO BE LAID UP TO WATER MAIN WITH 900mm COVER AND TERMINATED 1m BEHIND HIGHWAY BOUNDARY

SLUICE VALVE
WASHOUT VALVE
WASHOUT
AIR VALVE

SHDC
Planning & Development
0 4 MAR 2005
Ref: 1374/04

Amendment details

LINCOLNSHIRE - Part of the East Midlands Region

LINCOLNSHIRE COUNTY COUNCIL
HIGHWAYS & PLANNING DIRECTORATE
P.D. JAMESON, B.Sc.C.Eng.F.I.C.E., Head of Technical Services
Witham Park House, Witham Park, Waterside South, Lincoln LN5 7JN

DRG.No. A/S05033/31

Archive No.

SUTTON BRIDGE
WINGLAND ENTERPRISE PARK
NRSWA - EAST MIDLANDS ELECTRICITY & ANGLIAN WATER SHEET 1 of 2

SCALE 1:500 DATE 10.99

Drawn D.B. Draughted C.W. Approved D.B.

SHEET No. 16