

Demolish existing house to make way for proposed extensions.

Build on new shop extension in the manner shown.

External materials to match those of existing new shop front.

Shop front to match that of existing shop front – height, roof pitch, arches, etc.

Form opening in existing walls for access into new extension where shown, support over with IG Box 200 lintels. Form arches under openings.

Connect foul drains to main sewer in Bridge Road, all to Anglian Water requirements.

Make good to all disturbed and affected areas.

Provide and install emergency lighting all to BS5266:Part 1:1999.

Provide and install fire detector and alarm system all to BS5839:Part 1:2002.

Roof/Wall Abutments

Provide Code 4 lead flashings and lap over roof covering. Dress up wall a minimum of 150mm (stepped on pitched abutments) and provide d.p.c. cavity tray to make completely watertight.

New/Old Walling

Where new walling meets old provide proprietary flexible wall starters.

Soldier Coursing

Provide soldier course brickwork to all areas where shown on elevations.

Roof Ventilation

At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Valleys

Use proprietary fibreglass valleys or provide Code 4 lead to valleys to make completely watertight.

Safety Glazing

Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection

Provide mains operated self-contained smoke alarms to BS5446 Part 1 in accordance with Approved Document B1.

Rainwater Goods

PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Wall Construction

275mm cavity walls to consist of:
100mm face brickwork (see site plan for details), 75mm cavity to be filled with Crown Dritherm full fill insulation in accordance with BBA Certificate No. 86/1678 or similar approved, 100mm internal skin of Celcon standard blocks or similar approved to give 0.35 U/value. Cavity walls ties to be stainless steel type spaced 900mm horizontally and 450mm vertically to BS1243, 1978. Internal blockwork walls to receive 10mm sand/cement render and skim finish. Robust details in accordance with T50, 2001.

Kitchen/Utility/Bathroom/WC Trickle Ventilation

Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm²

Roof Insulation

To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.25 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Foul Water Drainage

Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage

To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes

Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Inspection Chamber Construction

Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

First Floor Walling

Provide 50 x 75mm timber vertical studs at 400mm c/c to be constructed of 50 x 75mm timber head and sole plates. Provide 12.5mm Gyproc plasterboard and skim finish to both sides. Provide to airspace proprietary acoustic insulation. Timber stud partitions running parallel to joist direction to be built off 2 no. floor joists fixed together. Provide 1 no. joist either end of stud partition joist beam to fix flooring.

First Floor Construction

19mm flooring grade moisture resistant decking on timber joists as stated on plan. To external walls joists to be supported on joist hangers (not built into wall). Provide 30mm x 5mm mild steel restraint straps to joists running parallel with wall securely fixed to walls and to span minimum 3 no. joists at maximum 1200mm c/c. At strap positions provide pack and noggin to joists. Solid strutting to be installed mid-span where span of joists between 2.5m and 4.5m. For spans in excess of 4.5m position of struts at 1/3rd span. Double up floor joists locally under bath feet and hot water cylinder where applicable. All doubled up joists to be bolted together at 600mm centres. Provide 75mm fibreglass insulation between floor joists.

Fascia and Bargeboards

To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Roof Construction

Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 41.T.P.A. with timber support members to span 4 no. trusses.

Ceilings

To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Ground Floor Construction

65mm sand/cement screed on proprietary 100 mm thick Jablette floor insulation or 60mm Celotex with perimeter insulation to screed on 1200 gauge polythene d.p.m. on 100mm concrete oversite on minimum 150mm, maximum 600mm well blinded and compacted hardcore. Wall d.p.c. to lap floor d.p.m. by a minimum of 50mm.

Lintels

All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Foundations

As indicated on plan provide concrete strip foundations. To cavity walls provide 700mm wide x 225mm thick and to 100mm walls provide 450mm wide x 225mm thick, unless noted otherwise. To non-load bearing internal walls thicken out ground floor oversite concrete to 450mm wide x 200mm thick. Widen foundations at chimney breast accordingly and make 300mm thick. Foundations to be taken down to an approved firm base, subject to local authority specifications. Concrete to be ST3 grade unless noted otherwise. Proximity of existing and proposed trees are to be taken into account in accordance with N.H.B.C. chapter 4 when determining foundation depth.

I.G. Type L1/S75 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

Glazing

All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Internal Lighting

Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:


Number of Rooms	Recommended min number of locations
1-3	1
4-6	2
7-9	3
10-12	4

Note – Hall stairs and landing count as one room (but may contain more than one fitting).

Excludes garages, lofts and outhouses.

First Floor Insulation

Provide 75mm fibreglass insulation between floor joists.

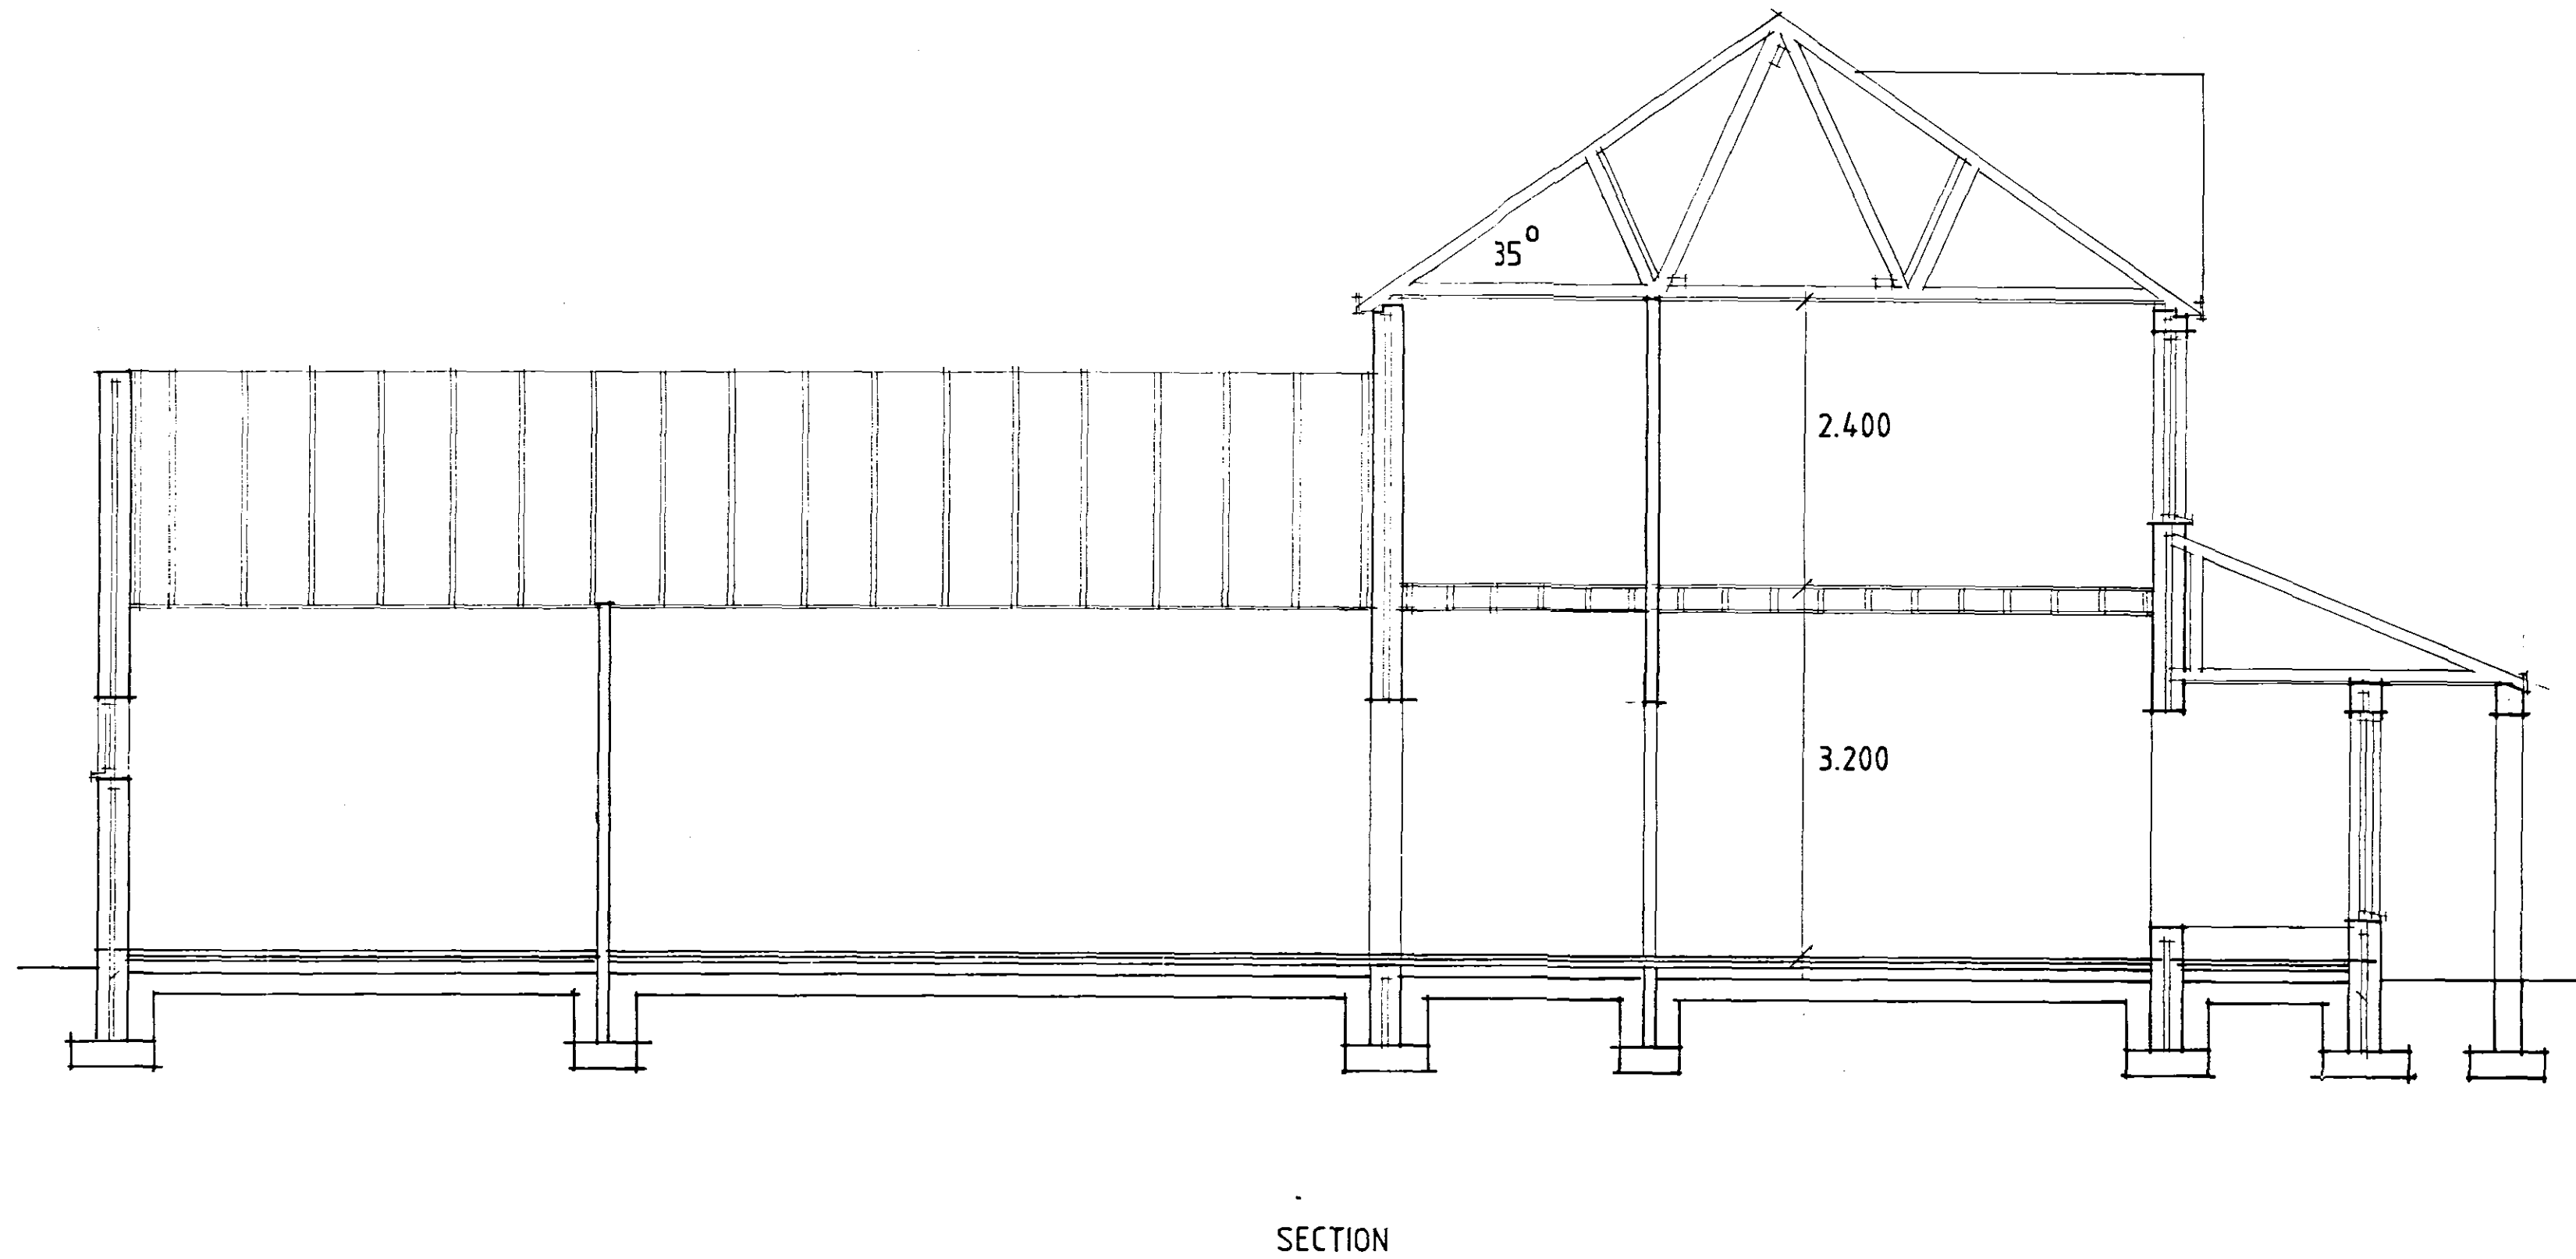

SHDC
Planning & Development
- 9 SEP 2005
Ref: 1244/05

DETERMINED
PLAN

Status
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED ALTERATIONS &
EXTENSION TO SHOP AT
108 BRIDGE ROAD, SUTTON
BRIDGE FOR

CINDY'S LADIES FASHIONS

1:50

SD05-040/6

AUG-05

B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702