SOUTH HOLLAND DISTRICT COUNCIL

Application no: H19/0939/92

Applicant: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Agent: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Description: Erect 11,000 KV overhead line on wooden poles

Location: Parish of Sutton St Edmunds
Spalding
Lincs

Type: ELECTRICITY

APPLICATION DETERMINED BY SECRETARY OF STATE - SUMMARY OF DECISION

Planning permission has been granted by the Secretary of State, or is deemed to have been granted, on conditions set out below or attached.

1 Development shall be begun not later than the expiration of five years beginning with the date of this letter.
Reason: Comply with provisions of Section 91(1) of the 1990 Act.
2 Dismantle/remove from the site any redundant lines/apparatus within six months from the date of commissioning of lines.
Reason: Restore the land as far as practicable to its previous condition.

7 October 1992

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

Department of Trade and Industry
Electricity Division
1 Palace Street
London SW1E 5HE

Fax No. 071 834 3771
Switchboard 071 238 3000
Direct Line 071 238 3634/3711

The Secretary
East Midlands Electricity plc
Boston

Dear Sir

Our Reference OL/266/2286

Date

OVERHEAD LINES
ELECTRICITY ACT 1989
TOWN AND COUNTRY PLANNING ACT 1990.

23 [illegible] 1992

With reference to the application particulars of which are specified below, I am directed by the Secretary of State to inform you that consent is hereby granted pursuant to section 37(1) of the Electricity Act 1989 ("the 1989 Act") to the installing above ground of electric lines ("the lines") particulars of which are specified below.

Pursuant to section 37(3) of the 1989 Act this consent is given subject to the following conditions:

1. The Secretary of State may review this consent at any time after a period of five years from the date hereof, and upon such review, after giving all persons concerned an opportunity of being heard, he may vary or revoke his consent.

2. If the Secretary of State revokes this consent the lines shall be removed within such period as the Secretary of State may direct.

Pursuant to section 90(2) of the Town and Country Planning Act 1990 ("the 1990 Act") the Secretary of State hereby directs that planning permission for the development shall be deemed to be granted subject to the following condition(s):

1. The development to which this permission relates shall be begun not later than the expiration of five years begining with the date hereof.

Reason: To comply with the provisions of section 91 (1) of the 1990 Act.

2. The Company shall dismantle and remove from the site any redundant lines and apparatus within six months from the date of commissioning of the lines.

Reason: To restore the land as far as practicable to its condition before the redundant lines and apparatus were installed.

SOUTH HOLLAND DISTRICT COUNCIL

Town and Country Planning Act 1990

Observations of Local Planning Authority

Reference: H19/0939/92 Received:03-SEP-92 Type:ELECTRICITY

Name: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Agent: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Description: Erect 11,000 KV overhead line on wooden poles

Location : Parish of Sutton St Edmunds Spalding
Lincs

South Holland District Council has considered the proposal and has NO OBJECTIONS to the development, subject to any comments set out below:

Director of Planning and Building Control Services
07-OCT-92 H19/0939/92

This decision refers only to that required for the purposes of the Town and Country Planning Act and not for Building Regulations or any other legislation. See enclosed notes relating to rights of appeal.

BRIAN SMITH Dip TP MRTPI Director of Planning & Building Control Services

Planning & Building Control Department, Council Offices, Priory Road, Spalding, Lincolnshire. PE11 2XE (Tel: 0775 761161)

Town and Country Planning Act etc

DRAFT DECISION

Reference: H19/0939/92 Received:03-SEP-92 Type:ELECTRICITY

Name: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Agent: East Midlands Electricity
Sleaford Road
Boston
Linsc
PE21 8EG

Description: Erect 11,000 KV overhead line on wooden poles

Location : Parish of Sutton St Edmunds Spalding
Lincs

South Holland District Council hereby give notice
that permission has been granted/refused etc
on the following conditions/reasons:

Authorised to issue:

29-SEP-92 H19/0939/92

AD..[signature].....DC..[signature]...
5/10 6/10

H19/0939/92

03 SEP 1992

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a naminal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT

Name: East Midlands Electricity plc

Address: Sleaford Road,
BOSTON,
Lincs..

Postcode: PE21 8EG

Telephone Number: Boston 365181

PART I

East Midlands Electricity plc Application Number EM92 21/94604 Date 27 August 1992

To the Chief Executive Planning Department Council South Holland District Council
Priory Road, SPALDING,
Lincs.. PE11 2XE

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90) [Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of East Midlands Electricity plc.

OFFICE COPY

D. A. Tuley
Designation. (Planning Engineer)

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The South Holland District/~~Borough~~ Council

(i) ~~object on the grounds set out below~~/have no objection to make to the development described overleaf.*

(ii) ~~request~~/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date 6 October 1992 Signed

*Delete as appropriate

Designation Director of Planning & Building Control Services

On behalf of the South Holland District/~~Borough~~ Council

(Reasons for objections)

PARTICULARS OF PROPOSED DEVELOPMENT AND REPRESENTATIONS

(To be completed by East Midlands Electricity plc)

Application is being made:

(a) for consent under section 37 of the Electricity Act 1989 to install or keep installed an electric line above ground;

(b) ~~for a direction under section 90(2) of the Town and Country Planning Act 1990 that planning permission for the proposed development be deemed to be granted.~~

1. Particulars of proposed development. (These particulars should be accompanied by such plans as may be necessary to enable the local planning authority to identify the land affected by the proposals and to appreciate the nature and extent of the proposed development and by a copy of the environment statement if the applicant has prepared one.)

To erect the proposed 11,000 KV overhead line on wooden poles in the parish of Sutton St. Edmunds
with a tolerance of 30m either side of the route shown on the attached plan no. 94604.

2. Particulars of any representations of objections which have been made to East Midlands Electricity plc.

3. Particulars of the applicant's compliance with his duty under paragraph 1 of Schedule 9 to the Electricity Act 1989.

East Midlands Electricity plc consider that the proposed overhead line will not have any significant impact on the surrounding landscape, and that due regard has been paid to their obligations under Schedule 9.

Date 27 August 19 92 For and on behalf of East Midlands Electricity plc.

Signed [signature] D. A. Tuley Designation (Planning Engineer)

Note: This Part to be completed, dated and signed before submitting to the local planning authority.

East Midlands Electricity plc Application Number EM 92 21/94604

(Application dated 27 August 1992)

PART II—INFORMATION AND OBSERVATION

(To be completed by the District/Borough Council)

Planning Reference Number H19/0939/92

1. Names of interested parties consulted about the proposals with details of any observations received.

Sutton St James Parish Council - No objection

Highways Department - No objection

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

None

3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?

No

4. Does the propoosed development involve the demolition, alteration or extension of a building of special architectural or historic interest included in a list compiled or approved under section 1 of the Planning (Listed Builkdings and Conservation Areas) Act 1990?

No

5. Does the local planning authority agree that the proposed development should be approved by the Secretary of State for Energy as described? (If the answer is 'NO', please answer question 6.)

Yes

6. Would the local planning authority be prepared to agree that the proposed development should be approved subject to modifications or conditions? (If so, specify the modifications or conditions proposed and state whether they are acceptable to the applicant). [Note: the precise form of any modifications or conditions subject to which the consent or direction given is a matter for the Secretary of State, but he will have regard to the form of words used by the local planning authority.]

N/A

Date **6 October 1992**

Signed

Designation **Director of Planning & Building Control Services**

On behalf of the **South Holland District** Council
(Local planning authority for the area in which the proposed development is to be carried out.)

Two completed copies of this Form, both signed, should be returned to East Midlands Electricity plc for submission by them to the Department of Energy.

PLANNING AUTHORITY REFERENCE: H19/0939/92

APPLICANT COMPANY: East Midlands Electricity plc

DATE AND REFERENCE OF APPLICATION: 9 October 1992 EM 21/92-94604

PARTICULARS OF OVERHEAD LINES:

Situated in the Parish of Sutton St Edmund

Route as indicated on Map No 92/94604 or within a distance not exceeding 30 metres on either side thereof.

Voltage 11,000

Yours faithfully

Authorised by the Secretary of State

BRIAN **TH** Dip TP MRTPI
Director of Planning & Building Control Services
Planning & Building Control Department,
Council Offices,
Priory Road, Spalding,
Lincolnshire. PE11 2XE

Telephone: (0775) 761161
Fax: (0775) 710772

SOUTH HOLLAND DISTRICT COUNCIL

Application no: H19/0939/92 Type: ELECTRICITY

Applicant: East Midlands Electricity
Tel: Boston 365181

Agent: East Midlands Electricity
Boston 365181

Description: Erect 11,000 KV overhead line on wooden poles

Location: Parish of Sutton St Edmunds
Spalding
Lincs

Valid date: 03-SEP-92
Target dates:
To case officer 08-SEP-92
Inspected by 13-SEP-92
Extra contacts 18-SEP-92
Report if not clear by 08-OCT-92

Terminal date: 29-OCT-92
Target Committee: 27-OCT-92
Report deadline: 13-OCT-92

Case Officer:
D M GEDNEY

DEVELOPMENT/CONSTRAINTS

Size:
Category: Misc works
Listed building:
Conservation Area:

CONSULTATIONS CARRIED OUT

	Sent	Expiry
Clerk to Sutton St E 0406 26739	10-SEP-92	24-SEP-92
Cllr Mrs E O Hall-Pa 0945 700 829	10-SEP-92	24-SEP-92

L.C.C - No objection JCB 17/9/92

SITE DETAILS

Grid ref: 537200 312800
OS Sheets: 365 Parcel:

APPLICATION ASSESSMENT

Notes for Case Officer

Site Inspection | Accuracy | Neighbours | Boundaries

Site features

Other On proposed line [illegible] affected [illegible] field. Along road [illegible] (see photo)

Inspected by [illegible]
Date [illegible]

Notice posted by
Date

Resident Notices required

Sent | Delivered

Case Officer Conclusions DMG 28/9.

~~[illegible]~~ Proposed line through village underground.
Overhead line in open countryside. Follows line of drain in part.
Avoids significant trees
No objections

RECOMMENDATION

COMMITTEE

Departure from Policy .....

Ward Member request .....

Recommend approval against material objection .....

Other circumstance viz: .....

Change to Committee recorded

DELEGATED

Case Officer ....DMG....

Senior Officer .....

Case Officer Recommendation

Approve | Refuse

Signed ....D.M. Gedney

No Objections

Conditions/Reasons
(continue overleaf)

Notes to applicant

- [ ] Disabled
- [ ] Outstanding RM
- [ ] Amended plans

DC RECORD SHEET

APPLICATION REF:

Directions

Art 7 (Outlines)
RM checklist

	Siting	Design	Ext app	Access	Landscape
Previous					
Current					
Required					

Reg 4 Scale drawing ..... Highway S/W ..... Agric appraisal .....

Other ....

Precise details, for non-standard direction:

Senior Officer authorised: ..... Sent: .....

Revalidation after Direction

Information satisfactory/unsatisfactory Signed: .....

Further direction: Precise details:

Amended description:

New valid date: .....

Consultation/Publicity Required DMF 9/9

	Requested	Sent
Extra Publicity:		
Departure	.....	.....
Setting of LB	.....	.....
Public Right of Way	.....	.....
Discretionary	.....	.....
Extra Consultations:		
Dept of Transport	.....	.....
Environmental Serv.	.....	.....
LB/Cons. Area - Local	.....	.....
- Local & National	.....	.....
- English Heritage	.....	.....
Consultant: Name.....		..... Order No .....
Other:	.....	.....

Case Officer DMF

Recorded on board:

ADMIN RECORD SHEET

Initial

Submitted Fee £ NIL

Receipt Issued

Date first Rec'd 08 SEP 1992

Registration

Reference H19/0939/92

Cross-Ref N/A

Date 4/9

Validation

DEL

TYPE 07 SEP 1992

Earliest permission

Site area

No of dwellings

Floorspace

Description

Tech

Certificate
Site plans
Description

Accuracy
Incomplete form

Fees

Nil fee

Discounted fee

Previous app Type

Correct fee NIL

Additional
Refund

Receipt Issued

Information

Newbuild/Redevelopment/Change of use/Extension/Alteration/Works

Earlier permission Ref

RM

	Siting	Design	Ext app	Access	Landscaping
Previous					
Current					

Index sheets 365

OS No's

Grid ref 537900 319800

Ward W

Parish SSE

TR Rural
TR Bypass
Level Cross
Footpath

CA
LB
TPO /

Inside IBD NO

Inside LP area NO

Linked to site

Ref 790

Linked to property

Ref

Planning Records:
Earlier apps

B Reg Records:
Already submitted - Ref
Request
Requested

Sutton St Edmund

3x 025 CAB cu. (7/.073 in)

3x 025 C.C

Nº176
SUTTON ST EDMUNDS
315 KVA GMT.

1000 CROSS ROAD.

Chapel End

The Oaks Farm

95 A.S

6207
CHESTNUT FARM
200 KVA P.MT.

HV

Chestnut Farm

3 x 025 C.S.R

Nº6327
GUANOCK FARM
PROPOSED 16KVA 1Φ P.M.T.
EST. MD 8 KVA

Guanock Farm

STAY DYKESIDE

TERMINATE LV LINE

3x 95 A.C.S.R

ANGLE POLE, STAY DYKESIDE
INSTALL A/B SWITCH

ANGLE POLE
STAY ACROSS DYKE
IN DYKESIDE
REMOVE BACK STAY

A

Nº6714
COTTESMORE

SUTTON ST EDMUND C P

A TO B STRING 1 EXTRA
50 A.C.S.R CONDUCTOR.

50 A.C.S.R

COMBINED W/OUT

Nº5713
WHITE COTTAGE

3x 025 C.C

BROADGATE No1

ASHTON DRIER

3x 50 A.C.S.R

2x 50 ACSR

Nº5712
GUANOCKGATE Nº2

3x 025 C.C (7/.073 in).

Eye Farm

3x 04 S.C.A

B

Nº4250
GUANOCK GATE Nº1

3x 04 S.C.A (6/1/.18 in)

3x 025cc (7/073in)

SOUTH HOLLAND D.C.
PLAN DEPT.
03 SEP 1992
DATE 0939/92

East Midlands Electricity PLC

EAST LINCOLNSHIRE DISTRICT

Title SUTTON ST. EDMUNDS REBUILD PHASE 3

		EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines Shown	33 kv			
	11 kv			
	Lv			
Underground Cables Shown	33 kv			
	11 kv			
	Lv			
Transformers Shown	G.M.T.			
	P.M.T.			

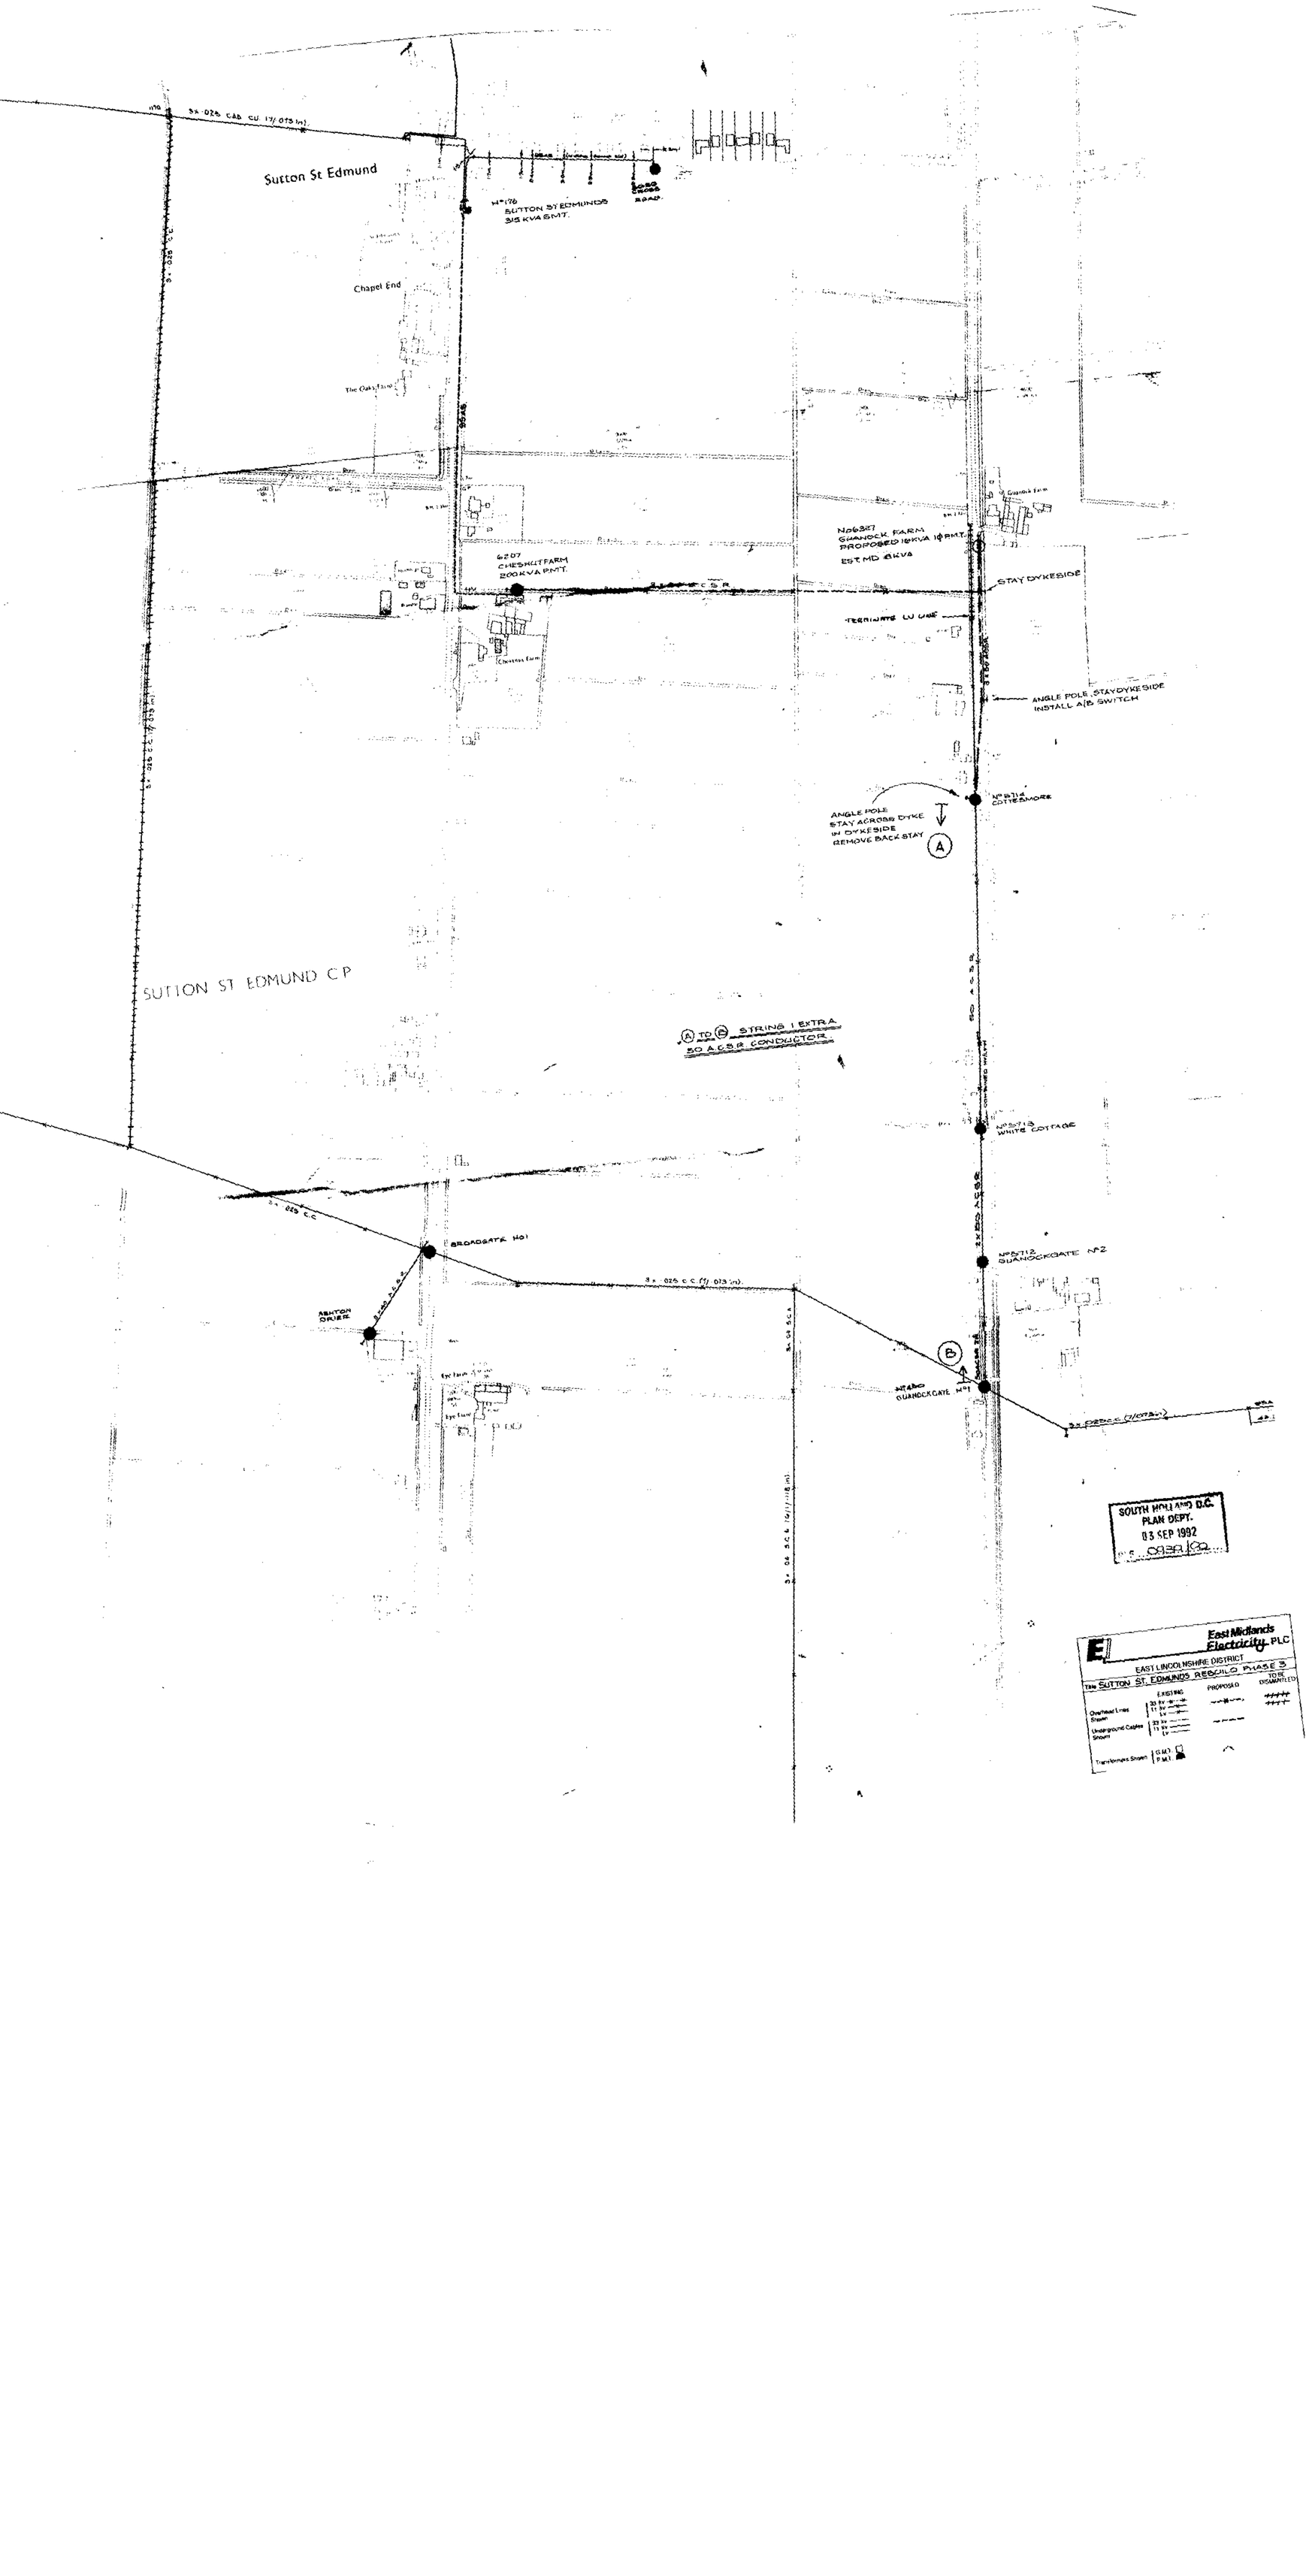
Sutton St Edmund
Chapel End
The Oaks Farm
SUTTON ST EDMUND C P
Nº178
SUTTON ST EDMUNDS
315 KVA 6M.T.
6207
CHESNUT FARM
200 KVA P.M.T.
Nº6327
GUANOCK FARM
PROPOSED 16KVA 1Φ P.M.T.
EST MD 6KVA
STAY DYKESIDE
TERMINATE LV LINE
ANGLE POLE ,STAYDYKESIDE
INSTALL A/B SWITCH
ANGLE POLE
STAY ACROSS DYKE
IN DYKESIDE
REMOVE BACK STAY
Nº5714
COTTESMORE
A TO B STRING 1 EXTRA
50 A.C.S.R CONDUCTOR
Nº5713
WHITE COTTAGE
Nº5712
GUANOCK GATE Nº2
BROADGATE H01
ASHTON
DRIER
Nº4340
GUANOCK GATE Nº1
3 x 025 c.c (7/.013 in)
3 x 04 S.C.A (7/.029 in)
2 x 50 A.C.S.R
3 x 04 S.C.A
SOUTH HOLLAND D.C.
PLAN DEPT.
03 SEP 1992
S/0939/92
East Midlands Electricity PLC
EAST LINCOLNSHIRE DISTRICT
TRN SUTTON ST. EDMUNDS RECOILD PHASE 3
EXISTING
PROPOSED
TO BE DISMANTLED
Overhead Lines Shown
Underground Cables Shown
Transformers Shown
(S.M.)
P.M.T.

