East Midlands Electricity

EAST LINCOLNSHIRE DISTRICT

Title SUTTON ST. JAMES, BROADGATE

	EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines Shown	33 kv 11 kv LV		
Underground Cables Shown	33 kv 11 kv LV		
Transformers Shown	GMT PMT	8	

Grid Sheet No TF 8616/1 Scale 1:1500 Drawn K.B.

Based upon the Ordnance Survey with the permission of the Controller of H.M. Stationery Office ©BROWN COPYRIGHT RESERVED

Scheme No 97309A

Drg. No. 96/97309

Date 21-6-96

SUTTON ST JAMES C P

Poplar Farm

NP 5685 POPLAR FM

Water Broadgate

NP 6382 NEW OLD FEN DYKE

NP 6609 FOOTBRIDGE

NP 6608 CHAPEL GATE

Chestnut House

Priory Cottage

Walnut Farm

Bowgrave Farm

Common House

ADD LV STAY

RESITE.

ACCESS 1ST JULY OR END OCTOBER

STAY ON GRASS BANK

NEW LV CABLE SERVICE.

SHORT SPREAD STAYS No 6609.

CHESTNUT HOUSE SOUTH. PROPOSED 16 KVA 1Ø PMT.

NO ACCESS TO THIS FIELD SEE WAYLEAVE OFFICER

REBUILD USING 2 x 95 A.B.C.

NEW LV SERVICE.

3 x 50 A.C.S.R.

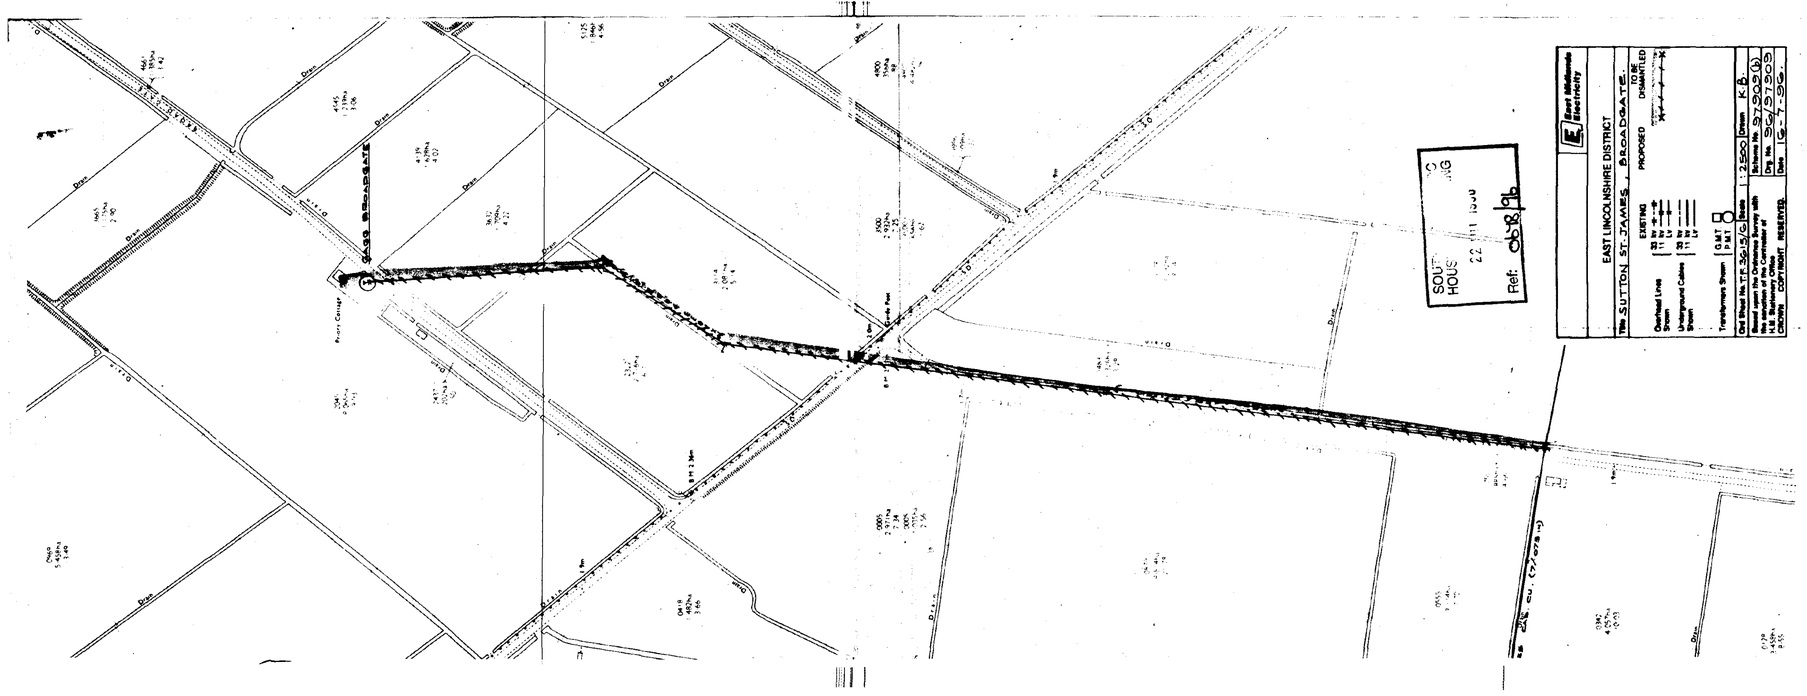
3 x 95 A.C.S.R.

3 x 95 S.C.A.

3 x 6 S.C.A.

SOU … HOU… 22 … 1996

Ref: CB/8/96


EAST LINCOLNSHIRE DISTRICT
Title SUTTON ST JAMES - BROADGATE
EXISTING
PROPOSED
DISMANTLED
Overhead Lines Shown
Underground Cables Shown
Transformers Shown
OAT
Old Sheet No's 36-5/6
Based upon the Ordnance Survey with the permission of the Controller of H.M. Stationery Office
Crown Copyright RESERVED.
1:2500
Drawn K.B.
Scheme No's 92/2805(2)
Dig No's 92/2750
Date 6-7-96
SOUTH HOLLAND DISTRICT COUNCIL
Ref. 08/96
Broadgate
Drain
Pump
Sluice
Bridge
Track
Ditch
Pond
Post
Telephone Kiosk
Footpath
Sluice Gate
Pump House