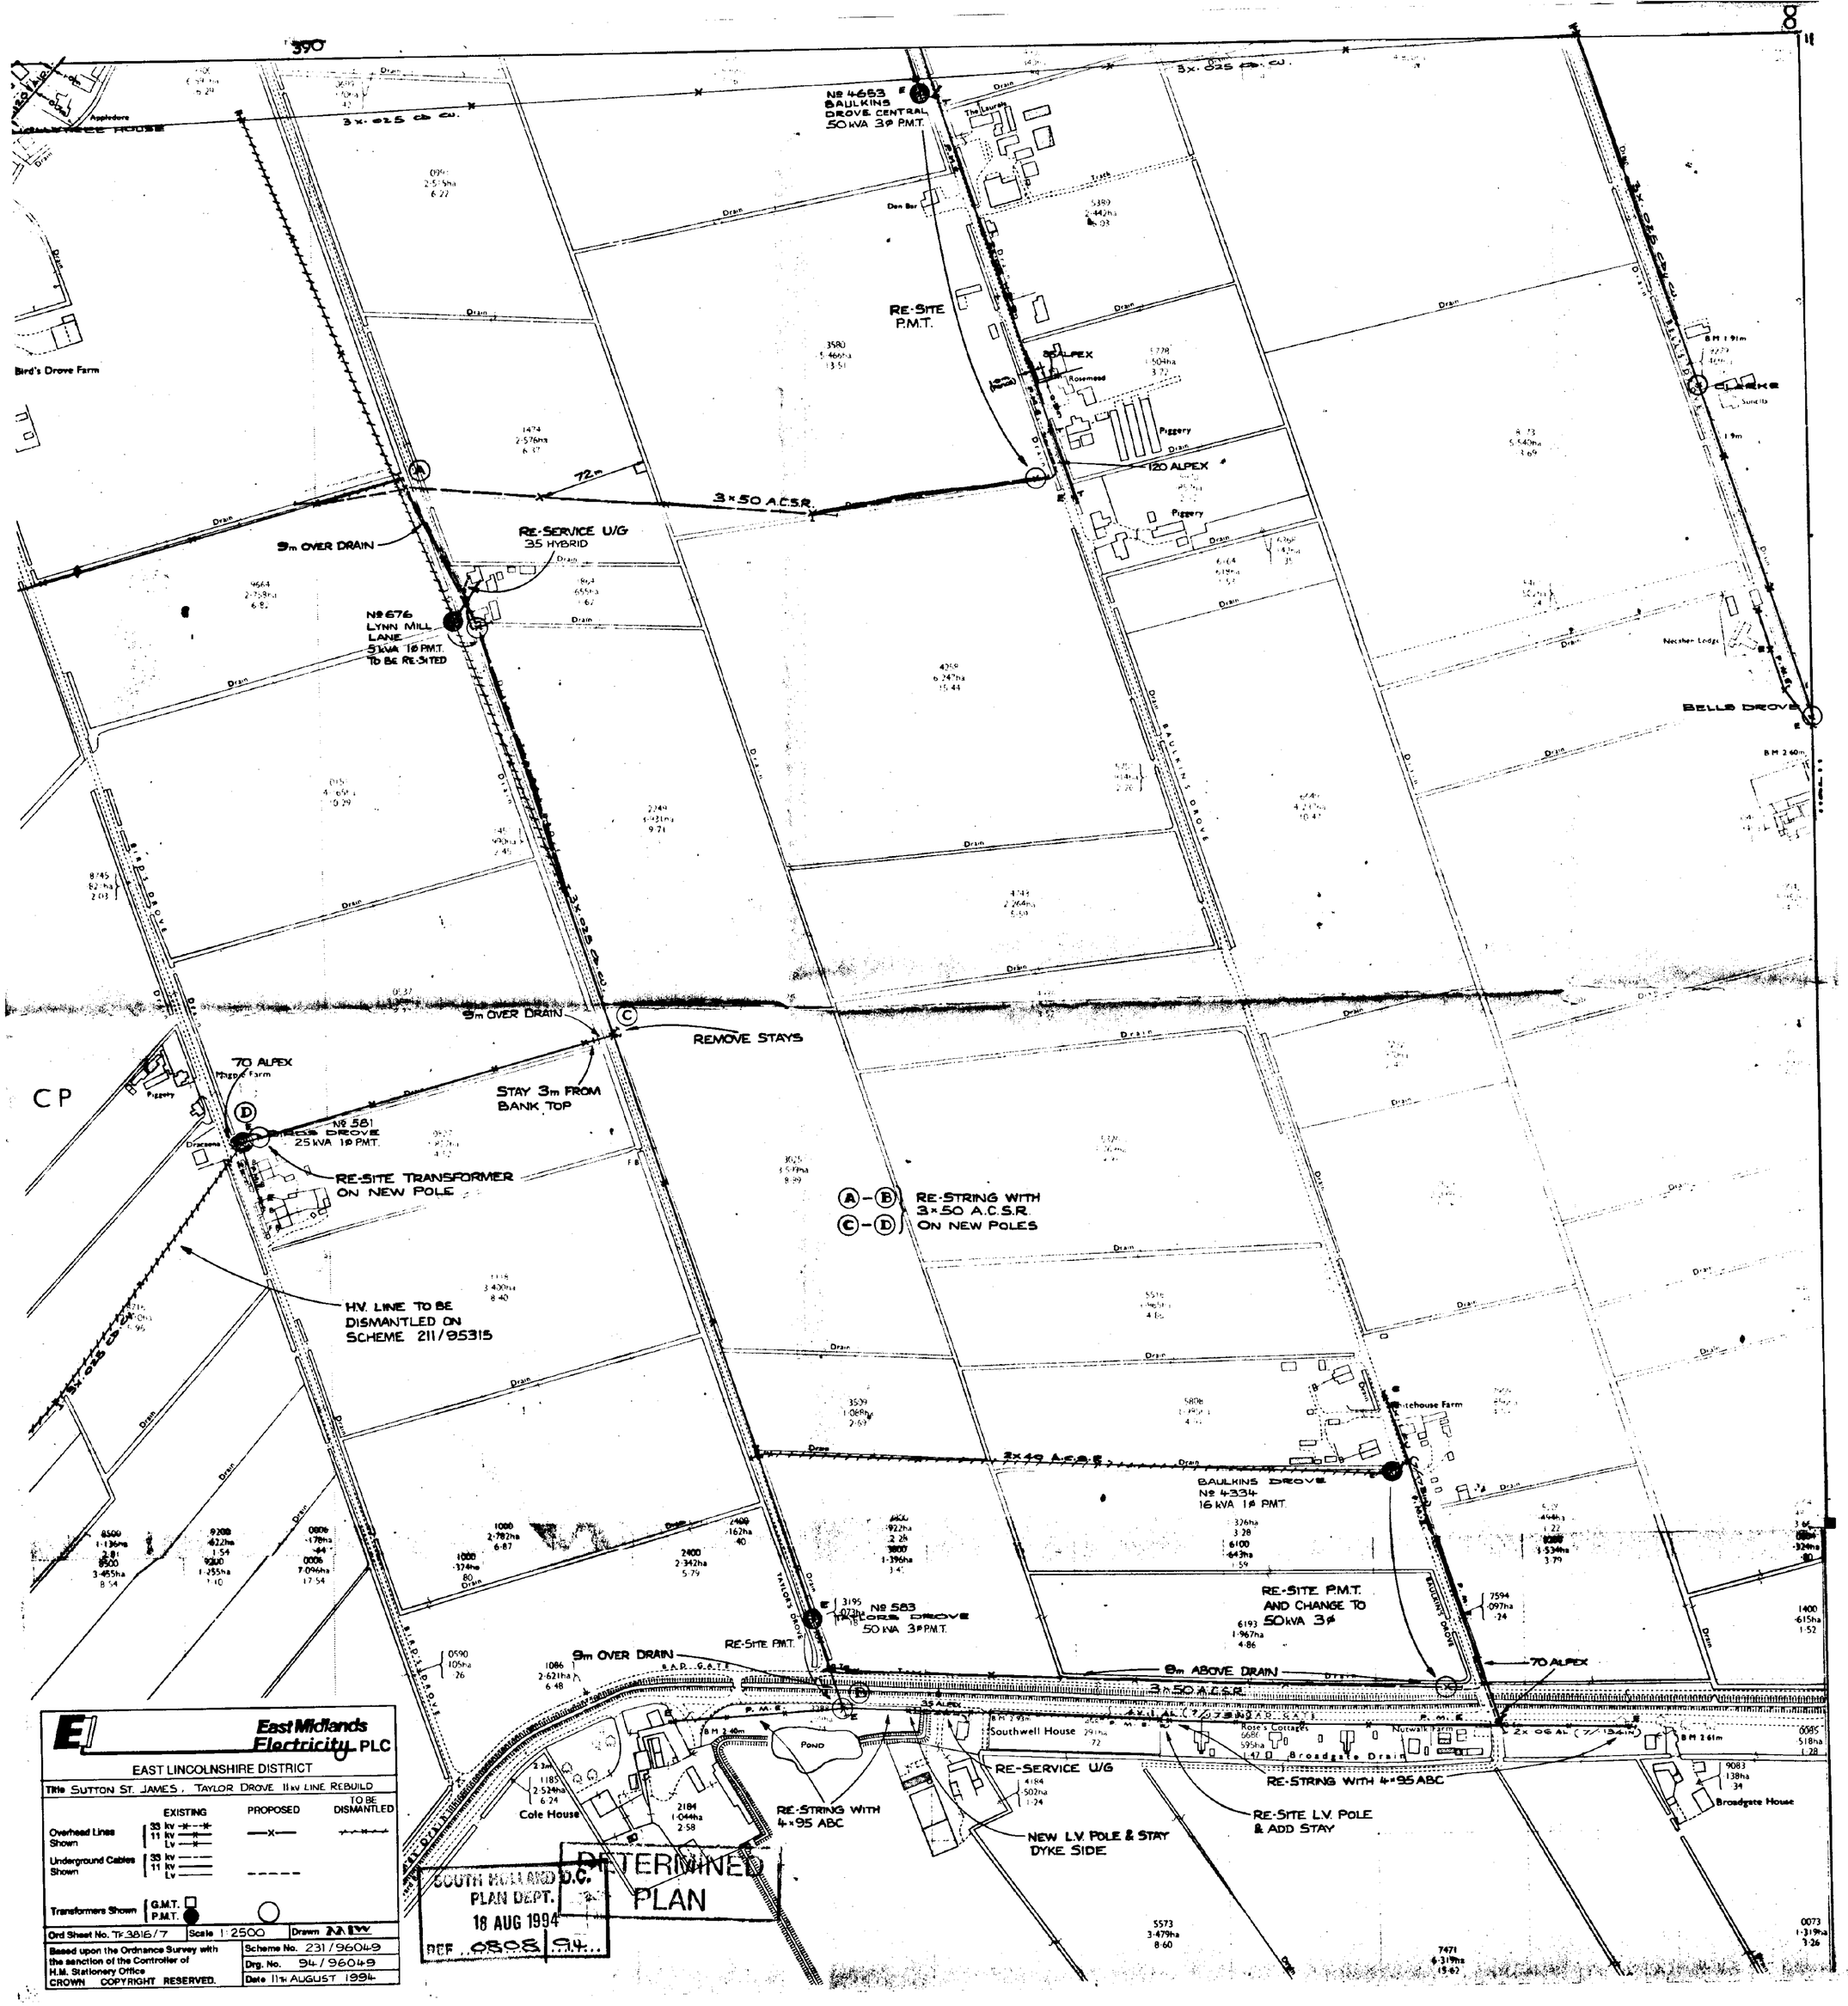

East Midlands Electricity PLC

EAST LINCOLNSHIRE DISTRICT

Title SUTTON ST. JAMES, TAYLOR DROVE 11kV LINE REBUILD

	EXISTING	PROPOSED	TO BE DISMANTLED
Overhead Lines Shown	33 kv, 11 kv, Lv	—x—	
Underground Cables Shown	33 kv, 11 kv, Lv	-----	
Transformers Shown	G.M.T., P.M.T.	○	

Ord Sheet No. TF 3816/7	Scale 1:2500	Drawn MW
Based upon the Ordnance Survey with the sanction of the Controller of H.M. Stationery Office CROWN COPYRIGHT RESERVED.	Scheme No. 231/96049	
	Drg. No. 94/96049	
	Date 11TH AUGUST 1994	

SOUTH HOLLAND D.C.
PLAN DEPT.
18 AUG 1994
REF. 0808/94
DETERMINED PLAN