FLOOD RISK ASSESSMENT
FOR A STORAGE BUILDING AT
CHAPELGATE, SUTTON ST JAMES

FINAL REPORT

ECL1169/STATUS DESIGN

DATE NOVEMBER 2023

ELLINGHAM CONSULTING LTD
Email: tim@ellinghamconsulting.co.uk

CONTENTS

1.0 INTRODUCTION

2.0 SITE LOCATION AND DESCRIPTION
- 2.1 Site Location
- 2.2 Existing Site
- 2.3 Proposed Development
- 2.4 Local Development Documents
- 2.5 Available Flood Risk Information

3.0 FLOOD RISK VULNERABILITY
- 3.1 The Sequential and Exception Test
- 3.2 Vulnerability Classification
- 3.3 Application of the Sequential Test

4.0 SITE SPECIFIC FLOOD RISK
- 4.1 Local Flood Assets
- 4.2 Sources of Flooding
- 4.3 Probability of Flooding
- 4.4 Historic Flooding
- 4.5 Climate Change
- 4.6 Residual Risks

5.0 FLOOD RISK MITIGATION
- 5.1 Summary of Risks
- 5.2 Mitigation Measures

6.0 CONCLUSIONS

ATTACHMENT 1 – Site Plan (Dwg SD23-011/1)

DISCLAIMER
This document has been prepared solely as a Flood Risk Assessment in support of a planning application for proposed storage building at Chapelgate, Sutton St James. "Ellingham Consulting Ltd" accepts no responsibility or liability whatsoever for any use made of this document other than by the client Mr P Heanes for the purposes it was originally commissioned and prepared. All comments and opinions made are based upon information available to "Ellingham Consulting Ltd" during the necessary investigative process, and the conclusions and recommendations, could therefore, differ in the event of material subsequently being found erroneous, incomplete, or misleading. "Ellingham Consulting Ltd" therefore, accepts no liability should this prove to be the case.

1.0 INTRODUCTION

This Flood Risk Assessment has been prepared in accordance with National Planning Policy Framework (NPPF) and supporting planning practice guidance (PPG) on Flood Risk and Coastal Change.

In areas at risk of flooding or for sites of 1 hectare or more, developers are required to undertake a site-specific Flood Risk Assessment to accompany an application for planning permission. This Flood Risk Assessment has been produced on behalf of Mr P Heanes in respect of a development that consists of a storage building at Chapelgate, Sutton St James.

A planning application for the proposed development is to be submitted by Status Design.

2.0 SITE LOCATION AND DESCRIPTION

2.1 Site Location

The site is located at 147 Chapelgate, Sutton St James, Wisbech, PE12 0EF. The National Grid Reference of the site is 53897/31811.

The location of the site is shown in Figure 1.



Figure 1 – Location Plan (© OpenStreetMap contributors)

2.2 Existing Site

The site is on the southern side of Chapelgate. This site consists of land within the curtilage of a commercial development and includes two buildings. The site has an existing access to Chapelgate. The area of development is approximately 0.17 hectares.

Environment Agency LiDAR shows that the site is flat with ground levels typically between +1.7m OD and +1.9m OD. Chapelgate carriageway to the north of the site is at a level of +2.2m OD.

The site is in the North Level Internal Drainage Board (IDB) District. Surface water at the site would naturally drain through soakaway and hence to the IDB drain system. There is a riparian drain on the western boundary of the site and an IDB Drain 100m east of the site.

The online British Geological Survey maps indicate that the site is likely to be underlain by West Walton Formation Mudstone and Siltstone. The bedrock is shown to be overlain with superficial deposits of clay and silt.

2.3 Proposed Development

The proposed development consists of a storage building for personal use and the extension to the domestic curtilage to include the building. One of the existing buildings will be demolished. The proposed site layout is provided in Attachment 1.

2.4 Local Development Documents

The South East Lincolnshire Local Plan 2011 – 2036, adopted in March 2019, is the Local Plan for the district. Policy 4: Approach to Flood Risk states the requirements for flood risk reduction.

The South East Lincolnshire Level 1 and Level 2 Strategic Flood Risk Assessment (SFRA) was prepared in June 2017.

The Joint Lincolnshire Flood Risk and Drainage Management Strategy has been prepared by Lincolnshire County Council as the Lead Local Flood Authority. The purpose of the Strategy is to increase the safety of people across Lincolnshire by reducing the number of people at risk of flooding, increasing the resilience of local communities, and reducing the impact of flooding.

2.5 Flood Zones

The site is located within Flood Zone 3, an area with a high probability of flooding, of the Environment Agency Flood Maps for Planning as shown in Figure 2.

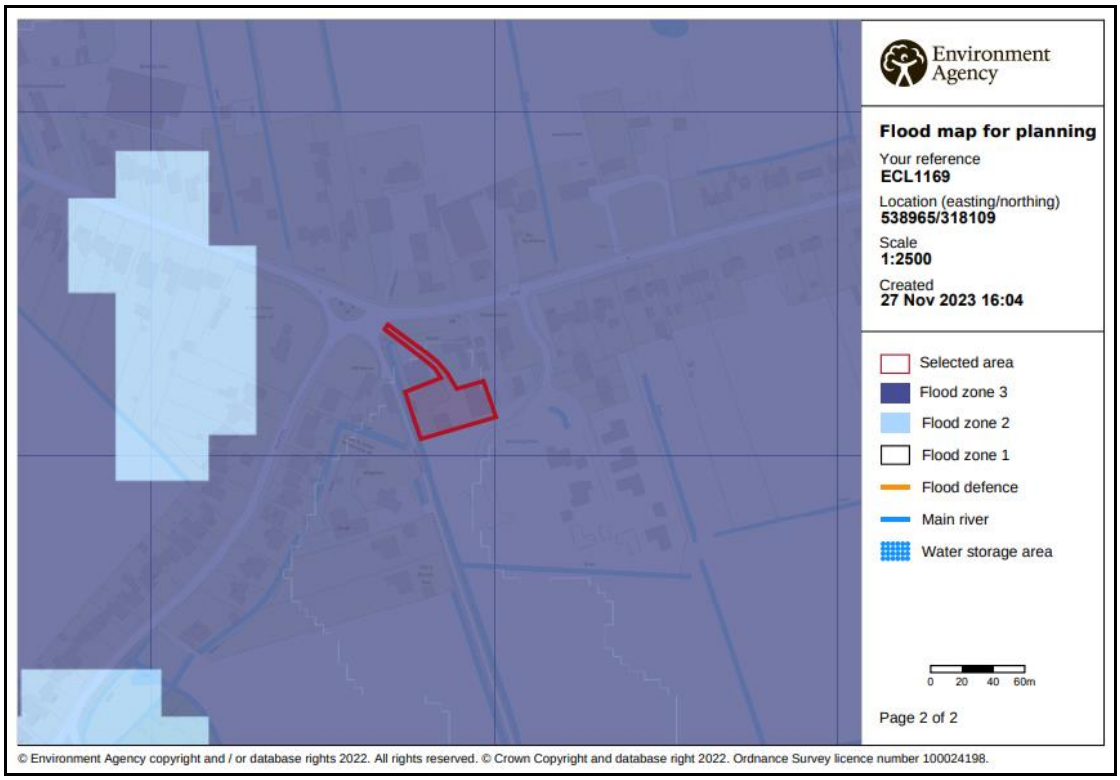


Figure 2 – Environment Agency Flood Map for Planning

The Environment Agency Long Term Flood Risk maps show that:

- the site has a low risk of flooding from rivers or the sea (annual probability between 0.1% and 1%);
- the site has a very low risk of surface water flooding (annual probability of less than 0.1%); and
- the site is not within an area at risk of reservoir flooding.

Table 1 shows the level of risk at the site within the South East Lincolnshire SFRA.

SFRA Map	Present Day	2116
Residual Flood Hazard Map for the 1% fluvial and 0.5% tidal event	The site is outside the 'Low Hazard' area	The site is outside the 'Low Hazard' area
Residual Peak Depth Map for the 1% fluvial and 0.5% tidal	The site is outside the area at risk	The site is outside the area at risk

Table 1 – Flood Risk within SFRA Maps

3.0 FLOOD RISK VULNERABILITY

3.1 The Sequential and Exception Test

The NPPF requires the application of a Sequential Test to ensure that new development is in areas with the lowest probability of flooding.

The Exception Test is a method to demonstrate and help ensure that flood risk to people and property will be managed, while allowing necessary development to go ahead in situations where suitable sites at lower risk of flooding are not available.

3.2 Vulnerability Classification

Table 2 of the PPG Flood Risk and Coastal Change categorises different types of uses and development according to their vulnerability to flood risk. The proposed development is classified as 'Less Vulnerable'.

Table 3 of the PPG Flood Risk and Coastal Change sets out Flood Risk Vulnerability and flood zone 'compatibility'. The site is within Flood Zone 3 and the development is 'Less Vulnerable' therefore it is not necessary to complete the Exception Test.

PPG Flood Risk and Coastal Change defines that the lifetime of the development in terms of flood risk and coastal change is 100 years.

3.3 Application of the Sequential Test

It is for the Local Planning Authority, using the evidence provided and taking advice from the Environment Agency as appropriate, to consider whether an application passes the Sequential Test.

Large parts of the South Holland district between the River Welland and River Nene lie within Flood Zone 2 or Flood Zone 3. The River Nene and River Welland have defences that provide protection during the 0.5% annual probability (1 in 200 chance each year) event and therefore the 'actual risk' of flooding at the site is low.

The SFRA states that as it is necessary to use the refined flood risk information (hazard and depth maps) to assist with the application of the sequential test. The refined flood risk information contained within the SFRA demonstrates the site is not at risk during the 1% annual probability fluvial and 0.5% annual probability tidal event including climate change. The site therefore has a low probability of flooding and is considered to pass the Sequential Test.

4.0 SITE SPECIFIC FLOOD RISK

4.1 Local Flood Assets

The site is 7.8km west of the tidal River Nene. The site is protected by the River Nene tidal defences between Wisbech and Sutton Bridge. The River Nene is the responsibility of the Environment Agency.

There is a long-term strategy for the maintenance of the Environment Agency defences which is reviewed and updated periodically.

There is an extensive local drainage network managed by North Level IDB. There is an IDB Drain, Baulkins Drove Drain, approximately 100m east of the site. The site and the surrounding land are within the Tydd catchment and drain to Denhams Pumping Station and hence via the North Level Main Drain to Tydd Pumping Station. The Tydd Pumping Station discharges to the tidal River Nene.

During the operation and maintenance of its pumping stations, associated structures and channel systems, the IDB seeks to maintain a general standard capable of providing flood protection to its district. A routine maintenance programme is in place to ensure that the Boards assets are commensurate with the standard of protection that is sought.

Current maintenance standards of the North Level Internal Drainage Board and the Environment Agency are generally good.

4.2 Sources of Flooding

A summary of the sources of flooding is provided in Table 1.

Source of Flooding	Level of Risk
Drainage Network Flooding	The risk is assessed in Section 4.3.
Surface Water Flooding	Based upon the EA maps the risk is very low.
Fluvial Flooding	The risk is assessed in Section 4.3 and 4.5.
Tidal Flooding	The risk is assessed in Section 4.3 and 4.5.
Reservoir Flooding	Based upon the EA maps the site is not at risk of flooding from reservoirs.
Groundwater Flooding	There is no evidence to suggest the site is at risk of groundwater flooding.

Table 1 – Sources of Flooding

4.3 Probability of Flooding

The probability of flooding associated with blockages in the North Level IDB drainage system is low due to the maintenance standards achieved and managed by the IDB. Failure of Denhams Pumping Station would lead to an increased level of risk in the catchment.

Through the operation and maintenance of the pumping stations and the channel system the Board seek to maintain a general standard capable to providing flood protection to agricultural land and developed areas of 1 in 20 years and 1 in 100 years, respectively. The risk associated with flood events that exceed the standard of protection provided is lowered due to the North Level IDB main drains incorporating freeboard. This freeboard provides storage during the exceedance events.

The site benefits from defences on the River Nene that provide protection during a 0.5% annual probability (1 in 200 chance each year) tidal event and a 1% annual probability (1 in 100 chance each year) fluvial event.

4.4 Historic Flooding

During the preparation of this assessment, no evidence was discovered of the site being flooded.

4.5 Climate Change

Climate change is likely to impact the site through increased rainfall intensity and duration affecting the local drainage network and increased flood levels in the River Nene.

The River Nene tidal defences have been designed to include an allowance for climate change.

In summary the existing systems and defences are appropriate for the design life of the development (i.e., 100 years).

4.6 Residual Risk

There is a residual risk of flooding in the vicinity of the site should a breach of the tidal defences occur. The South East Lincolnshire SFRA includes maps demonstrating the residual peak depth in 2116. An extract from this map is shown in Figure 3 below. When climate change allowances are applied to the 1% annual probability (1 in 100 chance each year) fluvial event and 0.5% annual probability (1 in 100 chance each year) tidal event the site is not at risk during a breach.

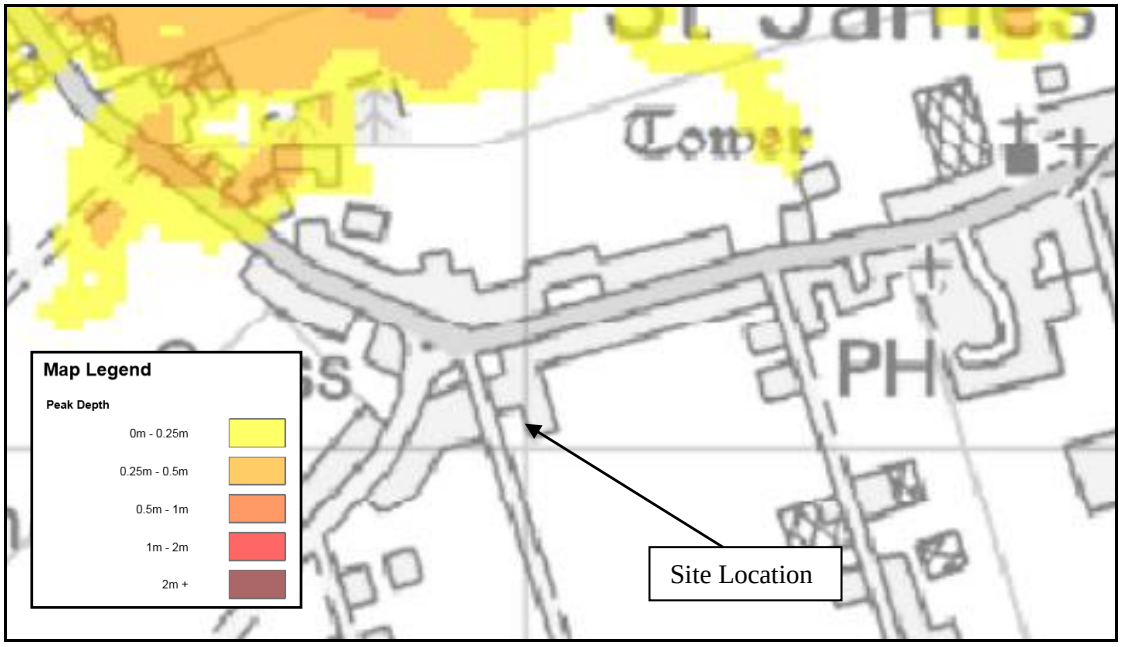


Figure 3 – SFRA 2116 Residual Peak Depth Map

5.0 FLOOD RISK MITIGATION

5.1 Summary of Risks

The probability of this development flooding from localised drainage systems is low. Failure of Denhams Pumping Station could lead to an increased level of risk at the site.

The probability of the site flooding from any Environment Agency system is less than 1% annual probability (1 in 100 chance each year) because of the standards of the existing flood defences. Over time there will be a gradual increase in risk to the site due to climate change. During the design life of the development, it is not anticipated that the site would flood.

The SFRA considers the residual risk associated with overtopping and a breach in the defences in 2116. The maps show that the site is not at risk.

The development increases the impermeable area and therefore has the potential to increase flood risk elsewhere.

5.2 Mitigation Measures

The site has a low 'actual risk' of flooding. Considering the development is a storage building for personal use there are no specific mitigation measures proposed associated with the design.

The developer should ensure that the user of the building is sufficiently aware of the risk of flooding, and the standard of the existing defences. The Environment Agency operates a flood warning system for properties at risk of flooding to enable householders to protect life or take actions to manage the effect of flooding on property. Floodline Warnings Service is a national system run by the Environment Agency for broadcasting flooding warnings. The user of the building should register to receive flood warnings.

Should there be a failure of Denhams Pumping Station and conditions were such to put properties and land at risk of flooding, the Internal Drainage Board would take emergency action to maintain the drainage level of service by utilising temporary pumping equipment.

It is recommended that surface water run-off is managed so that stormwater from the site will not affect any adjoining properties or increase the flood risk elsewhere.

6.0 CONCLUSIONS

As a result of the assessment, the following conclusions have been reached.

- The proposed development consists of a storage building for personal use and the extension to the domestic curtilage to include the building at 147 Chapelgate, Sutton St James.

- The site is located within an Internal Drainage Board catchment and through the operation and maintenance of the pumping stations and the channel system the Board seek to maintain a general standard capable to providing flood protection to agricultural land and developed areas of 1 in 20 and 1 in 100 years, respectively.


- The proposed development is in Flood Zone 3. The site benefits from defences on the tidal River Nene that provide protection during the 0.5% annual probability (1 in 200 chance each year) tidal event including an allowance for climate change. The site is not at risk during a breach of the tidal defences.

- There are no specific recommendations associated with the storage building to reduce the risk of flooding to the development.

- The development passes the Sequential Test and is therefore suitable for the proposed location.

ATTACHMENT 1

SITE PLAN
(Dwg SD23-011/1)

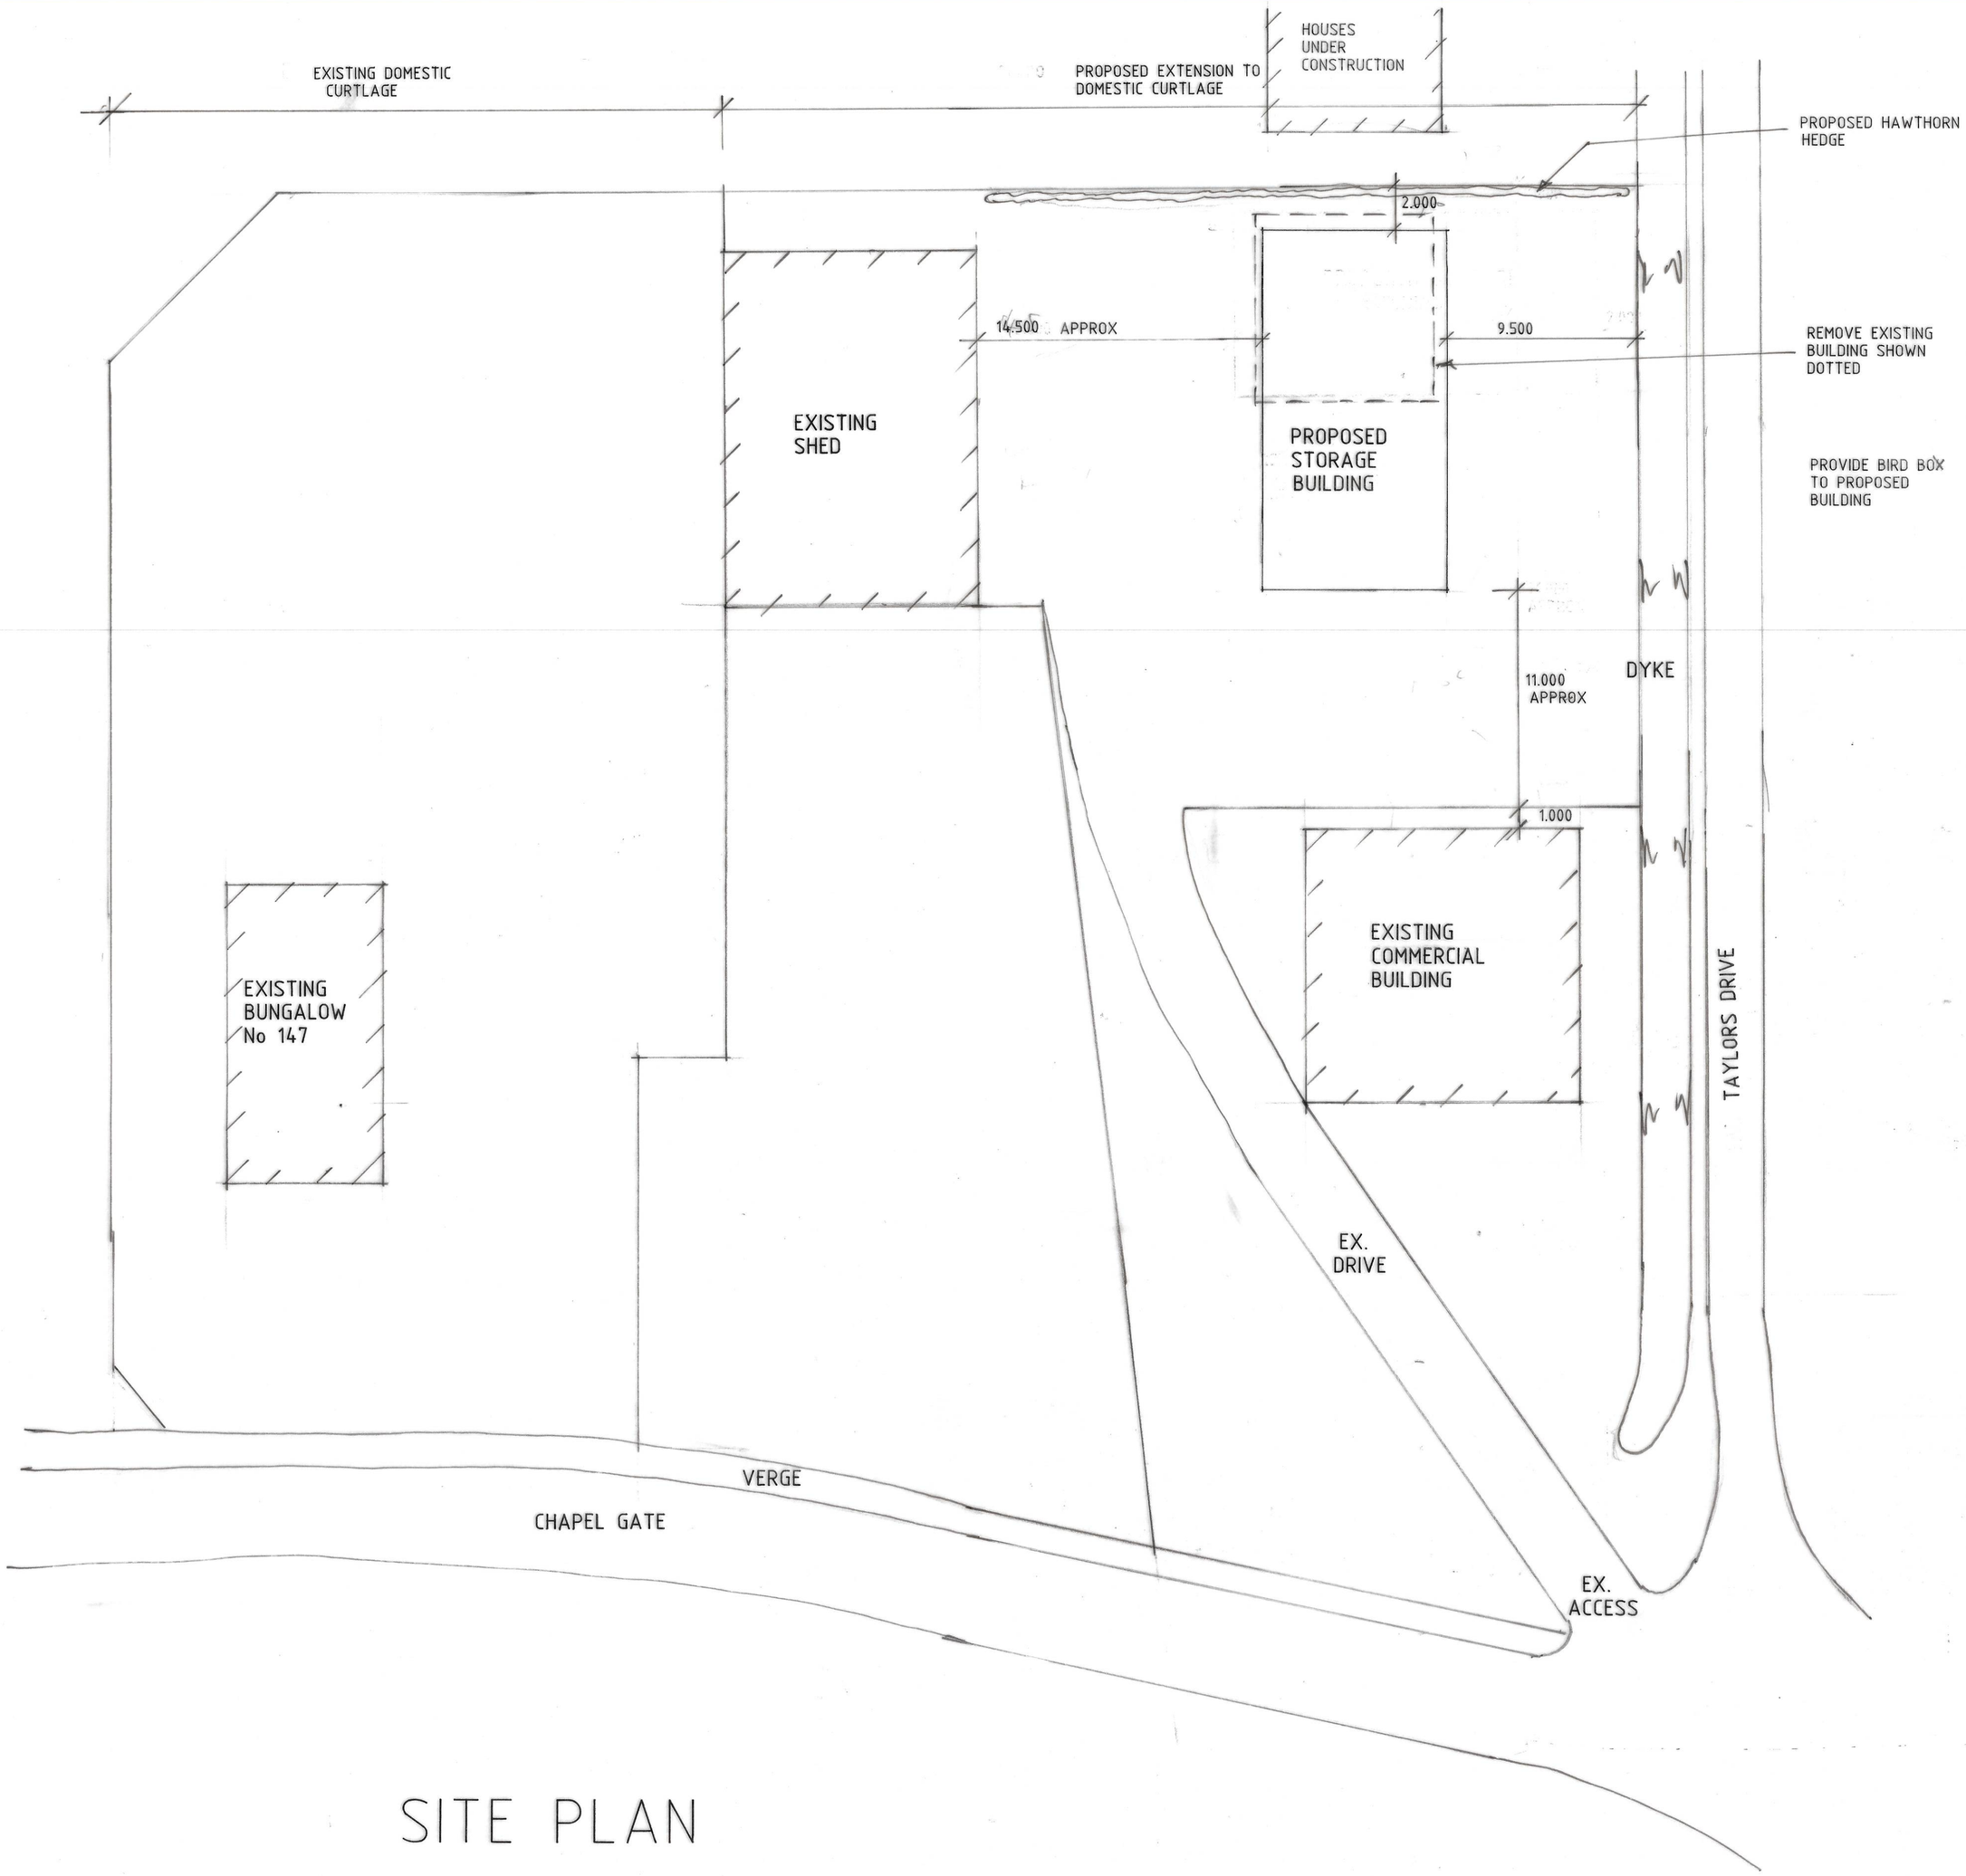

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH SD23-011/2

A - ALTS - 15.11.23

Status DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED STORAGE BUILDING AND EXTENSION TO DOMESTIC CURTLAGE AT 147 CHAPEL GATE, SUTTON ST. JAMES FOR

MR. P. HEANES.

SITE PLAN

1:200	SD23-011/1
AUG-23	B.GILHAM.

2 Edinburgh Walk, Holbeach, Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702