

General Notes

Do not scale from this drawing.

This drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other than that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property.


This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works. It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so. It is the client or their agent's responsibility to control workmanship, substitution of materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practice. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

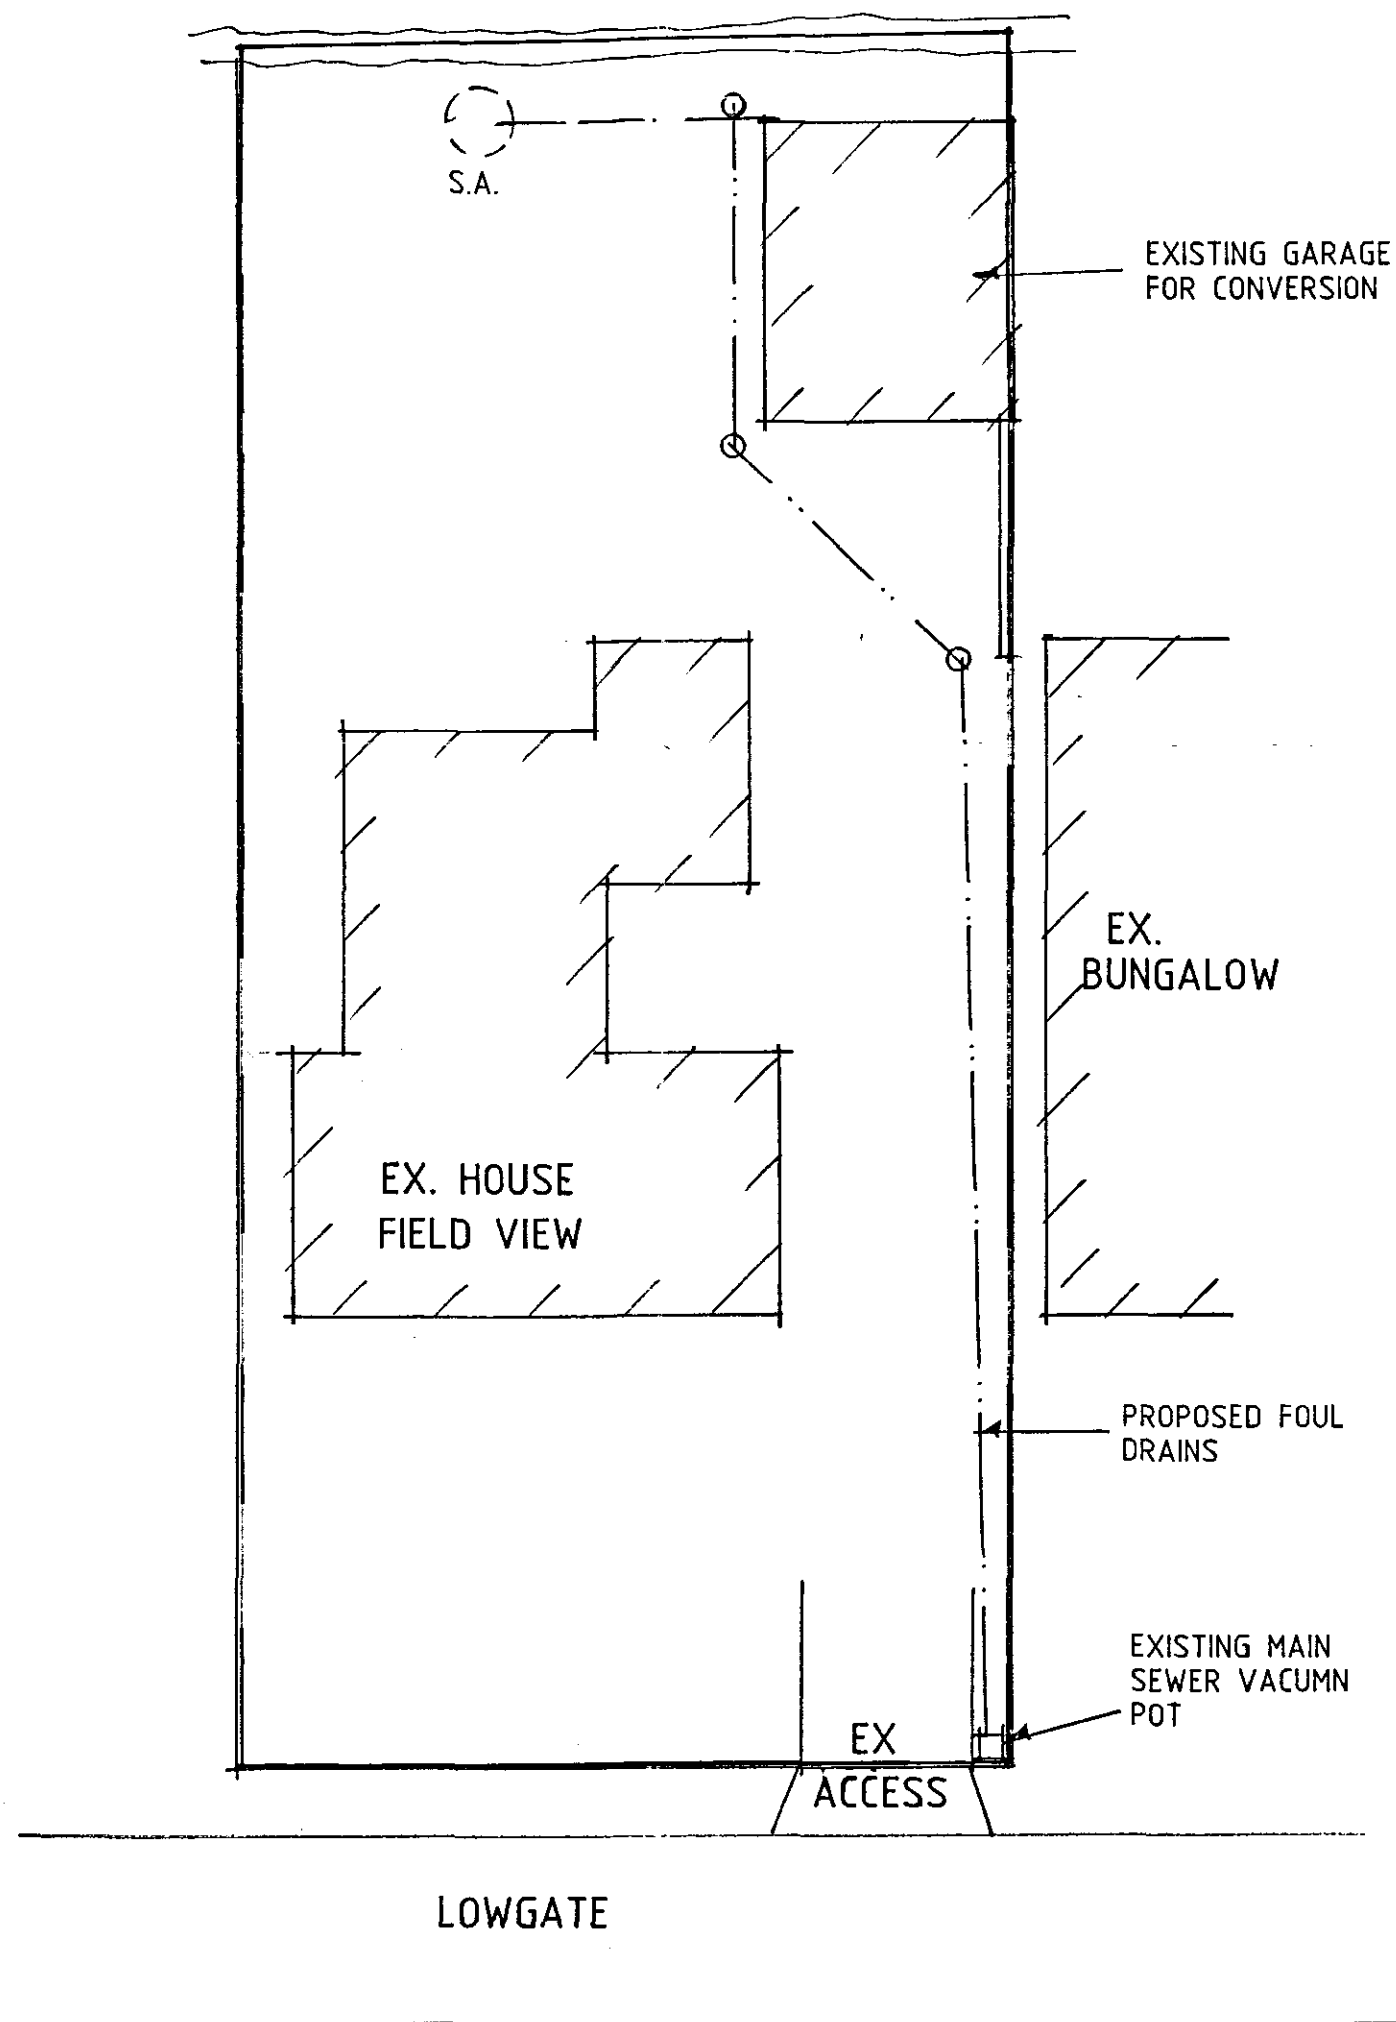

SITE PLAN

Existing garage with first-floor attic den to be converted and extended to create granny annexe in the manner shown.

Form balcony, as shown.

For all structural matters relating to roof alterations and balcony, etc., refer to SRC structural calculations.

To existing ground-floor level up as necessary and paint with 2 no. coats of Synladapufe waterproof. Provide 100mm Celotex insulation with 19mm moisture-resistant Weyroc boarding.

Existing first-floor side window to be removed and opening adjusted to suit 1200mm wide French doors; support over with IG box 200 lintel.

Private Stairs

Stairwell formed by timber trimmers and load bearing walls (see plan). Provide timber balustrading to open side of stairs 900mm above pitch line and 1000mm high to stairwell opening to act as guarding and to be capable of resisting a horizontal force of 0.36 kN/m. Balustrading to be vertical type, not horizontal or ranch style. No parts of stairs to have any gaps greater than 99mm. Provide timber handrail to top of balustrading or independently 900mm above pitch line. Ensure minimum headroom above pitch line is 2000mm. Total rise: See plan. Maximum rise: 220mm. Minimum going: 220mm. Maximum pitch: 42°. Read in conjunction with Approved Document K.

Roof Ventilation

At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Kitchen Ventilation

Provide proprietary mechanical extract ventilation unit capable of extracting 60 l/sec. Alternatively provide proprietary cooker hood capable of extracting 30 l/sec.

Dry Lining

Dry line existing solid external walls with Celotex TUFF-R™ Zero GA3000Z system internally all in accordance with manufacturers specification.

Sound Insulation to single Dwelling

The intermediate floor should be provided with 100mm thickness mineral wool between the joists. In addition internal stud walls should be suitably sound resisting to walls around bedrooms, WC and en-suites (unless the wall contains a door).

Electrical Work

All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion of the works the council must be satisfied that either:
a) an electrical installation certificate issued under a competent person's scheme has been issued or
b) an appropriate electrical installation certificate has been issued for the work, and that it has been signed by a person competent to do so.

All soakaways to be minimum 1m deep.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

Provide 100mm Celotex insulation between flat roof joists.

Connect foul drains to main sewer, all to Anglian Water requirements.

Existing foundations to be checked for adequacy and underpinned if found to be inadequate.

Flat Roof Construction (Cold Roof)

12.7mm white spar chippings bedded on bitumen on 3no. layers built up felt (first layer asbestos based) on 12mm external grade plywood decking on 50mm to 0mm timber firings securely spiked to treated timber joists (size stated on drawings). Provide 30 x 5mm mild steel anchor and lateral restraint straps to joists fixed to walls at maximum 1200mm c/c. Extend joists past wall and provide suitably sized fascia board, complete with soffit board. Provide proprietary ventilation to soffit to offer equal to a 25mm continuous gap along eaves. Lay between joists proprietary 150mm thick insulation maintaining a 50mm air gap between insulation and plywood. Form all necessary felt drips including tiling fillets and keep felt drips clear of fascia boarding. If flat roof intersects with pitched roof ensure flat roof felt laps under felt of pitched roof by a minimum of 600mm.

Bathroom/En-suite Ventilation

Provide proprietary mechanical extract ventilation unit capable of extracting 15 l/sec. System to offer intermittent operation.

Hot Water Storage

Provide system approved by BBA and installed by BBA approved installer. System to be vented and insulated in accordance with BS5615 1985. Provide thermostatic control.

Heating System

Provide room thermostat or thermostatic radiator valves or similar approved to control the output from the heating system.

Insulated Pipes and Ducts

All pipes, which do not contribute to the heating of the building, will be insulated to BS5422 1977.

Safety Glazing

Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection

Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods

PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Existing first floor side external walls to be dry-lined.

Dormer Wall Construction

16mm shiplap boarding on 19mm x 38mm timber battens on breather membrane on sheathing ply fixed to studs with GA3050Z Celotex between studs, maintain a 50mm cavity. 50mm x 125mm vertical studs at 400mm centres built off doubled-up rafters as stated. GA3012Z fixed to internal face of studs with taped joints and finished with plasterboard and skim.

Provide all necessary lead flashing to make completely watertight.

All new steelwork to be encased to give ½ hour fire protection.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing

All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Commissioning of Heating and HWS Systems

A competent person, i.e. the main contractor or sub-contractor shall supply a Certificate of Satisfactory Compliance with Building Regulations Part L. A copy of which shall be made available to both the client and the Building Control body.

A suitable set of operating and maintenance instructions are to be made available to the client to explain to the householders how to operate the systems so that they can perform efficiently and what routine maintenance is advisable for the purpose of the conservation of fuel and power.

Internal Lighting

Provide energy efficient lights that only take lamps having a luminous efficiency greater than 40 lumens per circuit watt. Examples of lamps are fluorescent tubes and compact fluorescent lamps (note GLS tungsten lamps with bayonet cap or Edison screw bases).

Method of determining number of locations:

Provide energy efficient lights of one per 25m² of floor area or one per four fittings whichever is the largest.

Excludes garages, lofts and outhouses.

Habitable Room Trickle Ventilation

Provide proprietary trickle ventilators to head of windows giving a total opening area of not less than 8000mm².

Kitchen/Utility/Bathroom/WC Trickle Ventilation

Provide proprietary trickle ventilators to head of window giving a total opening area of not less than 4000mm².

Roof Insulation

To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U-value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Roof Insulation to Sloping Ceiling

To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Foul Water Drainage

Underground drainage to be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Under building drains to be encased in 150mm pea gravel with lintel over pipes at wall abutments. Where drain passes through wall, provide suitable protection to prevent gas ingress to building. 110mm diameter soil and vent pipe to extend 900mm above window head and to terminate in balloon finial. Soil and vent pipe to be fitted with access plate at base. Provide suitably sized wastes from all appliances (in accordance with Approved Document H) complete with minimum 75mm deep sealed traps and rodding eye access points at every direction change. All above ground drainage to BS5582 and all underground drainage to BS8301. Provide seal plates both sides of pipe entry to avoid vermin entry.

Surface Water Drainage

To be proprietary 110mm diameter p.v.c. pipes flexible jointed to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Protection to Underground Pipes

Where pipes are not under road and have less than 600mm cover concrete paving slabs should be laid as bridging above the pipes on minimum 75mm pea gravel. If flexible pipes are under a road and have less than 900mm cover reinforced concrete bridging should be used instead of paving slabs. Provide compressible material below slab/concrete.

Inspection Chamber Construction

Proprietary polypropylene inspection chambers bedded on 150mm concrete. Form protective 255mm thick concrete collar around head of inspection chamber with 300mm projection from cover. Covers to be Grade C light duty unless inspection chambers are in driveways where Grade B medium duty covers are to be used.

First Floor Walling

Provide 50 x 75mm timber vertical studs at 400mm c/c to be constructed of 50 x 75mm timber head and sole plates. Provide 12.5mm Gyproc plasterboard of 10kg/m² density and skim finish to both sides. Provide to airspace proprietary acoustic insulation. Timber stud partitions running parallel to joist direction to be built off 2 no. floor joists fixed together. Provide 1 no. joist either end of stud partition joist beam to fix flooring.

Boiler

Provide balanced flue type oil fired boiler of required rating in position indicated on drawing to be either a wall hung type or free standing on 125mm high concrete hearth above oversite. Boiler to have protective guard cover and to be minimum 600mm from any opening into the building. Read in conjunction with Approved Document J1/2/3. At completion of works commissioning of heating system to be provided to the local authority Building Control by a competent Corgi registered person. Boiler to have a Sedbuk rating of 86%.

Fascia and Bargeboards

To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Ceilings

To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m² or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.



C - ALTS - 15.08
B - CALCS ADDED - 19.9.07
A - ALTS - 23.8.07

**DETERMINED
PLAN**

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED CHANGE OF USE
OF GARAGE TO GRANNY
ANNEXE AT FIELD VIEW,
LOWGATE, TYDD ST. MARY
FOR

MR. C. WORTS.

SITE PLAN

1:200 | SD07-038/4
AUG-07 | B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP.
Tel: 01406 424343 Fax: 01406 490702