Build on extension to the front of existing garage, as shown.

Existing roof trusses to be removed and replaced with room-in-roof trusses with same roof pitch 45°

Existing front gable wall to be removed.

New first-floor extension to be supported on 2 no. 330mm x 330mm brick piers and steel beams, as shown.

For structural design/calculations of all piers, foundations and steelwork, etc., refer to SRC Structural Calculations

Steelwork to be encased to give ½ hour fire protected.

Roof tiles to match those of existing.

External facing bricks to match those of existing.

Existing side garage door to be replaced with window, as shown; brick up to underside as necessary.

Existing side garage window to be removed and replaced with door, as shown; adjust opening as necessary and brick up, as necessary.

Form internal stud partition and door, as shown. Partition to be ½ hour fire protected; internal door to be ½ hour fire self-closing.

New staircase, as shown, to be 600mm wide,

Provide clock feature to top of roof, as shown.

Make good to all disturbed and affected areas.

Provide 150mm Celotex insulation between floor joists.

Ceiling to garage to give ½ hour fire protection.

Private Stairs
Stairwell formed by timber trimmers and load bearing walls (see plan). Provide timber balustrading to open side of stairs 900mm above pitch line and 1000mm high to stairwell opening to act as guarding and to be capable of resisting a horizontal force of 0.36 KN/m. Balustrading to be vertical type, not horizontal or ranch style. No parts of stairs to have any gaps greater than 99mm. Provide timber handrail to top of balustrading or independently 900mm above pitch line. Ensure minimum headroom above pitch line is 2000mm. Total rise: See plan. Maximum rise: 220mm. Minimum going: 220mm. Maximum pitch: 42° . Read in conjunction with Approved Document K.

Roof Ventilation
At eaves provide proprietary ventilation equivalent to a 10mm continuous gap along eaves.

Roof Ventilation to Sloping Ceiling
At eaves provide proprietary ventilation equivalent to a 25mm continuous gap along eaves. At ridge provide proprietary ventilation equivalent to a 5mm continuous gap.

Safety Glazing
Provide safety glass to BS6206 to all windows to a minimum height of 800mm above floor level plus doors to a minimum height of 1500mm above floor level. Side screens to be same as doors if within 300mm of doors.

Smoke Detection
Provide mains operated self-contained smoke alarms to BS5839 Part 6, 2006 in accordance with Approved Document B1.

Rainwater Goods
PVC rainwater goods 110mm half round gutters and 68mm diameter downpipes.

Roof Insulation
To roof spaces provide proprietary 300mm thick fibreglass insulation laid as 100mm between joists and 200mm across joists or equivalent to give 0.16 U/value. Ensure a gap of 50mm between roof underfelt and quilt at all times.

Roof Insulation to Sloping Ceiling
To ceiling slope provide 50mm Celotex between rafters and 75mm Celotex below rafters. Ensure a gap of 50mm between roof underfelt and insulation at all times.

Surface Water Drainage
To be proprietary 110mm diameter p.v.c. pipes flexible joined to fall 1:70 bedded in 100mm pea gravel. Pipes to discharge into 1200mm diameter soakaways sited 5000mm away from buildings.

Roof Construction
Concrete interlocking roof tiles (see site plan for details) on 38 x 25mm softwood treated timber battens on underfelt to BS747 (Type 1F) lapped 150mm horizontally and 100mm vertically. Prefabricated roof trusses at 600mm c/c and pitch as stated in accordance with BS5268, 1985. Provide 25 x 100mm timber bracing and fix in accordance with truss manufacturers instructions. All trusses and gable ladders (if any) to be strapped to 50 x 100mm timber wallplate, the gable wall at verges and ceiling level with 30 x 5mm mild steel anchor and lateral restraint straps to span minimum 3 no. trusses at a maximum of 1200mm c/c. At strap positions provide pack and noggins to trusses. Main contractor to supply local authority building control with roof truss calculations 28 days prior to erection on site. Provide concrete padstones at compound truss supports where required by roof design. Water storage tanks to be installed in accordance with Technical Bulletin No. 4LT.P.A. with timber support members to span 4 no. trusses.

Fascia and Bargeboards
To be 25 x 75mm PSE with 6 mm groove to accept 6mm thick exterior grade plywood soffit.

Ceilings
To all insulated roof ceilings provide 12.5mm Gyproc Duplex plasterboard of 10kg/m³ or similar and either 5mm skim or Artex finish. To remaining ceilings provide 12.5mm Gyproc plasterboard or similar with finishes as above.

Lintels
All coded lintels as stated in Schedule or marked on plan to be by I.G. To be installed in strict accordance with manufacturers instructions. Form d.p.c. cavity tray above all lintels. To all exposed lintels i.e. not sheltered from overhanging eaves, etc. to have proprietary weepholes to joints of brickwork at approximately 450mm c/c. To be confirmed on site with Building Control Surveyor

Opening at eaves level to be L1/E lintels by I.G. or similar approved.

Sub-structure Walling
100 mm Class A dense concrete blocks. Bitumen felt d.p.c. to external walls 150mm above ground level. Weak mix infill to base of cavities to terminate 225mm below lowest d.p.c. level.

I.G. Type L1/S85 lintels to cavity walls and I.G. type internal lintels to 100mm internal walls unless stated otherwise. To be confirmed on site with Building Control Surveyor.

All windows to give minimum 1/20th of floor area as ventilation and to be double-glazed.

Glazing
All windows and doors to be double-glazed with minimum 16mm spacing and to use Pilkington 'K' glass or similar approved, efficiency of 0.05.

Integral Garage
Internal door between dwelling and garage (where applicable) to have 100mm step down into garage and door to be ½ hour fire-resisting self-closing type. Ceiling between garage and domestic room above (where applicable) to be ½ hour fire-resisting.

Brickwork below d.p.c. to be F.L. quality

All soakaways to be minimum 1m deep.

First floor habitable rooms shall have means of escape windows with openings of at least 450mm wide x 450mm high and a minimum area of 0.33m². Escape windows to be within 1.1m of floor.

General Notes

Do not scale from this drawing.

Thus drawing is copyright and may not be altered, traced, copied, photographed or used for any purpose other that that for which it is issued without written permission from Messrs Status Design.

The General Contractor is to check all dimensions on site and report discrepancies to the Architect.

All details shown on this drawing are based upon typical site conditions related to the area. No responsibility can be accepted for abnormal conditions unless reported to the Architects so that design amendments may be considered. Site soil surveys are recommended in respect of foundations to establish specific site conditions before foundation work is undertaken.

Please note this drawing is not a conveyance drawing.

Proposed on-site soakaways to be maintained by the owner for the life duration of the property

This drawing is limited in the amount of information contained and does not purport to contain a full specification of the works It is solely for the purpose of obtaining Planning and Building Regulations approvals. This drawing must not be used as a contract document alone. The works will not be supervised or inspected by Status Design unless specifically contracted to do so It is the client or their agent's responsibility to control workmanship, substitution of, materials, adherence to specification, variations to contract, etc.

All materials to be new unless stated otherwise and all components and materials, etc. to be used, fitted and installed, etc. in strict accordance with manufacturers' instructions and relevant Code of Practise. Materials should conform to appropriate British Standard specification or BBA Certificate or European Code equivalent.

The Employer/Client shall ensure that the selected contractor is conversant with and adopts all measures necessary to achieve compliance with Health and Safety Legislation for Building Sites and Work Places. The Employer/Client is advised that should the works need to comply with the Construction Design and Management Regulations 1994 (CDM) and Health and Safety at Work, etc., Act 1974 (HSW Act) an Independent Planning Supervisor will be required, whom should be supplied with a set of all relevant drawings, etc.

The works shall comprise of all that shown on the drawings and information, etc. Works that may not specifically be shown but may be reasonably inferred as necessary to carry out the works shall be deemed to be included.

These notes relate to this drawing and all associated drawings.

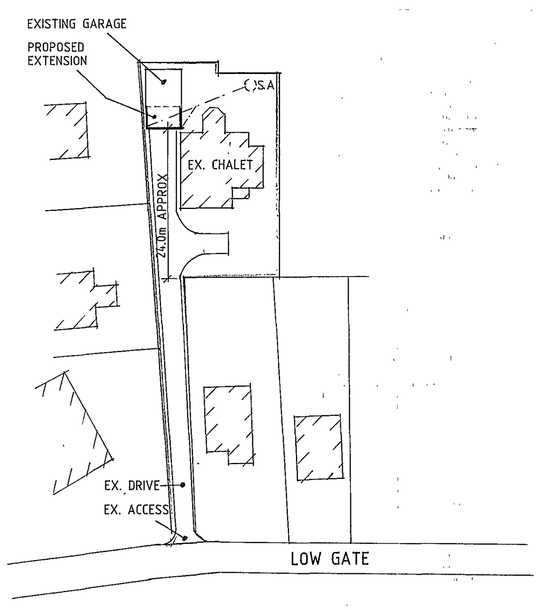

SITE PLAN

THIS DRG. TO BE READ IN CONJUNCTION WITH
DH07-002/1, DH02/004/1, DH02-004/2, DH02-0004/3

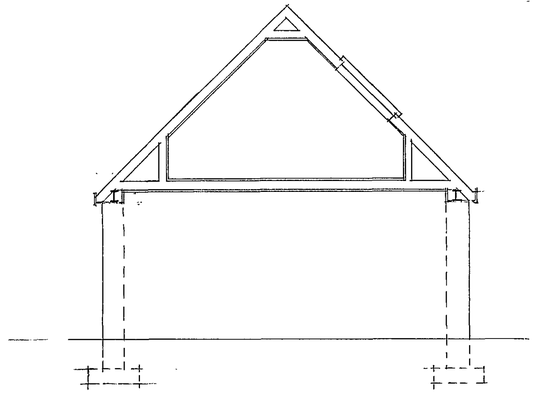

SECTION

Planning Control
- 2 NOV 2007
Ref: 1458/07

DETERMINED PLAN

Status
DESIGN
CONSULTANTS IN ARCHITECTURE & PLANNING

PROPOSED EXTENSION TO GARAGE AT COSY CORNER, LOW GATE, TYDD ST MARY, FOR

MR. V. DAY.

SITE PLAN / SECTION

1:500 1:50	DH07-002/2
OCT-07	B.GILHAM.

2 Edinburgh Walk, Holbeach,
Spalding, Lincs. PE12 7AP
Tel: 01406 424343 Fax: 01406 490702